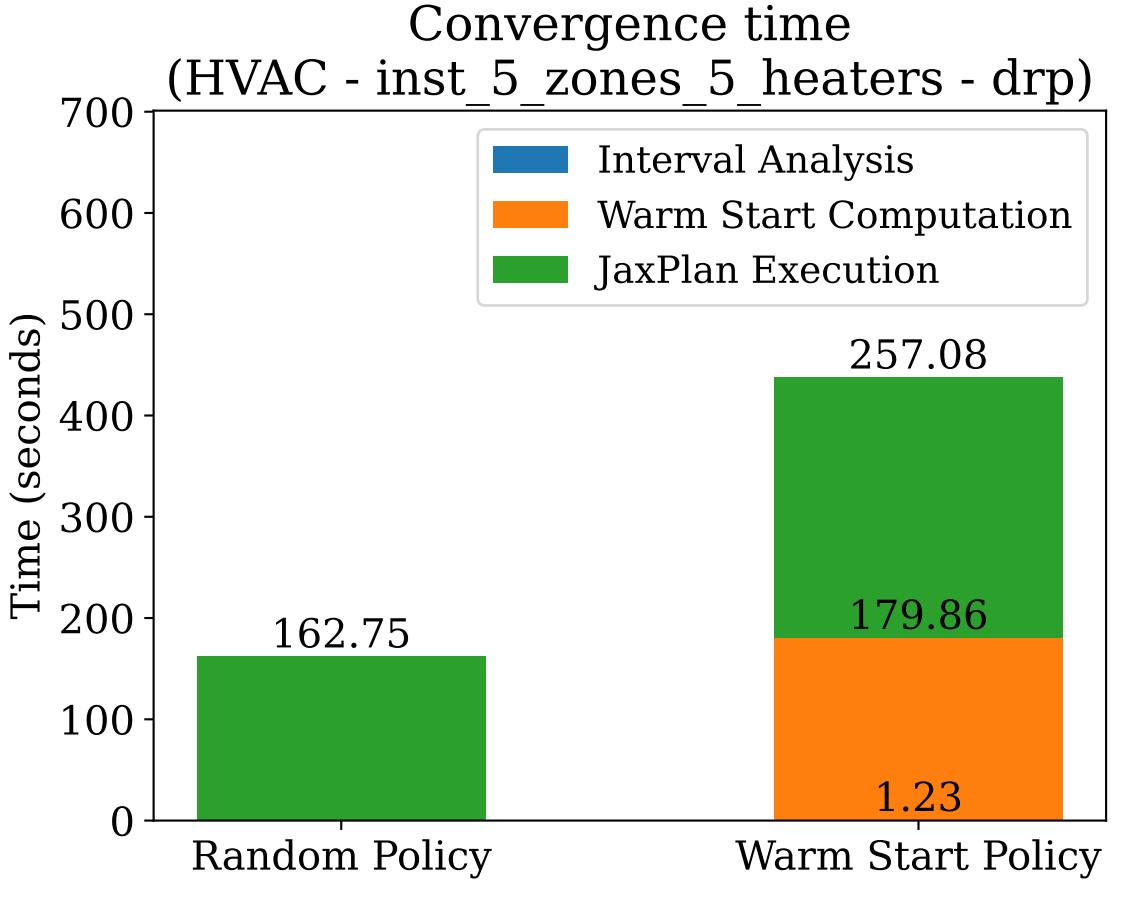
Convergence time
(HVAC - inst_5_zones_5_heaters - drp)
Time (seconds)
700
600
500
400
300
200
100
0
Interval Analysis
Warm Start Computation
JaxPlan Execution
257.08
179.86
1.23
162.75
Random Policy
Warm Start Policy