

The diagram illustrates a three-stage process, likely a Proton Exchange Membrane (PEM) electrolysis system, consisting of three identical stages labeled PDC-01, PDC-02, and PDC-03. Each stage is represented by a rectangular box containing a three-phase electrical symbol (a circle with three lines radiating from a central point) and four vertical lines, possibly representing membranes or catalyst layers.

Feed Gas Inlet (Red Lines):

- Each stage (PDC-01, PDC-02, PDC-03) has a red line entering from the top, labeled $\varnothing i 40$.
- This line passes through a valve and a temperature sensor (T) before entering the stage.
- The red lines from all three stages merge into a single vertical line on the right side of the diagram.
- This vertical line has a diameter label $\varnothing i 50$ and a downward arrow indicating flow direction.

Steam Inlet (Blue Lines):


- Each stage (PDC-01, PDC-02, PDC-03) has a blue line entering from the bottom, labeled $\varnothing i 40$.
- This line passes through a valve and a temperature sensor (T) before entering the stage.
- The blue lines from all three stages merge into a single vertical line on the right side of the diagram.
- This vertical line has a diameter label $\varnothing i 50$ and an upward arrow indicating flow direction.

Product Gas Outlet (Red Lines):

- Each stage (PDC-01, PDC-02, PDC-03) has a red line exiting from the bottom, labeled $\varnothing i 40$.
- This line passes through a valve and a temperature sensor (T) before exiting the stage.
- The red lines from all three stages merge into a single vertical line on the right side of the diagram.
- This vertical line has a diameter label $\varnothing i 50$ and a downward arrow indicating flow direction.

Overall Flow and Components:

- The diagram shows a complex network of pipes, valves, and temperature sensors (T) monitoring the process.
- The red lines represent the feed gas stream, and the blue lines represent the steam stream.
- The product gas outlet is shown as a red line exiting from the bottom of each stage.
- The diameter labels $\varnothing i 40$ and $\varnothing i 50$ indicate the internal diameters of the pipes.

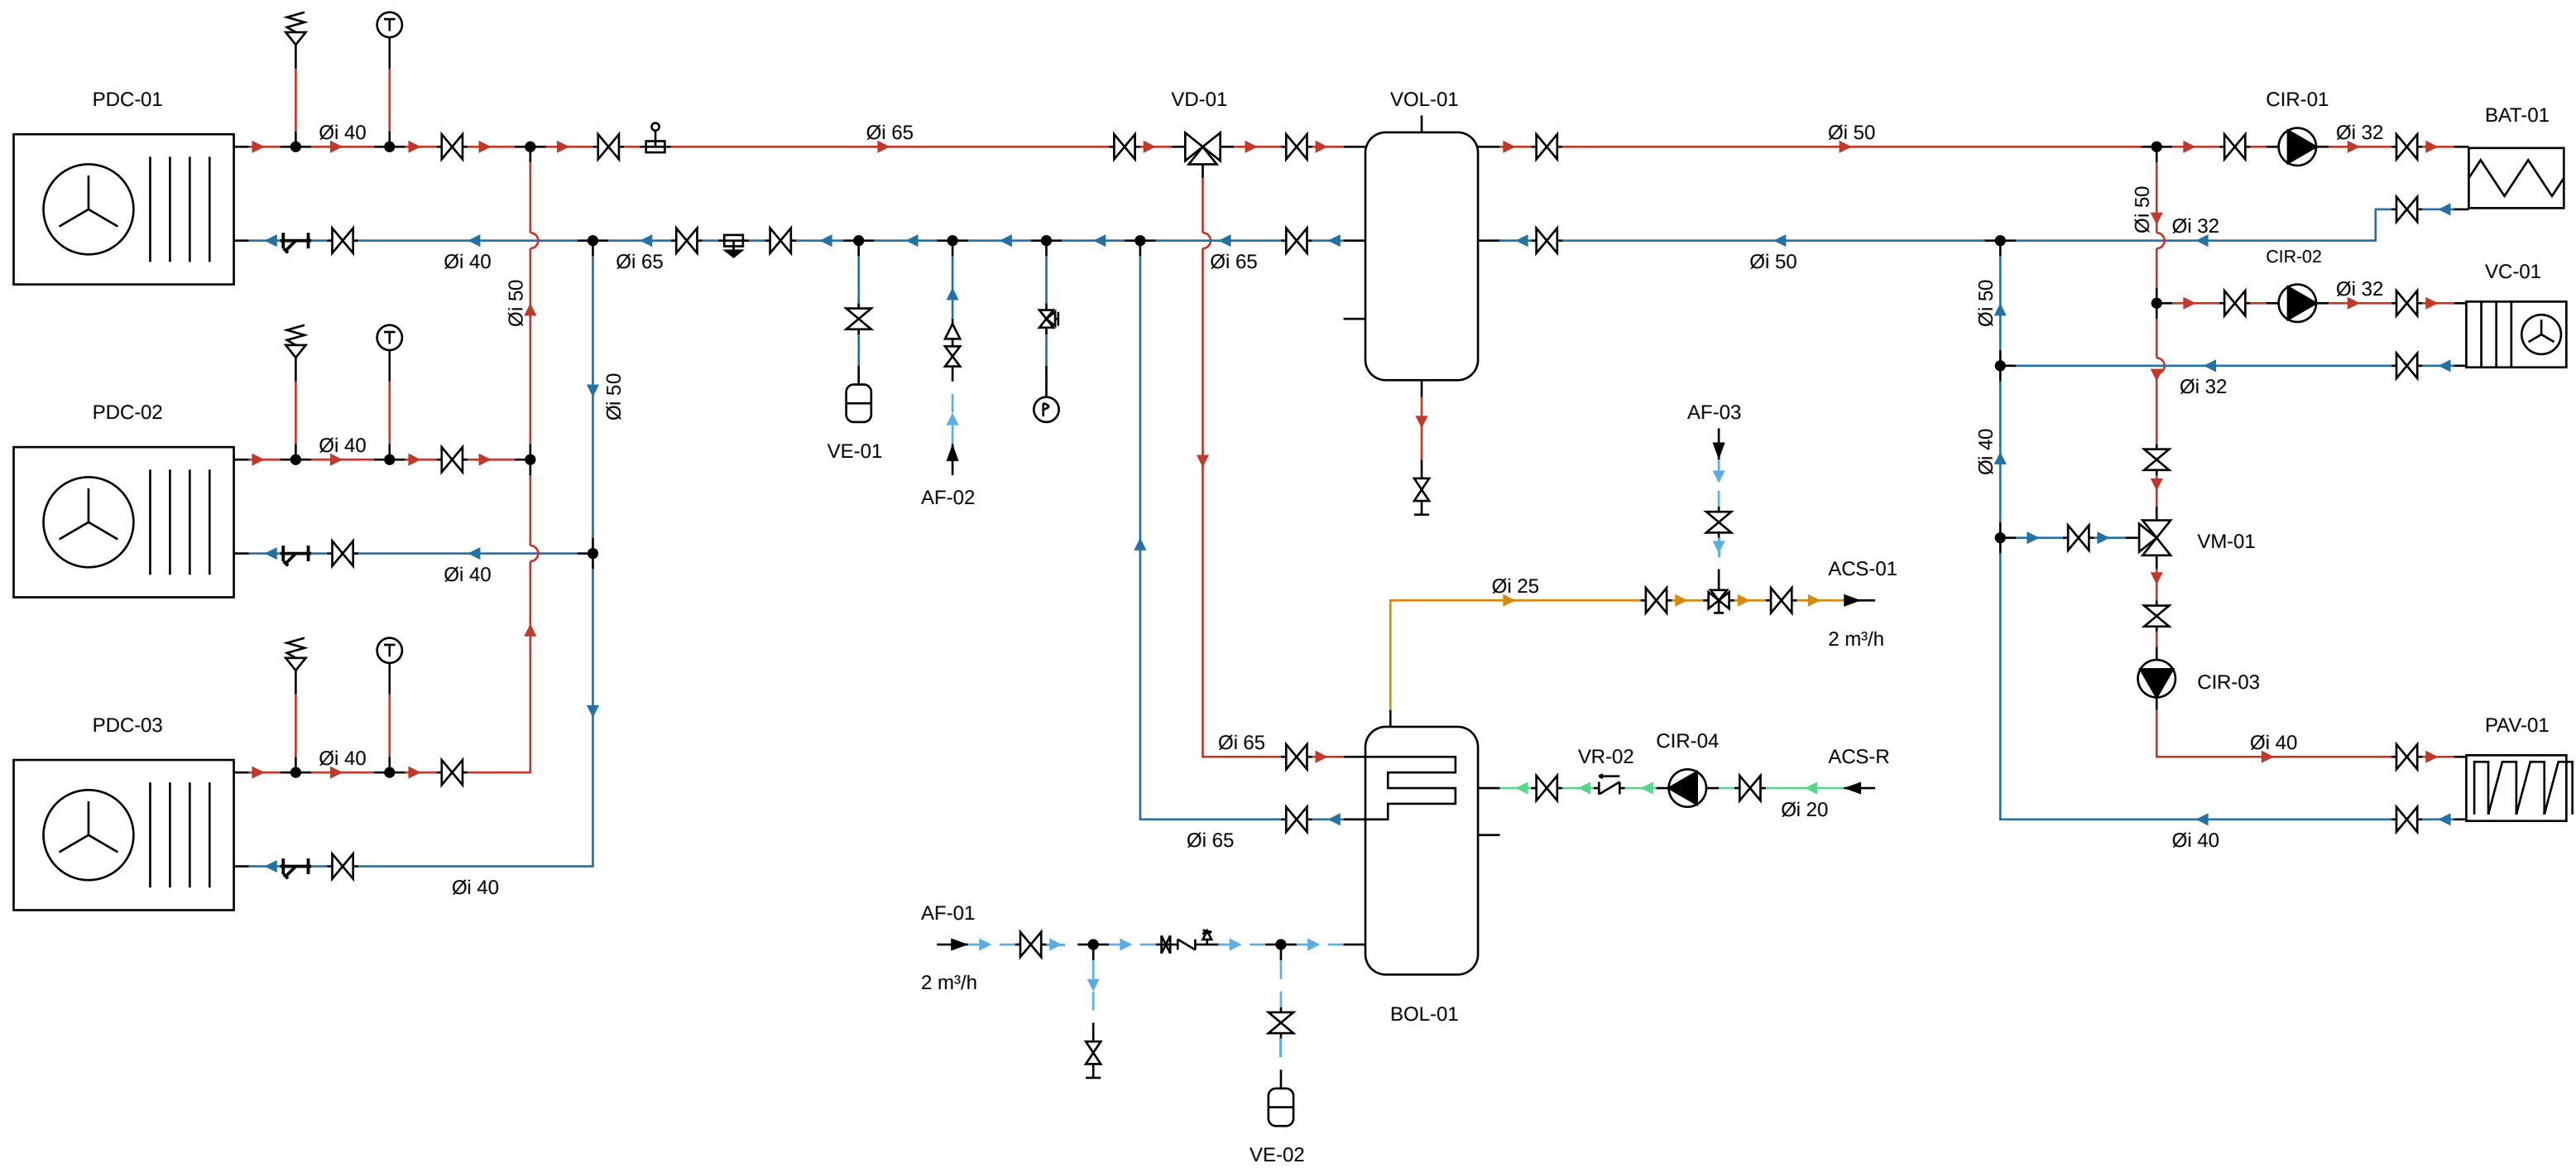

- Acqua fredda
 sanitaria — andata
— Acqua calda
 sanitaria — andata
— Acqua calda
 sanitaria — ricircolo
— Acqua di
 riscaldamento — andata
— Acqua di
 riscaldamento — ritorno
 Øi diametro interno
 netto minimo in mm,
 materiale a scelta