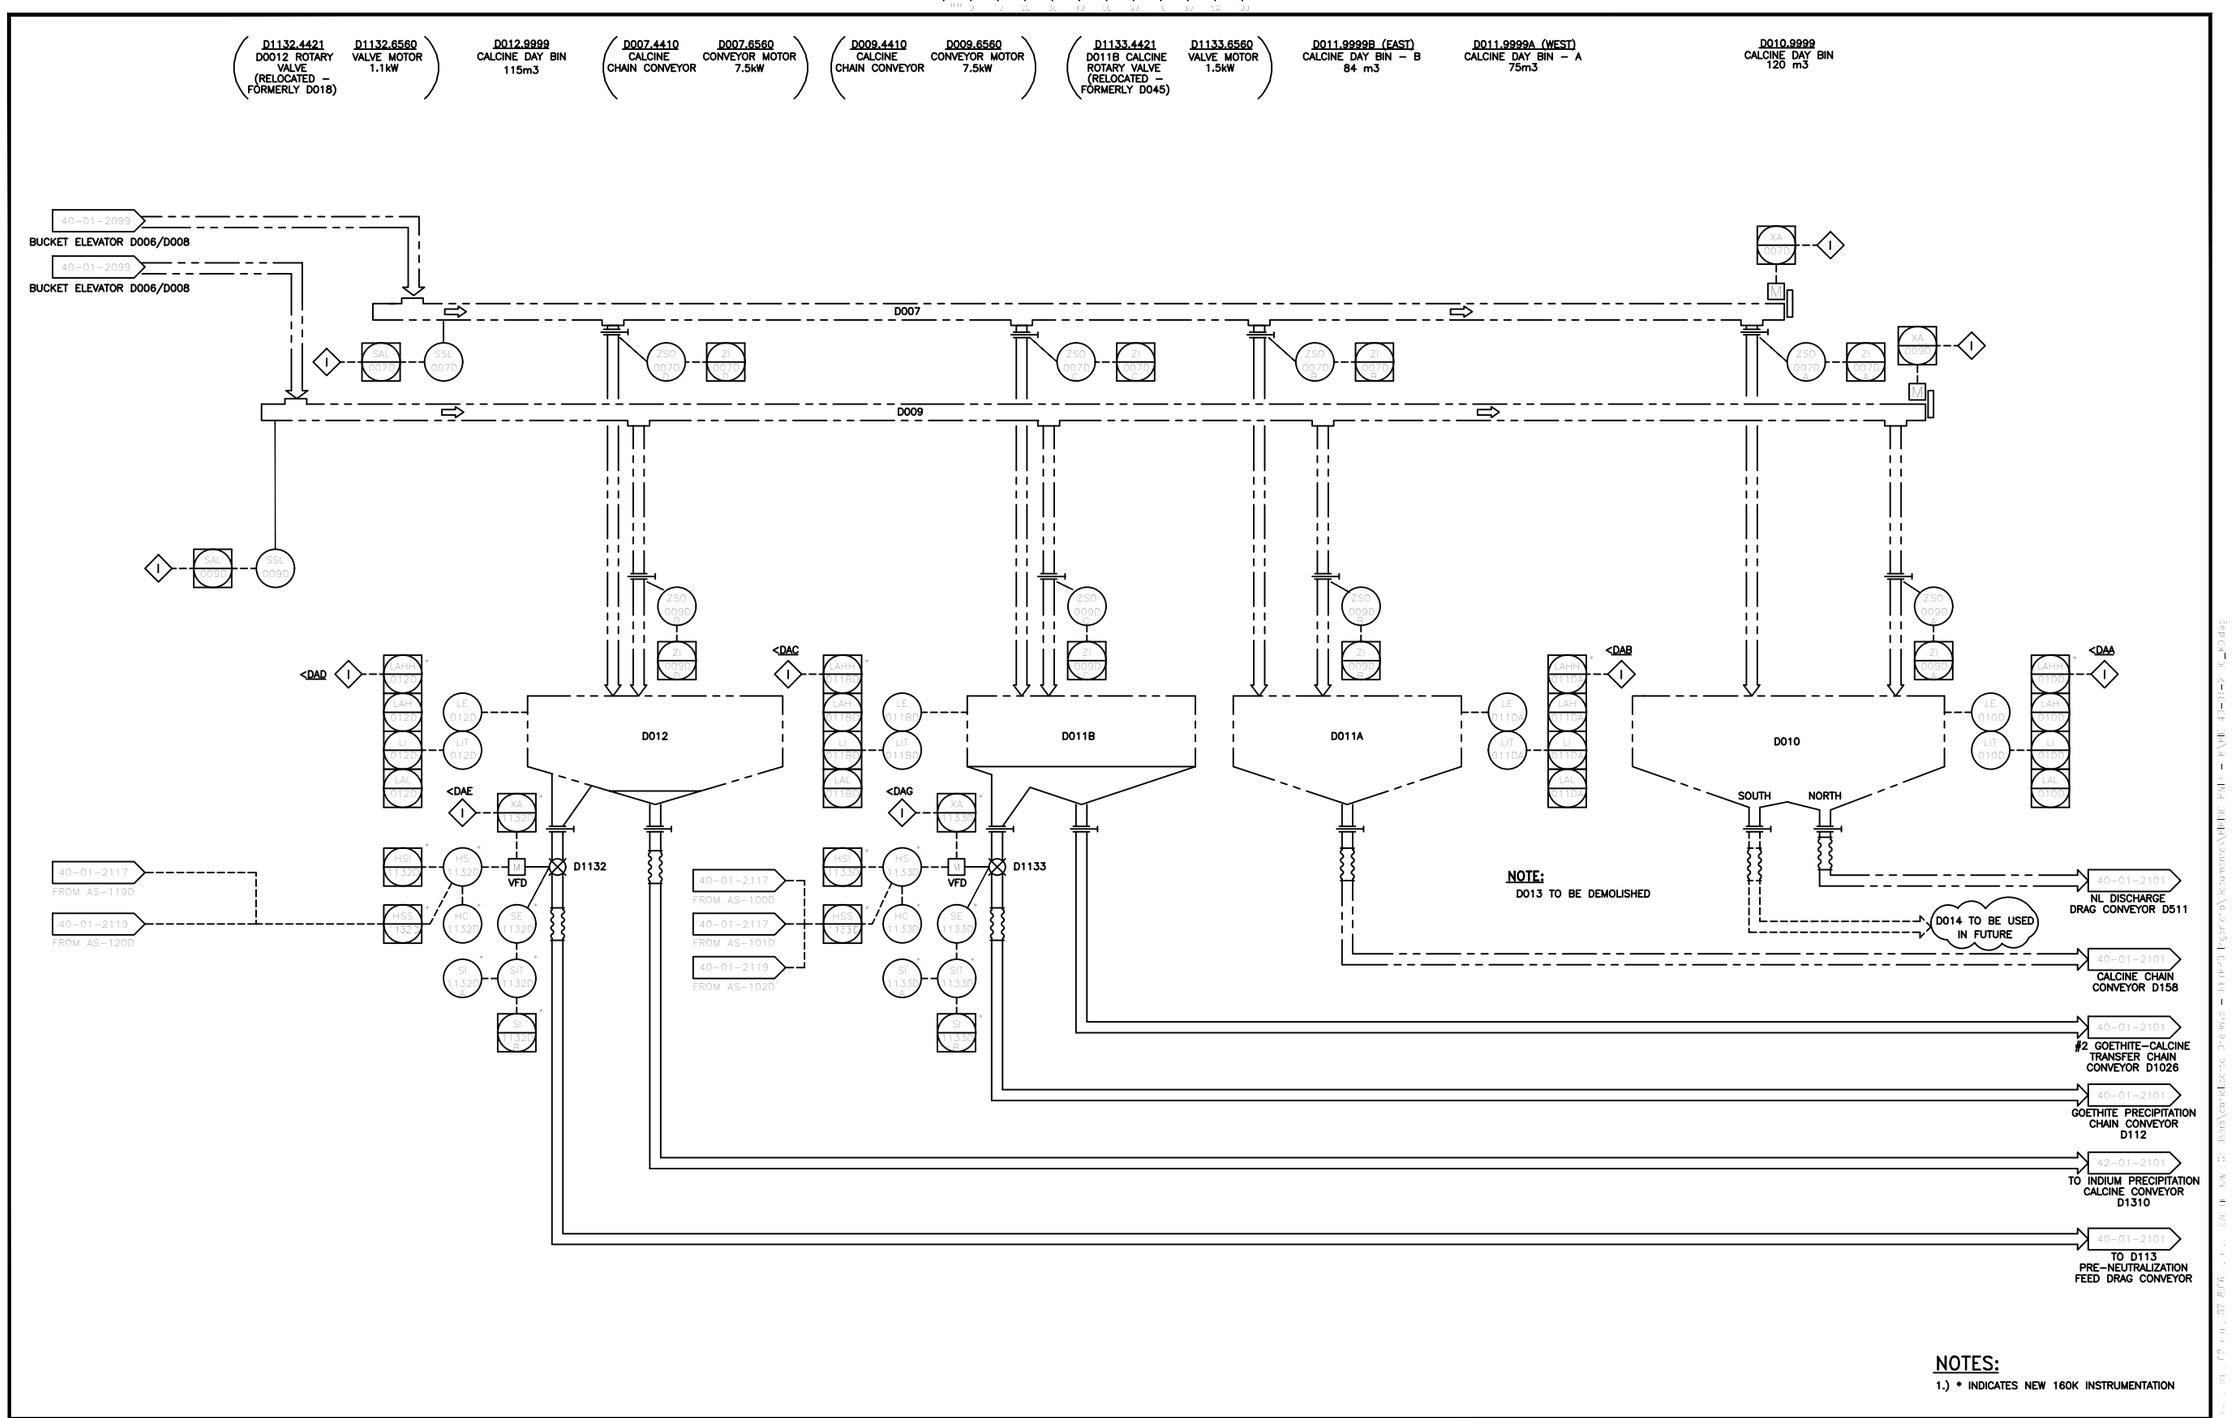

NOTES:

1.) * INDICATES NEW 160K INSTRUMENTATION

REV	DESCRIPTION	DRAWN BY	CHECKED BY	DESIGNED BY	CALCULATED BY	APPROVED BY	DATE
0	ISSUED FOR CONSTRUCTION						
3	ISSUED FOR APPROVAL						
2	ISSUED FOR INTERNAL REVIEW						

REV	DESCRIPTION	CHANGE NO.
1	40-01-2010 CALCINE STORAGE & DISTRIBUTION PROCESS FLOW DIAGRAM	

APROBACION – INGENIERIA

amec

Votorantim | Metais

Votorantim Metais - Cajamarquilla S.A.

APROBACION – CLIENTE

40-01-2100

160K PROJECT
AREA 40
LEACHING –
CALCINE DISTRIBUTION P&ID (SHT 1/2)

N° CONTRATO 152505

ESCALA NTS

PLANO N° 40-01-2100

REV 0