

Revisado / Reviewed

Revisado con Comentarios  
Reviewed with comments

Rechazado y volver a emitir  
Rejected, reissue

Solo Información  
Information Only




Fecha / Date  
17-02-2020

Firma / Signature  
Marcial Mendoza

BHP

PARA REVISION  
FOR REVIEW

amtec  
foster  
wheeler

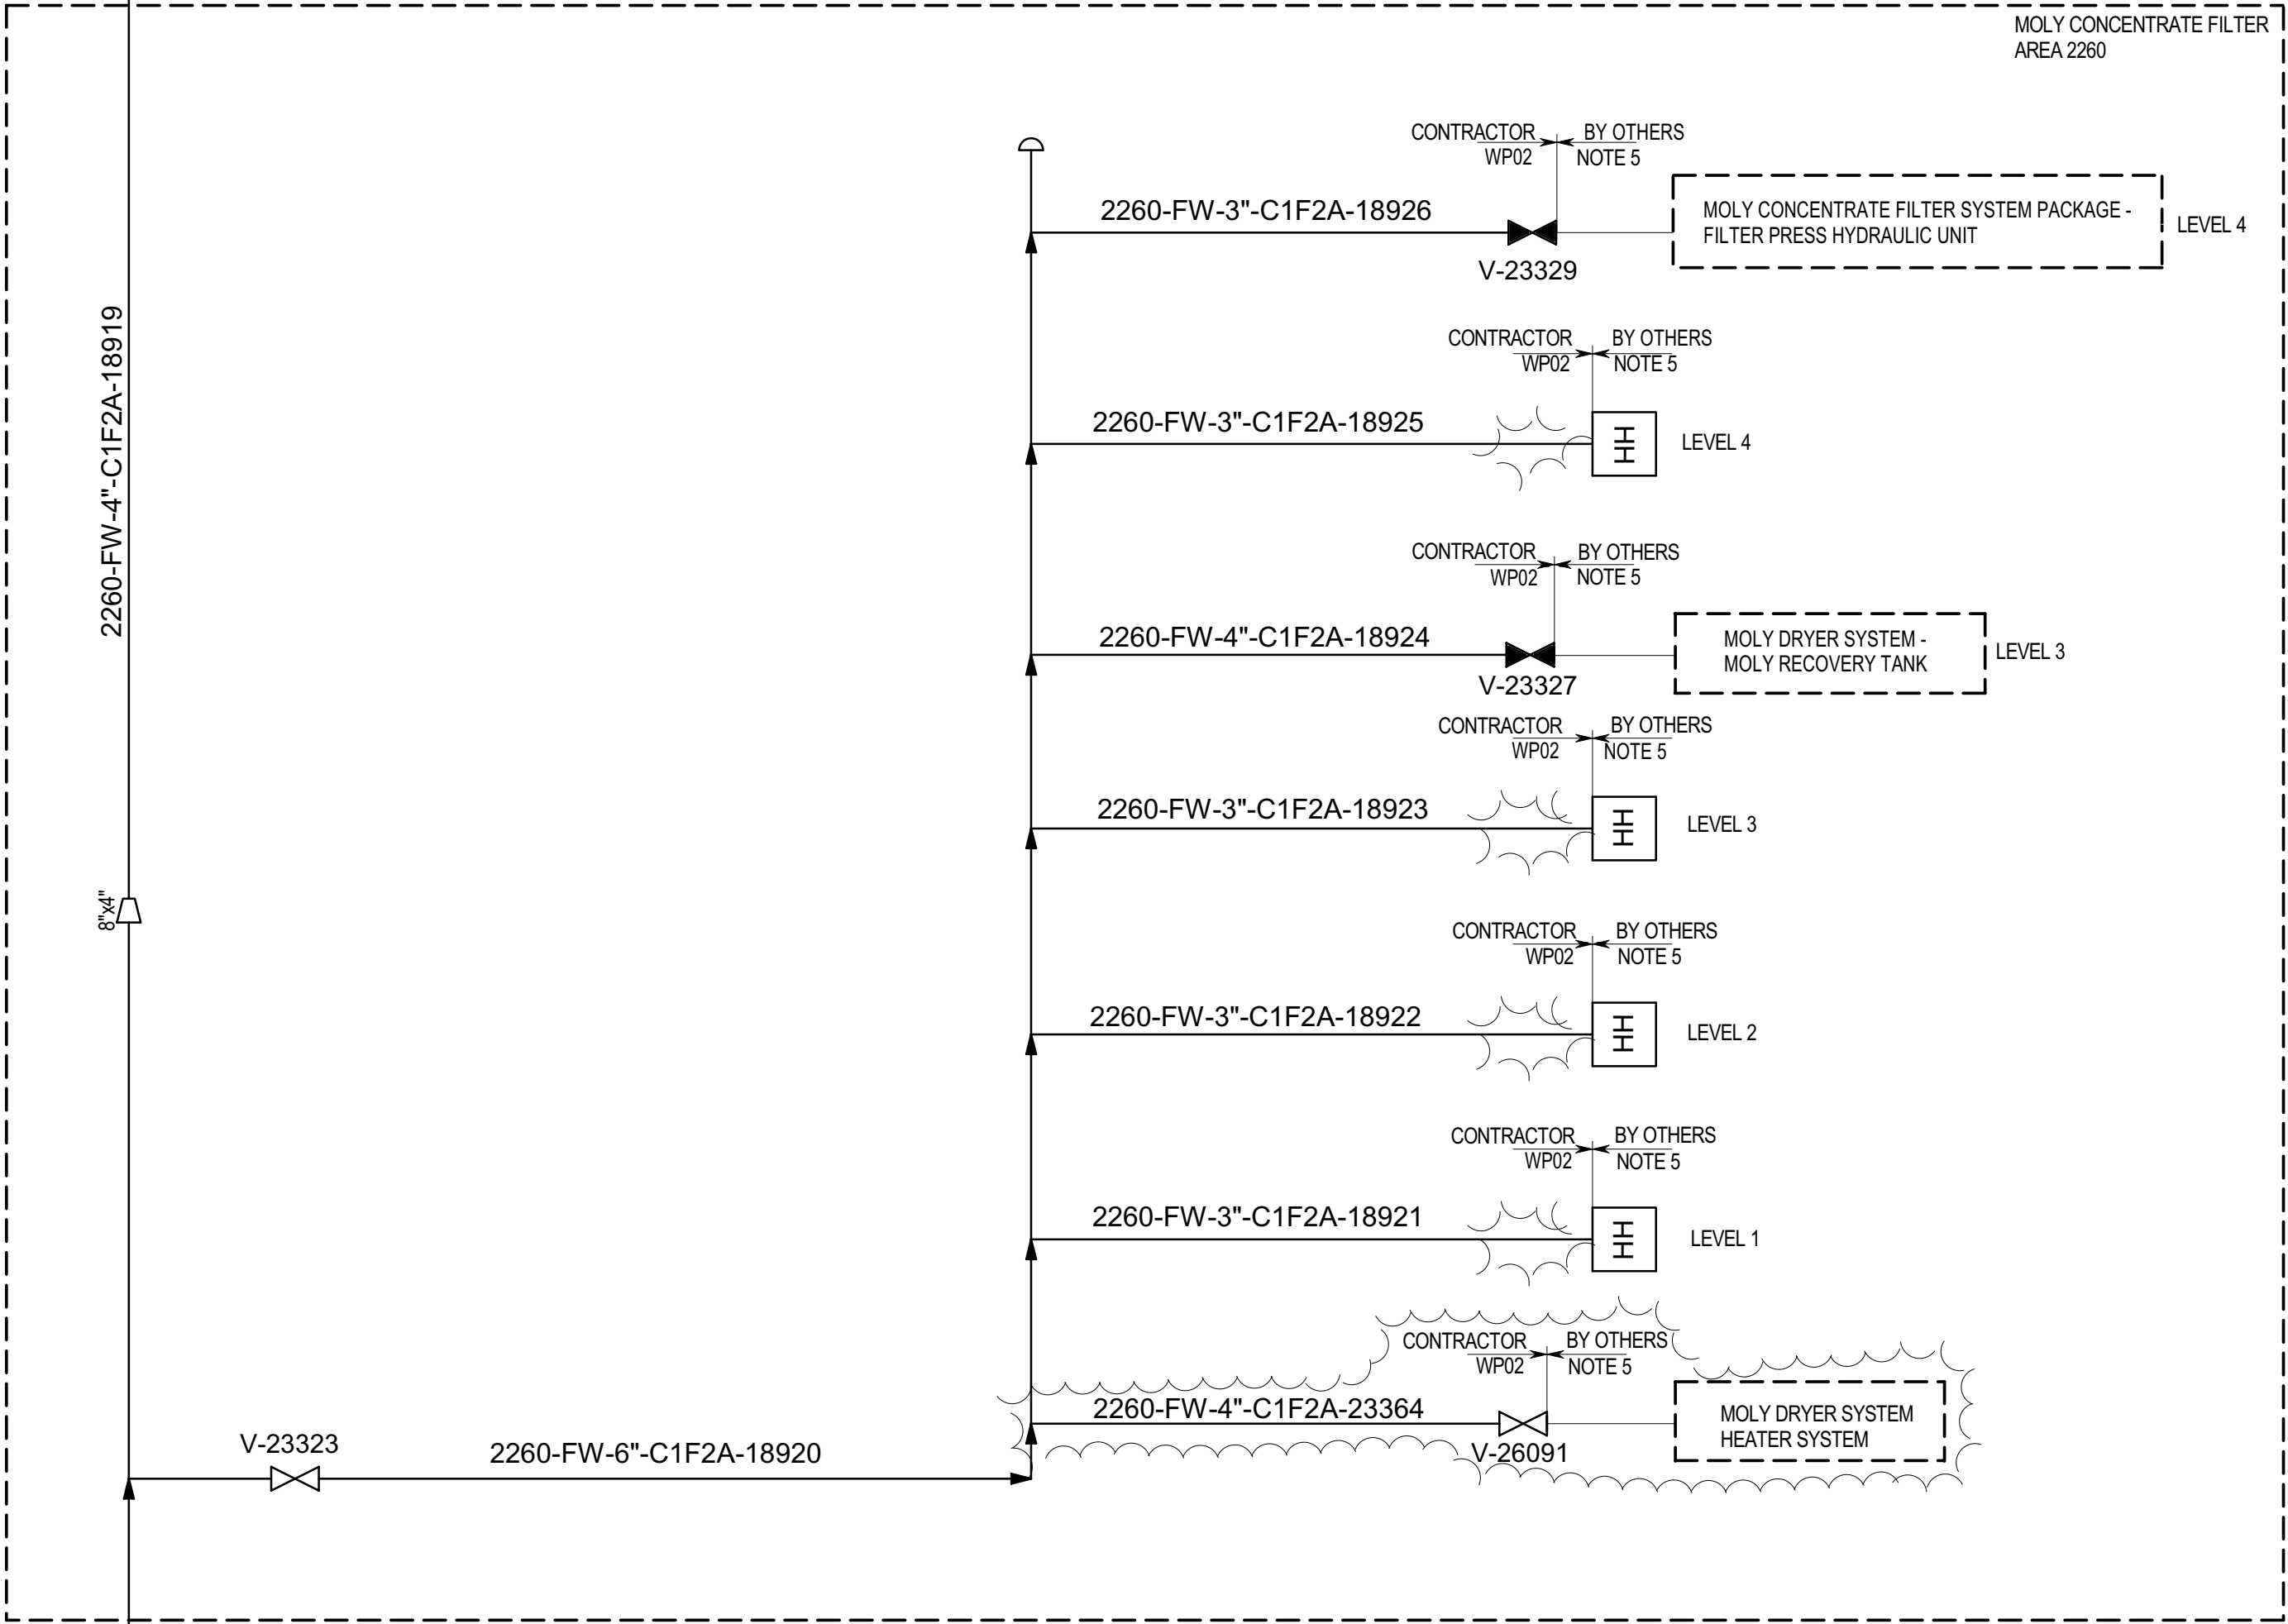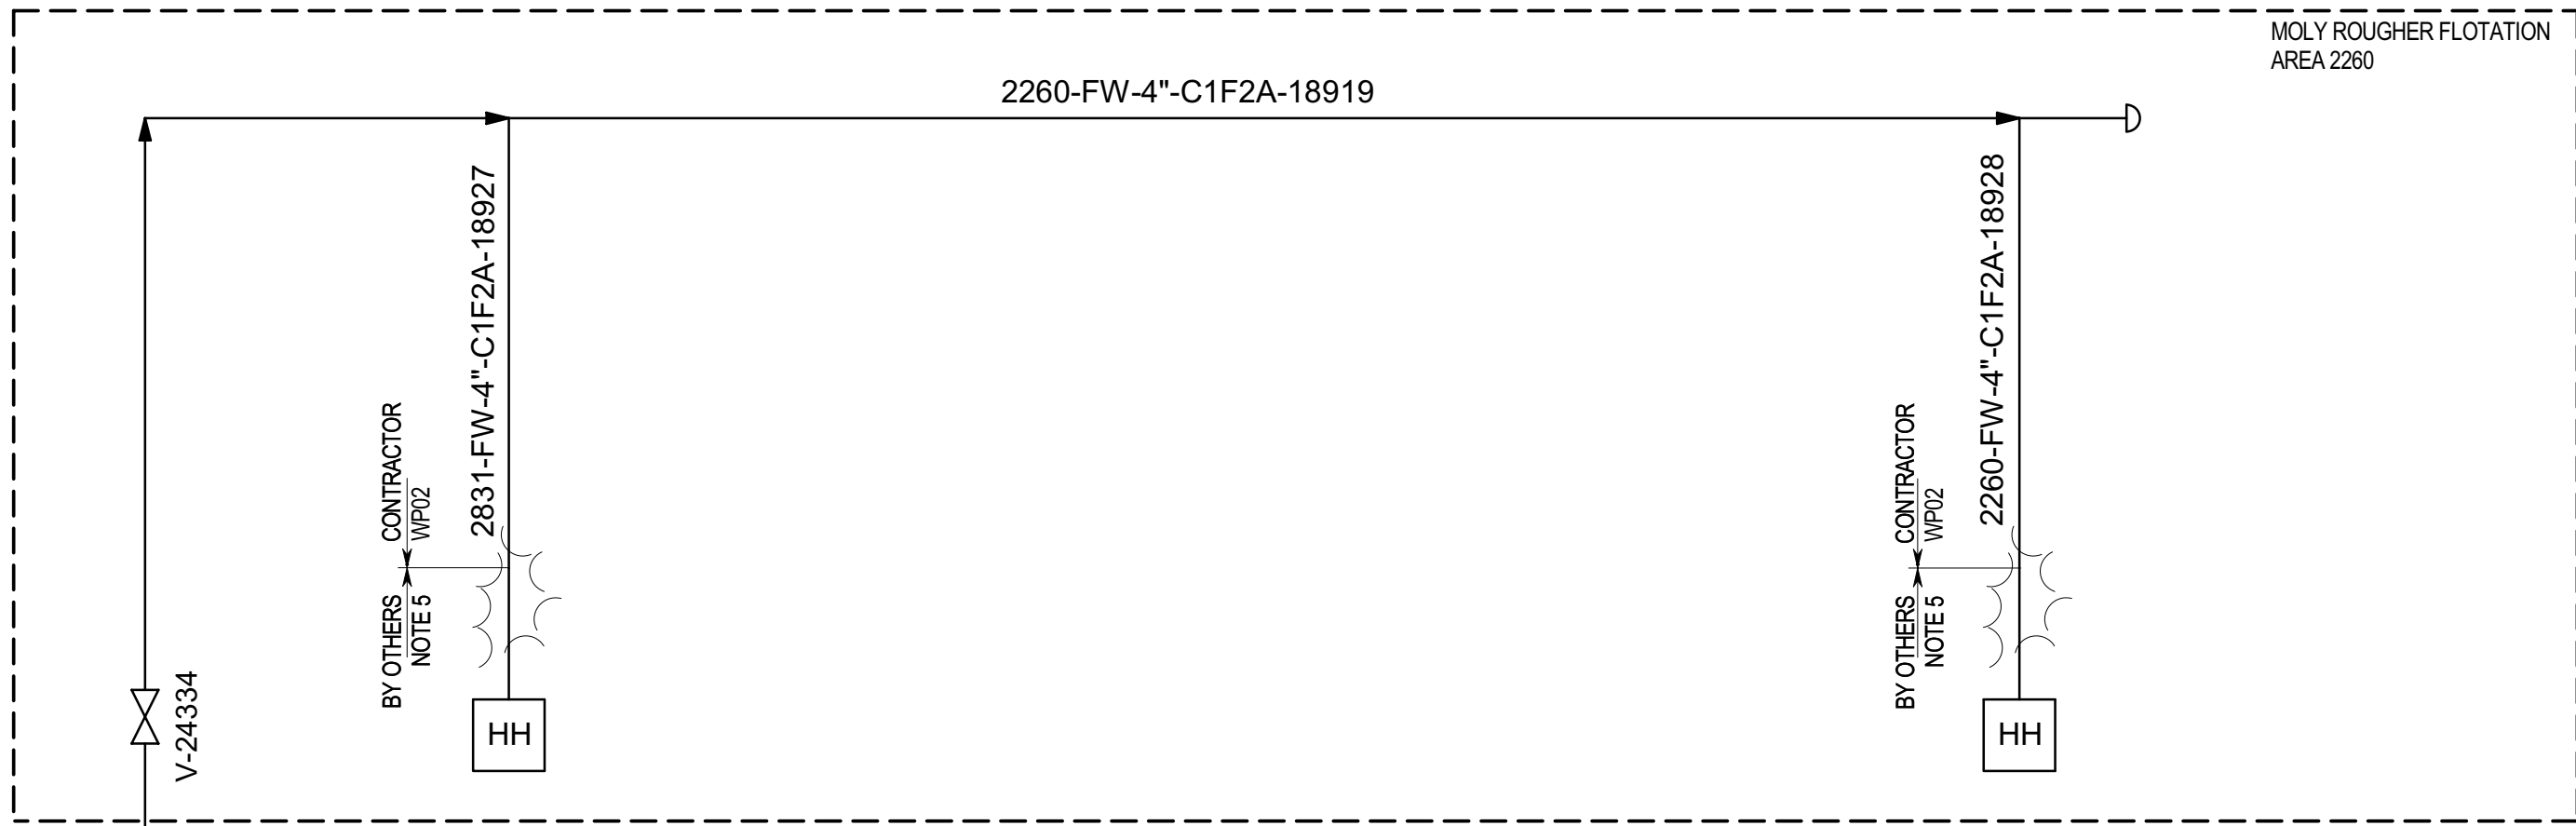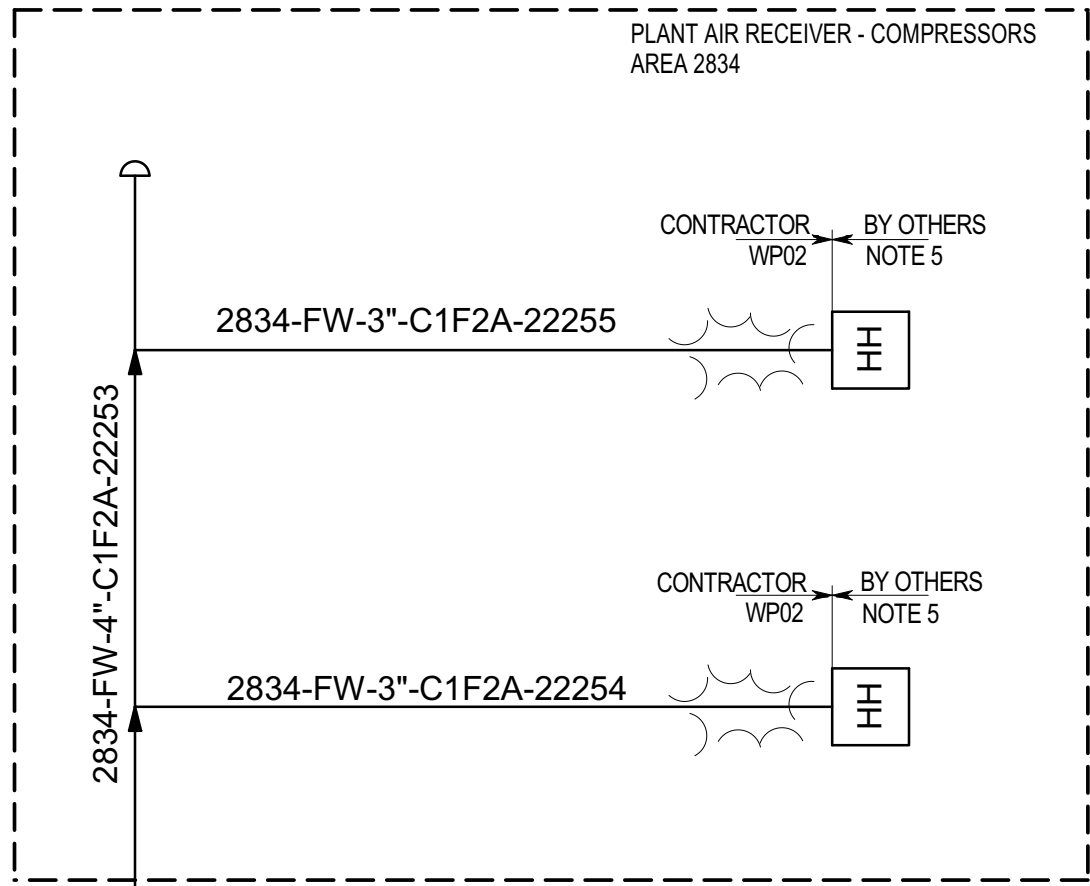

FIRE WATER  
2519 2831-PR-PID-000010  
FROM NETWORK  
DISTRIBUTION

2831-FW-8"-M2F0H2U-22045

FIRE WATER  
2518 2831-PR-PID-000010  
FROM NETWORK  
DISTRIBUTION

2831-FW-8"-M2F0H2U-22044

☐ SPANISH LANGUAGE GOVERNS  
☒ ENGLISH LANGUAGE GOVERNS

Fluor-Salfa

DESIGNED BY: H. ALVAREZ

REVISED BY: C. LEGGETT

ENGINEERING MGR: A. KING

SCALE

DATE

SCALE

DATE

MINERA SPENCE S.A.

SGO PROJECT

UTILITIES & ONSITE INFRASTRUCTURE  
WATER SUPPLY & DISTRIBUTION  
FIREFWATER NETWORK MOLY PLANT AREA P&ID

VENDOR DRAWING N°: 4-V2-2831-PR-PID-000026

CONTRACT N°:

BHP DRAWING N°: 4-V2-2831-PR-PID-000026

REV: 3

3	13-02-20	ISSUED APPROVED FOR CONSTRUCTION	FC	HA	JB				
2	23-05-19	ISSUED APPROVED FOR CONSTRUCTION	FC	GB	JB				
1	11-12-18	ISSUED APPROVED FOR CONSTRUCTION	GE	GB	JB				
0	28-11-18	ISSUED APPROVED FOR DESIGN	GE	GB	JB				
0A	07-08-18	ISSUED FOR COMPANY APPROVAL	GE	HA	JB				
A	13-07-18	ISSUED FOR INTERNAL REVIEW	GE	HA	JB				
Rev. No.	DATE	REVISION	DIS.	REV.	D.L	BHP	REFERENCE DOCUMENTS	N° BHP	NOTES

- FOR P&ID LEGENDS AND SYMBOLS SEE DRAWINGS N°4-V2-2000-PR-PID-000001@000009.
- \* INDICATES THAT IS PROVIDED BY VENDOR OR EQUIPMENT SUPPLIER.
- IN EQUIPMENT POWER DESCRIPTION, (E) ESTIMATED, (C) CALCULATED, (V) VENDOR'S CONFIRMED DATA.
- FOR FLUID CODES DETAILS SEE DRAWING N° 4-V2-2000-PR-PID-000004.
- SUBCONTRACT BY WP-02

MOLY PLANT AREA P&ID (WESTFIRE)

4-V2-2260-PR-PID-266002

FIRE WATER NETWORK P&ID - V2

4-V2-2831-PR-PID-000010

TECHNICAL SPECIFICATION FIRE PROTECTION

4-V2-2000-PP-SPE-000018