

# SOLAR PROPOSAL

## Residencia Montebello

Prepared for Mariana Torres / Montebello

C. 21 184, Montebello, Mérida, Yuc.

Proposal date 2026-09-10 · Valid until 2026-09-25 · Version 2

### Energía diseñada para tu proyecto

This document presents the accepted project design, energy estimate and commercial case captured in this proposal version. Values are estimates under the stated assumptions.

# Proposed solution


---

We propose a 23.04 kWp photovoltaic system using 36 × 640 W modules. The accepted R3 planning model estimates 37,225 kWh of first-year production, equivalent to approximately 170.4% of the recorded annual energy consumption on a simple annual energy-balance basis. The current R4 commercial snapshot shows an investment of MX\$330,600 including VAT, an estimated first-year avoided electricity value of MX\$65,958, and simple payback of 4.3 years. These figures are planning estimates, not guaranteed production, bill savings or returns.

|              |            |                   |                 |
|--------------|------------|-------------------|-----------------|
| INSTALLED DC | MODULES    | ANNUAL PRODUCTION | ENERGY COVERAGE |
| 23.04 kWp    | 36 × 640 W | 37 MWh            | 169.4%          |

# Consumption & proposed system


|                    |            |             |             |
|--------------------|------------|-------------|-------------|
| ANNUAL CONSUMPTION | CFE TARIFF | DC CAPACITY | INVERTER AC |
| 21,977 kWh         | DAC        | 23.04 kWp   | 20.0 kW     |

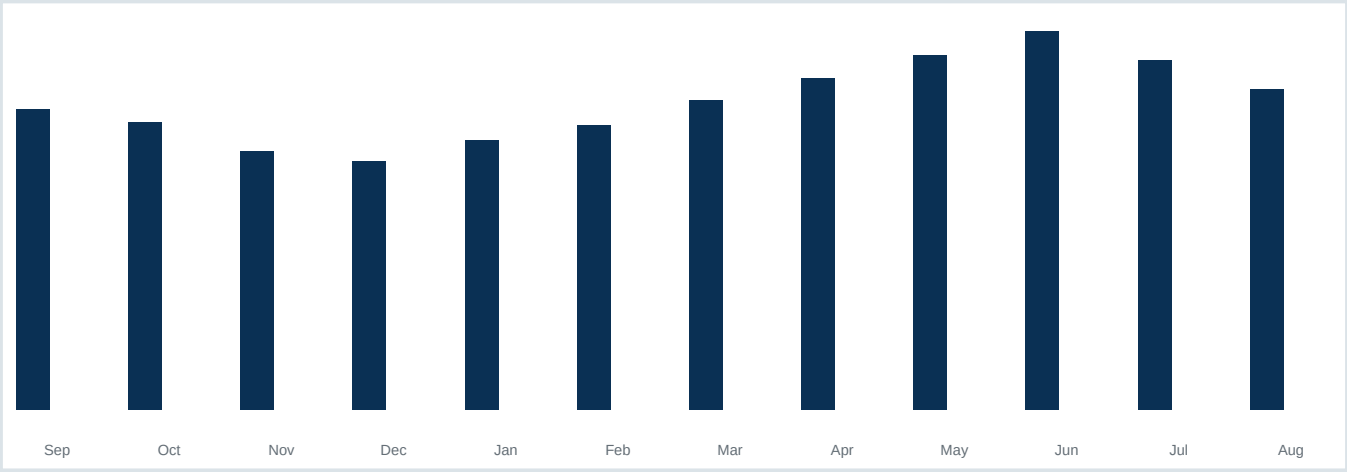


## Selected equipment

- 36 module · 640 W PV module
- 1 unit · 20 kW three-phase string inverter
- 36 module · Mounting structure allowance per module
- 1 project · Monitoring / communications allowance

# Solar design & energy

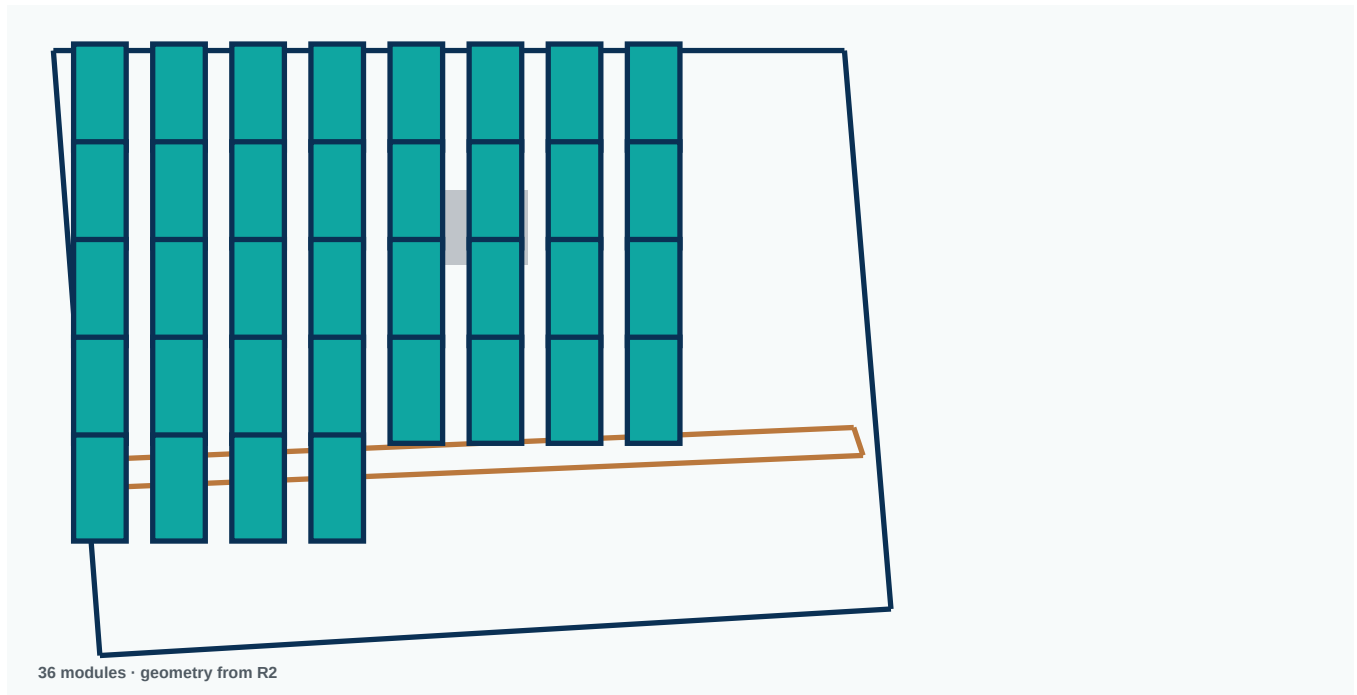


No satellite imagery is implied. This clean visual is rendered directly from accepted R2 roof, obstacle and module geometry.

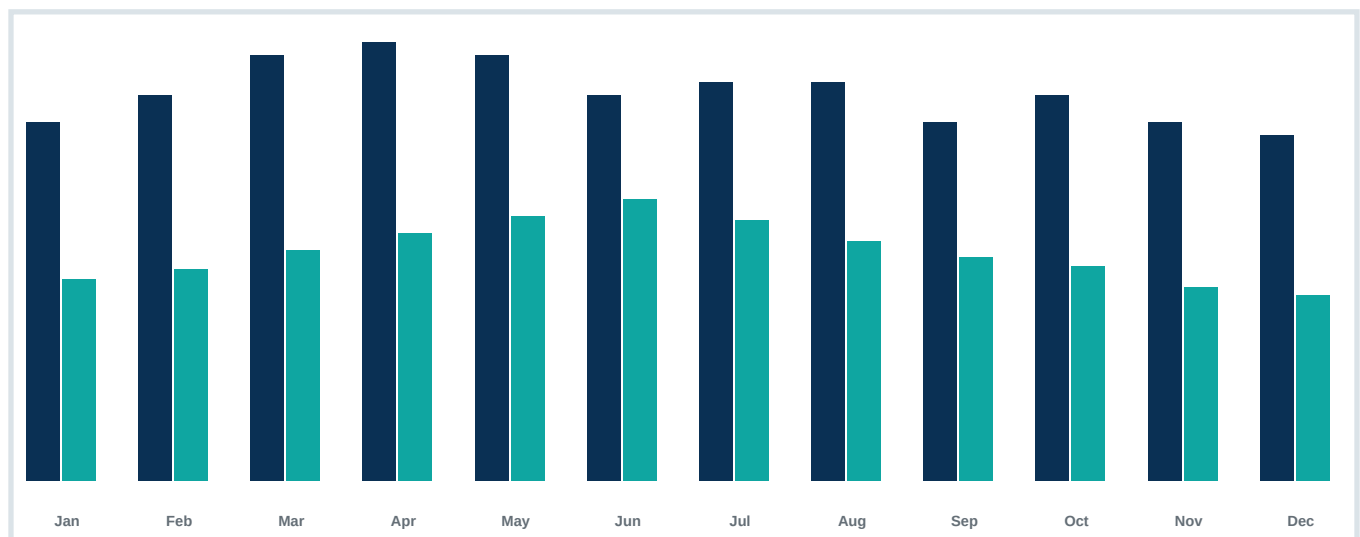

Production is a deterministic R3 planning estimate based on editable monthly resource and loss assumptions; it is not a bankable hourly/PVsyst-equivalent simulation.

# Investment & financial return

|                      |                |                  |              |
|----------------------|----------------|------------------|--------------|
| BEFORE VAT           | VAT 16%        | TOTAL INVESTMENT |              |
| MX\$ 285,000         | MX\$ 45,600    | MX\$ 330,600     |              |
| YEAR-1 AVOIDED VALUE | SIMPLE PAYBACK | IRR              | NPV          |
| MX\$ 65,958          | 4.3 years      | 24.9%            | MX\$ 451,470 |

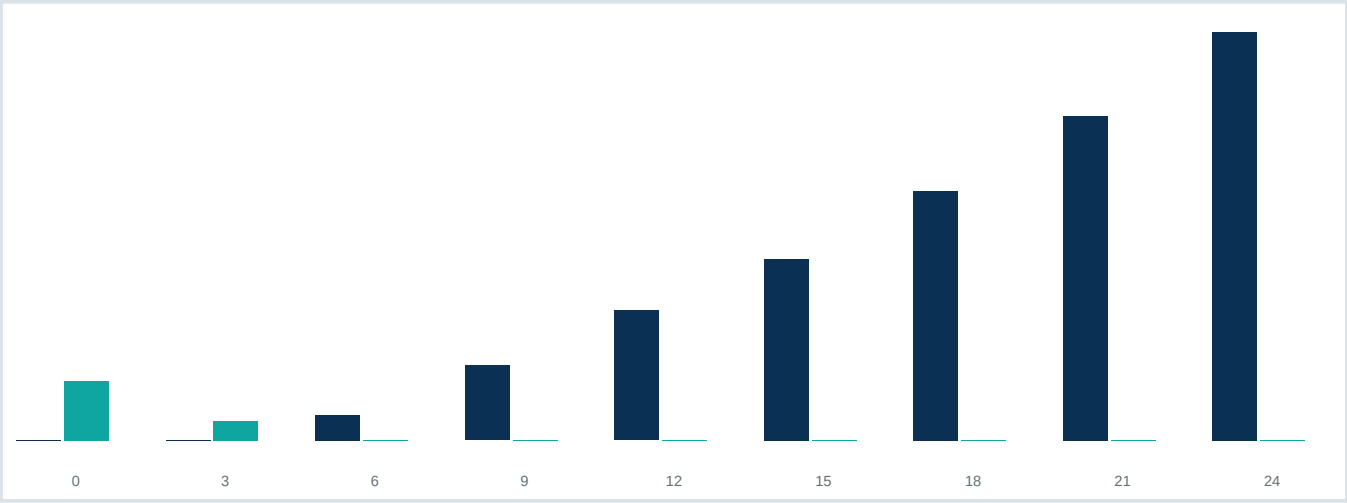

Economic case: Base / Recommended. Analysis horizon 25 years · electricity escalation 4%/yr · PV degradation 0.45%/yr · discount rate 10%.

Financial results use the accepted R4 monthly energy-value approximation and explicit economic assumptions; they are estimates, not guaranteed utility bills or returns.

# Scope, terms & assumptions

---

## Scope / inclusions

Supply and installation of the photovoltaic equipment identified in this proposal, standard mounting, electrical integration represented by the accepted project design, commissioning and basic handover documentation.

## Exclusions

Structural remediation, concealed electrical upgrades, civil works beyond normal installation, utility charges, permits or third-party works not expressly included are excluded unless added in writing.

## Warranties

Warranty terms must be entered and verified by the proposing company before issue. No manufacturer warranty duration or certification is inferred from product names in this proposal.

## Assumptions & methodology

Energy and financial results are estimates derived from the accepted project inputs and assumptions summarized in this document. Production is a deterministic planning estimate rather than an hourly bankable simulation.

## Next steps

Confirm commercial terms, authorize final site/engineering review and coordinate the installation schedule. Acceptance/signature workflow is outside this proposal version.

## Disclaimers

Estimated production, savings, payback, IRR and NPV are not guarantees. Actual performance depends on site conditions, consumption behavior, utility billing, equipment operation and future economic assumptions.

## Commercial terms

Payment terms to be confirmed in the commercial agreement.

Installation schedule and lead time will be confirmed after technical review, material availability and required customer approvals.

Customer to provide safe site access and accurate service/property information required for final engineering and installation.

Utility interconnection, meter changes and final approval remain subject to the applicable utility process; this proposal does not represent CFE approval.