


ALL RIGHTS RESERVED. THIS WORK IS COPYRIGHT AND CANNOT BE REPRODUCED IN ANY FORM OR BY ANY MEANS (GRAPHIC, ELECTRICAL OR MECHANICAL, INCLUDING PHOTOCOPYING) WITHOUT THE WRITTEN PERMISSION OF BLIGH TANNER. ANY LICENCE, EXPRESS OR IMPLIED, TO USE THIS DOCUMENT FOR ANY PURPOSE WHATSOEVER IS RESTRICTED TO THE TERMS OF AGREEMENT OR IMPLIED AGREEMENT BETWEEN BLIGH TANNER AND THE INSTRUCTING PARTY

REV	DATE	DESCRIPTION	ISSUED
P1	18.09.25	PRELIMINARY ISSUE	JW
P2	19.09.25	D&C TENDER ISSUE	JW
P3	20.02.26	FOR COORDINATION	BM
P4	17.03.26	BA ISSUE	BM
P5	08.04.26	BA ISSUE	MHW
P6	09.04.26	BA ISSUE	MHW

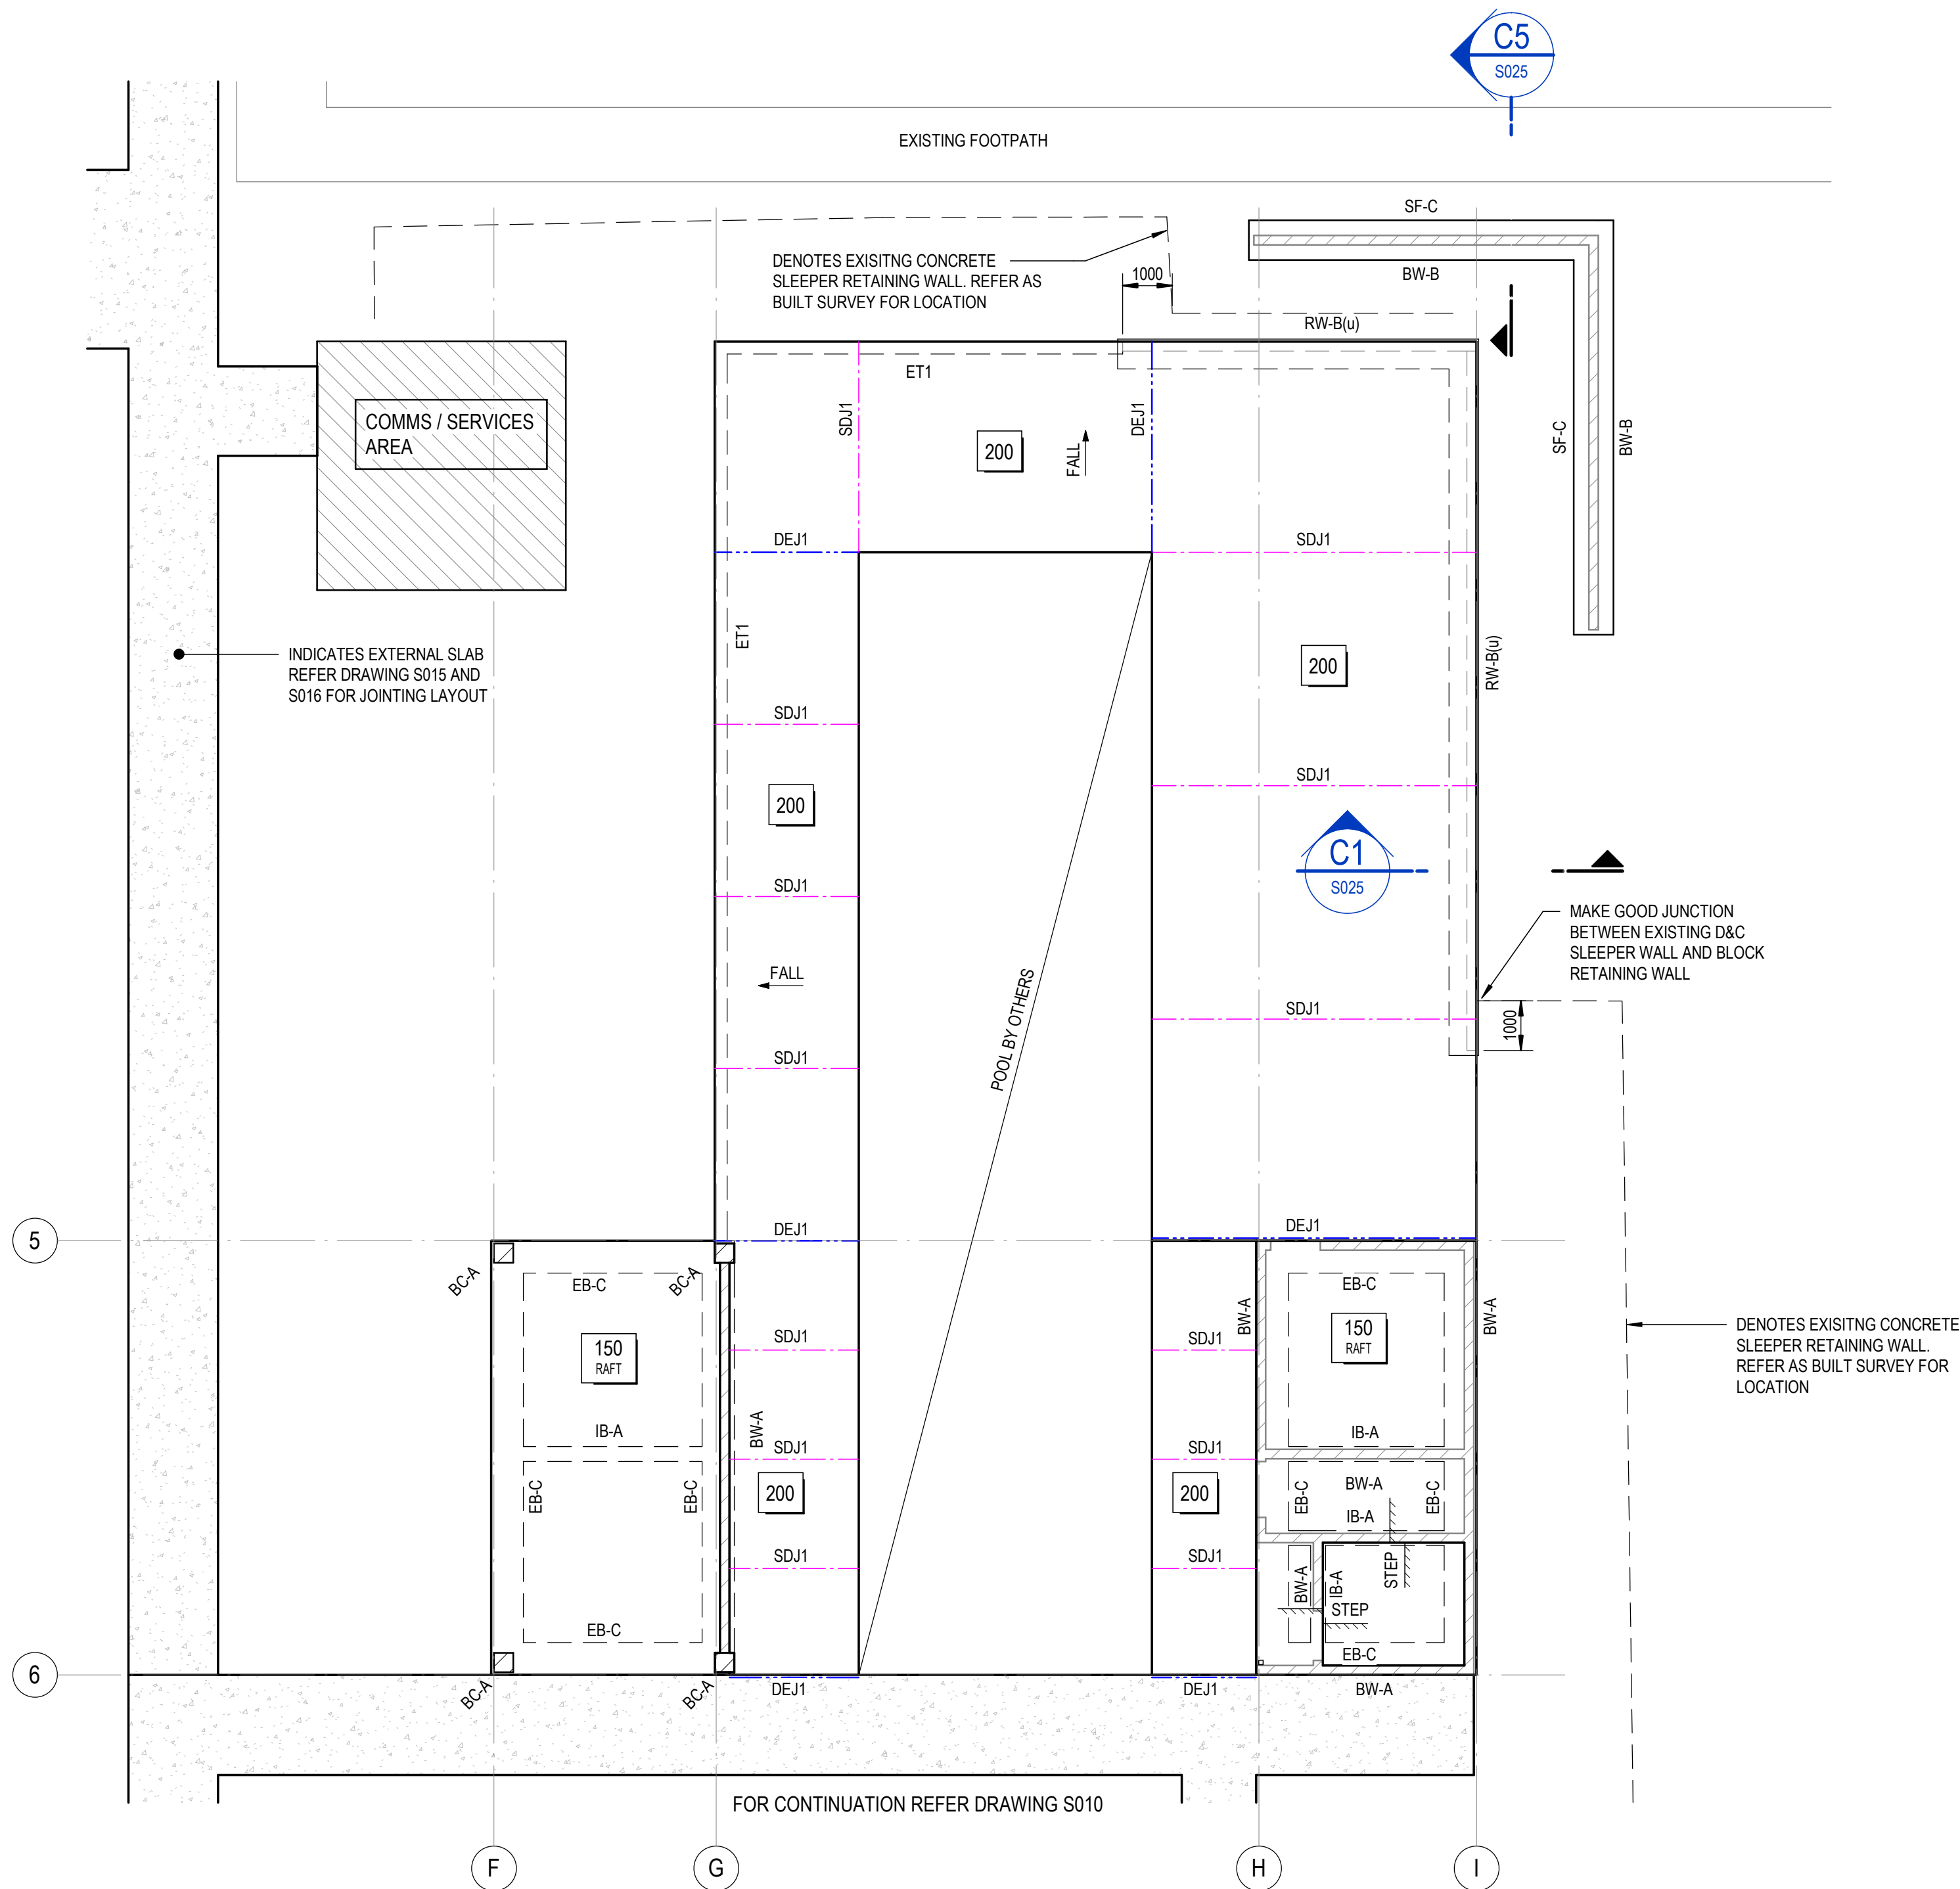

GROUND FLOOR - POOL/MAIL BUILDING

SCALE 1:100

NOTES

- GROUND LEVEL PLAN TO BE READ IN CONJUNCTION WITH THE GEOTECHNICAL INVESTIGATION REPORT No.1-29331 BR1.1 DATED SEPTEMBER 2025 AND PREPARED BY SOIL SURVEYS
- REFER ARCHITECTURAL DRAWINGS FOR ALL FLOOR FINISHES AND DETAILS TO ALL REBATES, STEPS, SETDOWNS AND FALLS ETC. AS WELL AS DRAINAGE PIT DETAILS AND SETOUT.
- SLAB ON GROUND TO BE CAST ONTO MIN 200um VISQUEEN AND 50mm BEDDING SAND. JOINTS TO BE LAPPED AND TAPED TO ARCHITECTURAL DETAILS.
- PROVIDE 250 WIDE x 200 DEEP EDGE THICKENING TO CONCRETE SLABS ON GROUND LESS THAN 150mm THICK, WHERE THE SLAB DOES NOT FOUND ON TO A FOOTING SYSTEM TYP UNO.
- PROVIDE 1 N12 TRIMMER BAR TOP TO ALL SLAB EDGES TYPICAL UNO. ALL RE-ENTRANT CORNERS TO HAVE 2 N12 TRIMMER BARS 1200 LG PLACED TOP AND BOTTOM UNO.
- ALL COMPACTED FILL SHALL BE CBR 15 SELECT FILL PLACED IN LAYERS NOT EXCEEDING 200mm THICK AND COMPACTED TO 98% (MODIFIED).
- REFER STANDARD NOTES ON DRG S001 FOR CONCRETE STRENGTHS, COVERS, BAR LAP LENGTHS, BEARING CAPACITIES ETC.
- THE CONTRACTOR IS TO NOTIFY THE STRUCTURAL ENGINEER AND FACILITATE AN INSPECTION OF STRUCTURAL WORKS PRIOR TO PLACEMENT OF CONCRETE OR COVERING OF STRUCTURAL ELEMENTS. FAILURE TO NOTIFY THE ENGINEER OF WORK AND FACILITATE AN INSPECTION WILL RESULT IN WORKS BEING EXCLUDED FROM CERTIFICATION.

LEGEND:

		BLOCKWORK OVER
		CONCRETE COLUMN / WALL OVER
		LOAD BEARING ELEMENT UNDER
		DENOTES SLAB THICKNESS
		DENOTES SLAB STEP
		DENOTES BLOCKWORK CONTROL JOINT TYPE x

SLABS

THICKNESS	REINFORCEMENT	REMARKS
100	SL72 MESH TOP	FOOTPATH SLAB
125	SL82 MESH TOP	RAFT SLAB
150	SL82 MESH TOP	RAFT SLAB
200	SL92 MESH TOP & BTM	EXTERNAL POOL AREA SLAB

STRIP FOOTINGS

MARK	WIDTH	DEPTH	COMMENTS
SF-A	450	450	STRIP FOOTING
SF-C	800	300	STRIP FOOTING

WALL SCHEDULE

MARK	VERTICAL	HORIZONTAL	DESCRIPTION
BW-A	N16- 400	N12-400	190 BLOCK WALL
BW-B	N12- 400	N12-400	190 BLOCK RETAINING WALL (800 MAX RETAINING)
RW-B	N12- 400	N12-400	190 BLOCK RETAINING WALL (800 MAX RETAINING)

BLOCK COLUMNS


MARK	SIZE	DESCRIPTION	COMMENTS
BC-A	390x390	BLOCK COLUMN	

PRINTING REQUIREMENTS


STATUS

PRELIMINARY
NOT FOR CONSTRUCTION

NORTH POINT



SCALES AT A1



BLIGH
TANNER

BRISBANE | SYDNEY | MELBOURNE
blightanner@blightanner.com.au
blightanner.com.au

CLIENT

SERENITAS

ARCHITECT

bda
architecture

DRAWN BY

BM

DESIGN BY

DM

CHECKED BY

SK

PROJECT

ROTHWELL CENTRAL FACILITIES
515 ANZAC AVE, ROTHWELL QLD 4022

DRAWING TITLE

POOL BUILDING SLAB AND
FOOTINGS LAYOUT

JOB NO

2025.0384

DRAWING NUMBER

S012

REVISION

P6