
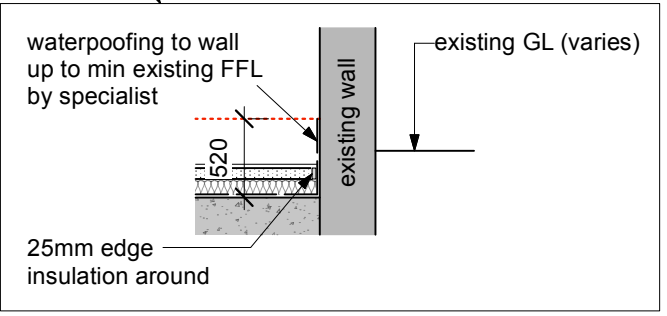


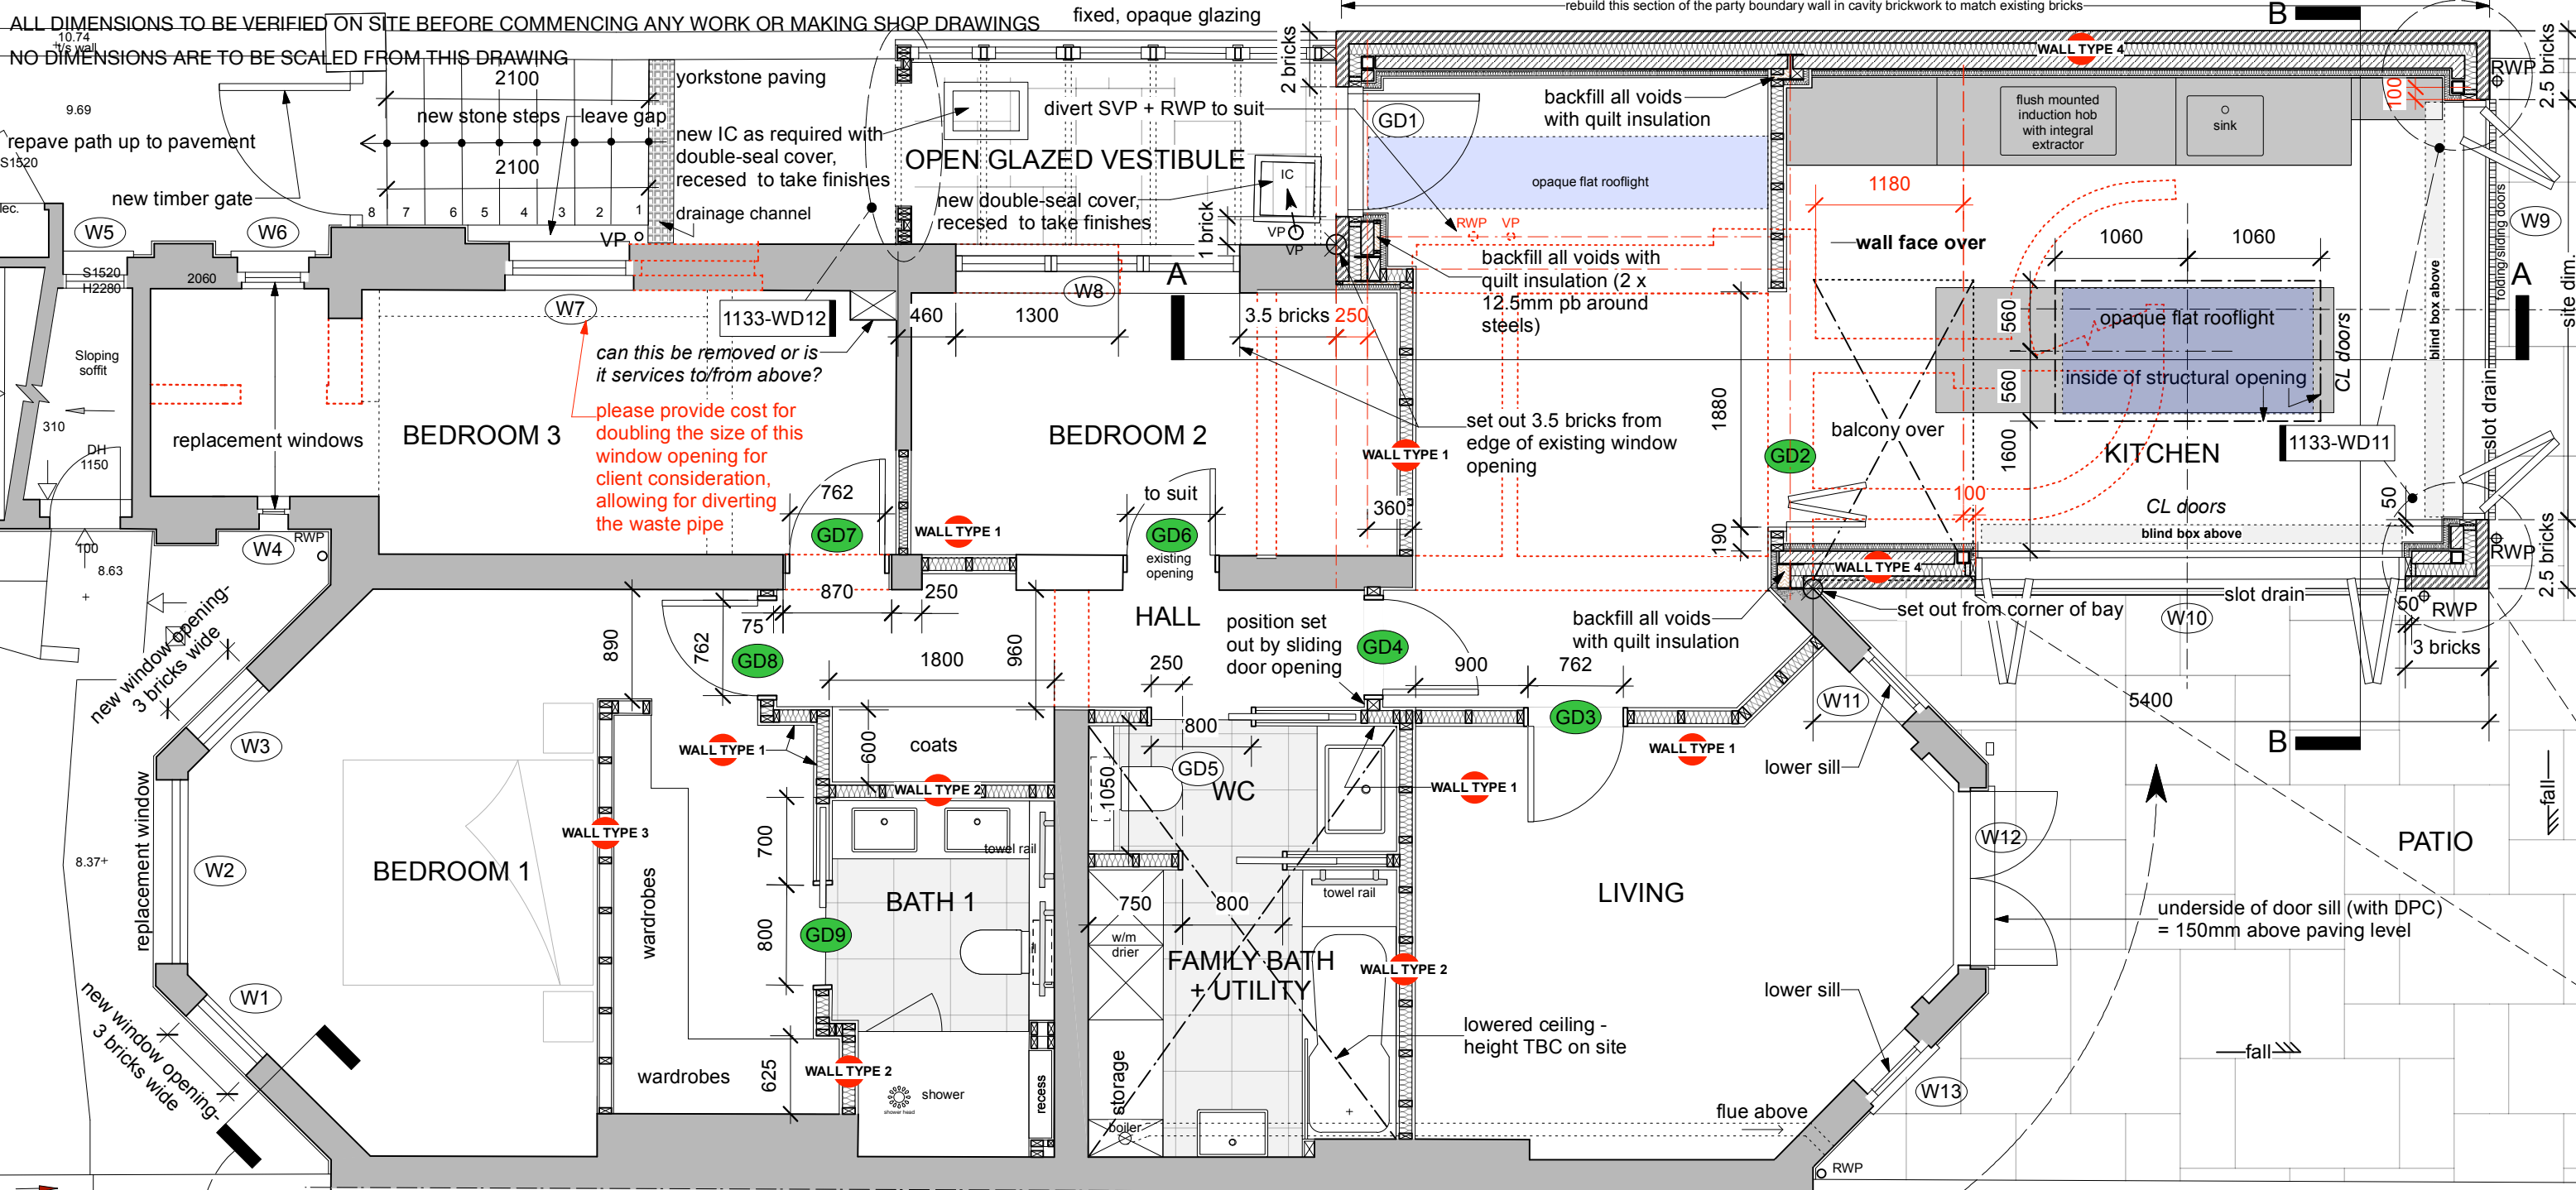

The extension features greater than 25% glazing - to mitigate this, it is proposed to insulate the existing solid brick external walls and to increase the extension glazing u-value to 0.12 W/m²K and rooflight u-value to 0.14 W/m²K

NEW BRICK MASONRY CAVITY WALLS (Full Cavity Fill): U-Value = 0.12 W/m²K
Brickwork (inc mortar and bonding) to match cleaned and repointed existing, 100mm cavity with 90mm Kingspan Kooltherm K106 insulation and Kingspan Kooltherm Cavity Closers, 140mm Medium Blockwork, 57.5mm Kingspan Kooltherm K118 (on 15mm dabs), 3mm Plaster skim

U-Value Calculation and Condensation Risk Assessment

Project Information: 99 King Henry's Road, London NW3
Construction: Cavity wall, full fill (with 100mm cavity) less than or equal to 120mm
Construction Type: Wall
File reference: 1133-231218-113311-42
Calculated U-value = 0.12 W/m²K

Description	Thickness (mm)	Thermal Conductivity (W/mK)	Thermal Resistance (m²K/W)	Vapour Resistance (m²K/g)	Vapour Permeability (perms)
Outside Surface			0.040		
100mm Kingspan Kooltherm K106	100	0.022	4.545	0.050	0.020
140mm Medium Blockwork	140	0.110	1.273	0.050	0.020
57.5mm Kingspan Kooltherm K118	57.5	0.022	2.636	0.050	0.020
3mm Plaster skim	3	0.250	0.012	0.050	0.020
Inside Surface			0.040		
Total			6.960	0.200	0.080

See Drawing 1133-WD01 for Key and Notes relating to this Drawing

Under and overground drainage design by main contractor

BROD WIGHT Architects
8a Baynes Mews --- London --- NW3 5BH

Flat 1, 99 King Henry's Road
London NW3 3QX

www.brodwight.co.uk office@brodwight.co.uk
Tel 020 7722 0810 This drawing is copyright

Drawing Title:
Proposed Lower Ground Floor Construction Issue

Drawing Ref:
1133-WD03

Date: July 2024
Scale: 1:50@A3