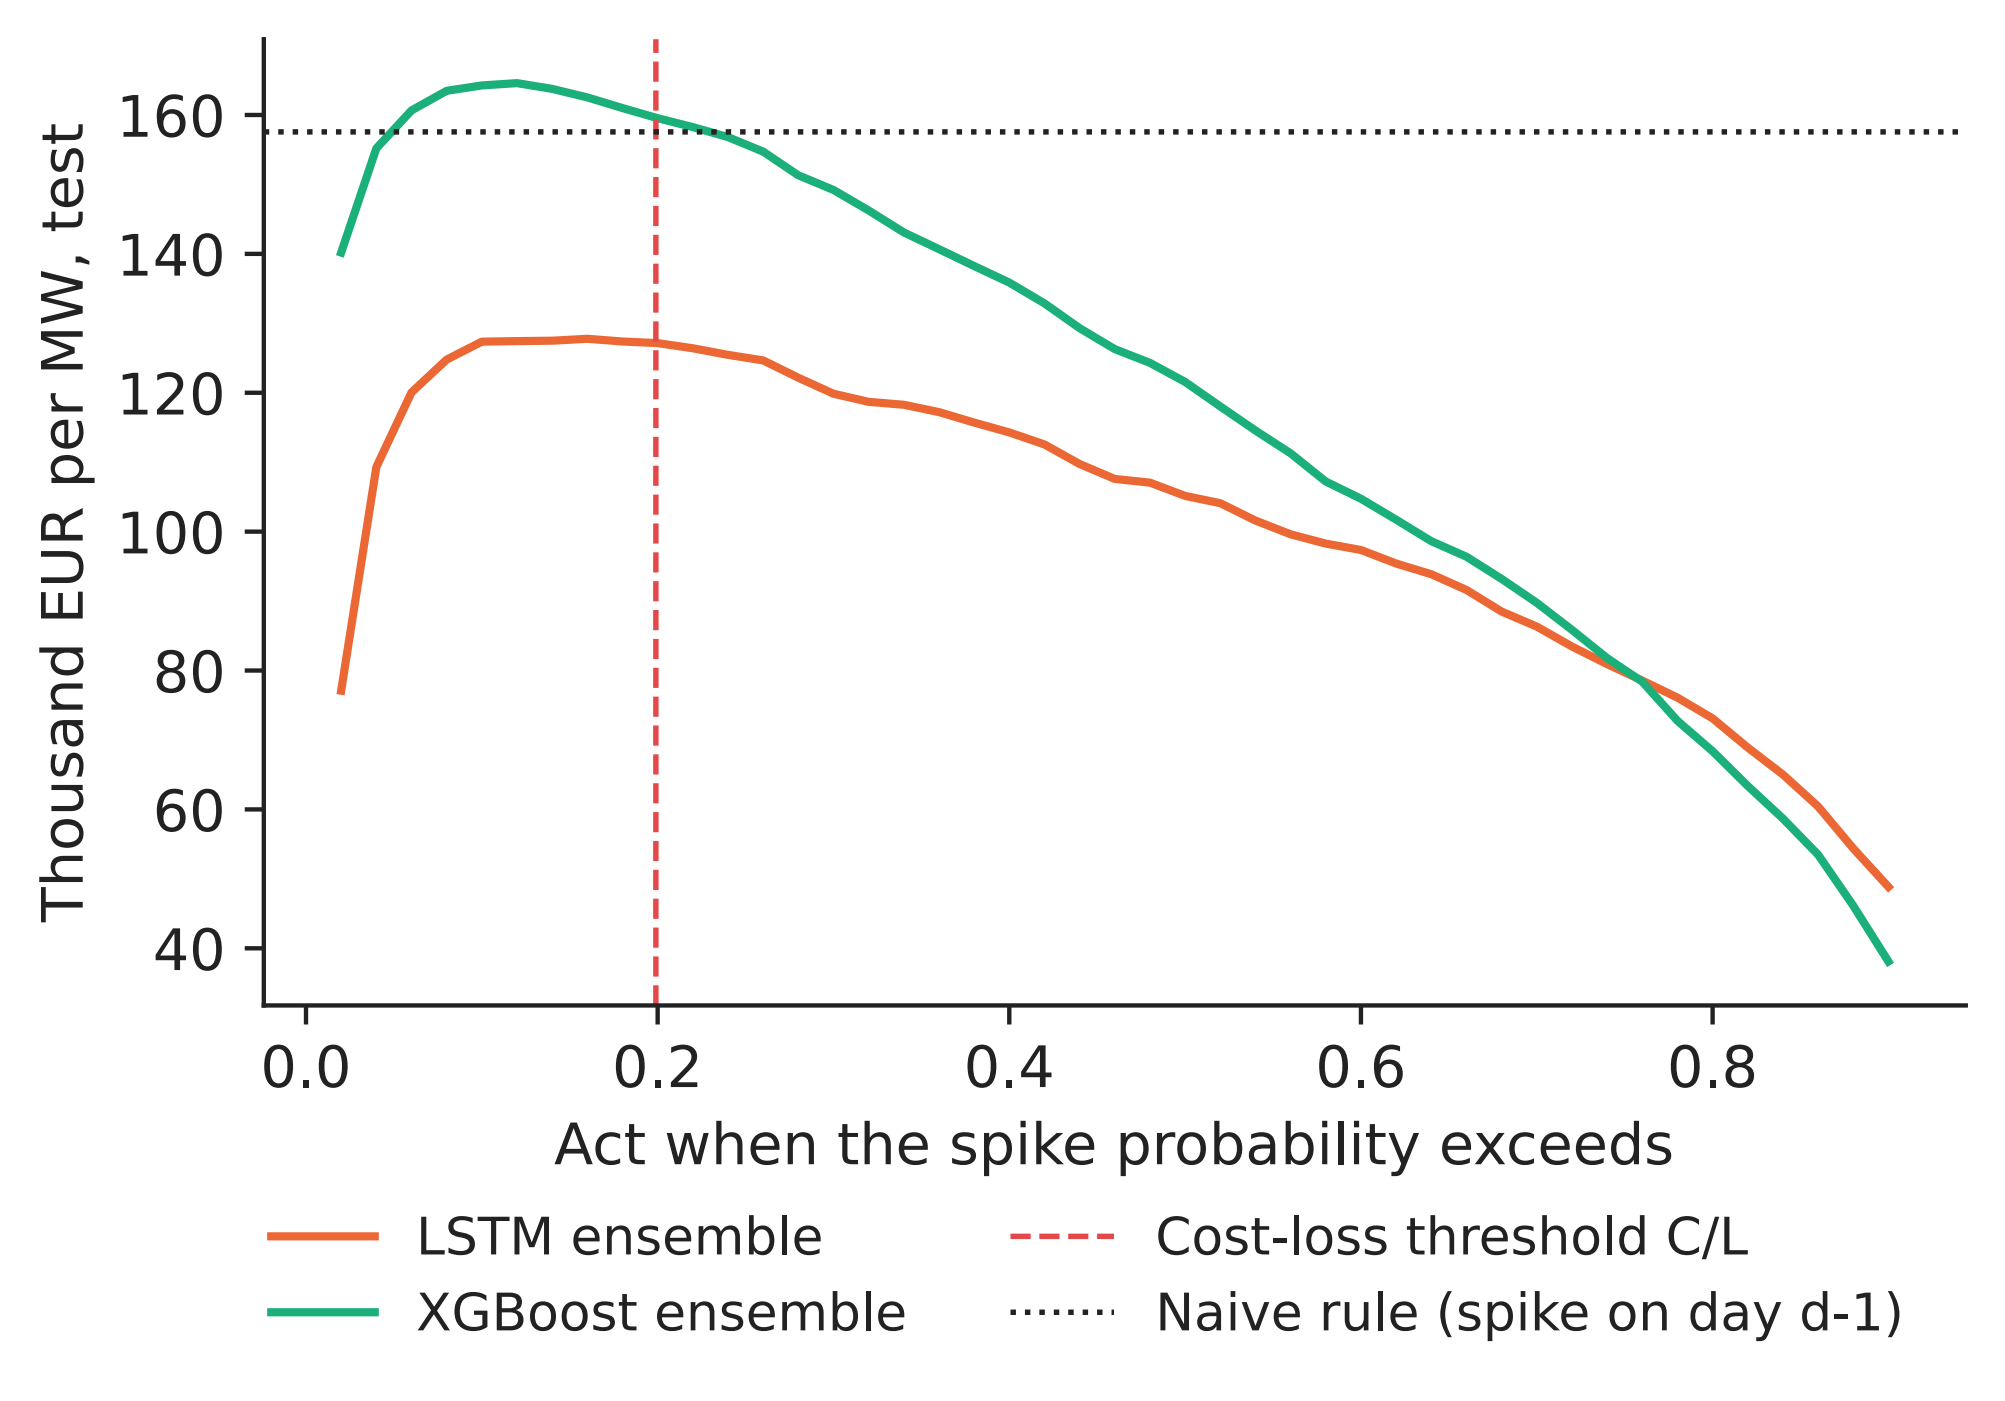
160
140
120
100
80
60
40
Thousand EUR per MW, test
0.0
0.2
0.4
0.6
0.8
Act when the spike probability exceeds
LSTM ensemble
XGBoost ensemble
Cost-loss threshold C/L
Naive rule (spike on day d-1)