A/C HEATER CONTROL (Continued)

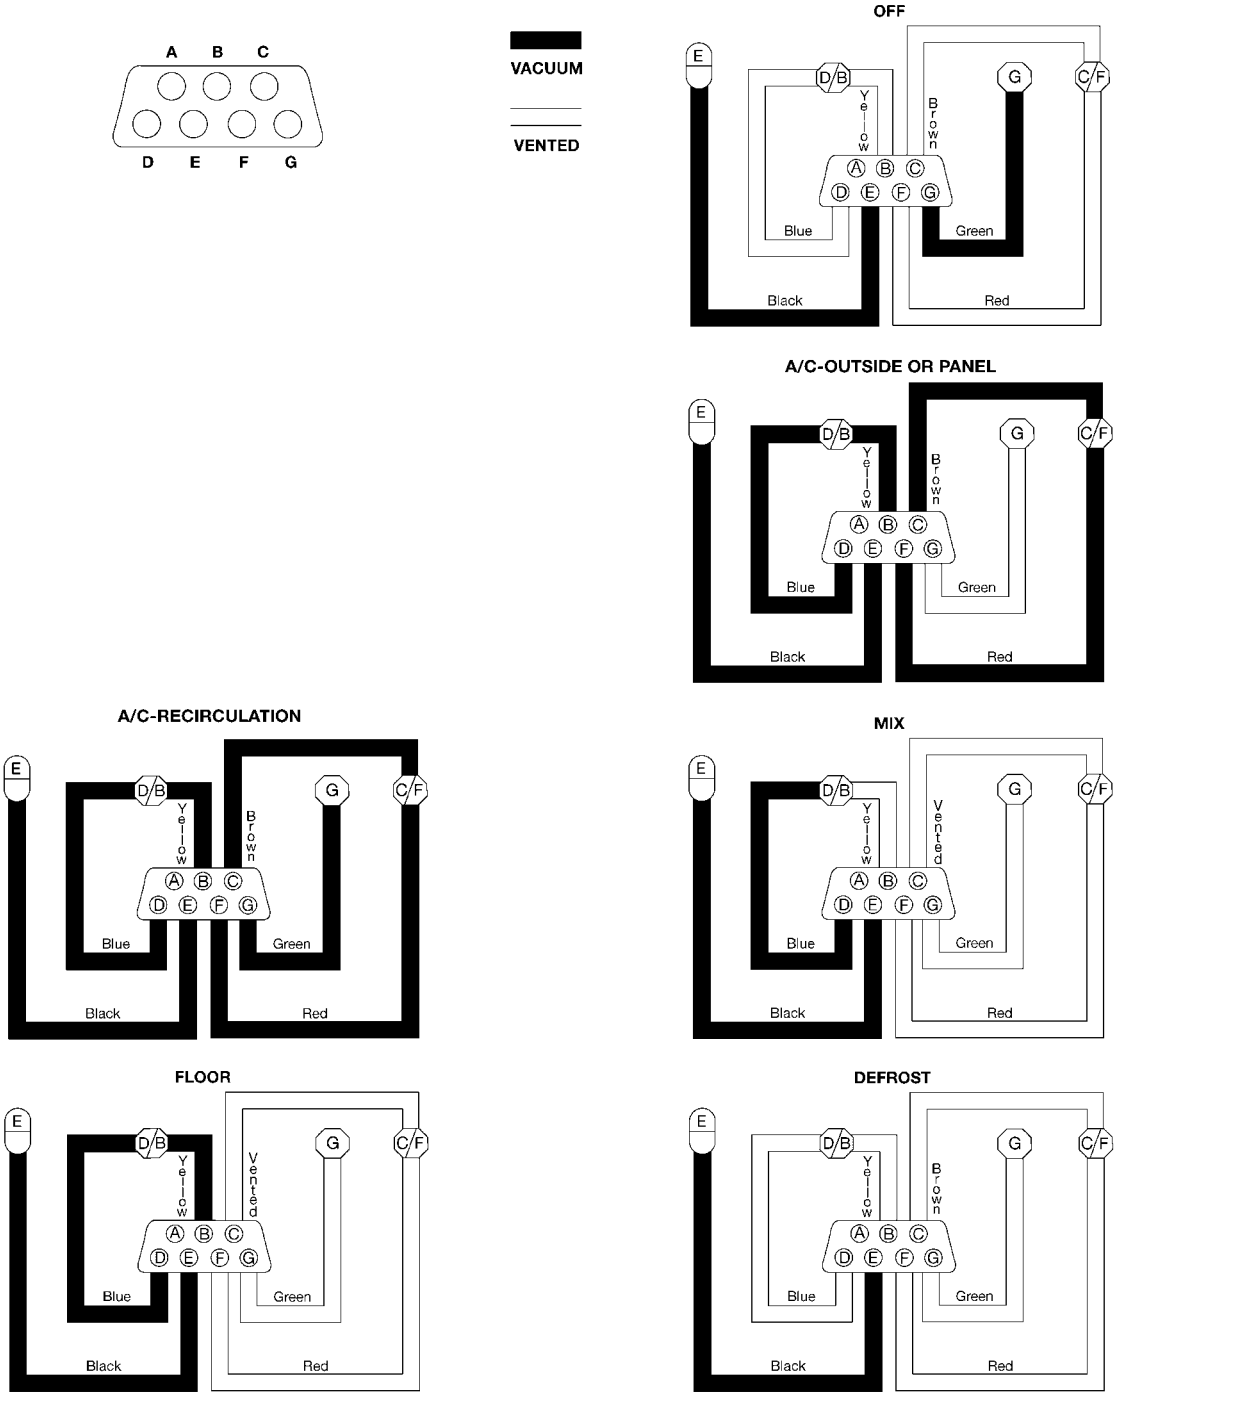

Fig. 15 Vacuum Circuits - Heater-A/C

A - NOT USED
B - DEFROST ACTUATOR (YELLOW)
C - FLOOR ACTUATOR (BROWN)
D - DEFROST ACTUATOR, MID-POSITION (BLUE)
E - VACUUM SUPPLY, RESERVOIR (BLACK)
F - PANEL ACTUATOR (RED)
G - RECIRCULATION ACTUATOR (GREEN)