What point adjustment changes

One hit inside a labelled anomaly interval fills that interval during evaluation.

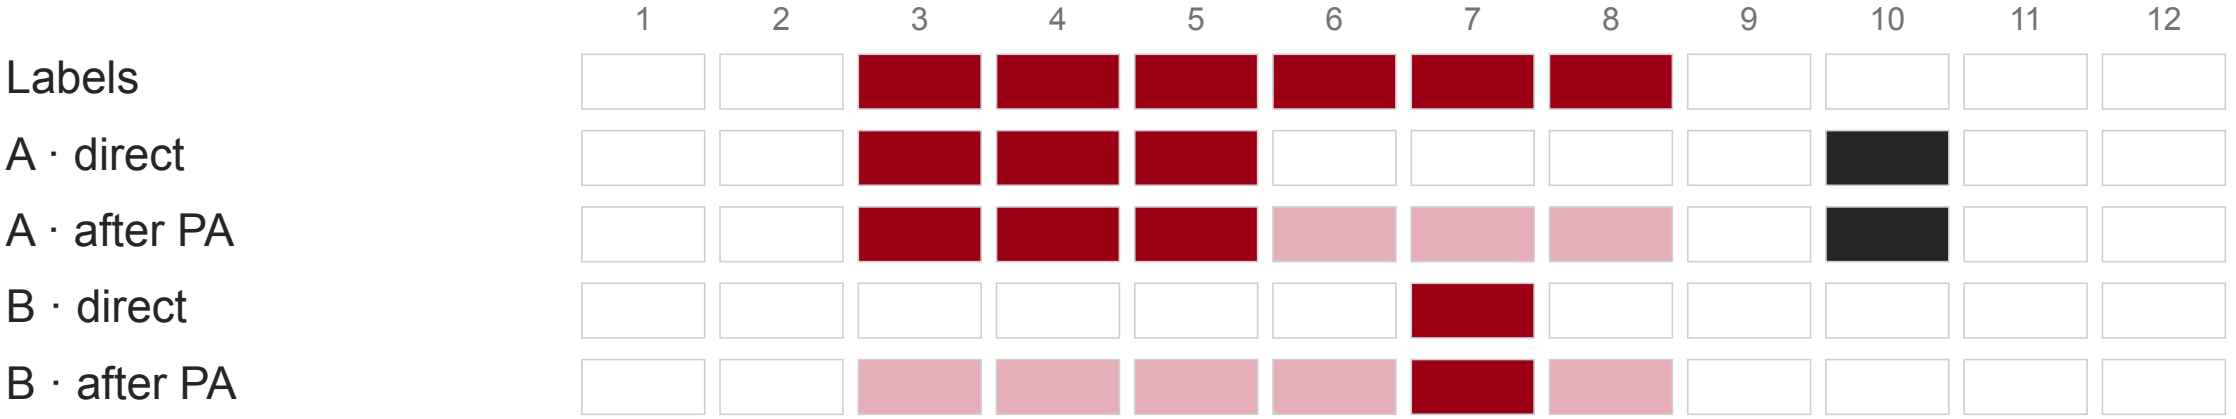

Red: detected · pale red: filled by PA · dark: false alarm

Model	Scoring	TP	FP	FN	Precision	Recall	F1
A	Direct	3	1	3	75.0	50.0	60.0
A	PA	6	1	0	85.7	100.0	92.3
B	Direct	1	0	5	100.0	16.7	28.6
B	PA	6	0	0	100.0	100.0	100.0

Intervals come from labels, not window size. False alarms outside remain unchanged.