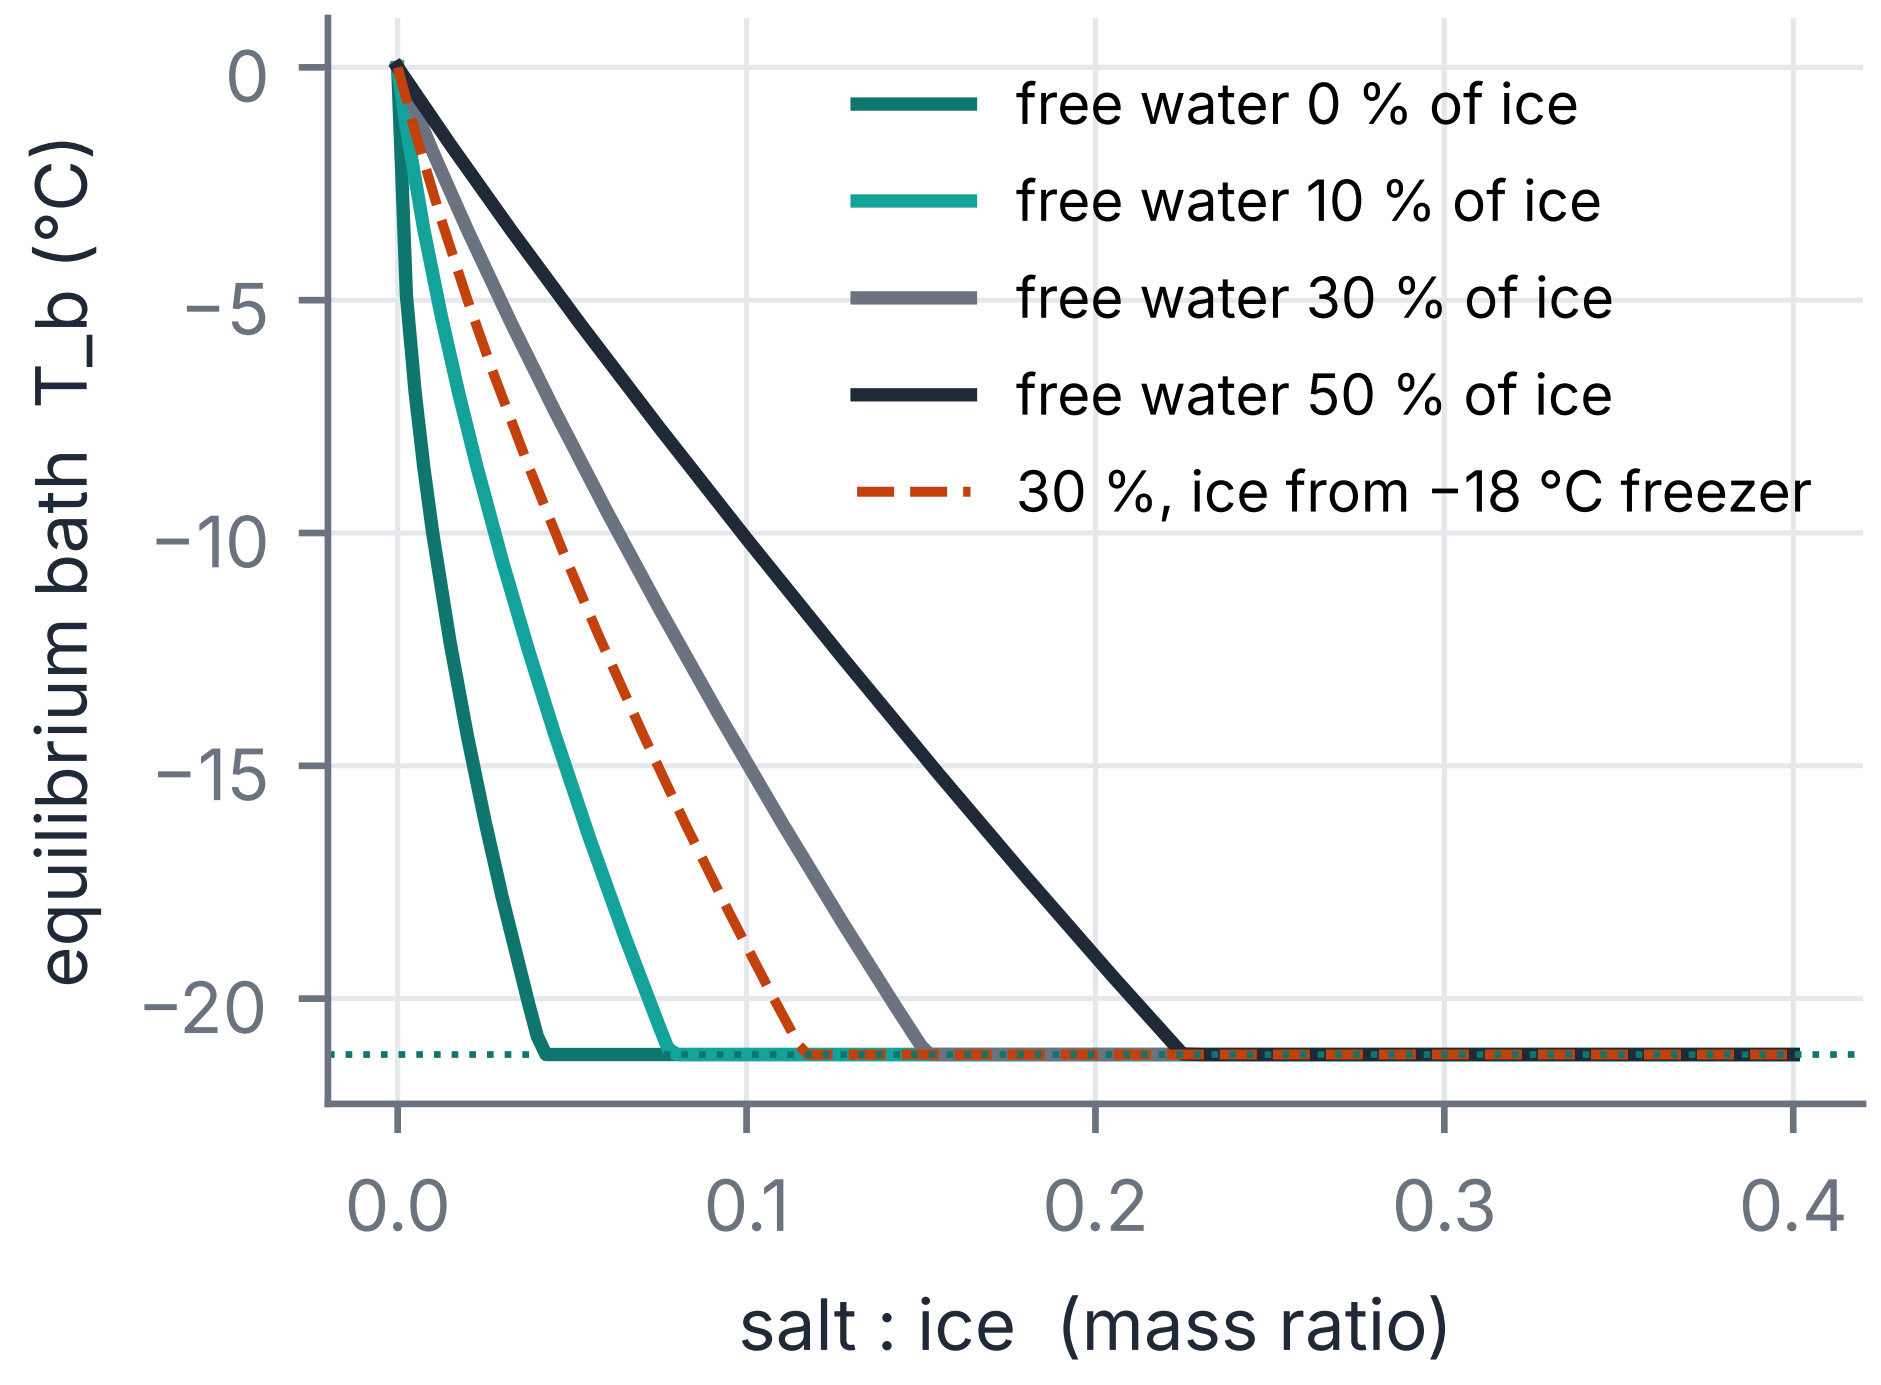
0
−5
−10
−15
−20
equilibrium bath T_b (°C)
0.0
0.1
0.2
0.3
0.4
salt : ice (mass ratio)
free water 0 % of ice
free water 10 % of ice
free water 30 % of ice
free water 50 % of ice
30 %, ice from −18 °C freezer