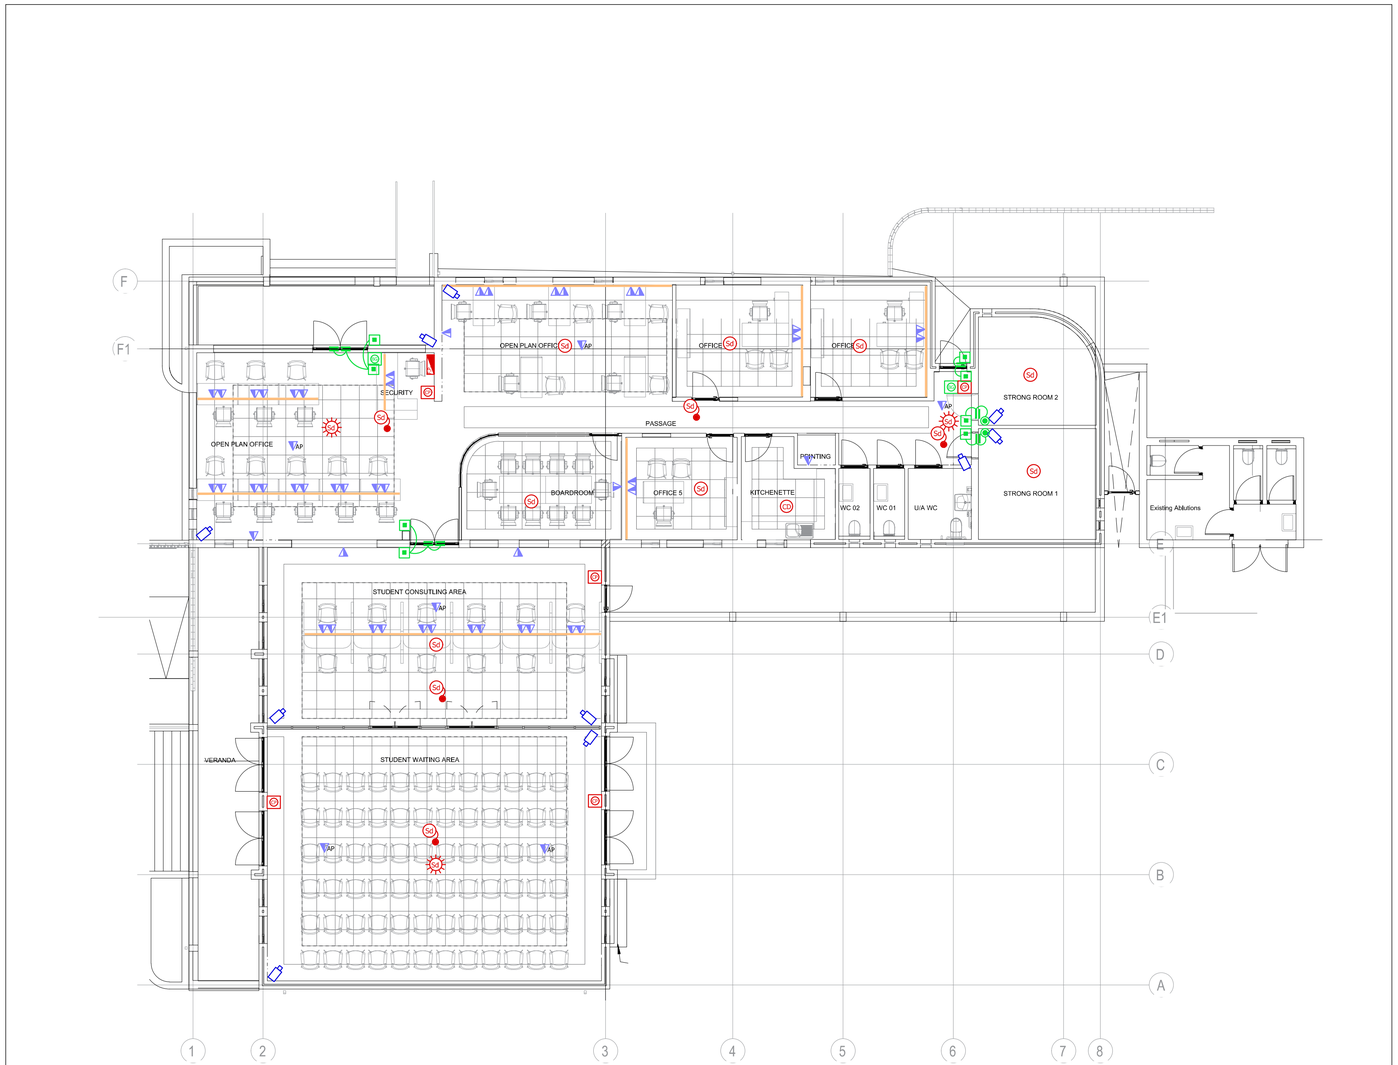

SHEET SIZE A1

LEGEND

	FIRE DETECTION
	4-LOOP ADDRESSABLE FIRE DETECTION PANEL
Sd	OPTICAL SMOKE DETECTOR
CD	SMOKE/HEAT COMBINATIONAL DETECTOR
	DETECTOR, SOUNDER AND STROBE COMBINATIONAL UNIT ON SINGLE BASE
	FIRE DETECTION RESETTABLE MANUAL CALL POINT (Break Glass)
	SIREN/STROBE COMBINATION UNIT
	I/O UNIT TO COMMUNICATE WITH THE SPRINKLER SYSTEM, COMPLETE.
	VOID DETECTOR REMOTE INDICATOR LIGHT
230T	230V RELAY UNIT TO CONTROL FANS VIA CONTACTOR IN CONTROL PANEL
	ACCESS CONTROL
	ON-LINE PROXIMITY CARD/DISC READER
	NO-TOUCH ELECTRONIC DOOR RELEASE
	ACCESS CONTROL EMERGENCY BREAK GLASS UNIT DOOR RELEASE
	ACCESS CONTROLLED MAGNETIC LOCK
	CONNECTION TO SLIDING DOOR MECHANISM.
	INTERCOM SYSTEM
	CCTV
	CCTV CAMERA
TV	100 x100 LINKED TO UNDER STAIR FOR TV OUTLET
	DATA OR TEL POINT (RJ45)
AP	IN CEILING FOR ACCESS POINT, WIFI

POWER SKIRTING, 2 TIER, PVC, COMPLETE WITH BENDS AND END CAPS AS REQUIRED. TO BE MOUNTED AT HEIGHTS AS PER THE ARCHITECTS DETAIL TO SUITE JOINERY.

REV	DATE	DESCRIPTION
A	Dec 2025	ISSUED FOR TENDER

NOTE:
ALL MEASUREMENTS TO BE CHECKED ON SITE**.**
IF IN DOUBT, ASK.
THIS DESIGN & DRAWING IS THE INTELLECTUAL & CONFIDENTIAL PROPERTY OF **CA du Toit EC (PTY) LTD** AND MAY NOT BE DISCLOSED TO THIRD PARTY, COPIED OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PERMISSION OF **CA du Toit EC (PTY) LTD.**

CA du Toit Eastern Cape (Pty) Ltd
CONSULTING ENGINEERS / RAADGEWENDE INGENIEURS
22 Shirley Street
Newton Park
GQEBERHA
6045
E-mail
pe@cadutoitec.co.za
Telephone
+27 (0)41 585 7559

PROJECT:
UNIVERSITY OF FORT HARE
ALICE CAMPUS
FINANCE OFFICES CONVERSION

DRAWING:
ELECTRICAL INSTALLATION
ICT SERVICES LAYOUT

SCALE:	DATE:
1 : 100	DECEMBER 2025
DRAWN: L.B.	DESIGNED: L.B.
APPROVED: P.S.	VERIFIED: P.S.

ISSUED FOR:
TENDER

CONSULTANTS JOB REFERENCE NUMBER. P8080

P8080E06-003

SHEET NO: 1 of 1 REV. NO: A