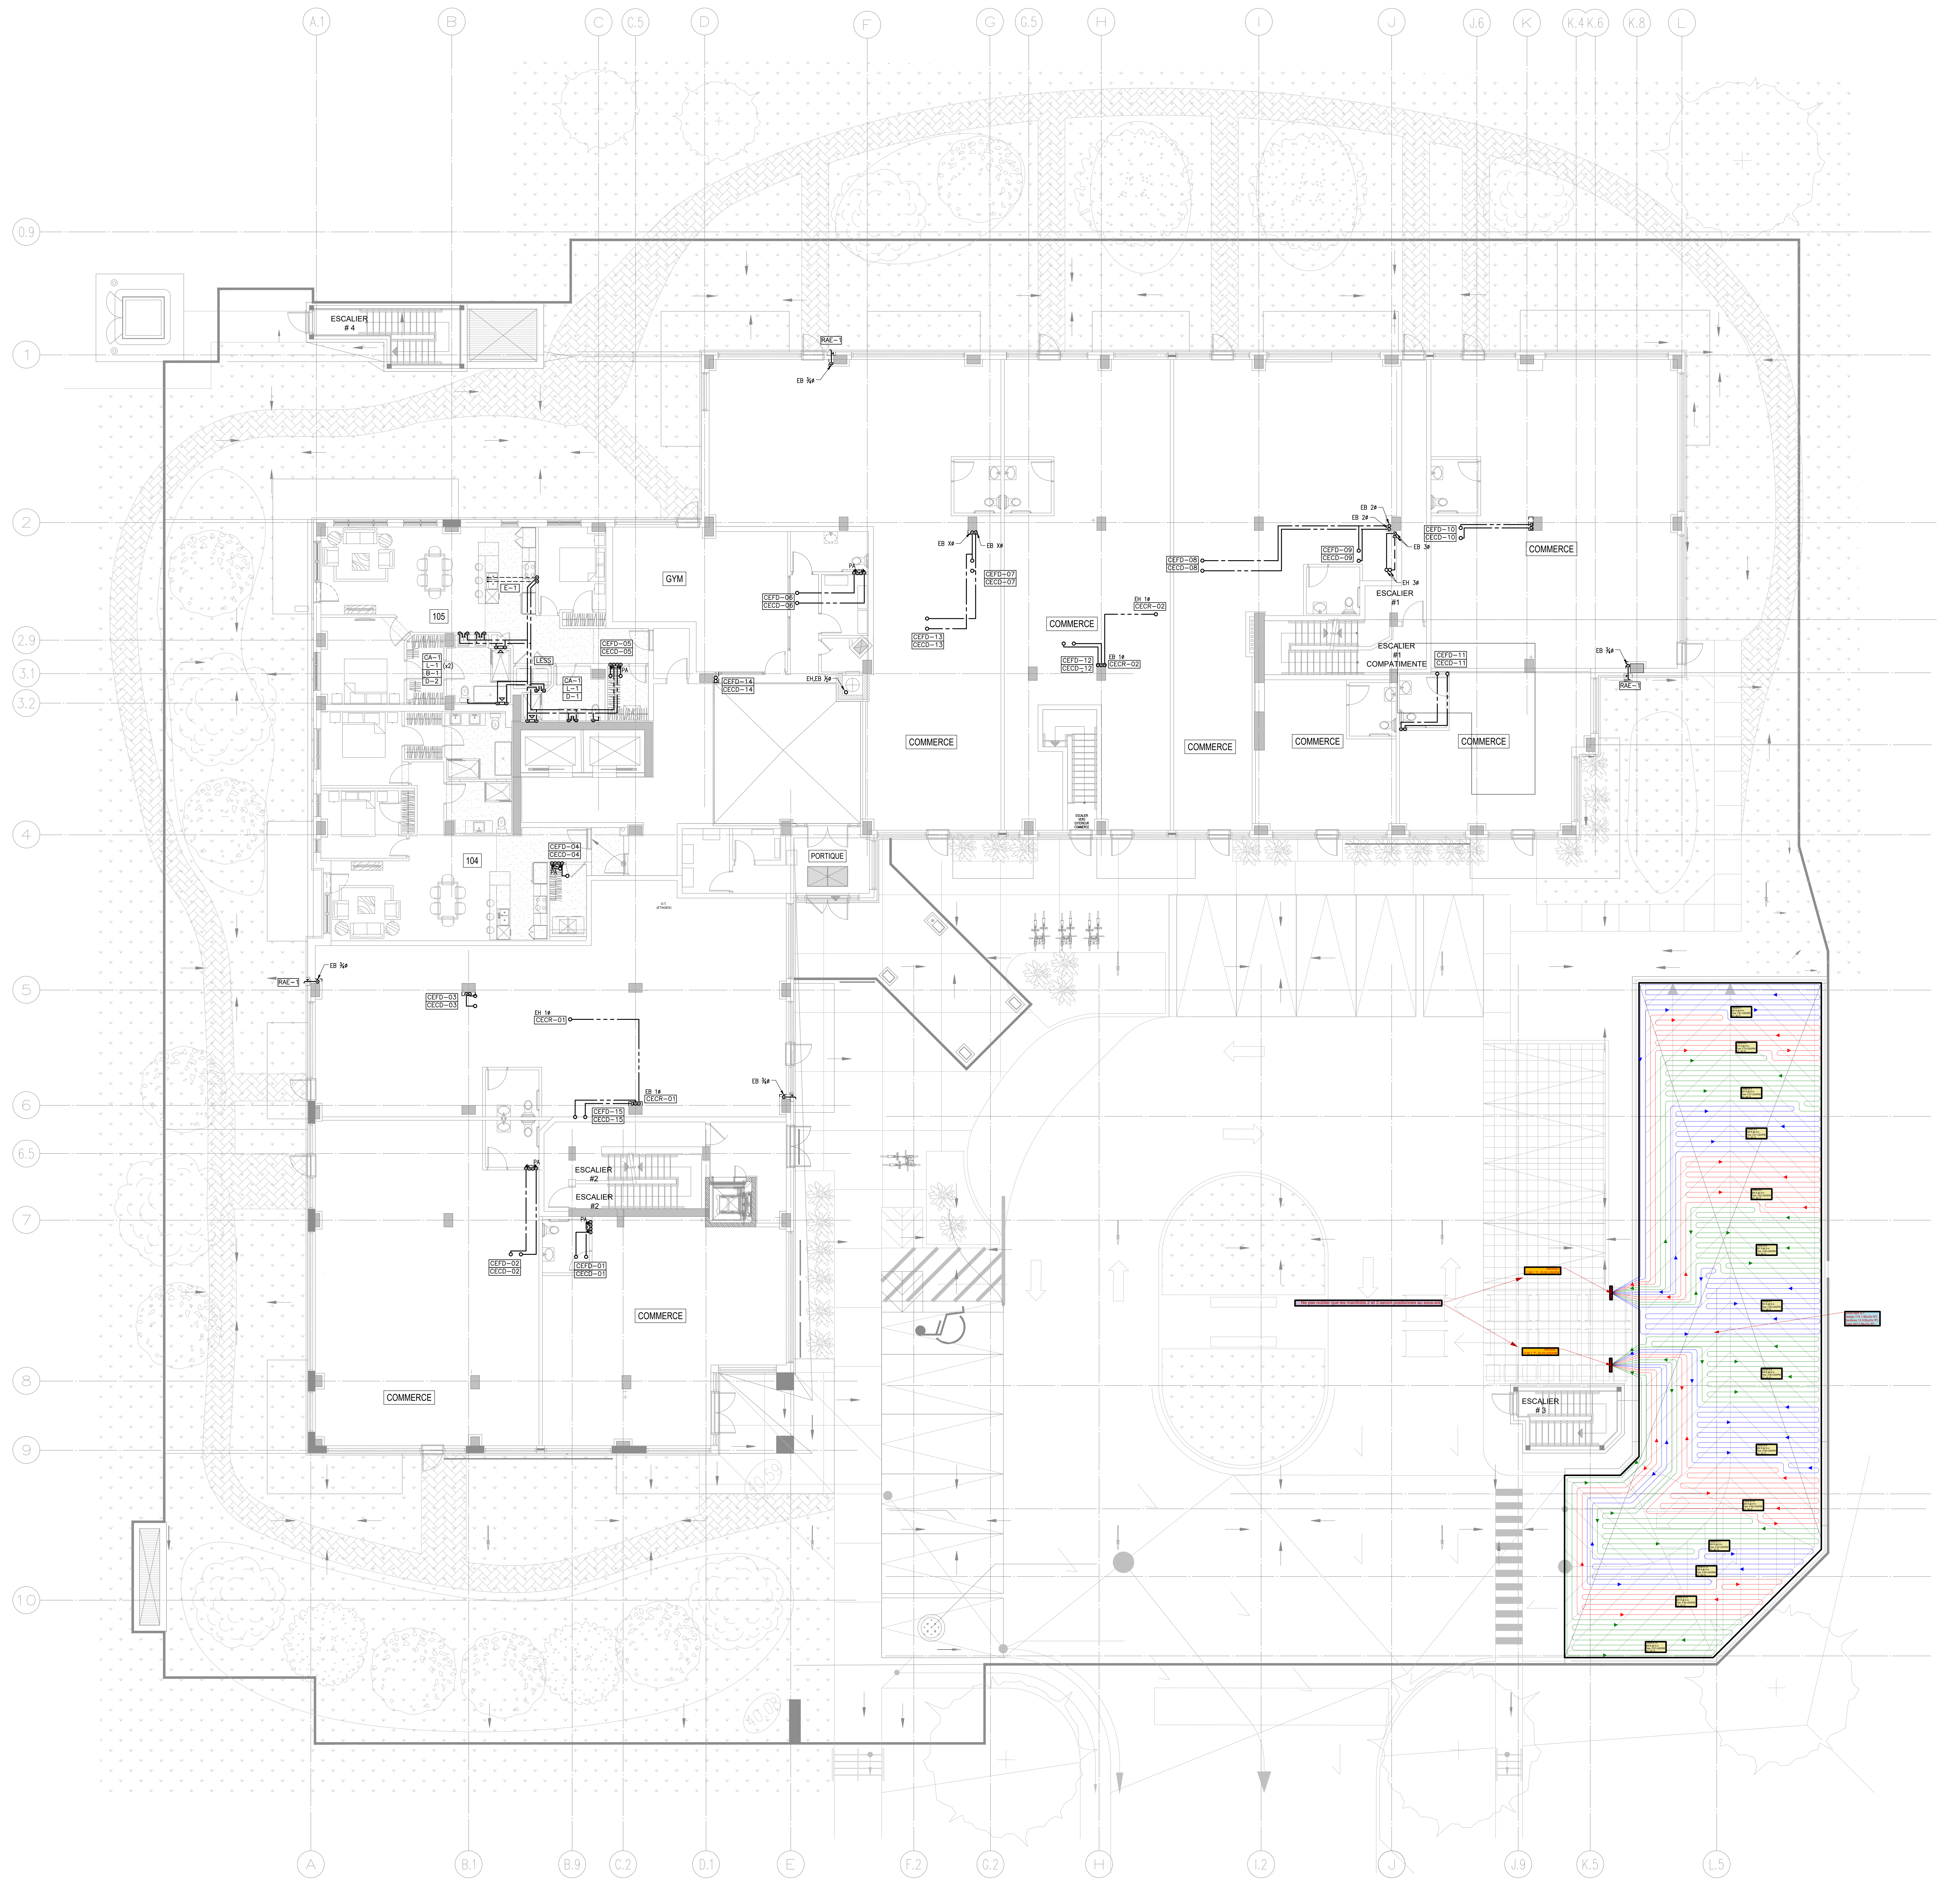
A.1
B
C
C.5
D
F
G
G.5
H
I
J
J.6
K
K.4
K.6
K.8
L
0.9
1
2
2.9
3.1
3.2
4
5
6
6.5
7
8
9
10
A
B.1
B.9
C.2
D.1
E
F.2
G.2
H
I.2
J
J.9
K.5
L.5
ESCALIER # 4
RAE-1
EB ¾ø
105
104
GYM
PORTIQUE
COMMERCE
COMMERCE
COMMERCE
COMMERCE
COMMERCE
COMMERCE
COMMERCE
COMMERCE
ESCALIER #1
ESCALIER #1 COMPATIMENTE
ESCALIER #2
ESCALIER #2
ESCALIER # 3
CEFD-01 CECD-01
CEFD-02 CECD-02
CEFD-03 CECD-03
CEFD-04 CECD-04
CEFD-05 CECD-05
CEFD-06 CECD-06
CEFD-07 CECD-07
CEFD-08 CECD-08
CEFD-09 CECD-09
CEFD-10 CECD-10
CEFD-11 CECD-11
CEFD-12 CECD-12
CEFD-13 CECD-13
CEFD-14 CECD-14
CEFD-15 CECD-15
CECR-01
CECR-02
EB 1ø
EB 2ø
EB 3ø
EH 1ø
EH 3ø
PA
Ne pas oublier que les manifolds 2 et 3 seront positionnés au sous-sol.
Manifold 2 (138.1 °F, 20.00 USGPM)
Manifold 3 (138.1 °F, 20.43 USGPM)
Snow Melt A-1
Design:174.1 Btu/(hr·ft²)
Backloss:12.9 Btu/(hr·ft²)
Total:187.0 Btu/(hr·ft²)
Circuit A-1 285 ft @ 9 in Flow: 2.81 USGPM ΔT: 30 °F
Circuit A-2 277 ft @ 9 in Flow: 2.74 USGPM ΔT: 30 °F
Circuit A-3 307 ft @ 9 in Flow: 3.07 USGPM ΔT: 30 °F
Circuit A-4 283 ft @ 9 in Flow: 2.81 USGPM ΔT: 30 °F
Circuit A-5 284 ft @ 9 in Flow: 2.82 USGPM ΔT: 30 °F
Circuit A-6 287 ft @ 9 in Flow: 2.86 USGPM ΔT: 30 °F
Circuit A-7 291 ft @ 9 in Flow: 2.89 USGPM ΔT: 30 °F
Circuit A-8 299 ft @ 9 in Flow: 2.96 USGPM ΔT: 30 °F
Circuit A-9 289 ft @ 9 in Flow: 2.88 USGPM ΔT: 30 °F
Circuit A-10 296 ft @ 9 in Flow: 2.96 USGPM ΔT: 30 °F
Circuit A-11 295 ft @ 9 in Flow: 2.92 USGPM ΔT: 30 °F
Circuit A-12 292 ft @ 9 in Flow: 2.90 USGPM ΔT: 30 °F
Circuit A-13 287 ft @ 9 in Flow: 2.84 USGPM ΔT: 30 °F
Circuit A-14 300 ft @ 9 in Flow: 2.97 USGPM ΔT: 30 °F