


20220914_mon-MonSim.py 2022-09-14T14-55-15

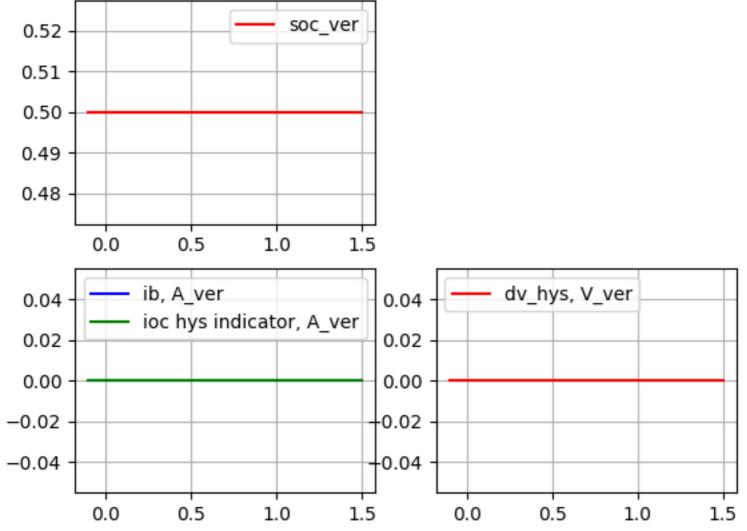

pulse20220914_mon-MonSim.py 2022-09-14T14-55-15

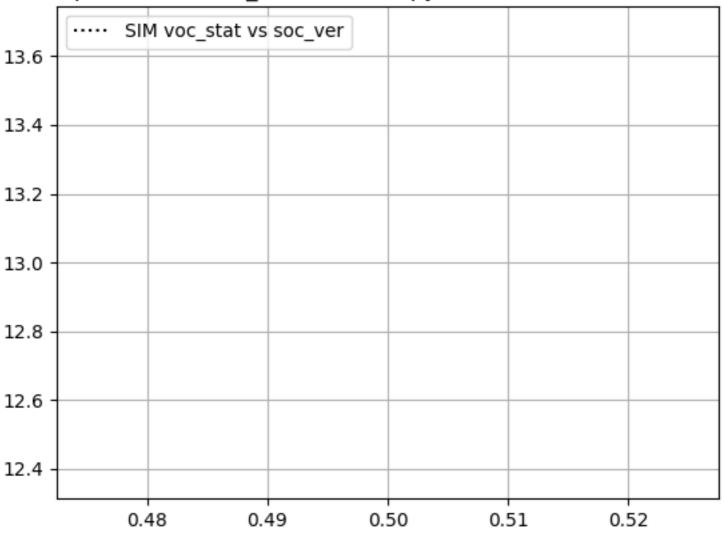

20220914_mon-MonSim.py 2022-09-14T14-55-15

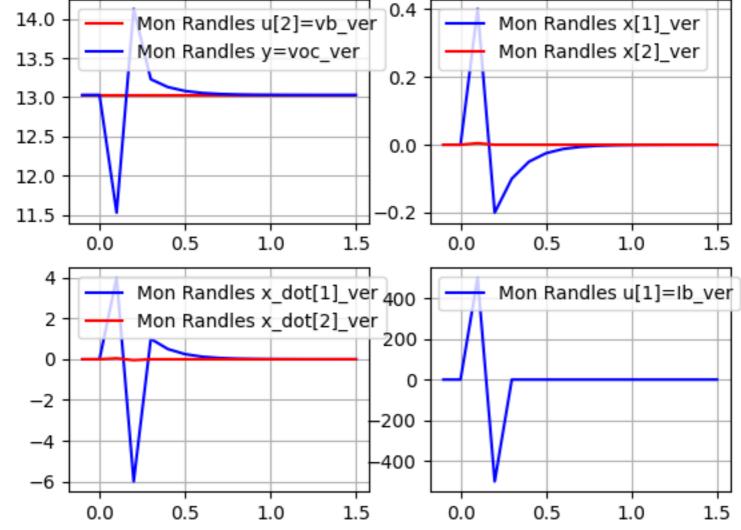

20220914_mon-MonSim.pypu2s0222029201941174L444505n-1M5onSim.py 2022-09-14T14 lb_amp_hdwe ib_diff 400 400 lb_noa_hdwe ib_diff_f 200 200 ib_diff_thr Ιb 0 0 -200-200 -400400 0.5 0.5 0.0 1.0 0.0 1.0 1.5 1.5 0.10 ib quiet ib rate 4 ib_quiet ib quiet thr 0.05 2 ib quiet thr dscn_fa-0.02 0.00 0 -2 -0.05

1.5

0.5

1.0

1.5


0.0

1.0

-0.10

0.0

0.5

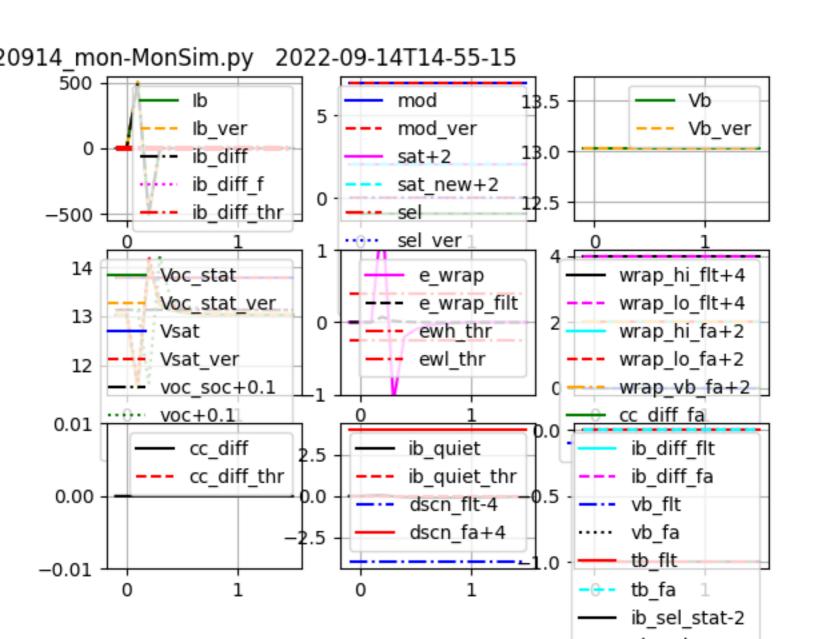

20220914_mon-MonSim.py 2022-09-14T14-55-15

