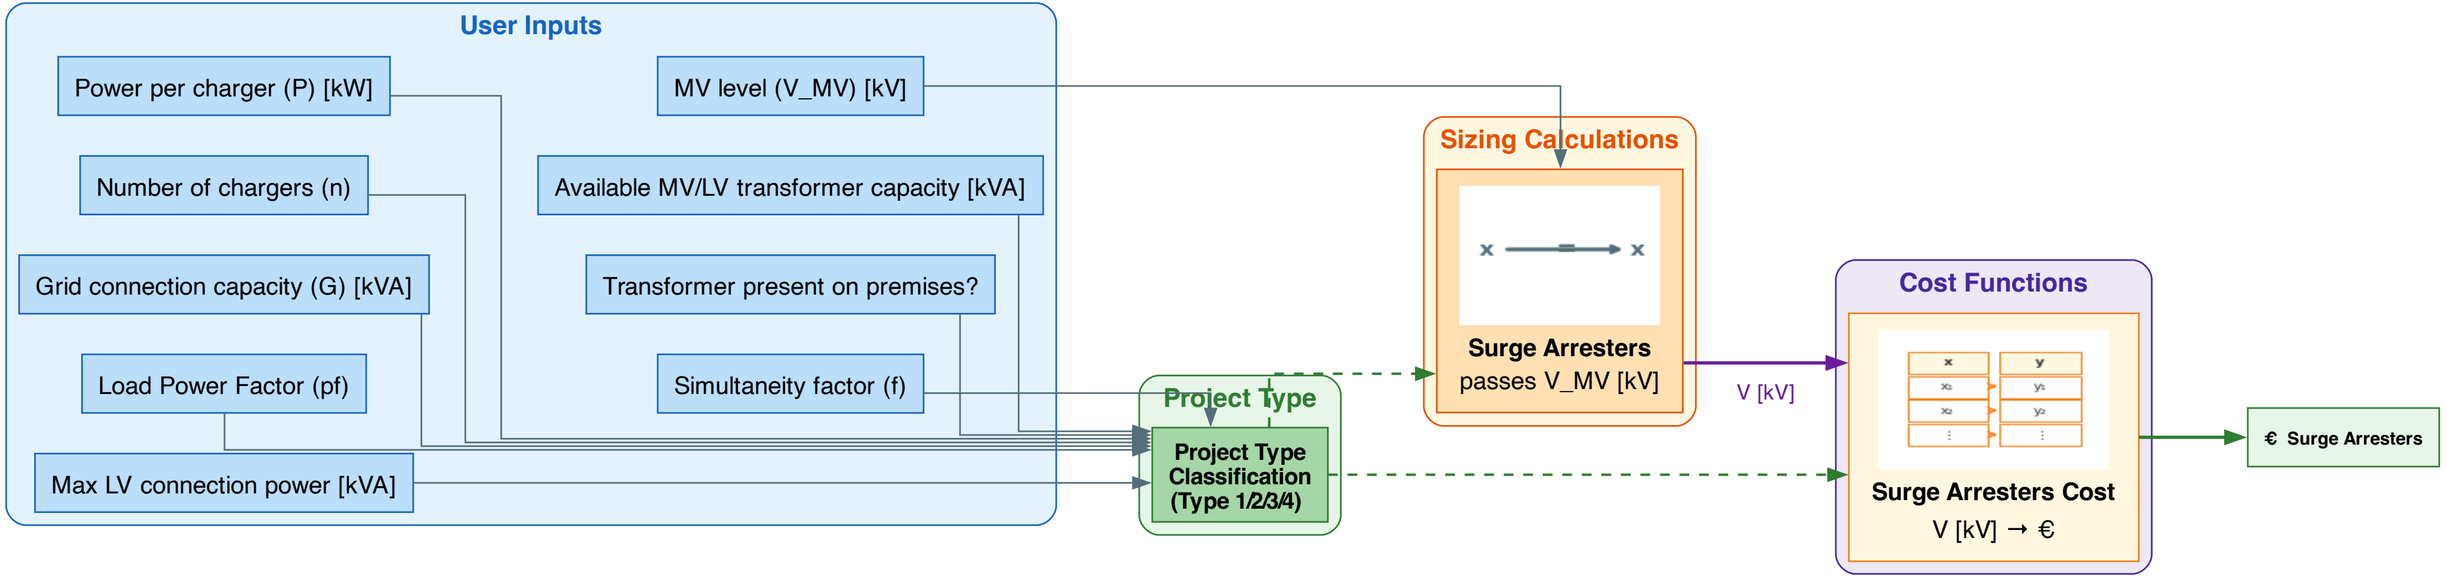
User Inputs
Power per charger (P) [kW]
MV level (V_MV) [kV]
Number of chargers (n)
Available MV/LV transformer capacity [kVA]
Grid connection capacity (G) [kVA]
Transformer present on premises?
Load Power Factor (pf)
Simultaneity factor (f)
Max LV connection power [kVA]
Project Type
Project Type Classification (Type 1/2/3/4)
Sizing Calculations
Surge Arresters
passes V_MV [kV]
V [kV]
Cost Functions
Surge Arresters Cost
V [kV] → €
€ Surge Arresters