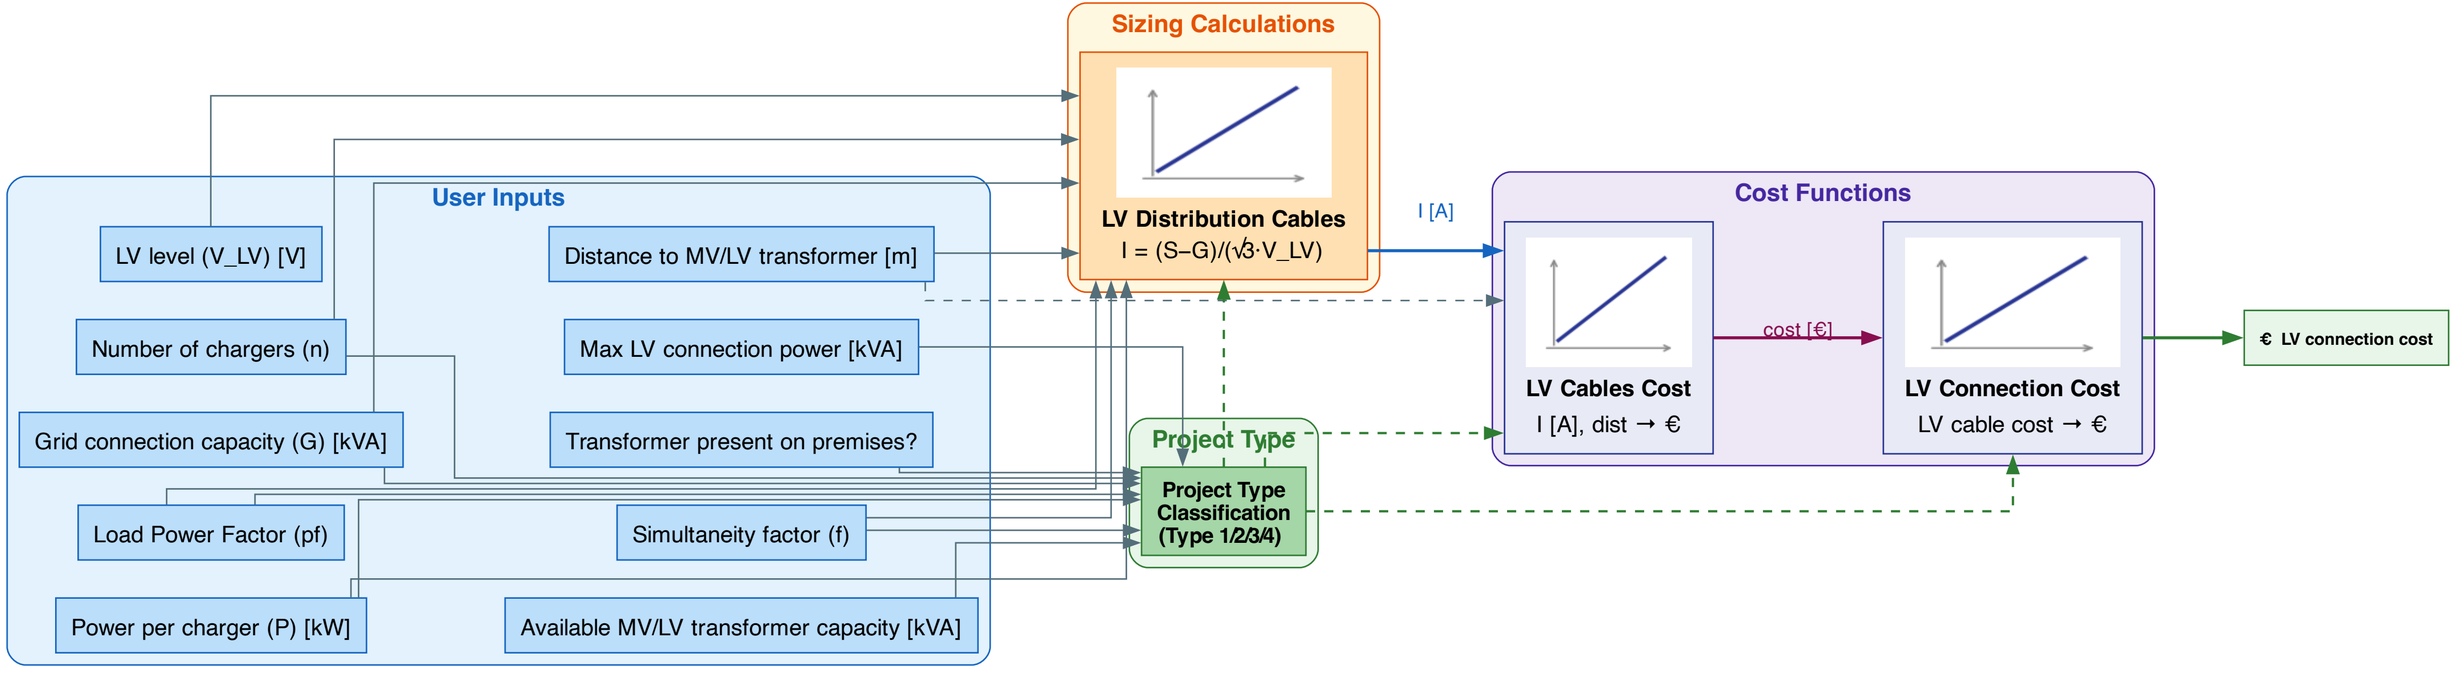

Sizing Calculations
LV Distribution Cables
I = (S−G)/(√3·V_LV)
User Inputs
LV level (V_LV) [V]
Distance to MV/LV transformer [m]
Number of chargers (n)
Max LV connection power [kVA]
Grid connection capacity (G) [kVA]
Transformer present on premises?
Load Power Factor (pf)
Simultaneity factor (f)
Power per charger (P) [kW]
Available MV/LV transformer capacity [kVA]
Project Type
Project Type Classification (Type 1/2/3/4)
I [A]
Cost Functions
LV Cables Cost
I [A], dist → €
cost [€]
LV Connection Cost
LV cable cost → €
€ LV connection cost