M2-RESOLVER

Lynxeo: 10168665

0.5 mm² (21 AWG)	+ S	25.0 ft	BK

+DP-X4		+AJB-X4
1	+DP-X4:1 BK:PR1(A+)	+AJB-X4:1
2	+DP-X4:2 WH:PR1(A-)	+AJB-X4:2
3	+DP-X4:3 SHIELD (PAIR 1)	+AJB-X4:3
4	+DP-X4:4 BK:PR2(B+)	+AJB-X4:4
5	+DP-X4:5 WH:PR2(B-)	+AJB-X4:5
6	+DP-X4:6 SHIELD (PAIR 2)	+AJB-X4:6
7	+DP-X4:7 BK:PR3(V+)	+AJB-X4:7
8	+DP-X4:8 WH:PR3(V-)	+AJB-X4:8
9	+DP-X4:9 SHIELD (PAIR 3)	+AJB-X4:9
10	+DP-X4:10 BK:PR4 (SPARE)	+AJB-X4:10
11	+DP-X4:11 WH:PR4 (SPARE)	+AJB-X4:11
12	+DP-X4:12 SHIELD (PAIR 4)	+AJB-X4:12
13	+DP-X4:13 BK:PR5 (SPARE)	+AJB-X4:13
14	+DP-X4:14 WH:PR5 (SPARE)	+AJB-X4:14
15	+DP-X4:15 SHIELD (PAIR 5)	+AJB-X4:15
16	+DP-X4:16 Shield	+AJB-X4:16

EN 50288-7 XLPE IOS Armoured 5 x 2 x 0,5

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

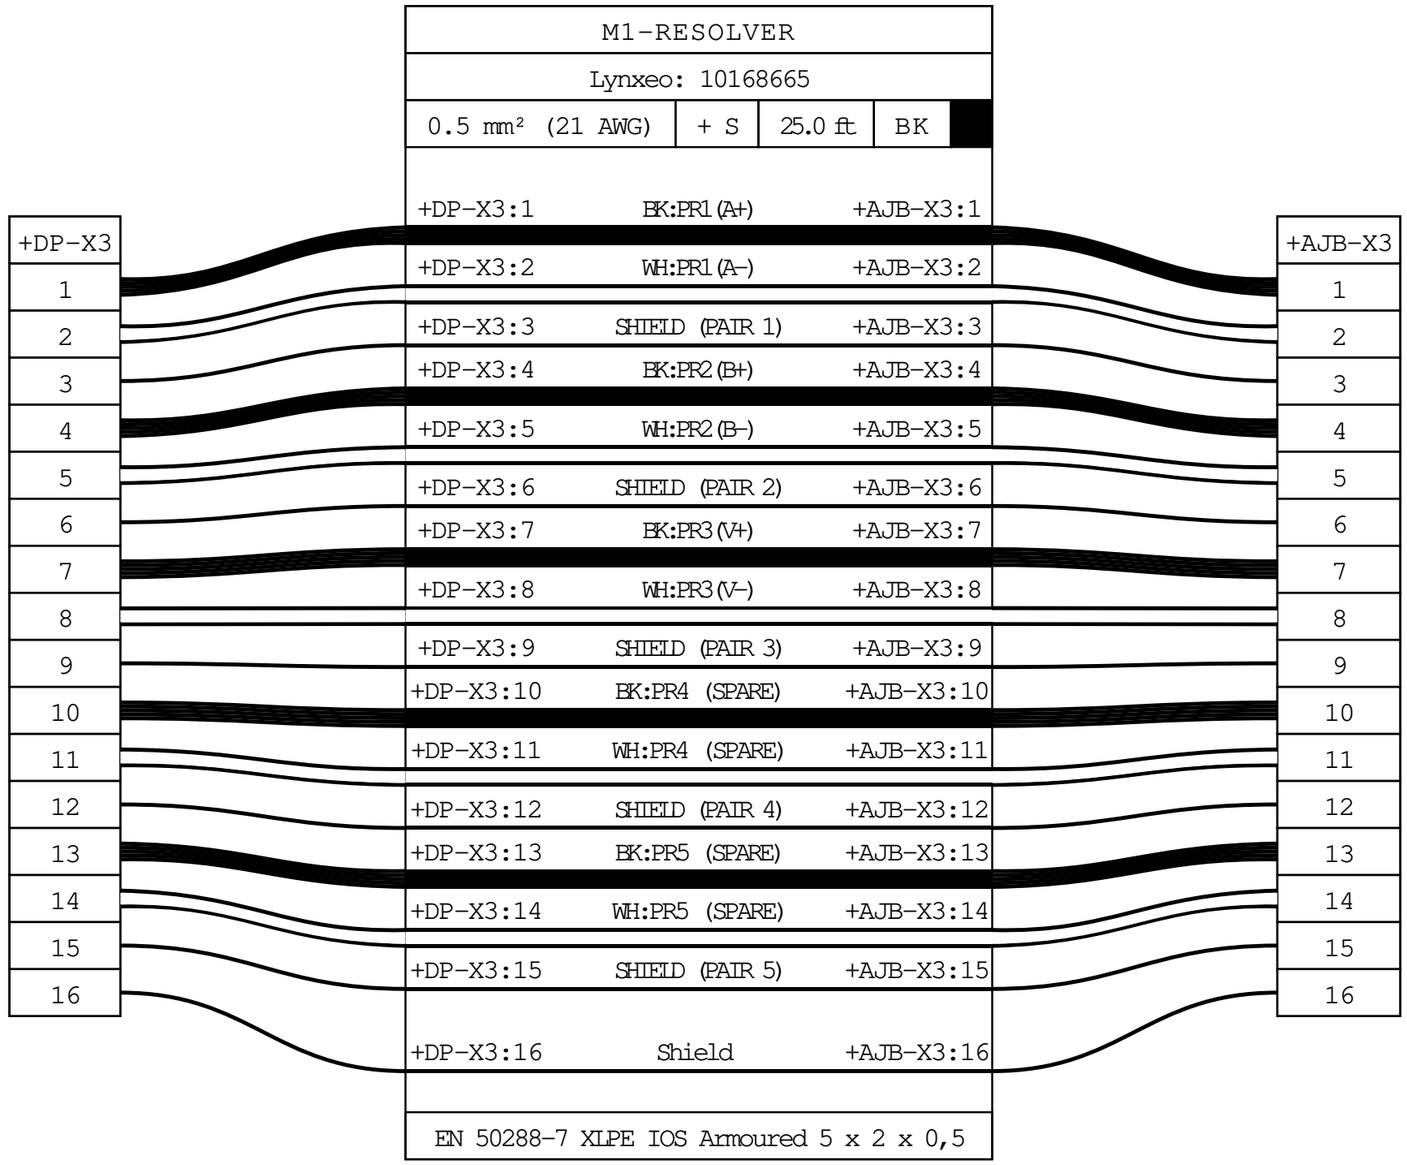

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

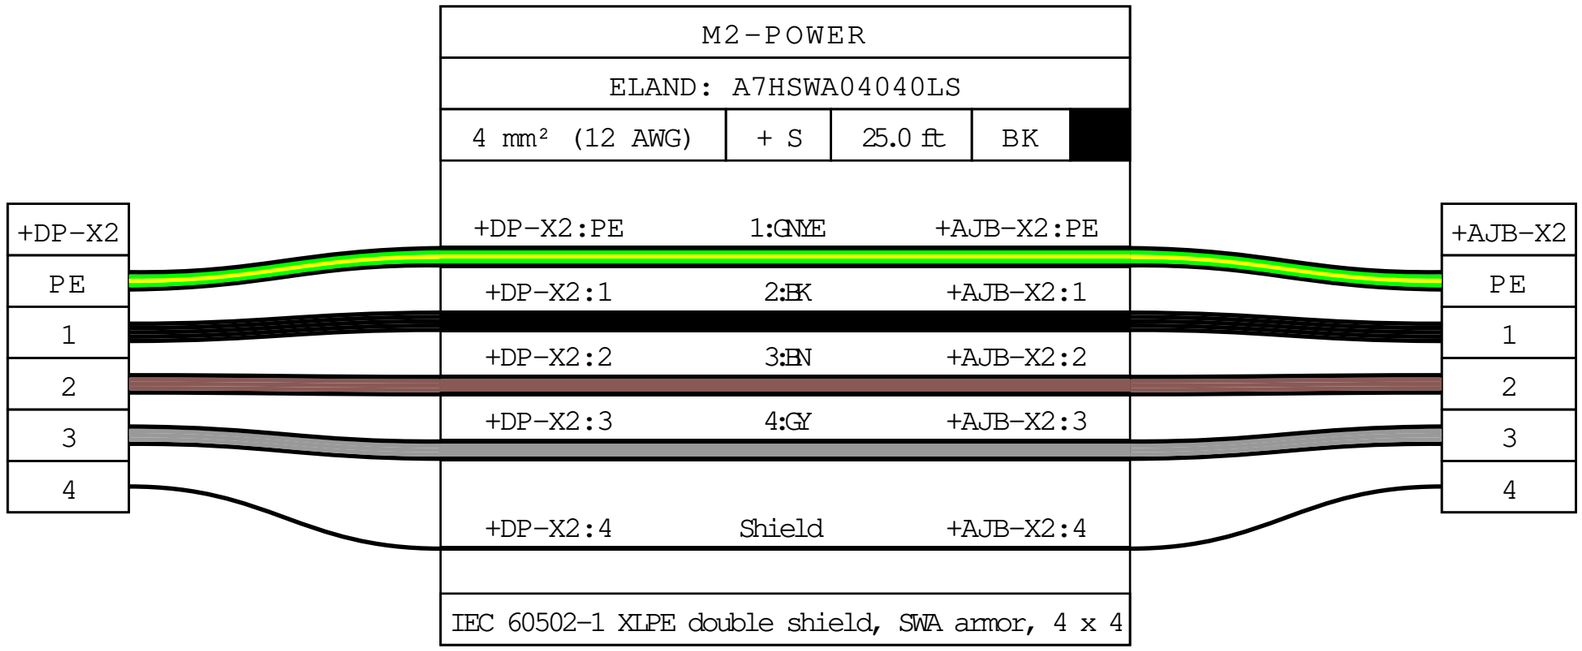

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

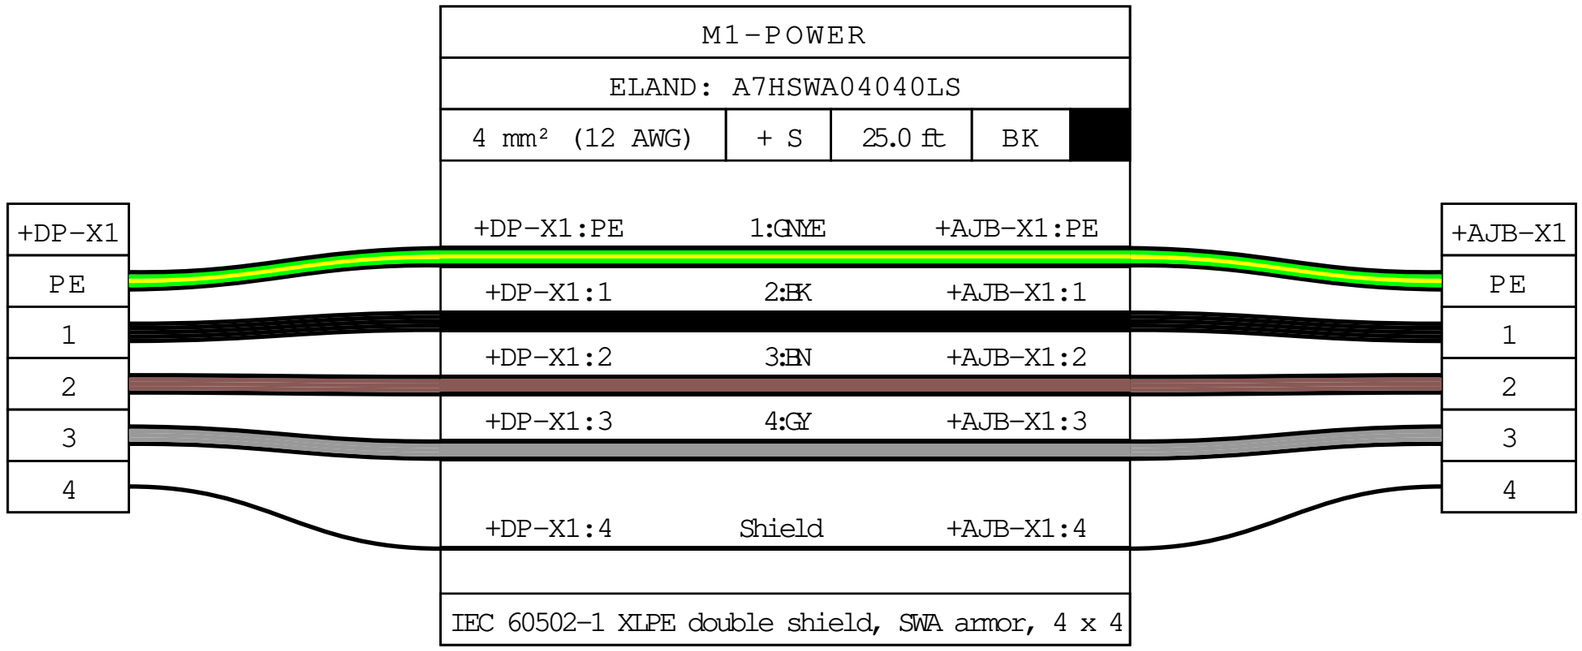

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

ACTUATOR-ANALOG			
Lynxeo: 10168748			
0.75 mm² (20 AWG)	+ S	25.0 ft	BK

+MCP-X4:1U	BK:1(BK)	+AJB-X4-MCP:1U
+MCP-X4:1M	WH:1(WH)	+AJB-X4-MCP:1M
+MCP-X4:1L	SHIELD (PAIR 1)	+AJB-X4-MCP:1L
+MCP-X4:2U	BK:2(BK)	+AJB-X4-MCP:2U
+MCP-X4:2M	WH:2(WH)	+AJB-X4-MCP:2M
+MCP-X4:2L	SHIELD (PAIR 2)	+AJB-X4-MCP:2L
+MCP-X4:3U	BK:3(BK)	+AJB-X4-MCP:3U
+MCP-X4:3M	WH:3(WH)	+AJB-X4-MCP:3M
+MCP-X4:3L	SHIELD (PAIR 3)	+AJB-X4-MCP:3L
+MCP-X4:4U	BK:4(BK)	+AJB-X4-MCP:4U
+MCP-X4:4M	WH:4(WH)	+AJB-X4-MCP:4M
+MCP-X4:4L	SHIELD (PAIR 4)	+AJB-X4-MCP:4L
+MCP-X4:5U	BK:5(BK)	+AJB-X4-MCP:5U
+MCP-X4:5M	WH:5(WH)	+AJB-X4-MCP:5M
+MCP-X4:5L	SHIELD (PAIR 5)	+AJB-X4-MCP:5L
+MCP-X4:SHIELD	Shield	+AJB-X4-MCP:SHIELD

EN 50288-7 XLPE IOS Armoured 5 x 2 x 0,75
Pair 5 spare

+MCP-X4
1U
1M
1L
2U
2M
2L
3U
3M
3L
4U
4M
4L
5U
5M
5L
SHIELD

3-deck fuse terminal block with shield to rail.

+AJB-X4-MCP
1U
1M
1L
2U
2M
2L
3U
3M
3L
4U
4M
4L
5U
5M
5L
SHIELD

3-deck through terminal block.

MEA INC
www.meaincorporated.com

TITLE: FIELD WIRING DRAWING

DWG NO. 2275-200

REV. A

ACTUATOR-DISCRETE		
Lynxeo: 10108697		
1.5 mm² (16 AWG)	25.0 ft	BK

+MCP-X2			+AJB-X2-MCP
1	+MCP-X2:1	1:BK	+AJB-X2-MCP:1U
2	+MCP-X2:2	2:BK	+AJB-X2-MCP:2L
3	+MCP-X2:3	3:BK	+AJB-X2-MCP:3L
4	+MCP-X2:4	4:BK	+AJB-X2-MCP:4L
5	+MCP-X2:5	5:BK	+AJB-X2-MCP:5L
6	+MCP-X2:6	6:BK	+AJB-X2-MCP:6L
7	+MCP-X2:7	7:BK	+AJB-X2-MCP:7

IEC 60502-1 Armoured (SWA) 7 x 1,5
Core 7 spare

+AJB-X2-MCP		
1U	BU	■
2L	BU	■
3L	BU	■
4L	BU	■
5L	BU	■
6L	BU	■
7		

Use the terminal that is marked blue.
(Upper for T1, lower for 2-6.)

* Terminal 3U means land the wire on the upper deck of the block.
* Note that there are two of each block 3-6.
* (Terminals for field wiring marked BU for clarity.)

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

ACTUATOR-DC-POWER		
Lynxeo: 10108697		
1.5 mm² (16 AWG)	25.0 ft	BK

+MCP-X1			
1	+MCP-X1:1	1:BK	+AJB-X1-MCP:1
2	+MCP-X1:2	2:BK	+AJB-X1-MCP:2L
3	+MCP-X1:3	3:BK	+AJB-X1-MCP:3U
4	+MCP-X1:4	4:BK	+AJB-X1-MCP:4U
5	+MCP-X1:5	5:BK	+AJB-X1-MCP:5U
6	+MCP-X1:6	6:BK	+AJB-X1-MCP:6U
7	+MCP-X1:7	7:BK	+AJB-X1-MCP:7

IEC 60502-1 Armoured (SWA) 7 x 1,5
Core 1 and core 7 spare

+AJB-X1-MCP		
1		
2L	BU	■
3U	BU	■
4U	BU	■
5U	BU	■
6U	BU	■
7		



Use the upper terminal that is marked blue.

* Terminal 3U means land the wire on the upper deck of the block.
* Note that there are two of each block 3-6.
* (Terminals for field wiring marked BU for clarity.)

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

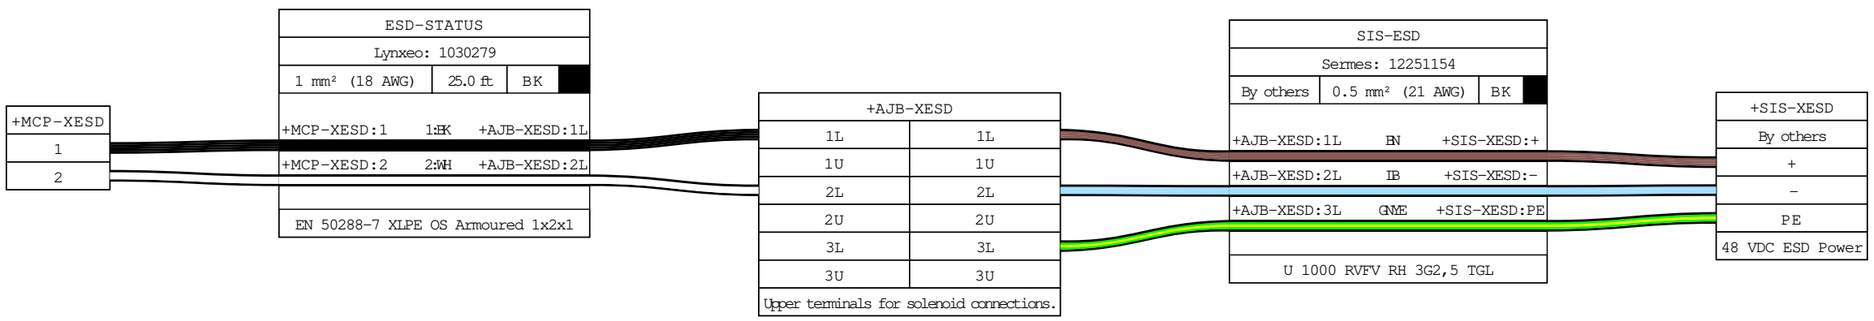

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

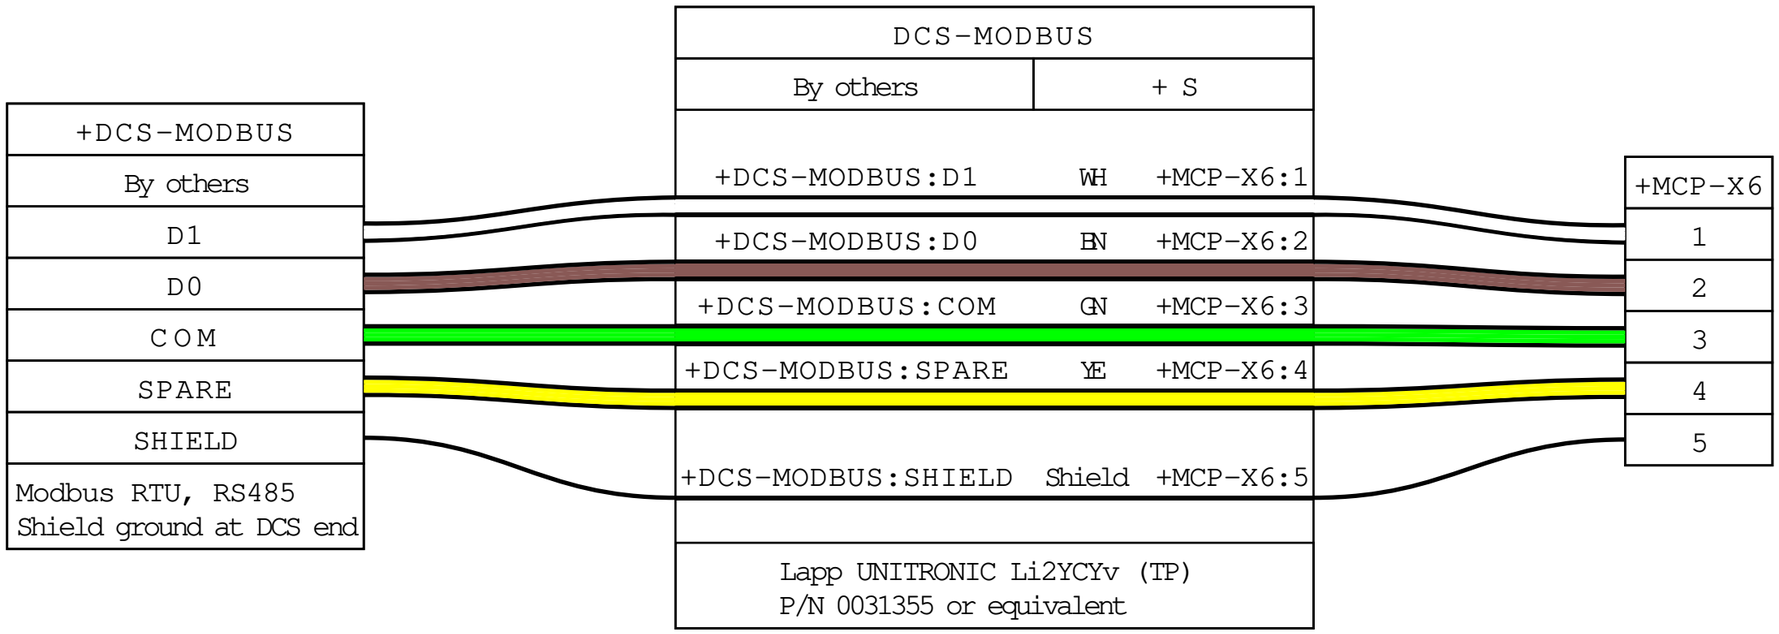

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

+DCS-INSTRUMENT	
By others	
ZC +	1
ZC −	2
ZI +	3
ZI −	4
PT ACC +	5
PT ACC −	6
PT A +	7
PT A −	8
PT B +	9
PT B −	10
ESD Alarm +	11
ESD Alarm −	12
Auto Alarm +	13
Auto Alarm −	14
Trouble Alarm +	15
Trouble Alarm −	16
Mode Bit 0 +	17
Mode Bit 0 −	18
Mode Bit 1 +	19
Mode Bit 1 −	20
Mode Bit 2 +	21
Mode Bit 2 −	22
SHIELD	23

Shield grounded at DCS end only
Unused cores terminated and earthed at DCS end per 60079-14 8.2.3.2

DCS-INSTRUMENT			
Sermes: 14483064			
By others	0.88 mm² (Unknown AWG)	+ S	BU
+DCS-INSTRUMENT:1:ZC +	RD:PR1	+MCP-X5:1U	
+DCS-INSTRUMENT:2:ZC −	WH:PR1	+MCP-X5:1M	
+DCS-INSTRUMENT:3:ZI +	RD:PR2	+MCP-X5:2U	
+DCS-INSTRUMENT:4:ZI −	WH:PR2	+MCP-X5:2M	
+DCS-INSTRUMENT:5:PT ACC +	RD:PR3	+MCP-X5:3U	
+DCS-INSTRUMENT:6:PT ACC −	WH:PR3	+MCP-X5:3M	
+DCS-INSTRUMENT:7:PT A +	RD:PR4	+MCP-X5:4U	
+DCS-INSTRUMENT:8:PT A −	WH:PR4	+MCP-X5:4M	
+DCS-INSTRUMENT:9:PT B +	RD:PR5	+MCP-X5:5U	
+DCS-INSTRUMENT:10:PT B −	WH:PR5	+MCP-X5:5M	
+DCS-INSTRUMENT:11:ESD Alarm +	RD:PR6	+MCP-X3:1	
+DCS-INSTRUMENT:12:ESD Alarm −	WH:PR6	+MCP-X3:2	
+DCS-INSTRUMENT:13:Auto Alarm +	RD:PR7	+MCP-X3:3	
+DCS-INSTRUMENT:14:Auto Alarm −	WH:PR7	+MCP-X3:4	
+DCS-INSTRUMENT:15:Trouble Alarm +	RD:PR8	+MCP-X3:5	
+DCS-INSTRUMENT:16:Trouble Alarm −	WH:PR8	+MCP-X3:6	
+DCS-INSTRUMENT:17:Mode Bit 0 +	RD:PR9	+MCP-X3:7	
+DCS-INSTRUMENT:18:Mode Bit 0 −	WH:PR9	+MCP-X3:8	
+DCS-INSTRUMENT:19:Mode Bit 1 +	RD:PR10	+MCP-X3:9	
+DCS-INSTRUMENT:20:Mode Bit 1 −	WH:PR10	+MCP-X3:10	
+DCS-INSTRUMENT:21:Mode Bit 2 +	RD:PR11	+MCP-X3:11	
+DCS-INSTRUMENT:22:Mode Bit 2 −	WH:PR11	+MCP-X3:12	
+DCS-INSTRUMENT:23:SHIELD	Shield	+MCP-X3:13	
19IP09EGFA − BLEU19IP09EGFA − BLEU Pairs 12 − 19 unused			

+MCP-X5
1U
1M
2U
2M
3U
3M
4U
4M
5U
5M

+MCP-X3
1
2
3
4
5
6
7
8
9
10
11
12
13

Terminate unused cores per IEC 60079-14 8.2.3.2.

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

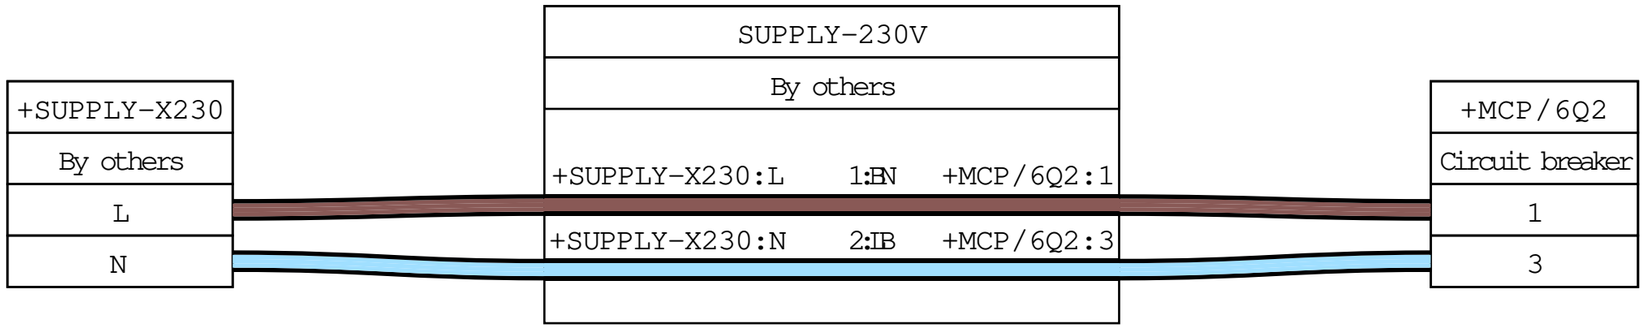

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A

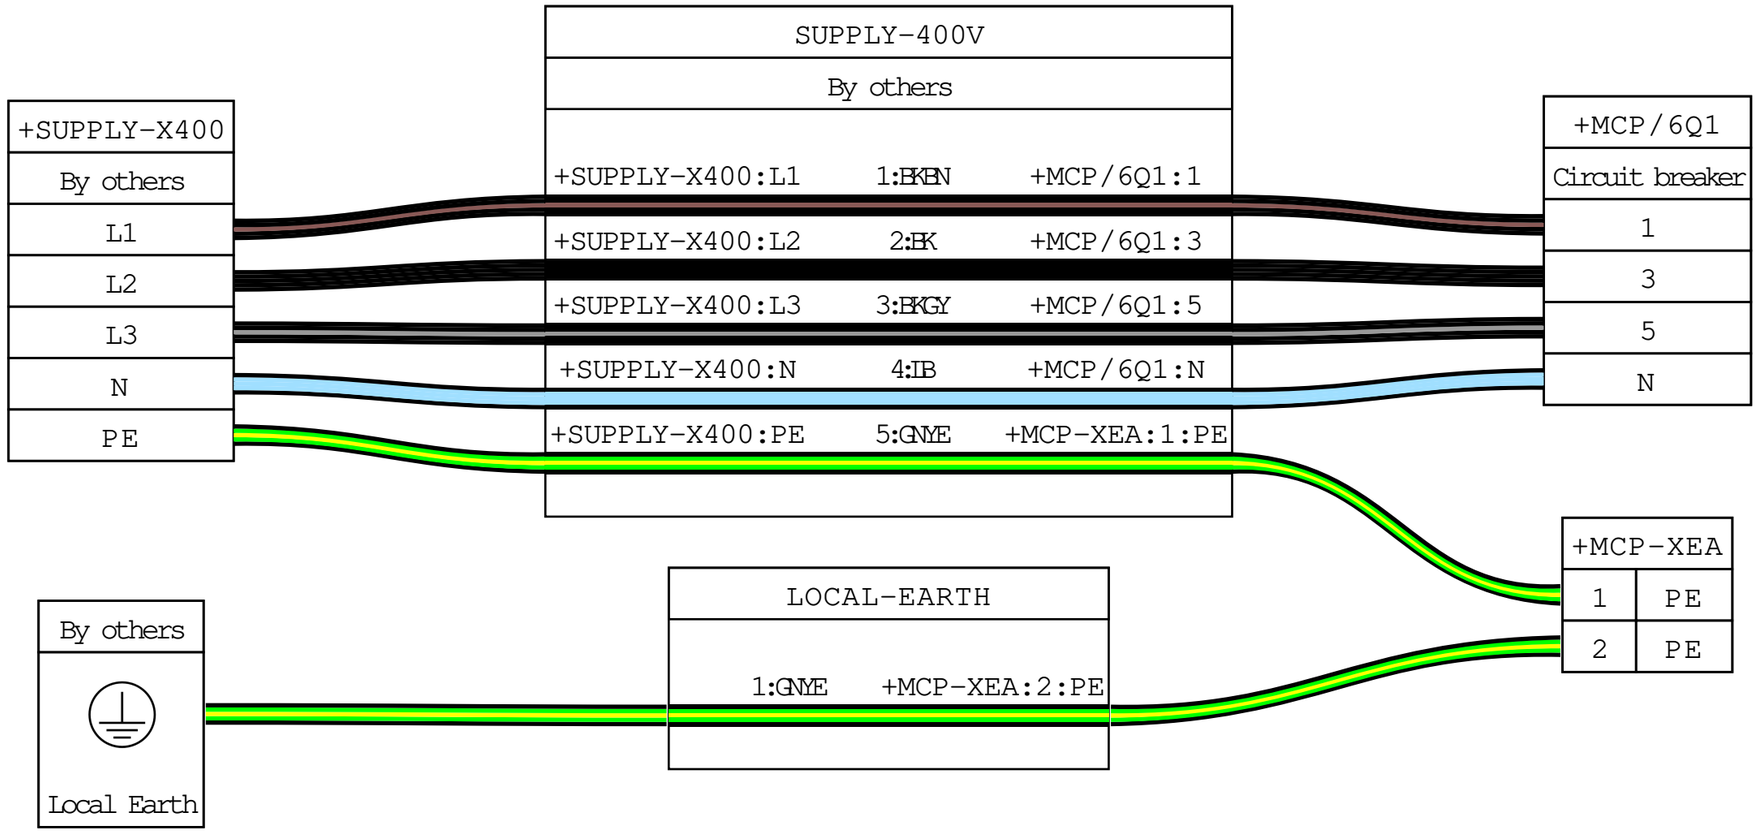

MEA INC
www.meaincorporated.com

TITLE:
FIELD WIRING DRAWING

DWG NO.
2275-200

REV.
A