

ARRAY CONFIGURATION:  
5 SOLECTRIA PVI-50TL INVERTERS: 45 STRINGS OF 20 MODULES  
900 MODULES TOTAL, 45 STRINGS  
ZHONGLI TALESUN SOLAR TP660M-285 285W MODULES

INTERCONNECTION STANDARDS COMPLIANCE  
The inverters listed have been tested and listed by Underwriters Laboratories to be in compliance with UL1741 Statistic Inverters And Charge Controllers For Use In Photovoltaic Power Systems, as well as IEEE-929-2000 Recommended Practice For Utility Interface Of Photovoltaic (PV) Systems.

IEEE-929-2000 provides guidance regarding equipment and function necessary to ensure compatible operation of photovoltaic systems which are connected in parallel with the electric utility. UL 1741 is the standard applied by Underwriters Laboratory to the Inverter to verify it meets the recommendations of IEEE-929-2000.

Refer to both documents for details of these Recommendations and test procedures.

AC Disconnect is accessible, and lockable.

Single line diagrammatic only. Actual layout determined by existing conditions.  
All hazardous transmission lines to be labeled: "CAUTION-Electrical Hazard"

NUMBERED NOTES

1 PROVIDE #6 CU GROUNDING ELECTRODE CONDUCTOR TO BUILDING GROUND, PER ARTICLE 250, CEC.

900 ET SOLAR  
TALESUN TP660M-285  
285W MODULES  
256.50 KW DC POWER

TOTAL SYSTEM CALCULATIONS			
INV#	# OF STRINGS	# OF PANELS	KW
1-5	45	900	256.50
TOTAL	45	900	256.50

TABLE A (NEC 690.7)


CELCIUS	FAHRENHEIT	FACTOR
14 TO 10	58 TO 50	1.06
9 TO 5	49 TO 41	1.08
4 TO 0	40 TO 32	1.1
(-1 TO -5)	31 TO 23	1.12
(-6 TO -10)	22 TO 14	1.14

MODULE MODEL	TP660M-285	MODULES PER STRING	20	VOLTAGE CORRECTION FACTOR	1.12 (TABLE A)
MAX MODULE POWER	285 W	STRING OUTPUT		STRING OUTPUT	
MAXIMUM POWER VOLTAGE	32.10 V	719.04 V		719.04 V	
MAXIMUM POWER CURRENT	8.879 A	8.879 A		8.879 A	
OPEN-CIRCUIT VOLTAGE	38.60 V	864.64 V		864.64 V	
SHORT-CIRCUIT CURRENT	9.278 A	9.278 A		9.278 A	
FUSE SIZE	15 A				

NOT TO EXCEED 1000V

20 PANEL STRING OUTPUT

# STRINGS	1	FACTORED 1.25	FACTORED 1.5625
MAX VOLTAGE	719.04 V	719.04	719.04 V
MAX CURRENT	8.879 A	11.10	13.87 A
OPEN CIRCUIT VOLTAGE	864.64 V	864.64	864.64 V
SHORT CIRCUIT CURRENT	9.278 A	11.60	14.50 A

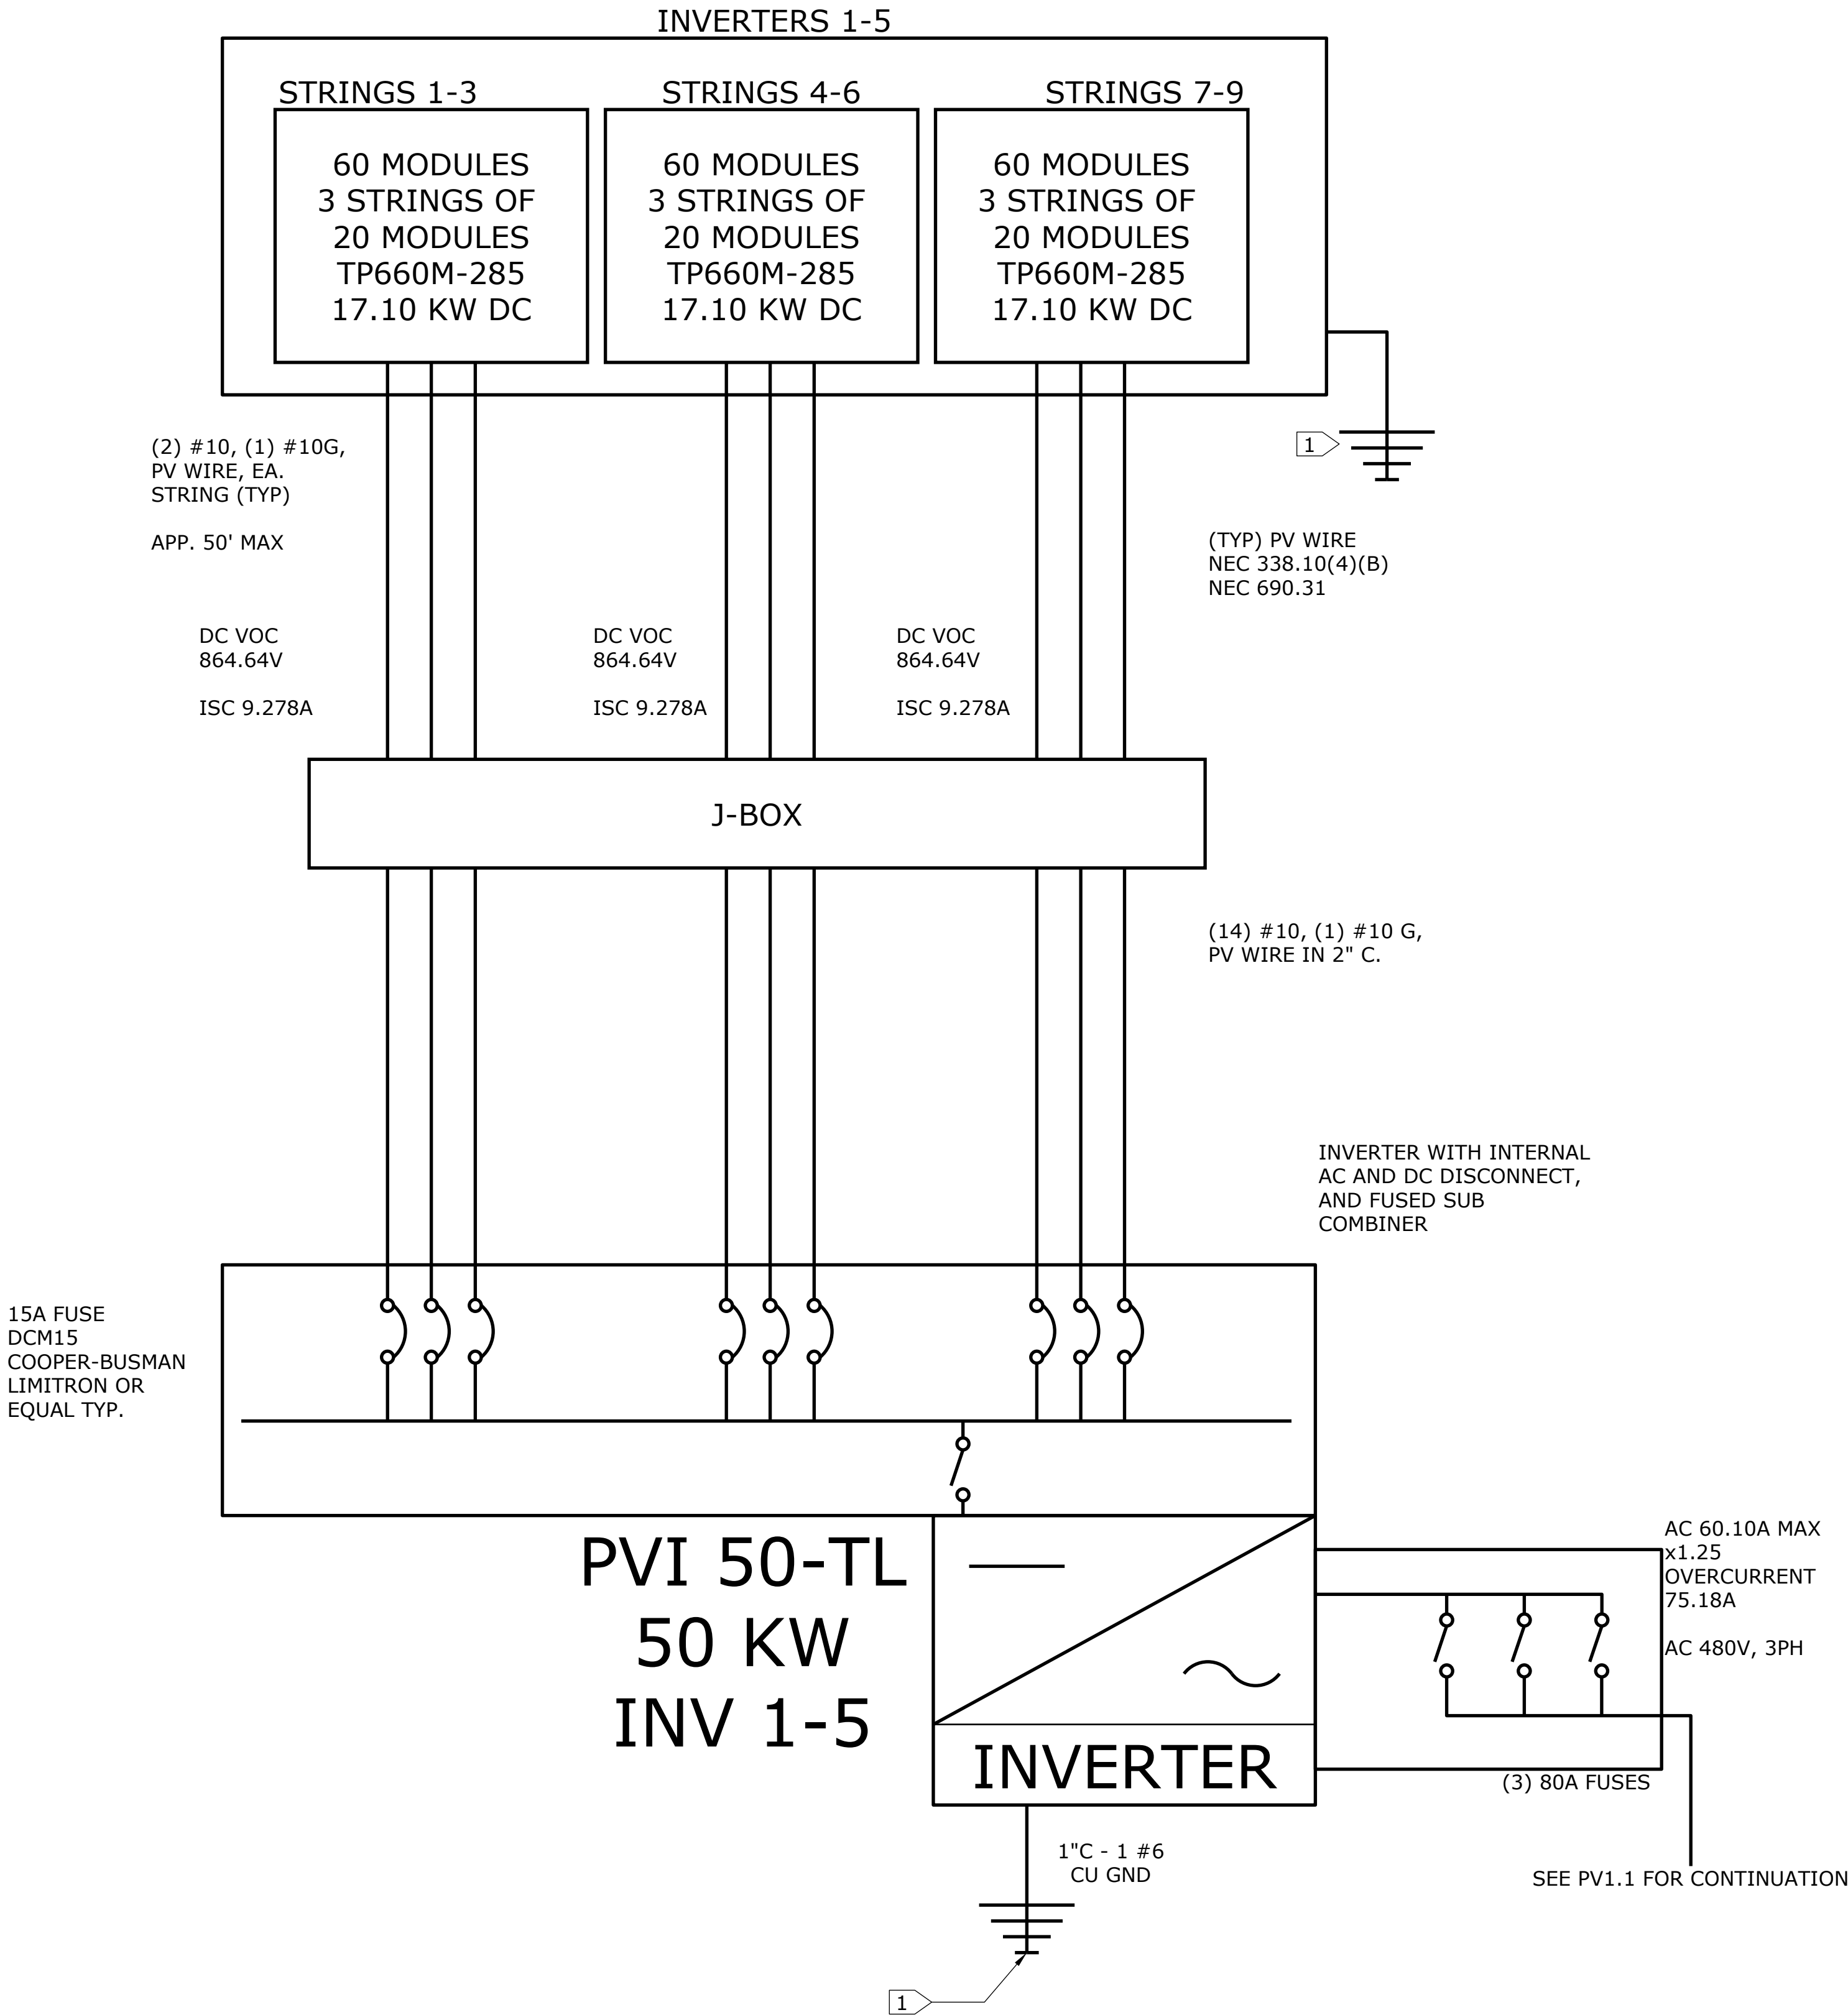

INV 1-6 CALCULATIONS			
MPPT#	# OF STRINGS	# OF PANELS	KW
1	3	60	17.10
2	3	60	17.10
3	3	60	17.10
4	0	0	0
TOTAL	9	180	51.30



PO BOX 10637  
NAPA, CA 94581  
PH: (707)-252-9990

WINERY SQUARE


1955 WEST TEXAS STREET  
FAIRFIELD, CA 94533  
APN: 011-060-038

PV1.0  
SDP 1

DATE: 8/1/16

BY: JK

JOB NO.:



ARRAY CONFIGURATION:  
5 SOLECTRIA PVI-50TL INVERTERS: 45 STRINGS OF 20 MODULES  
900 MODULES TOTAL, 45 STRINGS  
ZHONGLI TALESUN SOLAR TP660M-285 285W MODULES

INTERCONNECTION STANDARDS COMPLIANCE  
The inverters listed have been tested and listed by Underwriters Laboratories to be in compliance with UL1741 Static Inverters And Charge Controllers For Use In Photovoltaic Power Systems, as well as IEEE-929-2000 Recommended Practice For Utility Interface Of Photovoltaic (PV) Systems.

IEEE-929-2000 provides guidance regarding equipment and function necessary to ensure compatible operation of photovoltaic systems which are connected in parallel with the electric utility. UL 1741 is the standard applied by Underwriters Laboratory to the Inverter to verify it meets the recommendations of IEEE-929-2000.

Refer to both documents for details of these Recommendations and test procedures.

AC Disconnect is accessible, and lockable.


Single line diagrammatic only. Actual layout determined by existing conditions.  
All hazardous transmission lines to be labeled: "CAUTION-Electrical Hazard"

NUMBERED NOTES

1 PROVIDE #6 CU GROUNDING ELECTRODE CONDUCTOR TO BUILDING GROUND, PER ARTICLE 250, CEC.

900 ET SOLAR  
TALESUN TP660M-285  
285W MODULES  
256.50 KW DC POWER

TOTAL SYSTEM CALCULATIONS			
INV#	# OF STRINGS	# OF PANELS	KW
1-5	45	900	256.50
TOTAL	45	900	256.50

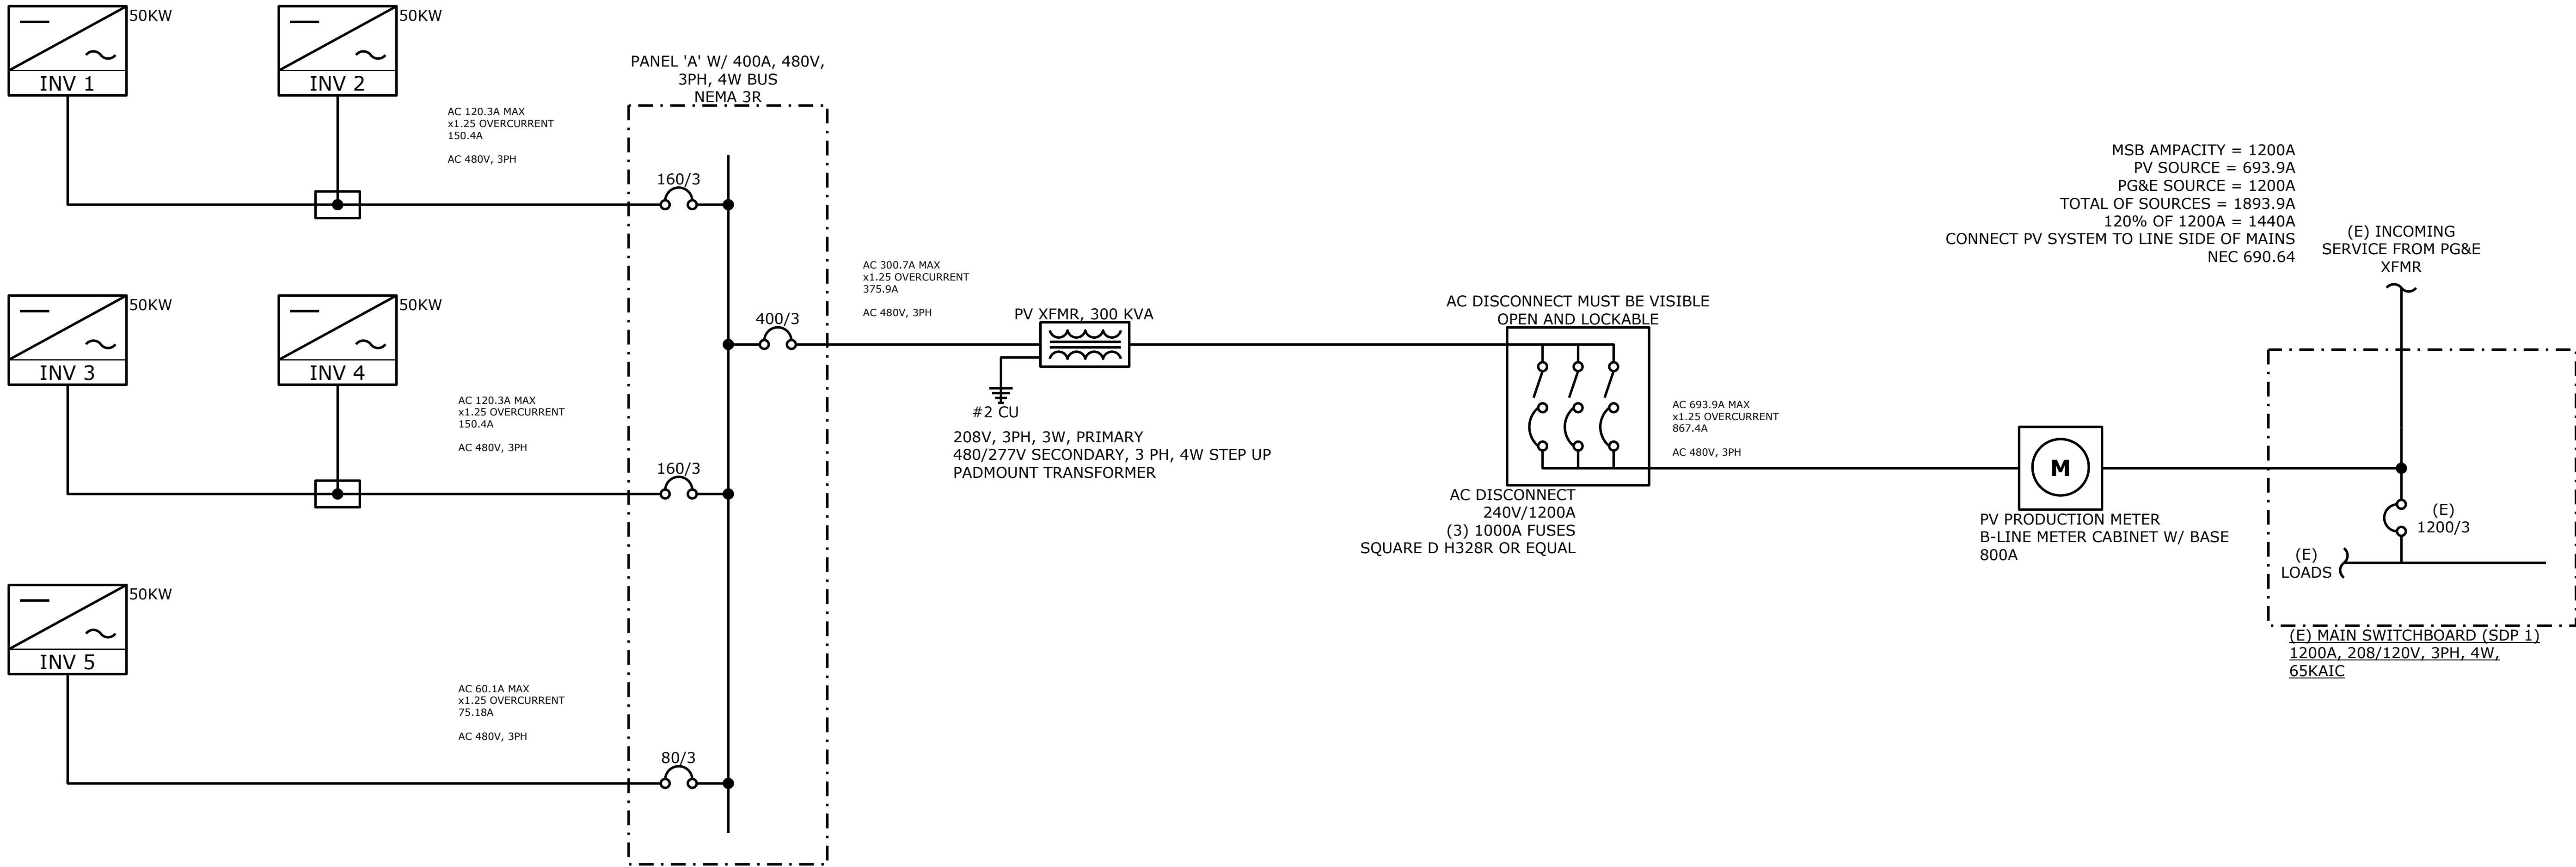



PO BOX 10637  
NAPA, CA 94581  
PH: (707)-252-9990

**WINERY SQUARE**  
1955 WEST TEXAS STREET  
FAIRFIELD, CA 94533  
APN: 011-060-038

**PV1.1**  
SDP 1

DATE: 8/1/16

BY: JK

JOB NO.:

