
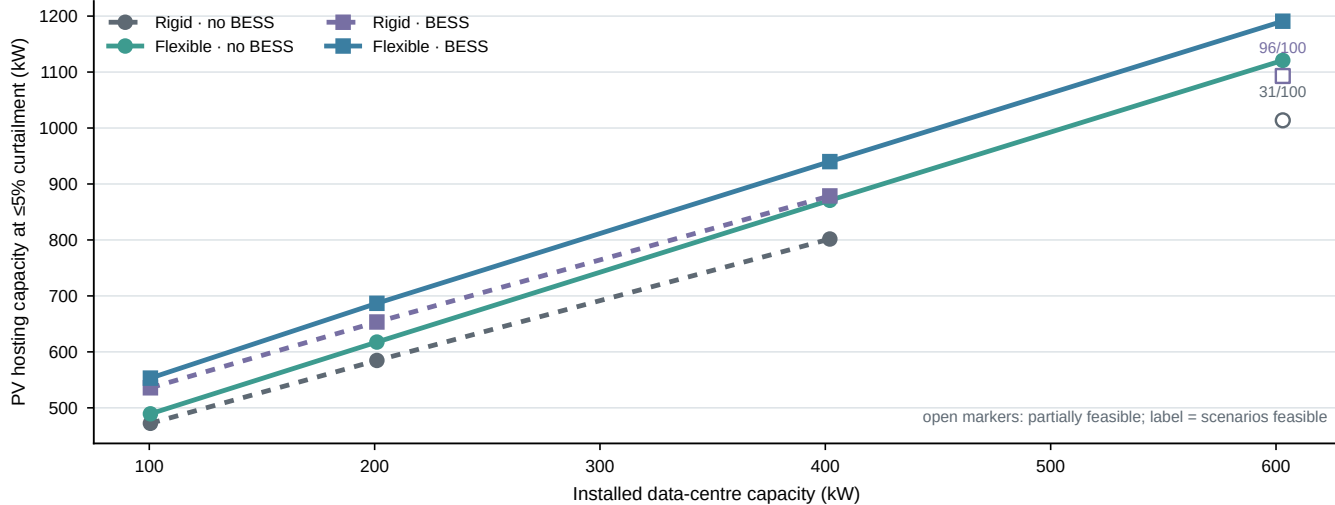
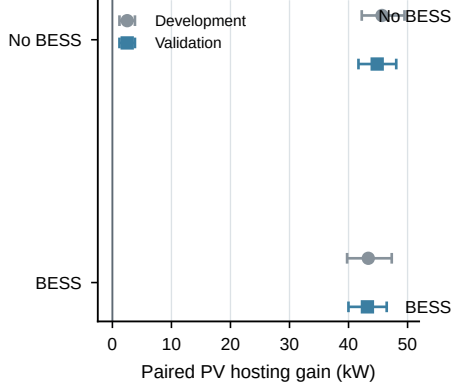
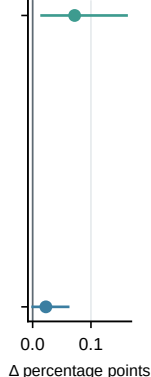


a Workload flexibility shifts the joint DC-PV feasibility boundary**b** Gain at a 201-kW data centre**c** Curtailment

PV utilisation



Grid import

**d**

Orthogonal resource interactions

