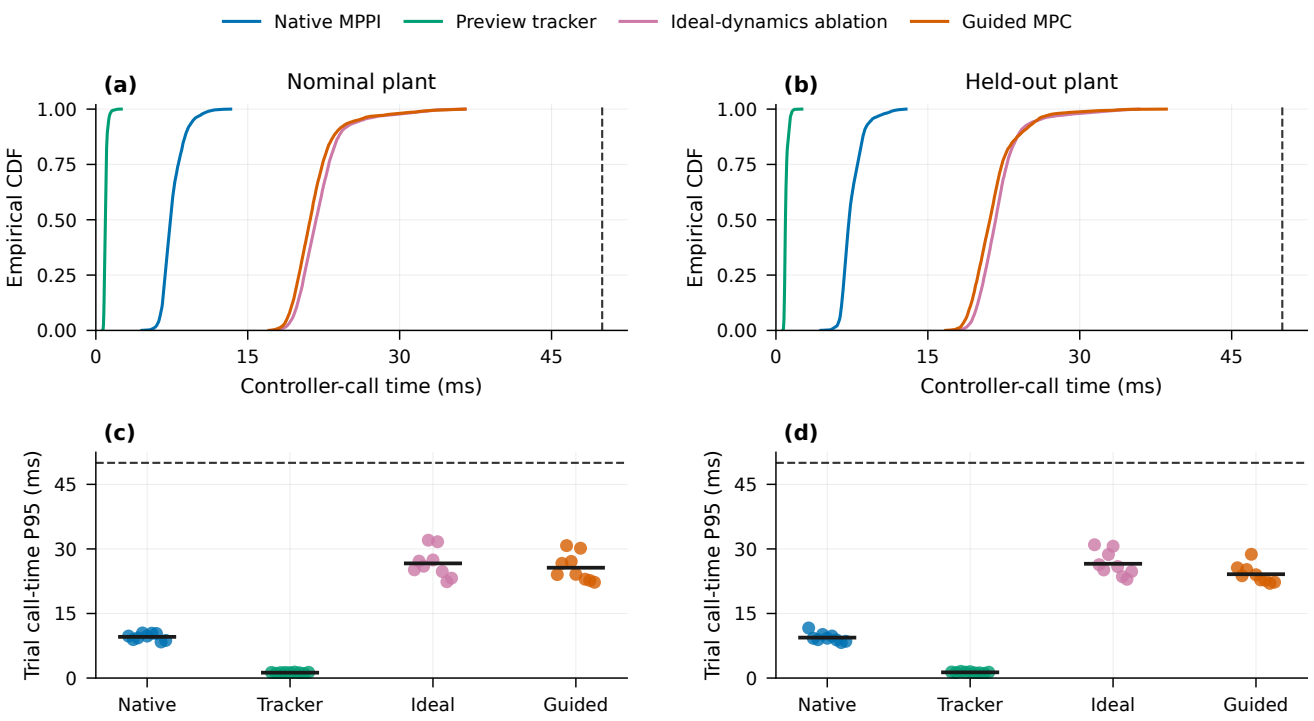
Native MPPI
Preview tracker
Ideal-dynamics ablation
Guided MPC
(a)
Nominal plant
(b)
Held-out plant
Empirical CDF
1.00
0.75
0.50
0.25
0.00
0
15
30
45
Controller-call time (ms)
(c)
(d)
Trial call-time P95 (ms)
Native
Tracker
Ideal
Guided