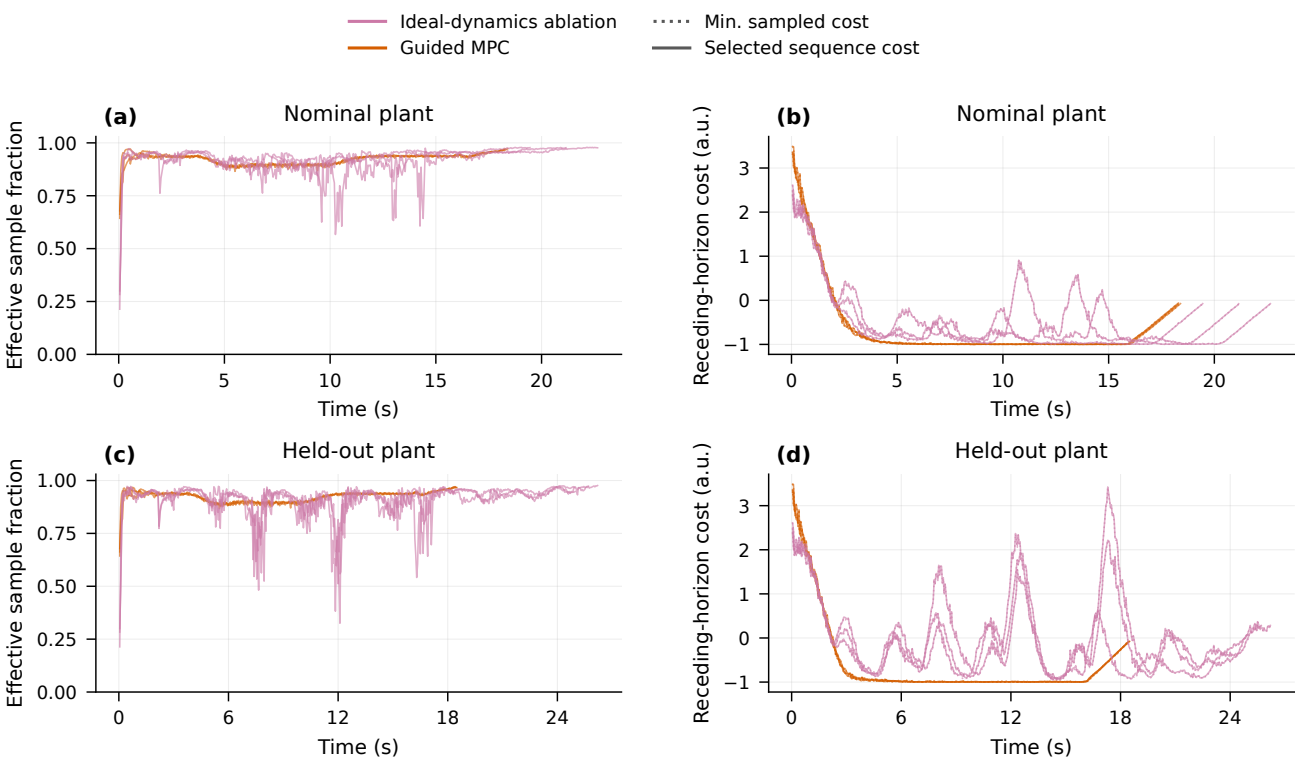

Ideal-dynamics ablation
Guided MPC
Min. sampled cost
Selected sequence cost
(a)
Nominal plant
Effective sample fraction
1.00
0.75
0.50
0.25
0.00
0
5
10
15
20
Time (s)
(b)
Nominal plant
Receding-horizon cost (a.u.)
3
2
1
0
−1
0
5
10
15
20
Time (s)
(c)
Held-out plant
Effective sample fraction
1.00
0.75
0.50
0.25
0.00
0
6
12
18
24
Time (s)
(d)
Held-out plant
Receding-horizon cost (a.u.)
3
2
1
0
−1
0
6
12
18
24
Time (s)