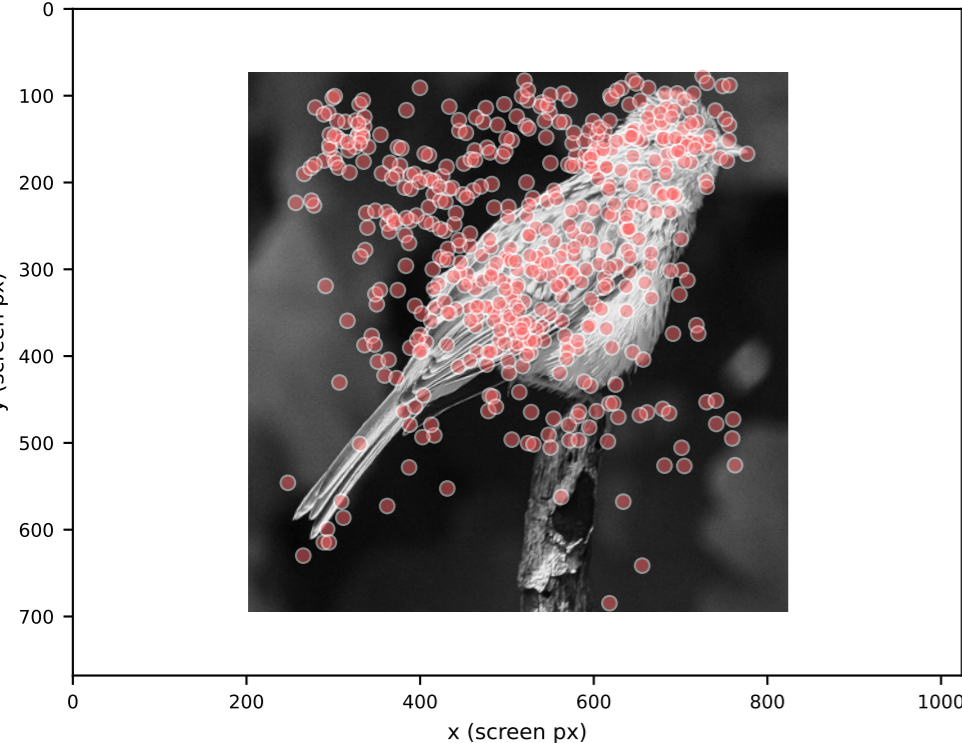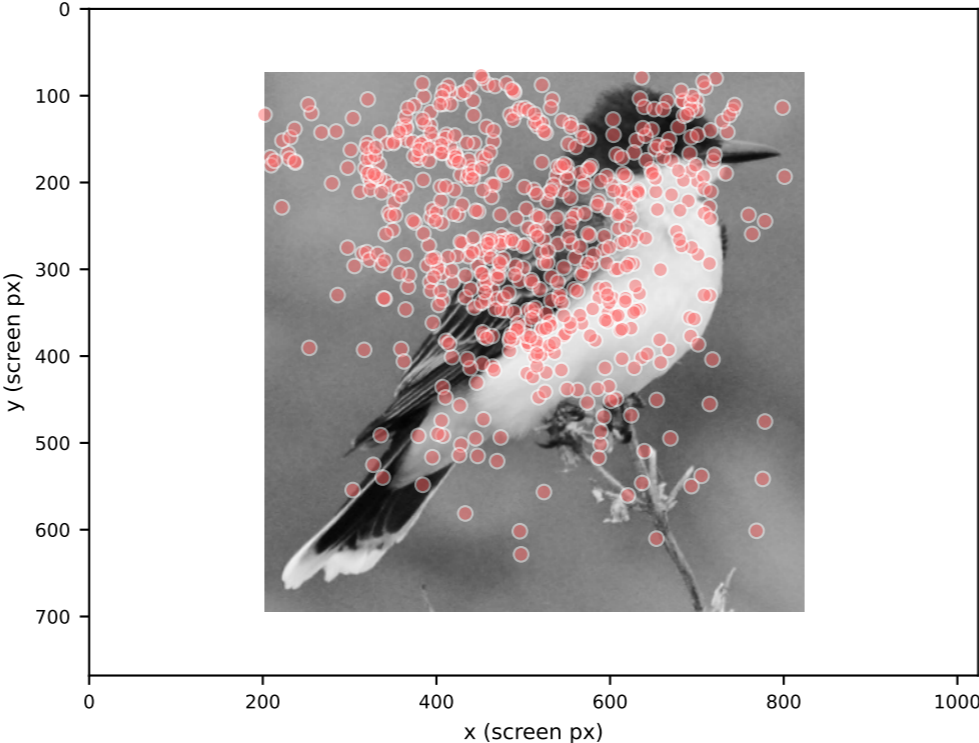# Testing Phase - CENTRAL Viewing Condition
Bottom 3 Trials (Low Accuracy)
Ordered from Most Incorrect → Least Incorrect
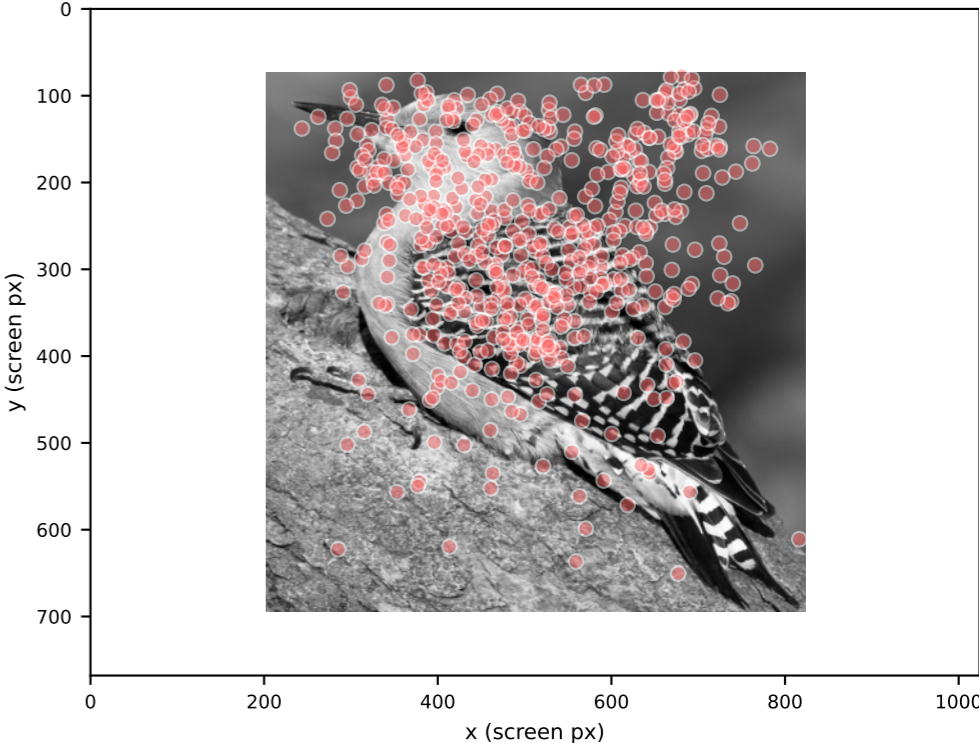
Testing • Acc: 12.5% • Pair 5/24 • Incorrect
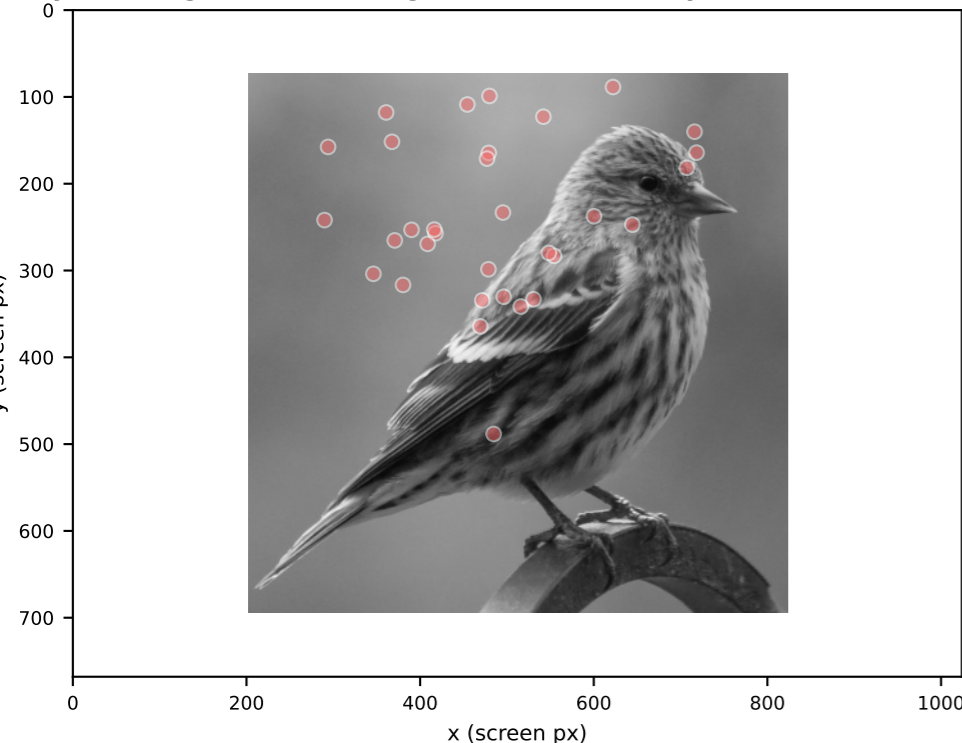**Subjects: right=4 • wrong=28 • N=32 subjects • First: 552 fix**

Testing • Acc: 21.9% • Pair 10/24 • Incorrect
Subjects: right=7 • wrong=25 • N=32 subjects • First: 606 fix
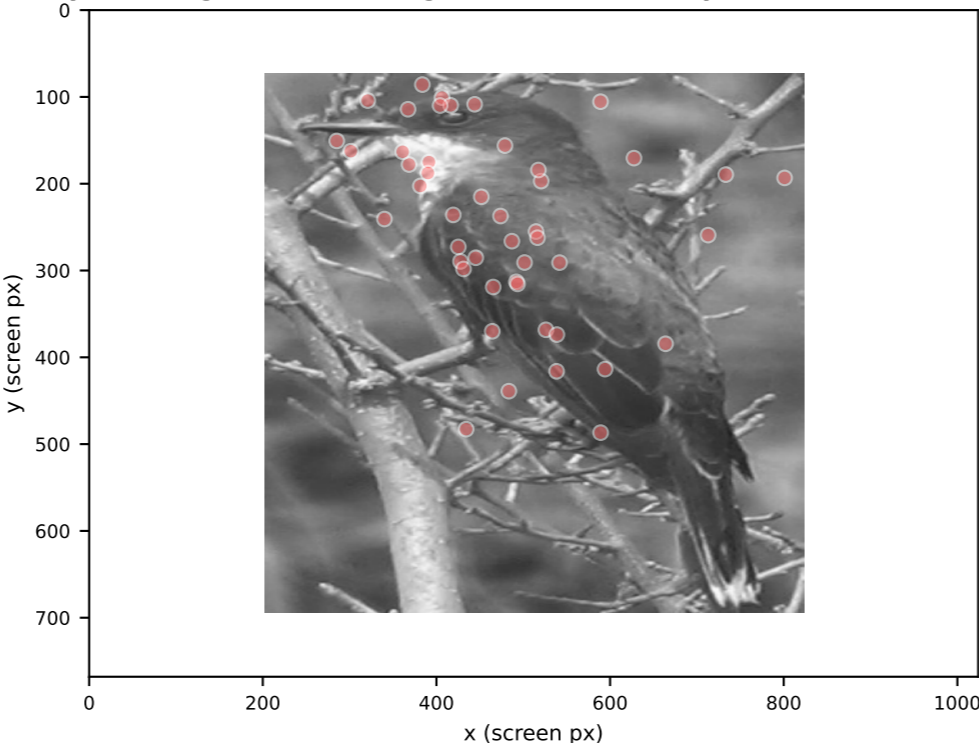

Testing • Acc: 25.0% • Pair 6/24 • Incorrect
Subjects: right=8 • wrong=24 • N=32 subjects • First: 612 fix

Testing • Acc: 12.5% • Pair 5/24 • Incorrect
Subjects: right=4 • wrong=28 • N=32 subjects • Second: 32 fix

Testing • Acc: 21.9% • Pair 10/24 • Incorrect
Subjects: right=7 • wrong=25 • N=32 subjects • Second: 47 fix

Testing • Acc: 25.0% • Pair 6/24 • Incorrect
Subjects: right=8 • wrong=24 • N=32 subjects • Second: 33 fix