

			<b>UC Davis FacilitiesLink</b>	
			<a href="http://facilitieslink.ucdavis.edu/">facilitieslink.ucdavis.edu/</a>	



<b>1A:</b> day clg set point 74 day htg set point 71 set point dial disabled clg flow max 500 clg/htg flow min 204 htg flow max 400	<b>1B:</b> day clg set point 74 day htg set point 71 set point dial disabled clg flow max 500 clg/htg flow min 204 htg flow max 400	<b>3:</b> day clg set point 74 day htg set point 71 set point dial disabled clg flow max 352 clg/htg flow min 116 htg flow max 240	<b>5:</b> day clg set point 74 day htg set point 71 set point dial disabled clg flow max 352 clg/htg flow min 116 htg flow max 240	<b>7A:</b> day clg set point 74 day htg set point 71 set point dial disabled clg flow max 424 clg/htg flow min 176 htg flow max 424	<b>7B:</b> day clg set point 74 day htg set point 71 set point dial disabled clg flow max 424 clg/htg flow min 176 htg flow max 424
---	---	--	--	---	---

Building ID: 0643  
Floor Code: 0

233 total


NOT TO SCALE  
DIGITAL PLOT

WELLMAN HALL

GROUND FLOOR

A0


Building ID: 0643  
Floor Code: 1

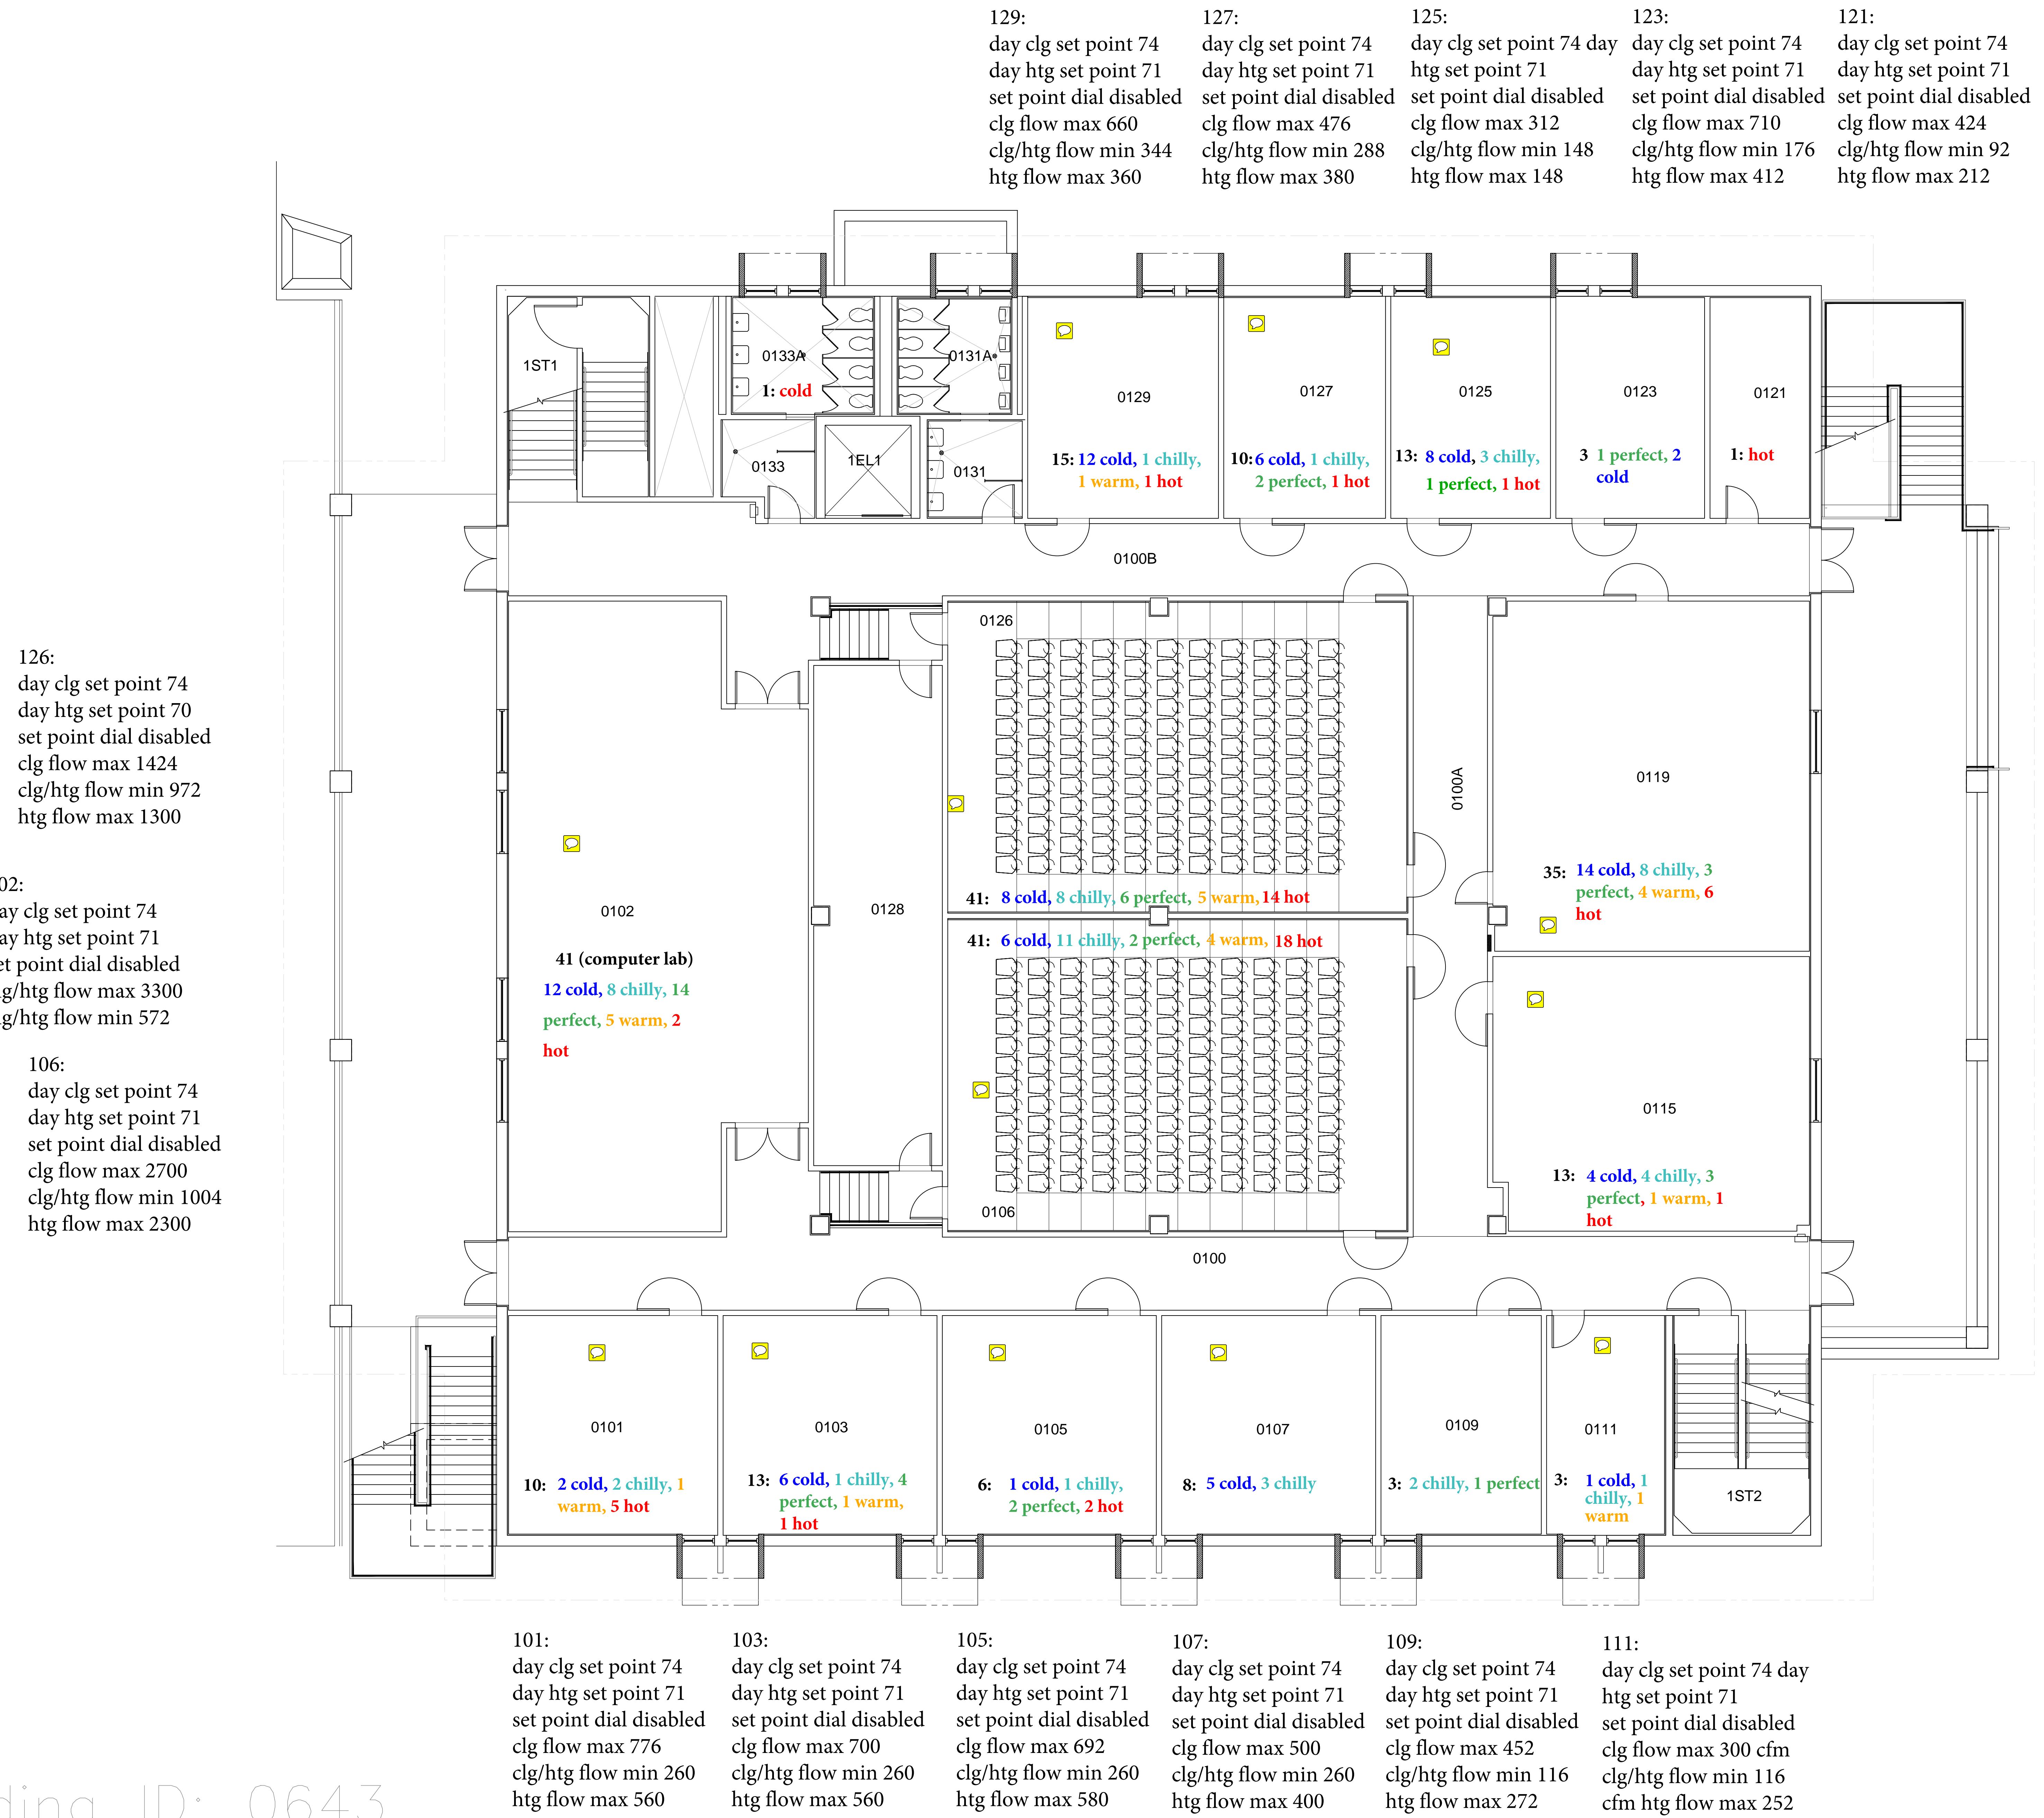

256 tota

WELLMAN HALL	CAAN:	4050	ZONE:	B042	NOT TO SCALE DIGITAL PLOT
A	PUBLISHED BY:	UCD Utilities-GIS		03/04/2012	facilitieslink.ucdavis.edu/
	UC Davis FacilitiesLink				
1					

Building ID: 0643  
Floor Code: 2

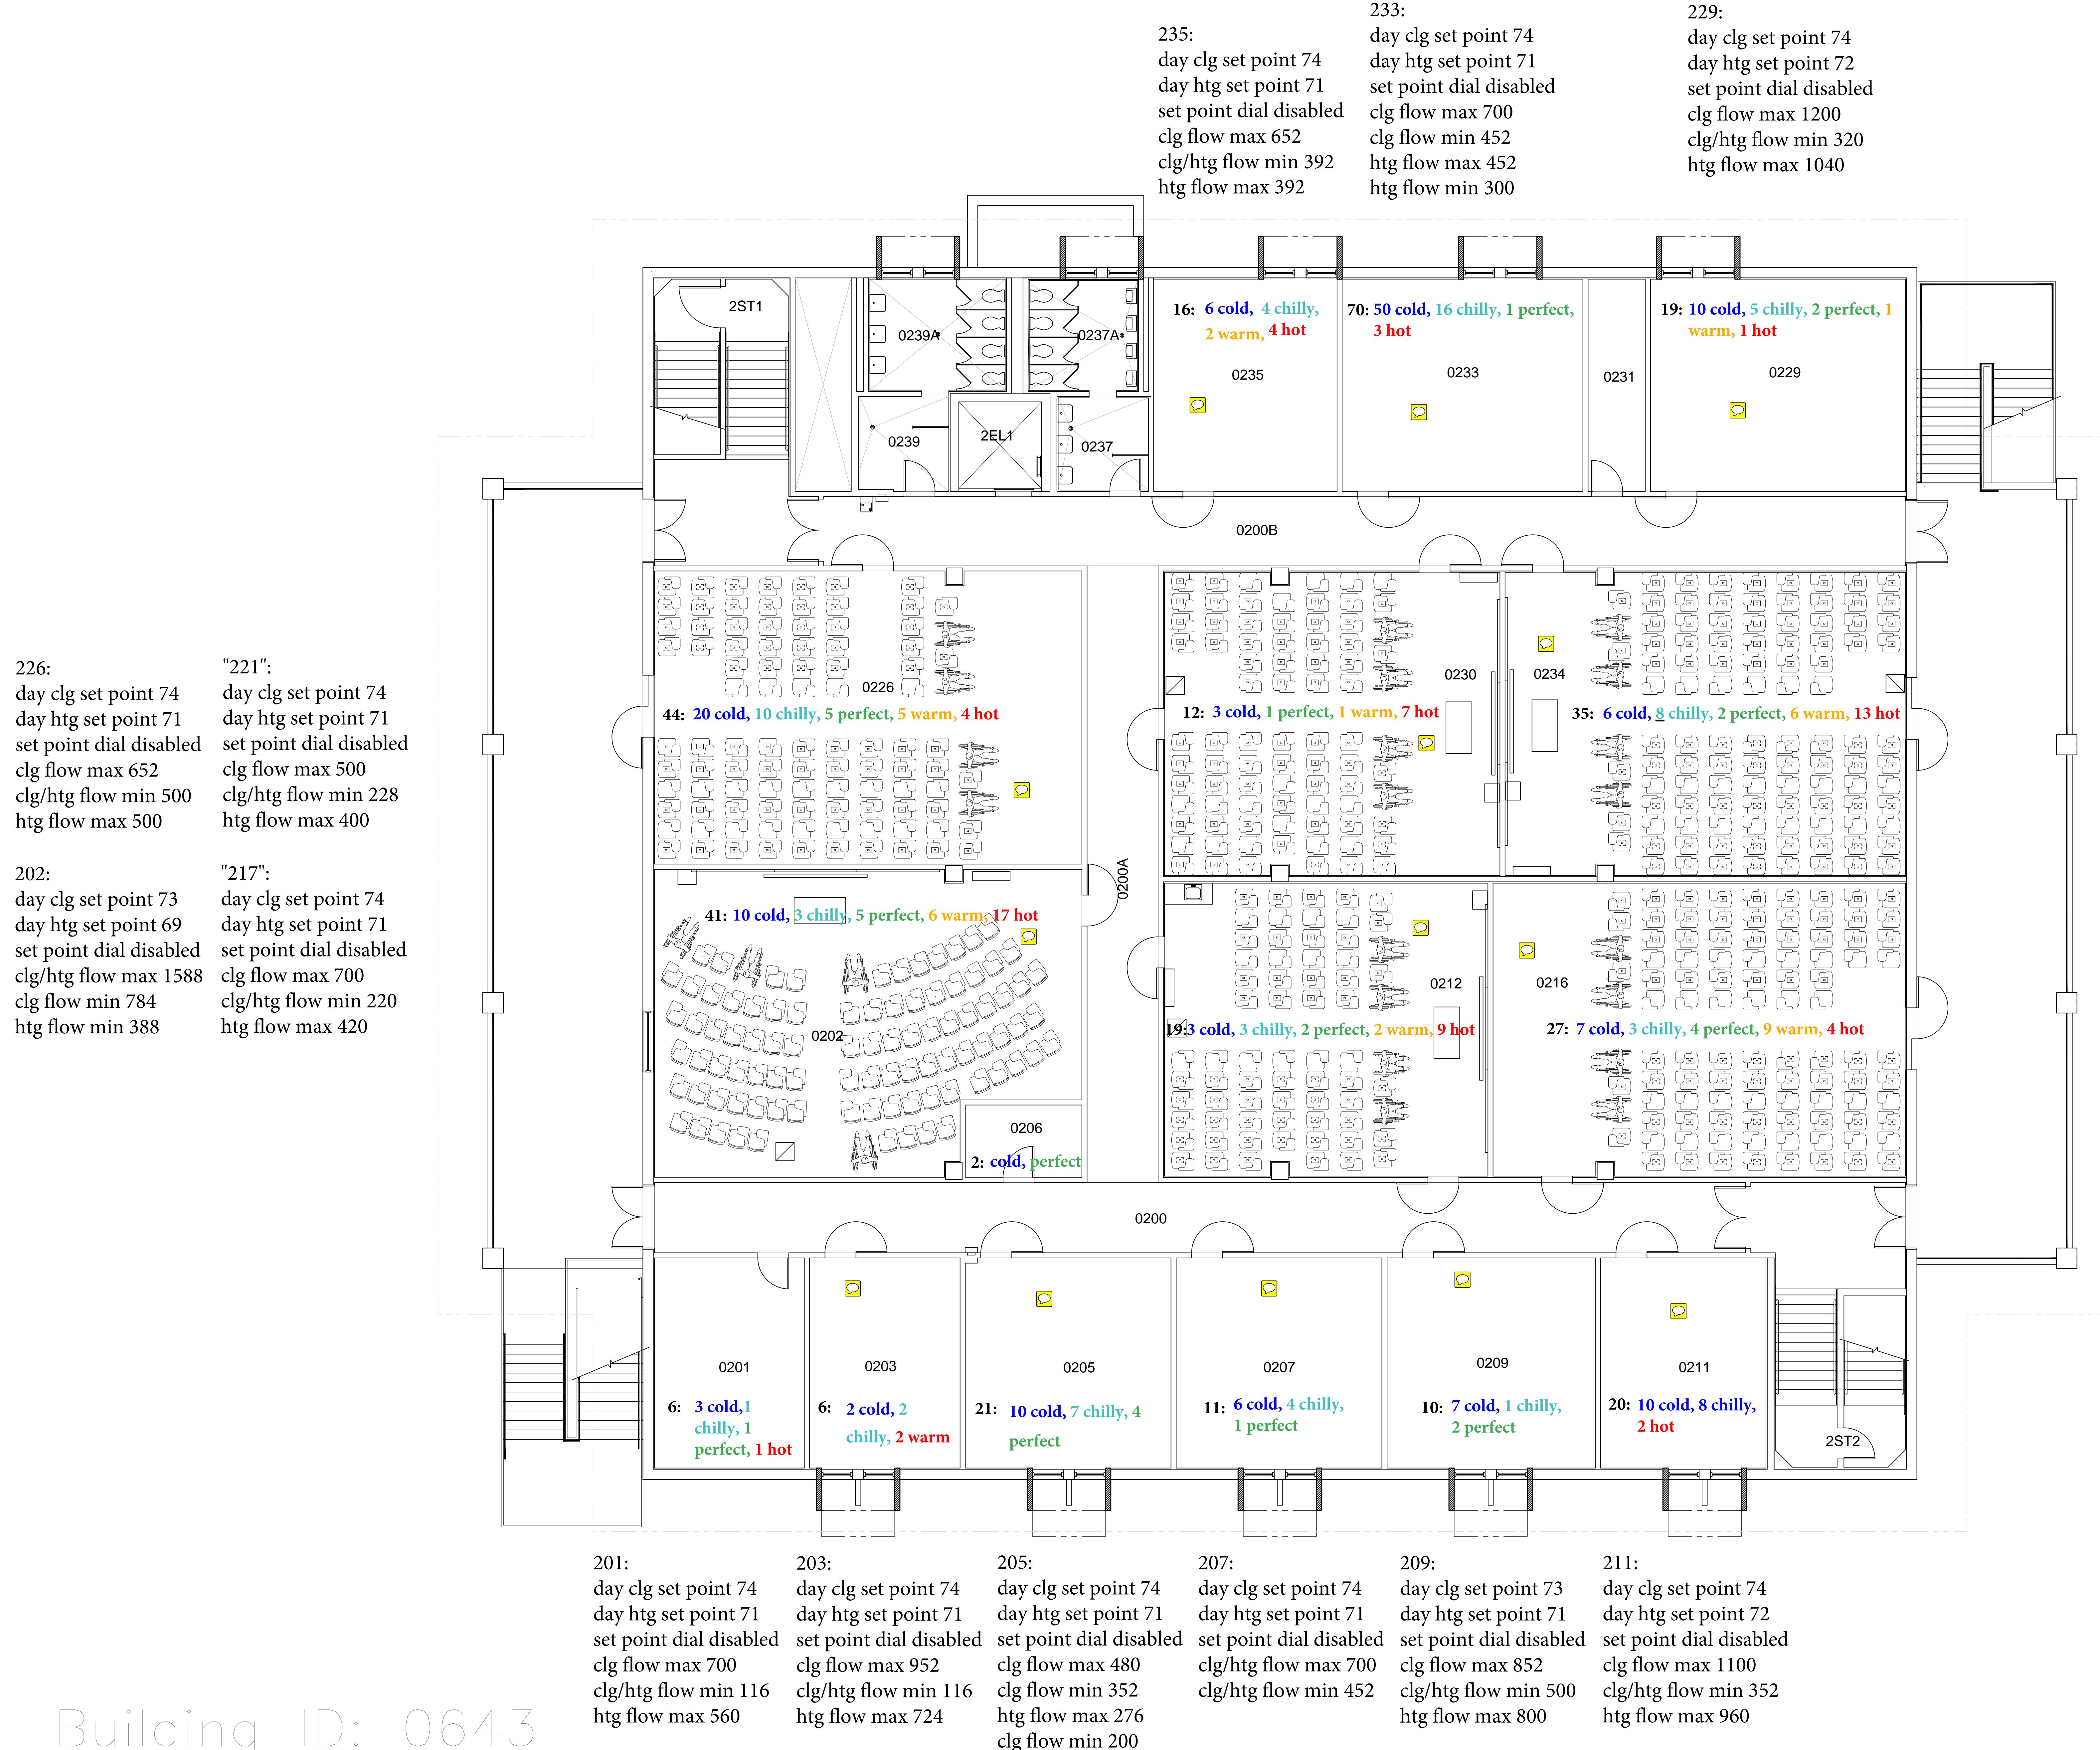

357 total

A2	SECOND FLOOR	NOT TO SCALE DIGITAL PLOT	WELLMAN HALL	PUBLISHED BY: UCD Utilities-GIS	03/04/2012
			facilitieslink.ucdavis.edu/		