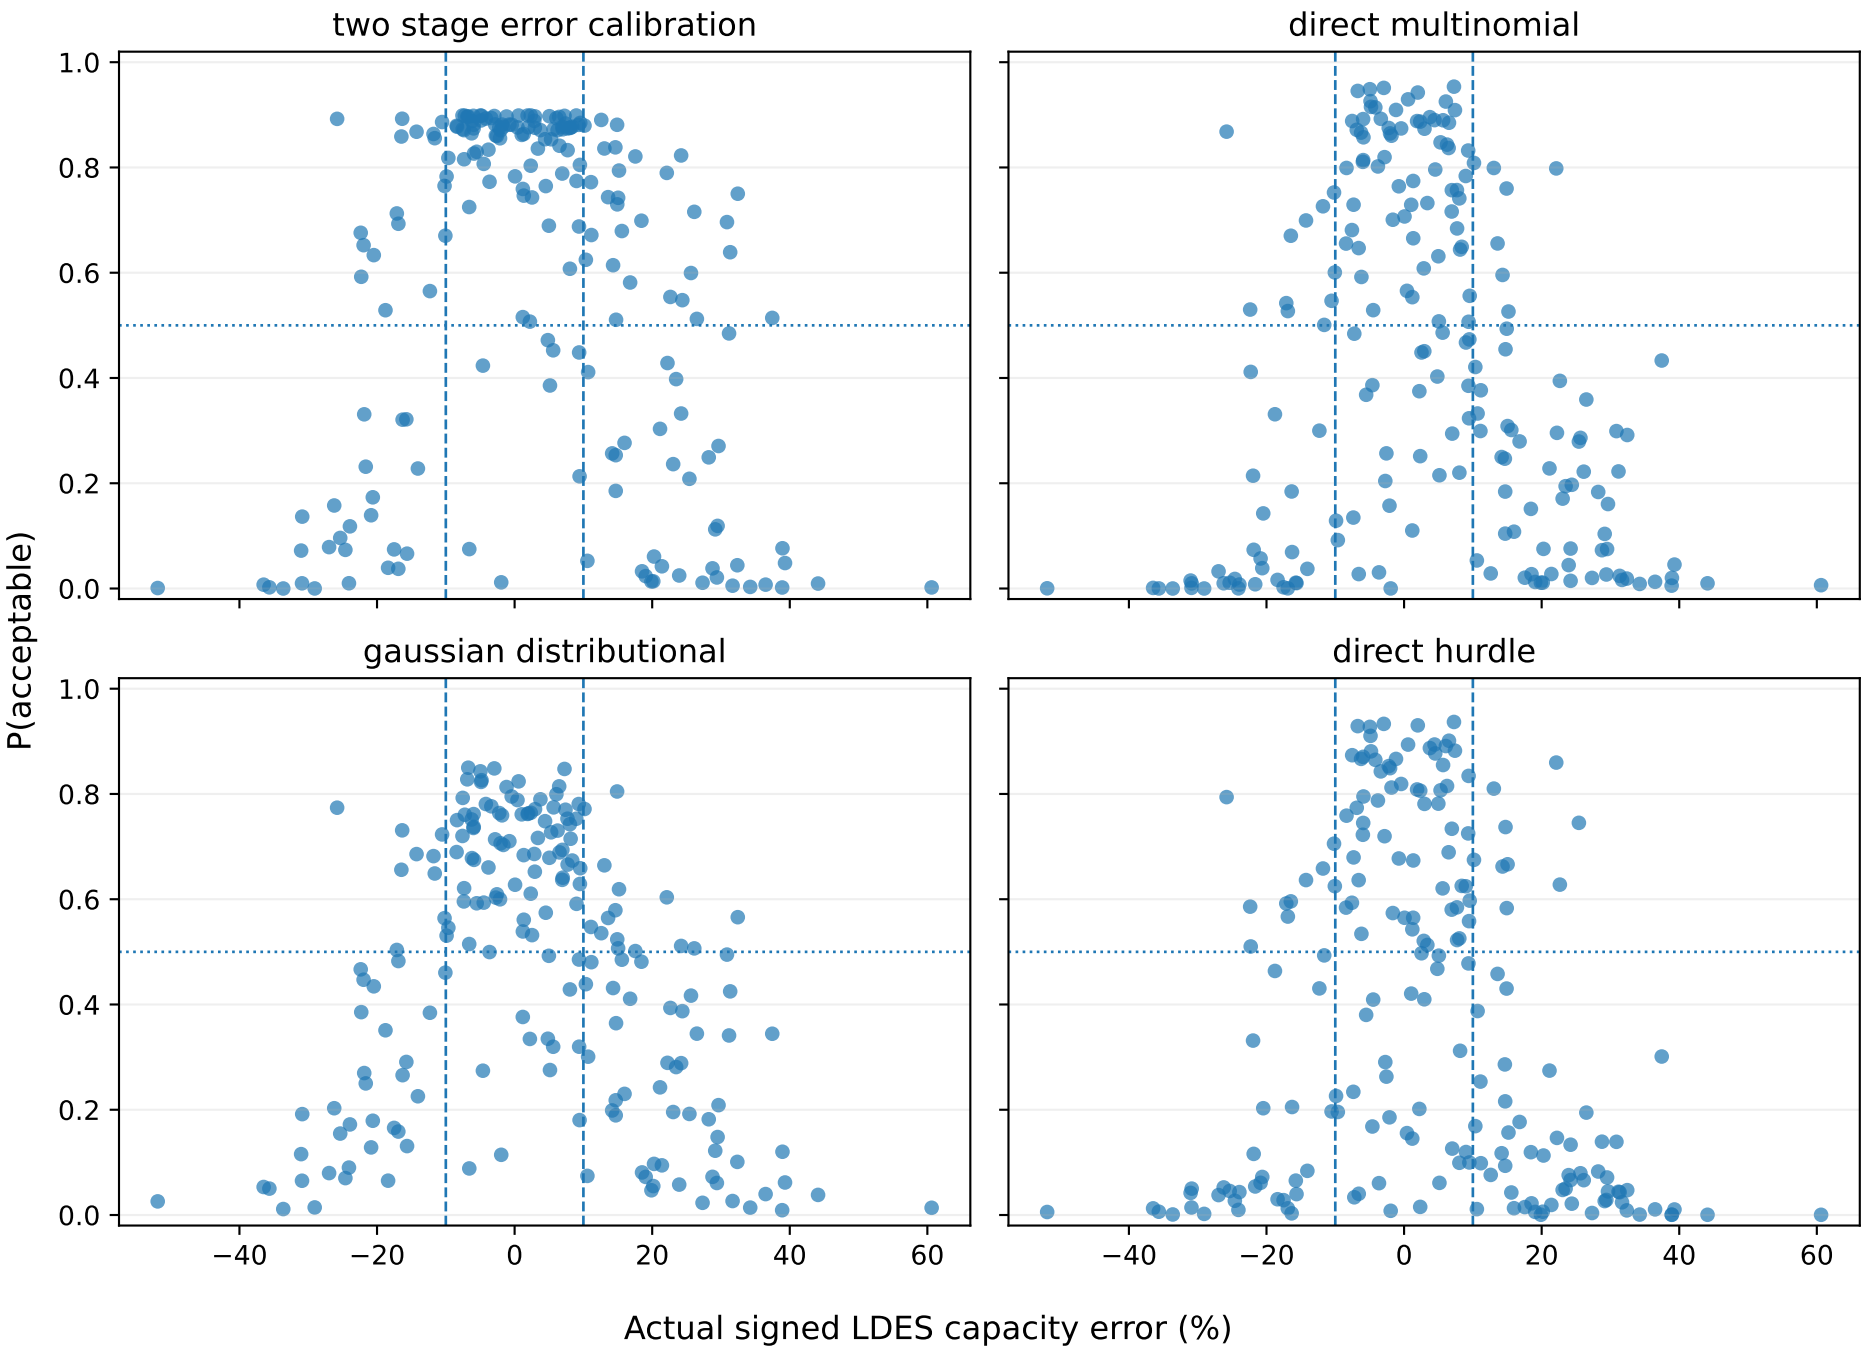
Belgium holdout: acceptability probability vs actual error
two stage error calibration
direct multinomial
gaussian distributional
direct hurdle
P(acceptable)
1.0
0.8
0.6
0.4
0.2
0.0
−40
−20
0
20
40
60
Actual signed LDES capacity error (%)