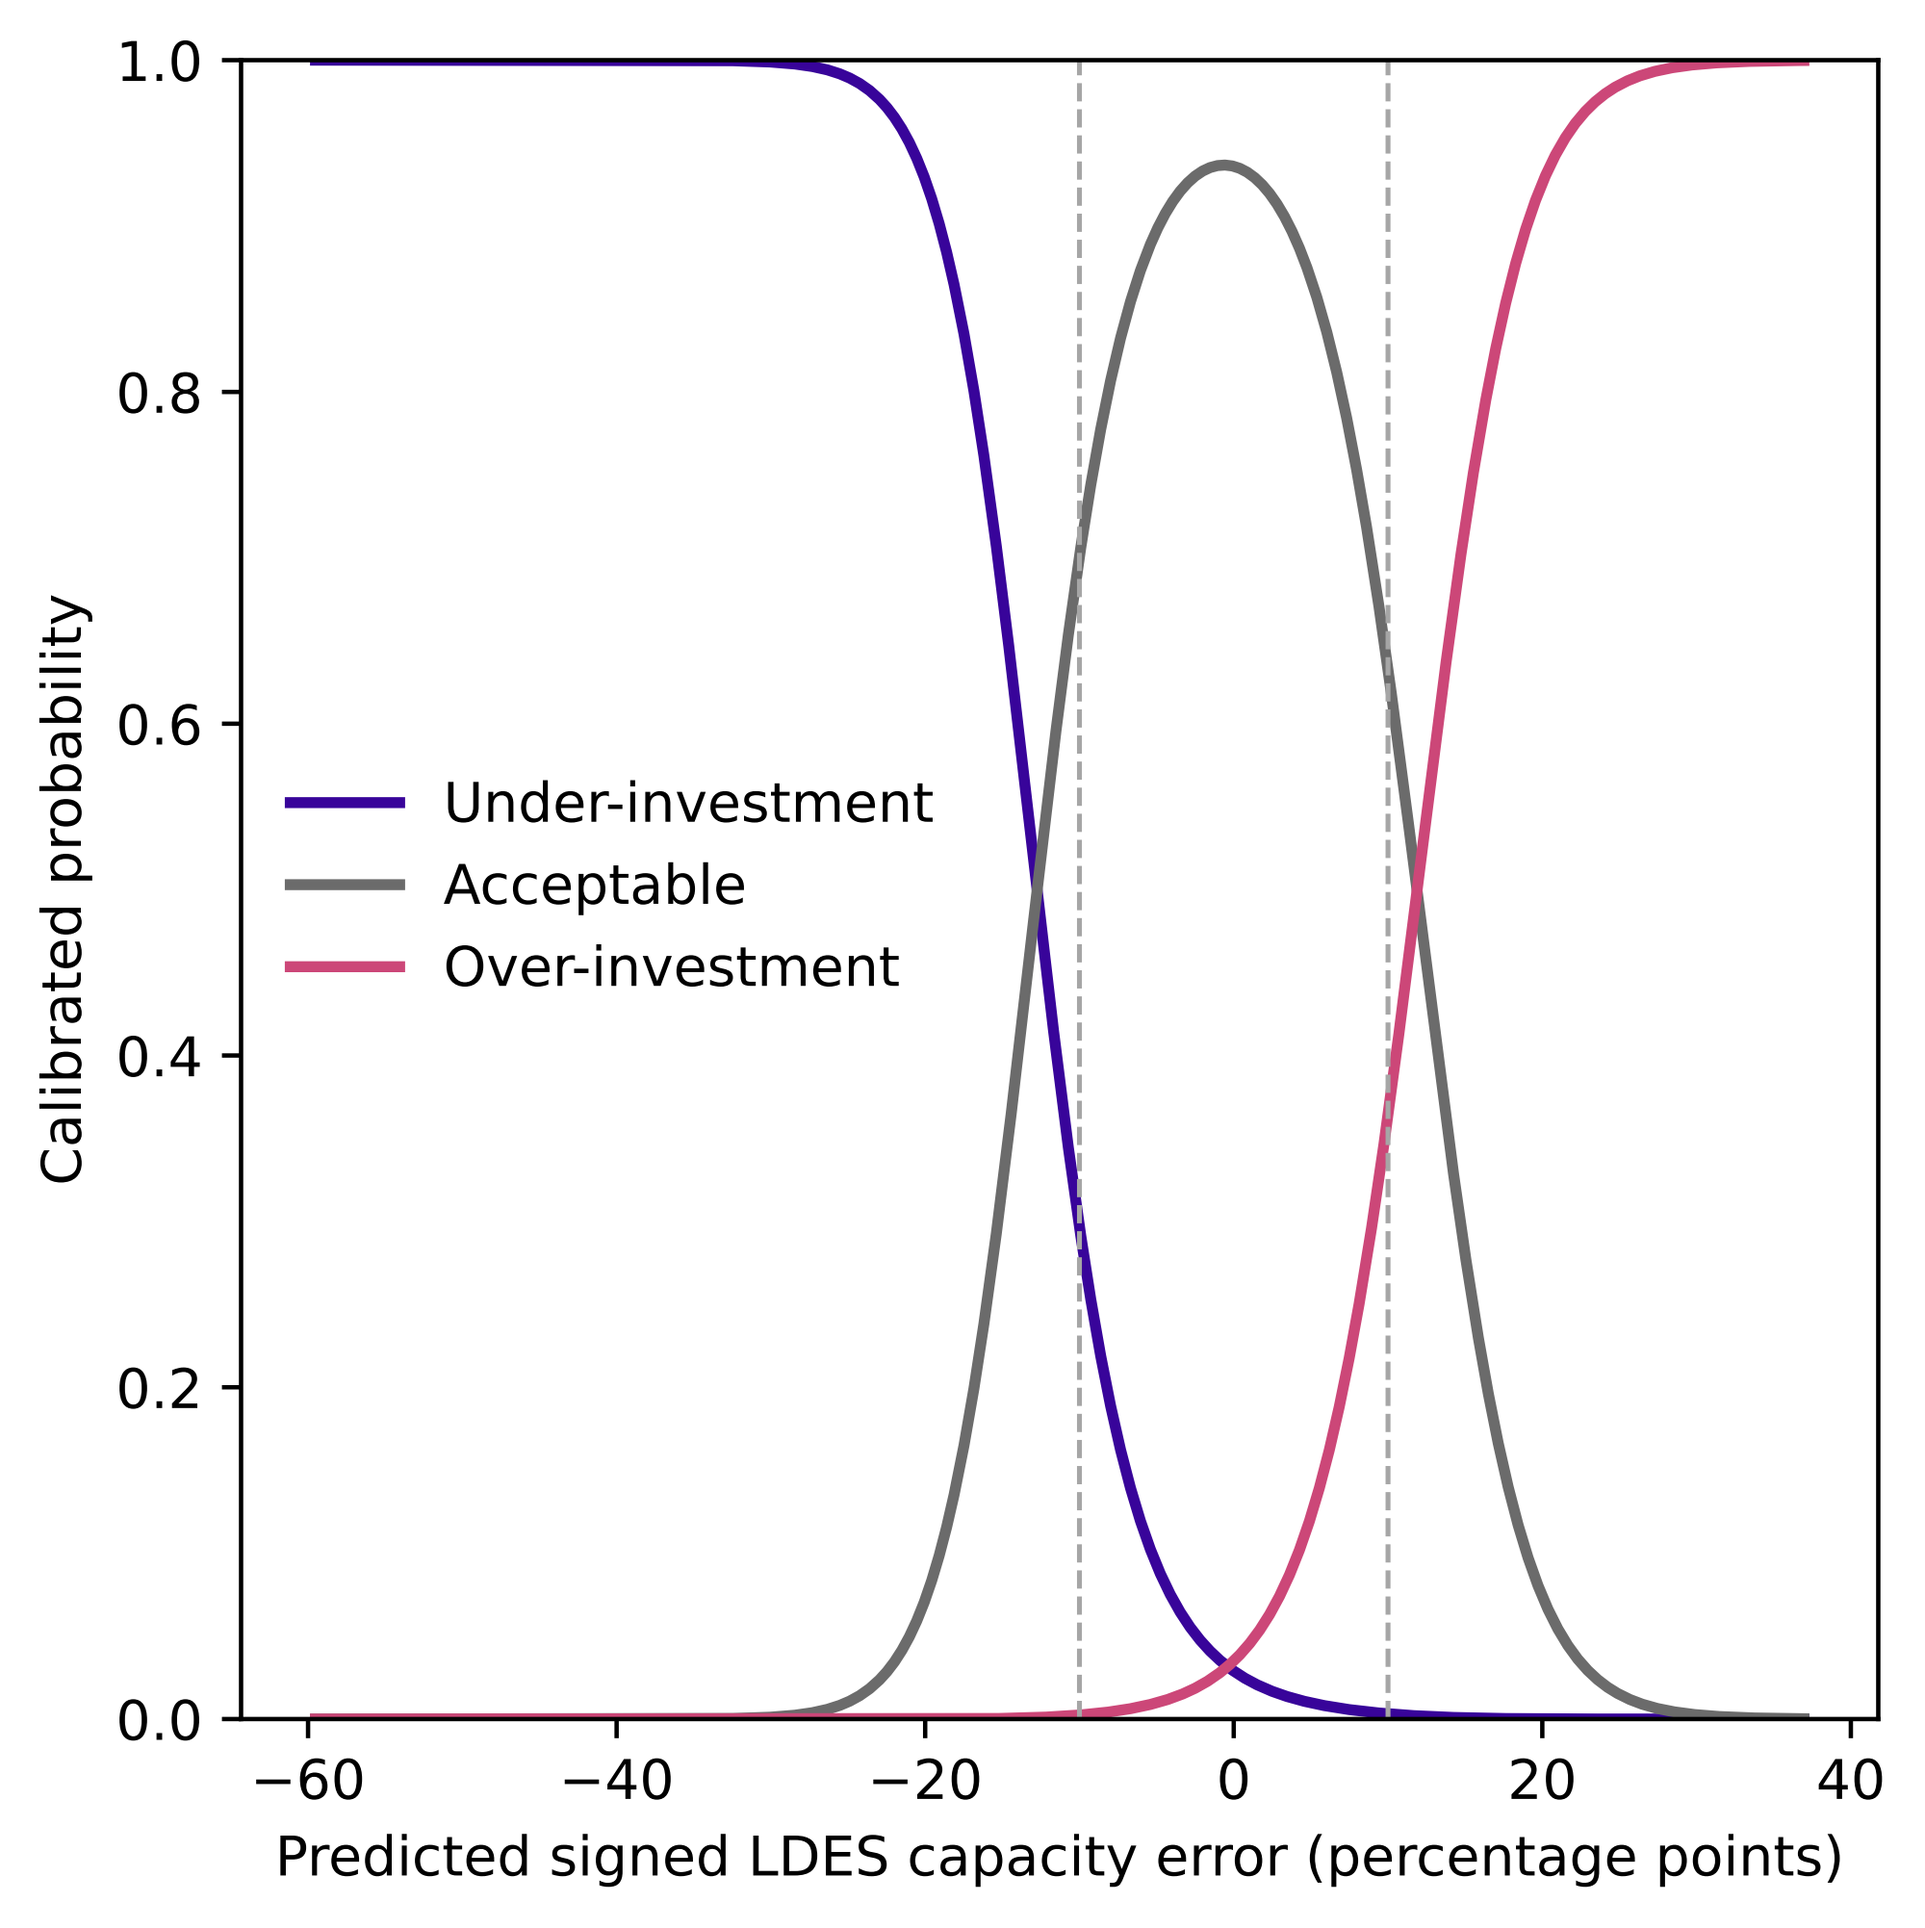
1.0
0.8
0.6
0.4
0.2
0.0
Calibrated probability
Under-investment
Acceptable
Over-investment
−60
−40
−20
0
20
40
Predicted signed LDES capacity error (percentage points)