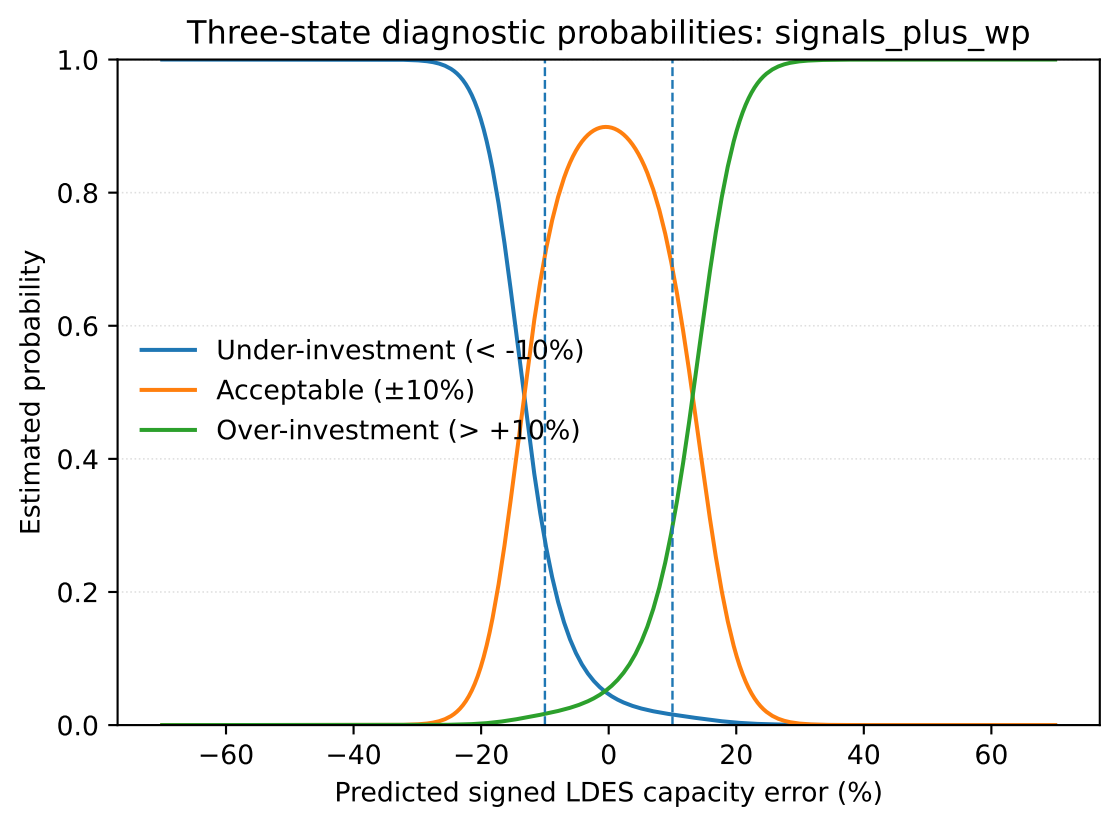
Three-state diagnostic probabilities: signals_plus_wp
Estimated probability
Predicted signed LDES capacity error (%)
Under-investment (< -10%)
Acceptable (±10%)
Over-investment (> +10%)
1.0
0.8
0.6
0.4
0.2
0.0
−60
−40
−20
0
20
40
60