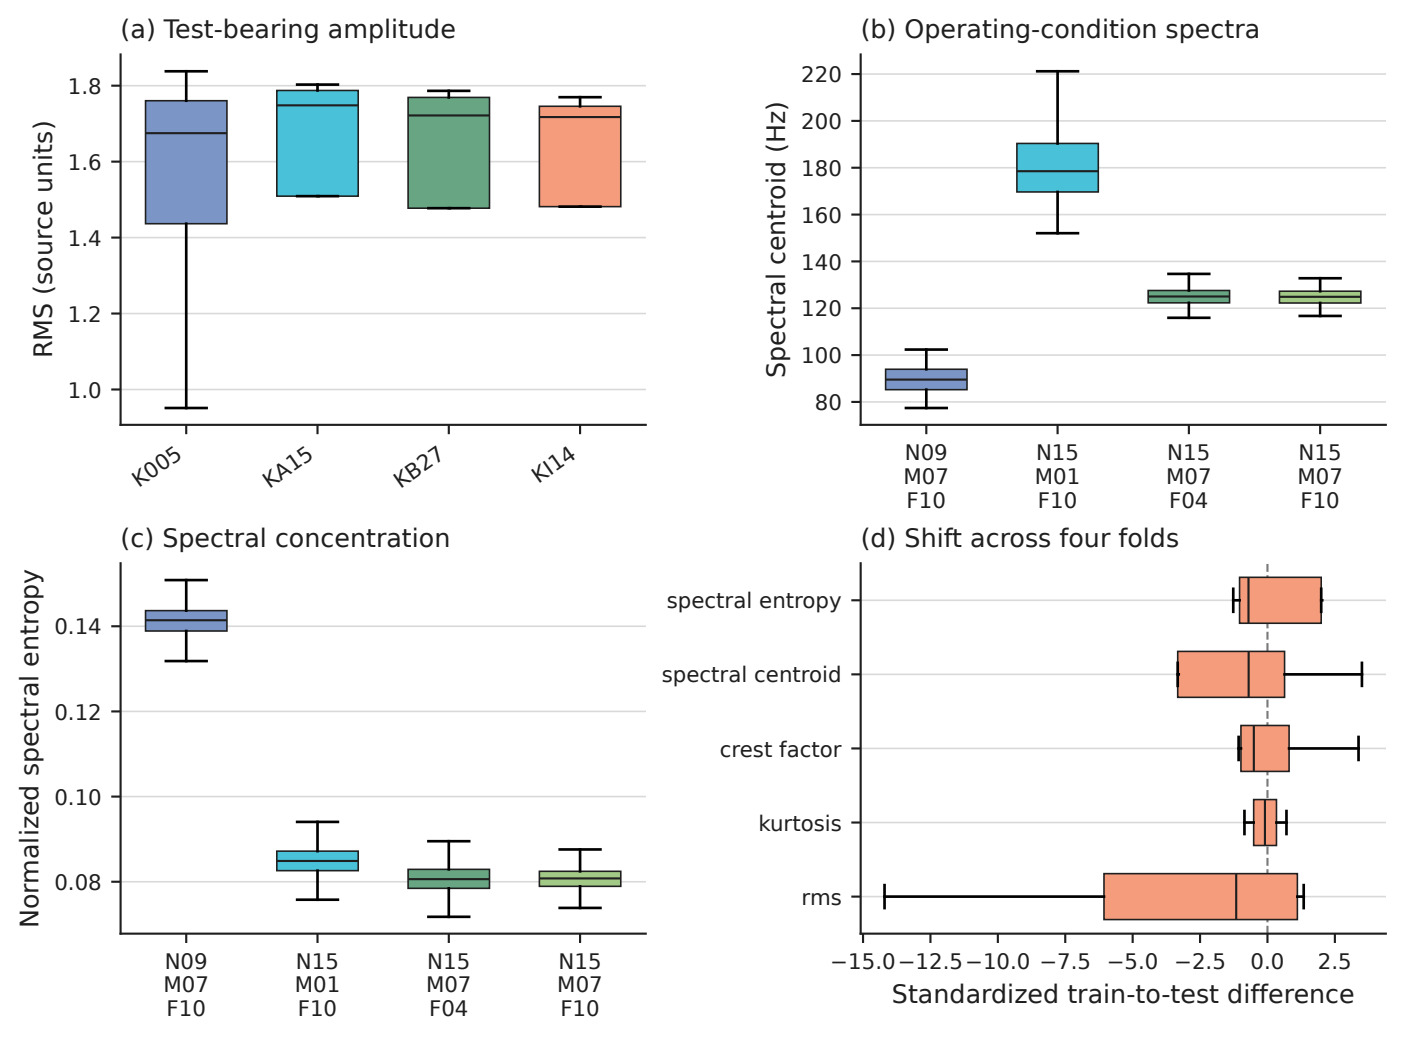
(a) Test-bearing amplitude
RMS (source units)
1.8
1.6
1.4
1.2
1.0
K005
KA15
KB27
KI14
(b) Operating-condition spectra
Spectral centroid (Hz)
220
200
180
160
140
120
100
80
N09 M07 F10
N15 M01 F10
N15 M07 F04
N15 M07 F10
(c) Spectral concentration
Normalized spectral entropy
0.14
0.12
0.10
0.08
N09 M07 F10
N15 M01 F10
N15 M07 F04
N15 M07 F10
(d) Shift across four folds
spectral entropy
spectral centroid
crest factor
kurtosis
rms
−15.0
−12.5
−10.0
−7.5
−5.0
−2.5
0.0
2.5
Standardized train-to-test difference