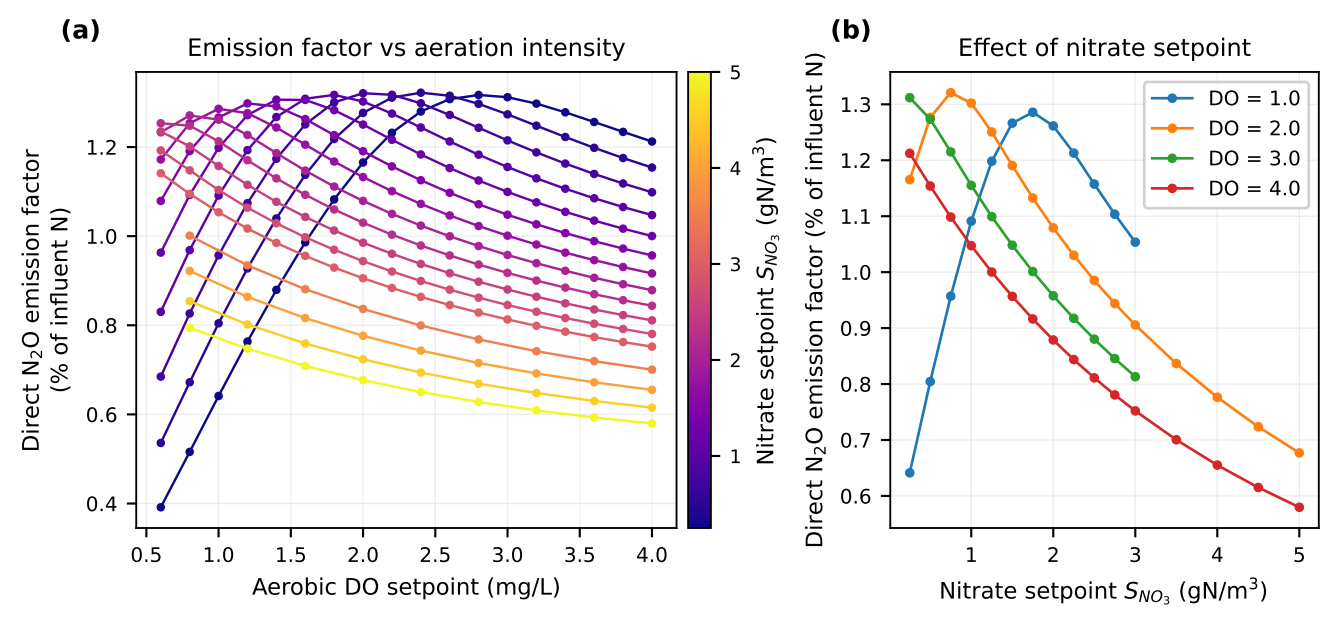
(a)
Emission factor vs aeration intensity
Direct N2O emission factor (% of influent N)
Aerobic DO setpoint (mg/L)
Nitrate setpoint S_NO3 (gN/m3)
(b)
Effect of nitrate setpoint
DO = 1.0
DO = 2.0
DO = 3.0
DO = 4.0
Direct N2O emission factor (% of influent N)
Nitrate setpoint S_NO3 (gN/m3)