
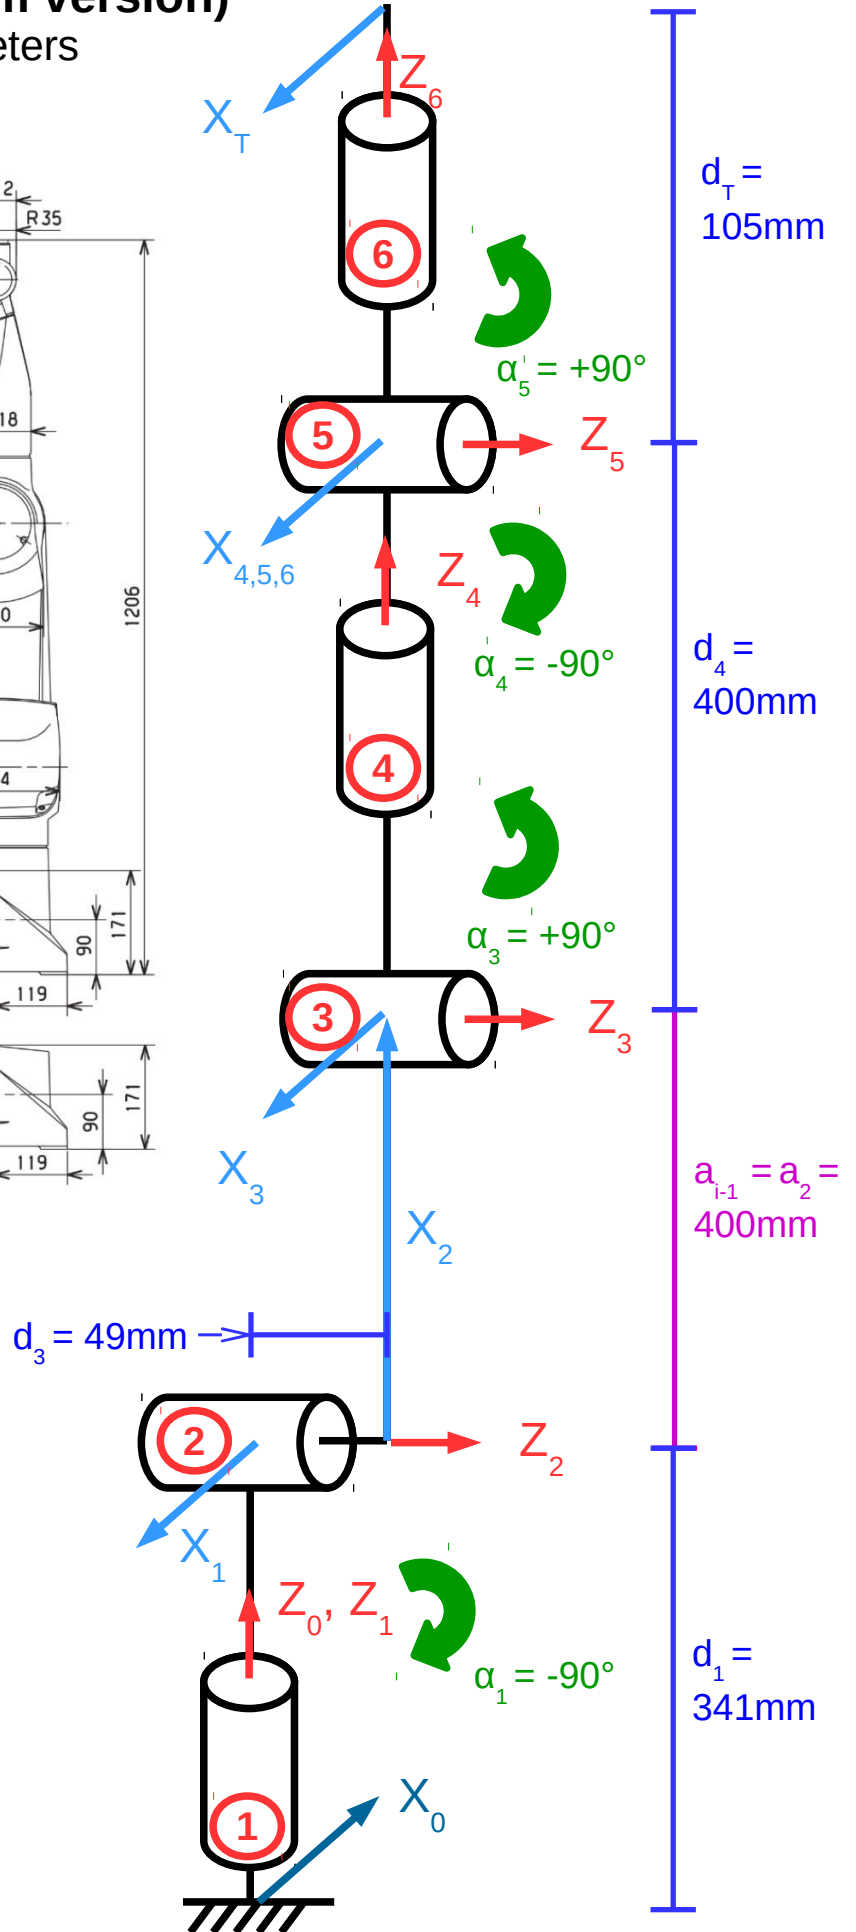


Denavit-Hartenberg Parameters

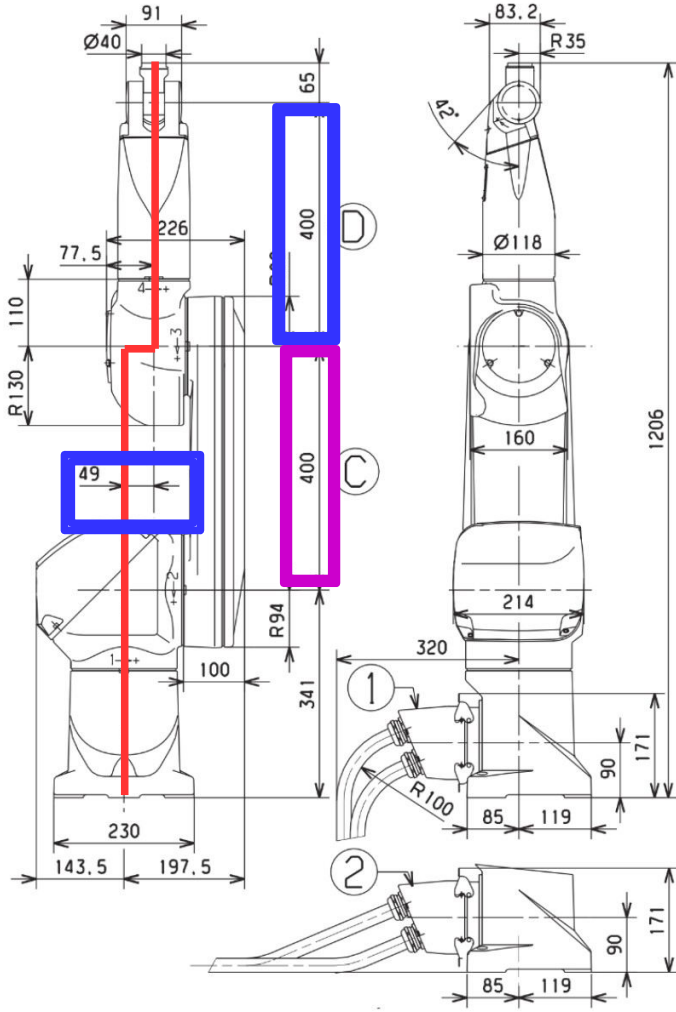

Notes:

Common normals X 4,5 and 6 are taken as coincident, to reduce parameters as per DH method.

Rotational Axes Z0 and Z1 are coincident.

Counterclockwise rotation of link I-1 to link I, given by α (α) about common normal x , is taken as **positive** as per right hand rule.