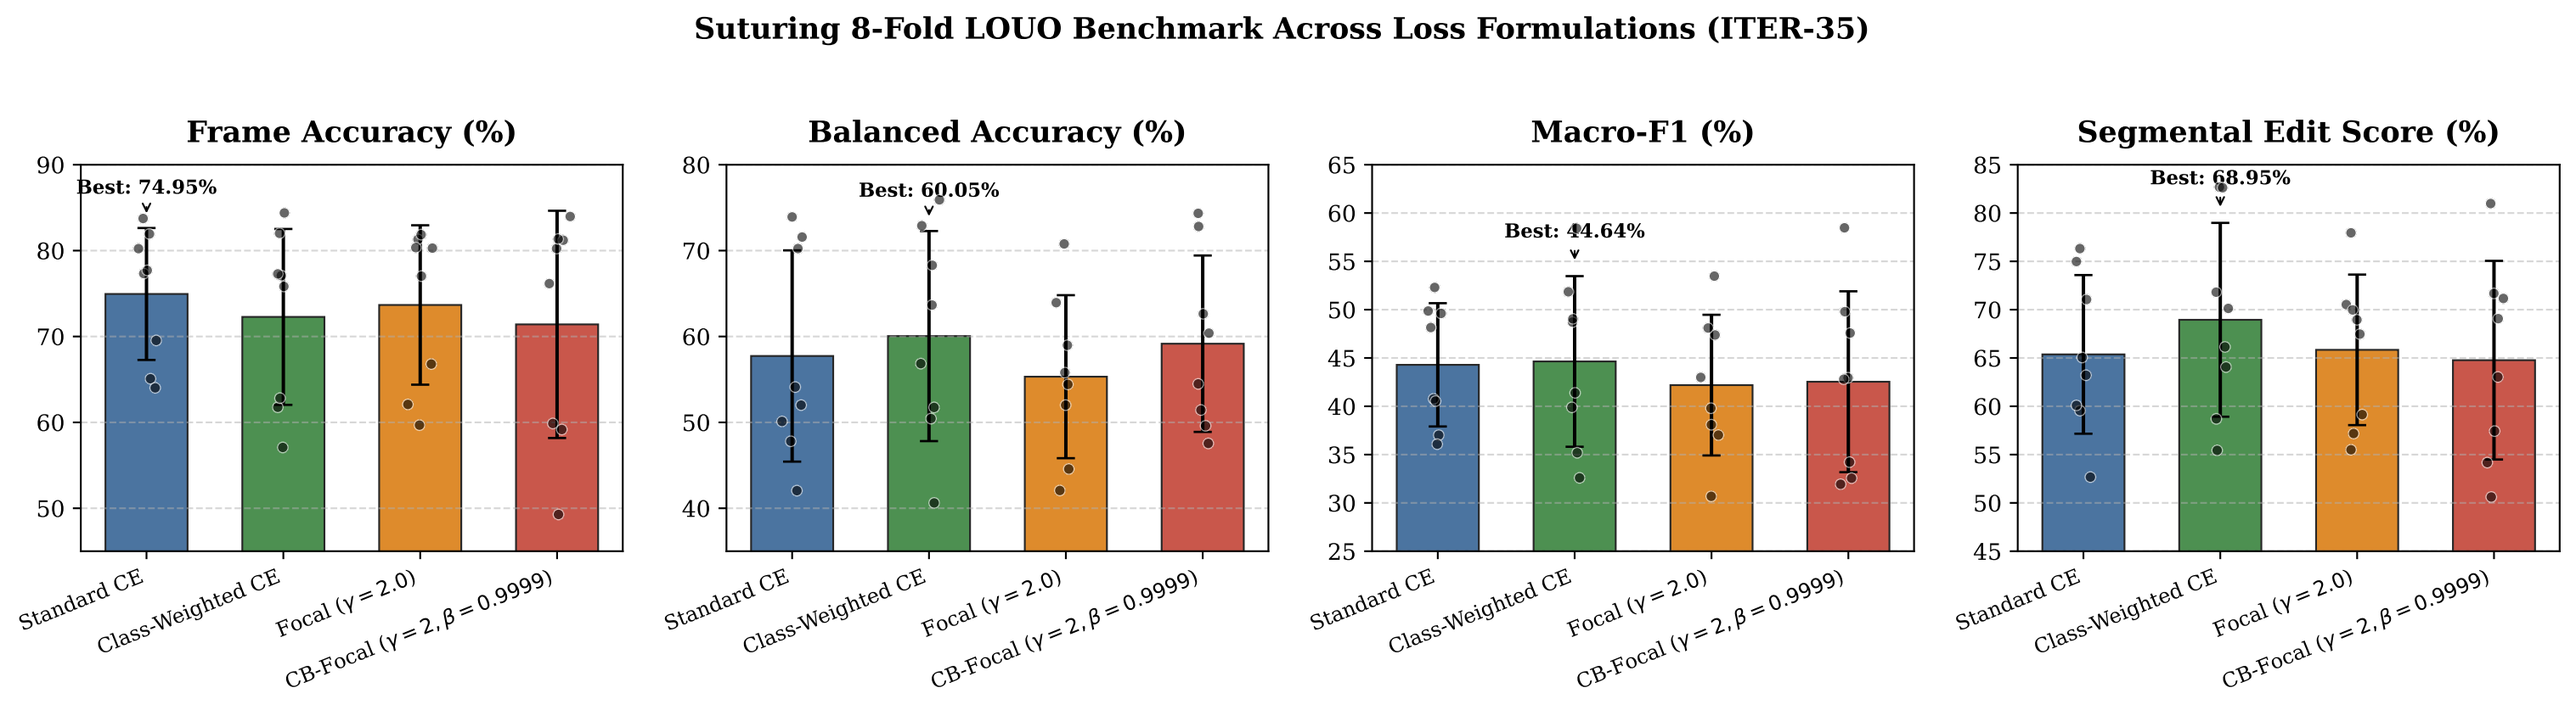
Suturing 8-Fold LOUO Benchmark Across Loss Formulations (ITER-35)
Frame Accuracy (%)
Best: 74.95%
Balanced Accuracy (%)
Best: 60.05%
Macro-F1 (%)
Best: 44.64%
Segmental Edit Score (%)
Best: 68.95%
Standard CE
Class-Weighted CE
Focal (γ = 2.0)
CB-Focal (γ = 2, β = 0.9999)