


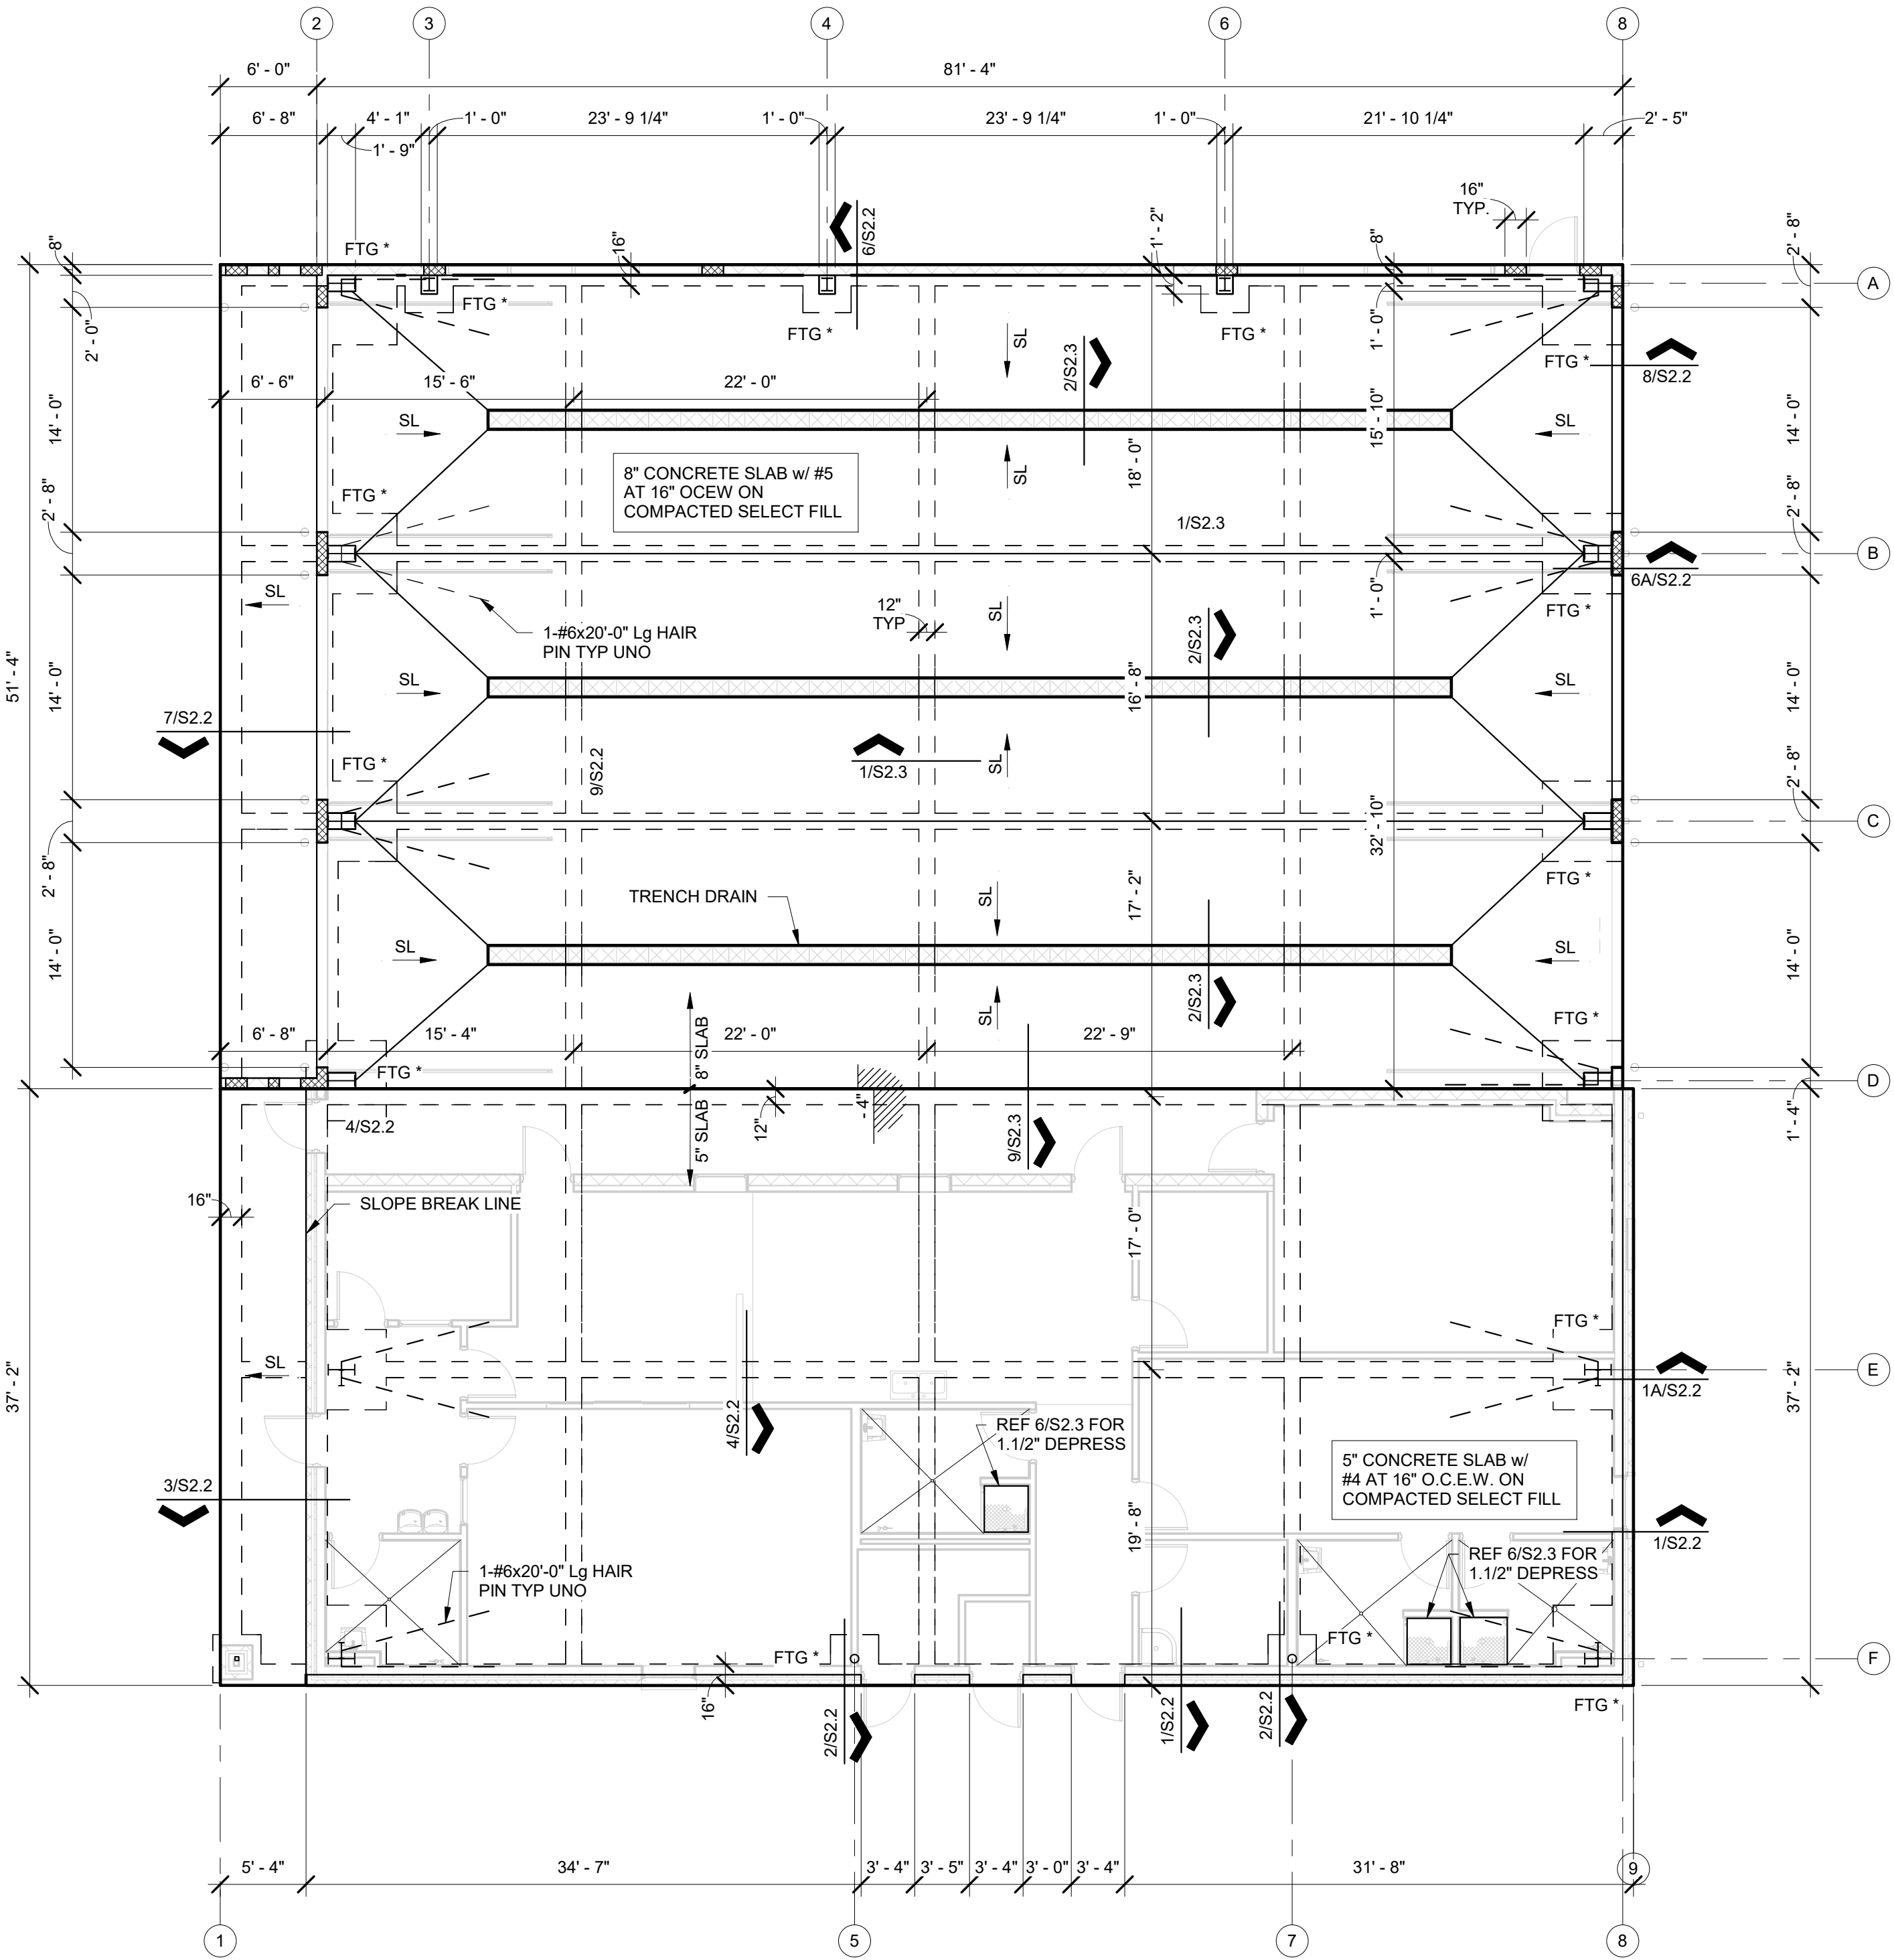

1 FOUNDATION PLAN

1/8" = 1'-0"

PLAN NORTH

- NOTES:
- REFERENCE PRE-ENGINEERED BUILDING ANCHOR BOLT PLAN FOR BOLT DIAMETER & LOCATION. COLUMN ANCHOR BOLT LENGTHS TO BE DETERMINED BY ENGINEER SUBSEQUENT TO RECEIPT & REVIEW OF THE BUILDING REACTION DIAGRAMS AND ANCHOR BOLT PLAN.
 - REFERENCE SCHEMATIC ROOF FRAMING PLAN FOR COLUMN LOCATIONS. FOUNDATION PLAN DIMENSIONS GENERALLY DENOTE GRADE BEAM CENTERLINE AND OUTSIDE FACE OF CONCRETE.
 - ALL CONDUIT GREATER THAN 1" IN DIAMETER SHALL BE RECESSED TO PROVIDE 1.1/2" CLEAR DISTANCE BETWEEN SLAB REBAR & CONDUIT.
 - MAINTAIN 2" MINIMUM CLEAR DISTANCE BETWEEN ALL CONDUIT IN SLAB.
 - A SINGLE CONDUIT (MAX 3" O.D.) MAY BE PLACED WITHIN THE BEAM CAGE. ALL CONDUIT IN BEAM CAGES TO BE TIED TO STIRRUPS MINIMUM OF 4" FROM HORIZONTAL BARS.
 - CRACK CONTROL JOINTS ARE NOTED ON THE PLANS. CONTRACTOR TO COORDINATE CHANGES WITH THE ENGINEER PRIOR TO FORMING FOUNDATION.
 - PLUMBING LINES SHALL NOT BE PLACED IN BOTTOM OF GRADE BEAM TRENCHES.
 - PLUMBING LINES PASSING THROUGH GRADE BEAMS SHALL BE SLEEVED. BEAMS SHALL BE DEEPENED AND BENT REBAR PROVIDED IF LOCATION OF DRAIN LINES REQUIRES CUTTING BOTTOM BARS. REFERENCE 6/S2.3.
 - ALL JOINTS IN 5 INCH SLAB TO BE CLEANED AND FILLED w/ SONOLASTIC SL1 (SONNEBORN).
 - ALL JOINTS IN 8 INCH SLAB TO BE CLEANED AND FILLED w/ METZGER/MCGUIRE MM-80
 - REFERENCE 1/S2.1C FOR CONTROL JOINT PLAN.
 - INDICATES 8" CMU w/ 1-#5 VERTICAL BARS AT 8" o/c.

NOT FOR CONSTRUCTION

No.	DESCRIPTION	DATE
01-06-2023		
SAM GARCIA ARCHITECT 200 S. 10th ST. SUITE 1602 McAllen, TX 78501 (956) 631 - 6327 info@samgarciaarchitect.com		
CITY OF LA JOYA FIRE STATION		
Enter address here		
1205-05		01-06-2023
FOUNDATION PLAN		

PRELIMINARY

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF INTERIM REVIEW UNDER THE AUTHORITY OF ROLANDO R. RUBIANO, P.E., 68359. IT IS NOT TO BE USED FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.

GREEN, RUBIANO & ASSOCIATES

CONSULTING STRUCTURAL ENGINEERS

1220 WEST HARRISON
MCKINNEY, TEXAS 75069
(972) 448-1101 (972) 448-1102 FAX
P.E. REGISTRATION # 64145

S2.1