



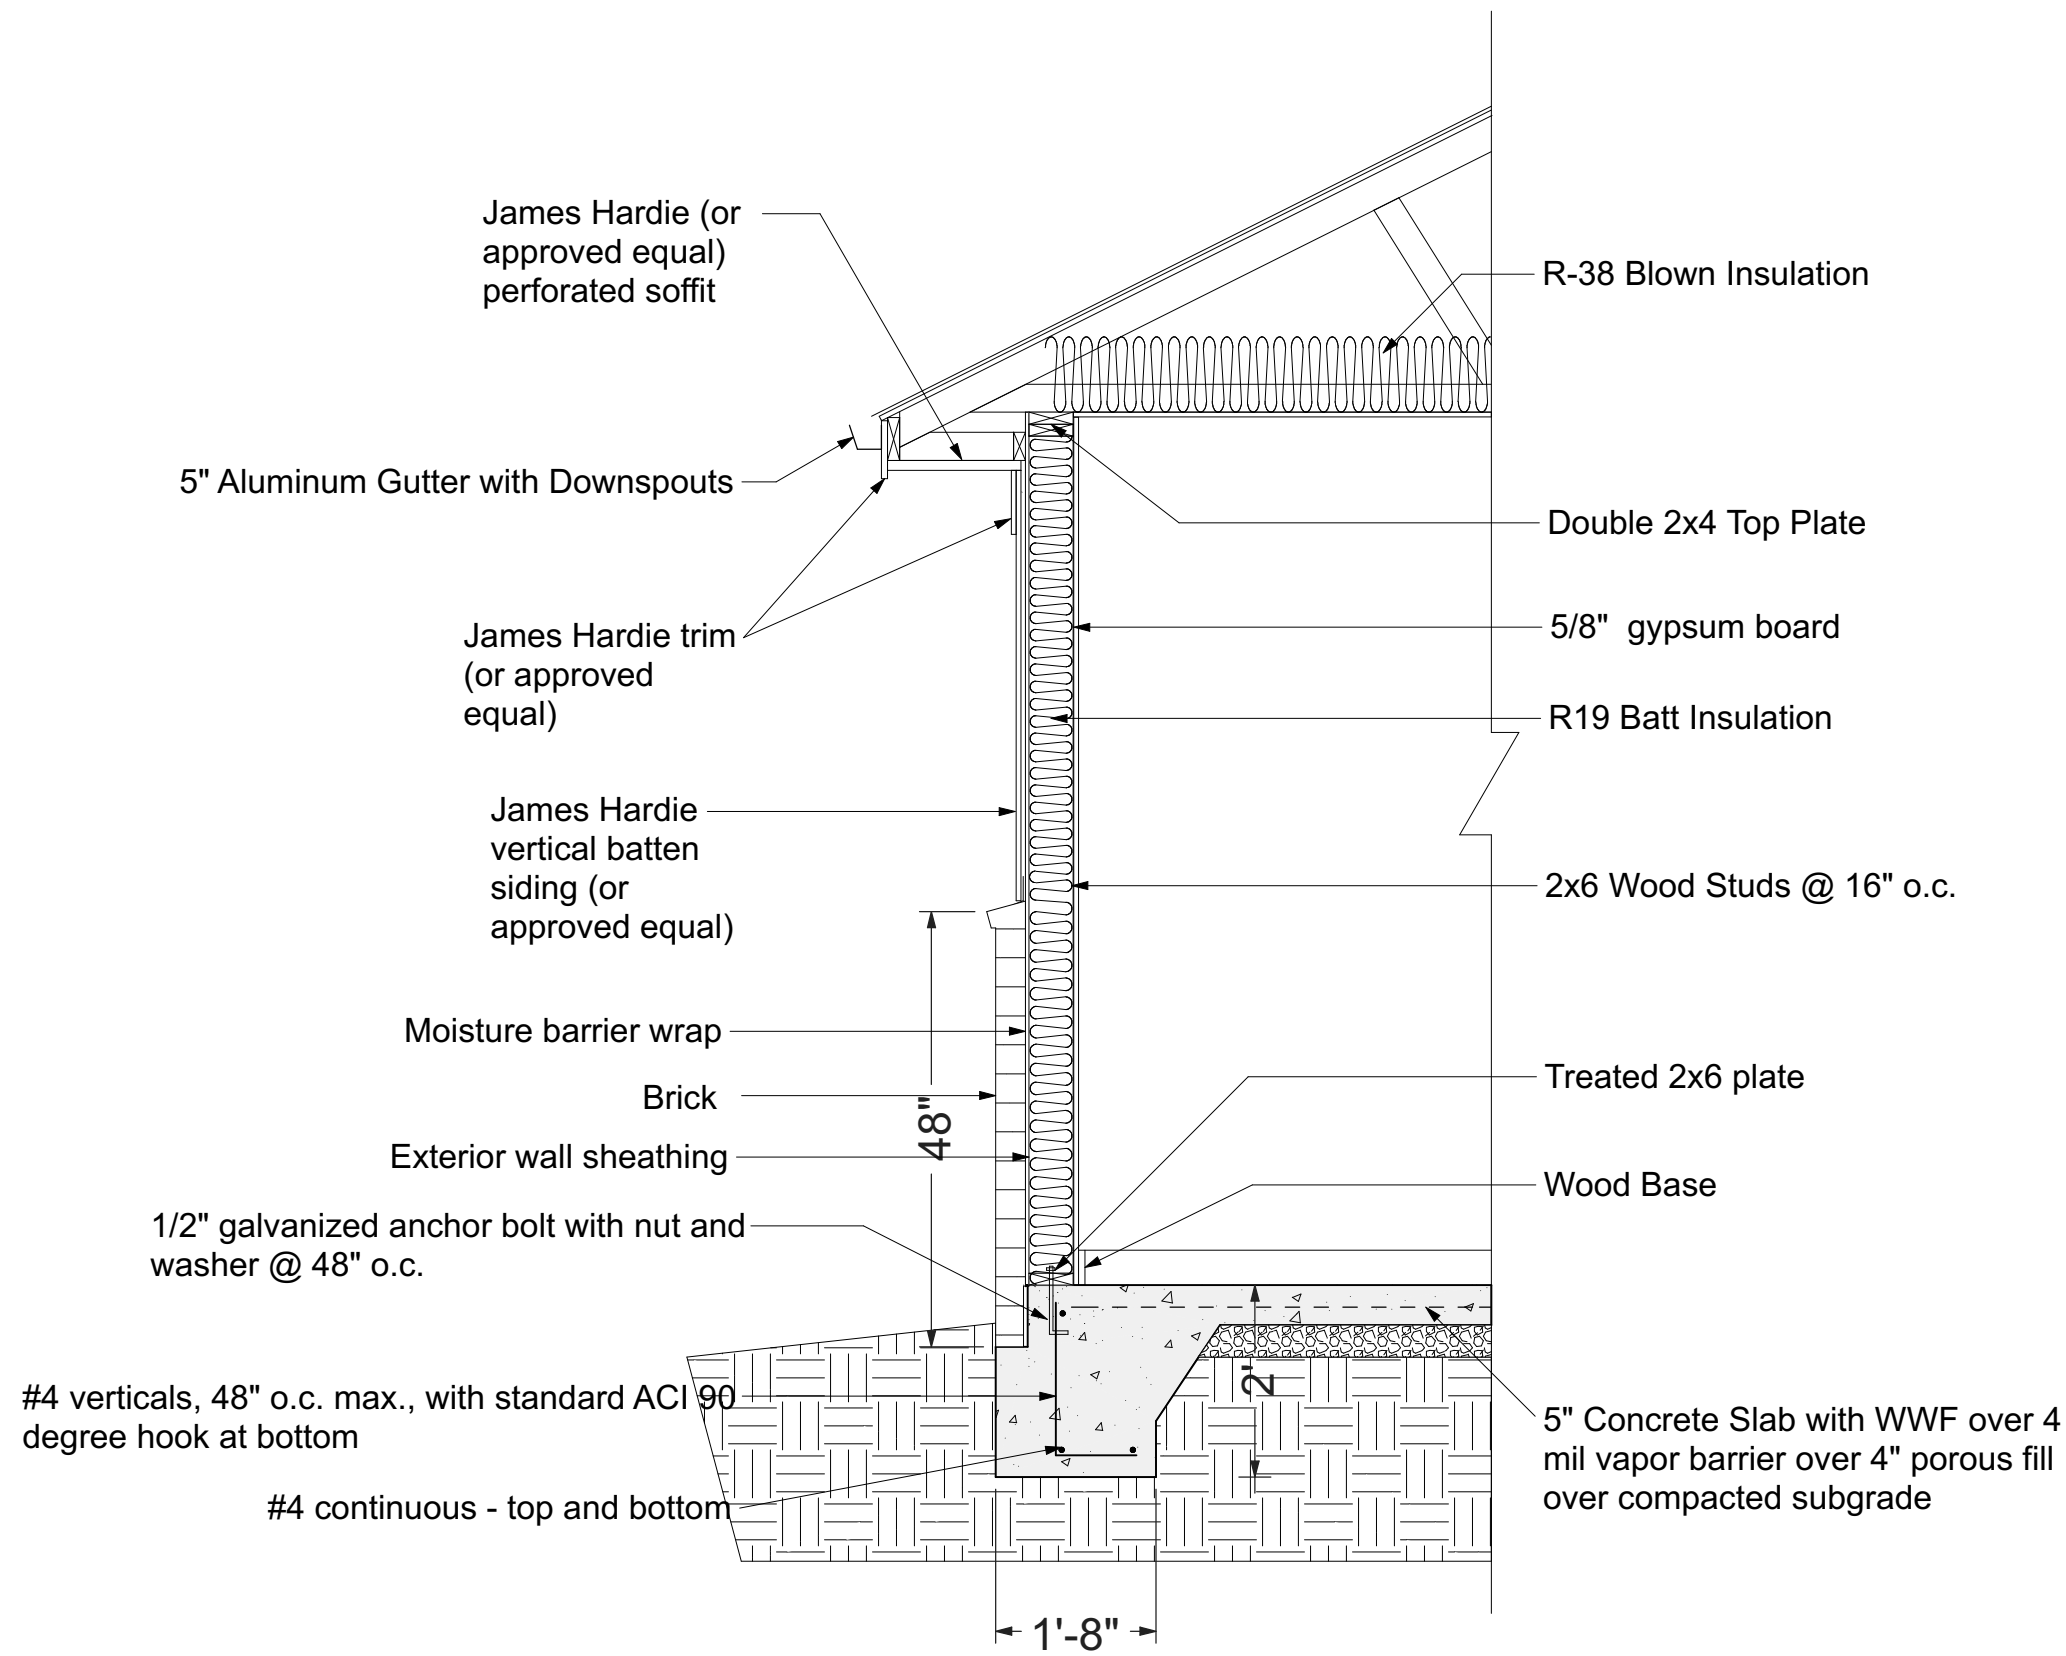

Section 1 Typical Exterior Pony Wall
A5

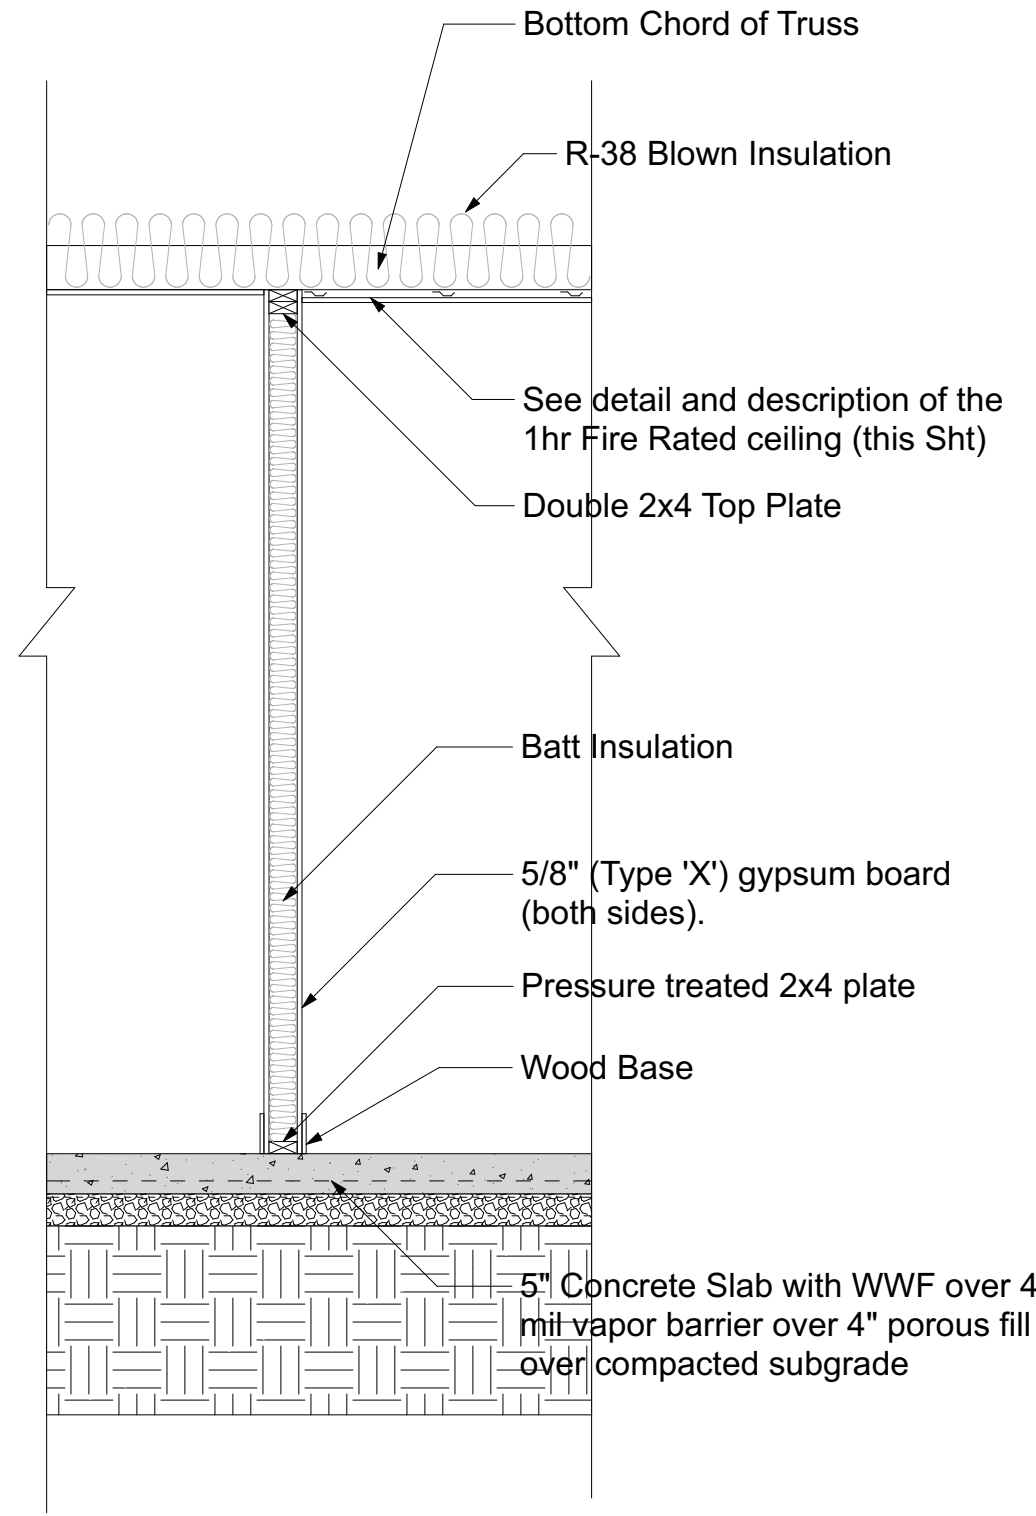

Section 2 Typical Interior Fire Rated Partition
A5
UL Design U305 (See below)

UL DESIGN NO. P522

FIRE RATING: 1 HOUR
STC: N/A
SOUND TEST: N/A
SYSTEM THICKNESS: N/A

NOTES:

FOR THE MOST UP-TO-DATE INFORMATION OR ASSEMBLY OPTIONS, REFER TO THE UL FIRE RESISTANCE DIRECTORY.

REFER TO THE UL FIRE RESISTANCE DIRECTORY FOR INFORMATION REGARDING PRODUCT ORIENTATION AND FASTENING REQUIREMENTS.

ASSEMBLY

ROOFING SYSTEM: ANY UL CLASS A, B OR C ROOFING SYSTEM (TGFU) OR PREPARED ROOF COVERING (TFWZ)

ROOF SHEATHING: NOM. 15/32" THICK WOOD STRUCTURAL PANELS, MIN. GRADE "C-D" OR "SHEATHING"

TRUSSES: PITCHED OR PARALLEL CHORD WOOD TRUSSES, SPACED 24" MAX. O.C., FABRICATED FROM NOM. 2x4 LUMBER, ORIENTED VERTICALLY OR HORIZONTALLY. MIN. TRUSS DEPTH SHALL BE 5 1/4" WITH A MIN. ROOF SLOPE OF 3/12


AIR DUCT: ANY UL CLASS 0 OR CLASS 1 FLEXIBLE AIR DUCT

CEILING DAMPER: MAX. NOM. AREA 324 SQ IN., MAX. SQUARE SIZE, 18" BY 18", RECTANGULAR SIZES NOT TO EXCEED 324 SQ IN. WITH WIDTH OF 18" MAX., DAMPER HEIGHT 14" MAX.

CAVITY INSULATION: 3-1/2" THICK MIN. BATTS AND BLANKETS DRAPED OVER RESILIENT CHANNEL AND GYPSUM BOARD CEILING MEMBRANE


RESILIENT CHANNELS: 1/2" DEEP, 25 GA., INSTALLED PERPENDICULAR TO THE TRUSSES SPACED 16" MAX. O.C.

GYPSUM BOARD: ONE LAYER 5/8" THICK GYPSUM BOARD (UL TYPE ULIX™)

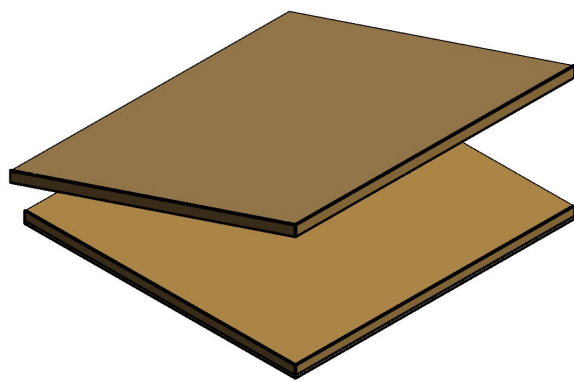

UL DESIGN NO. U305

FIRE RATING: 1 HOUR
STC: 33
SOUND TEST: USG-151234
SYSTEM THICKNESS: 4 3/4"

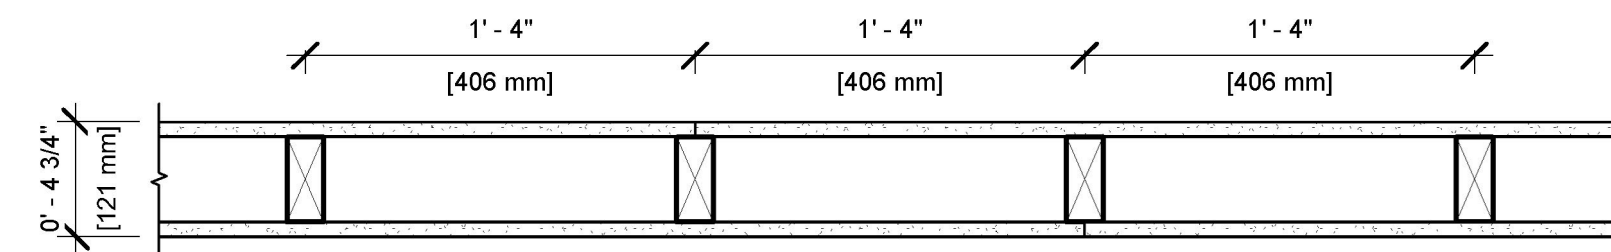

ASSEMBLY OPTIONS:

GYPSUM BOARD: ONE LAYER 5/8" THICK GYPSUM BOARD (UL TYPE ULIX™)

WOOD STUDS: 2X4 WOOD STUDS, 16" O.C.

GYPSUM BOARD: ONE LAYER 5/8" THICK GYPSUM BOARD (UL TYPE ULIX™)


NOTES:

STUD AND INSULATION SIZES ARE MINIMUM UNLESS OTHERWISE STATED IN DESIGN.

FOR THE MOST UP-TO-DATE INFORMATION OR ASSEMBLY OPTIONS, REFER TO THE UL FIRE RESISTANCE DIRECTORY.

UL TYPE ULIX™ REQUIRES THE USE OF INSULATION FOR SINGLE-LAYER, STEEL-FRAMED UL FIRE-RATED ASSEMBLIES.

REFER TO THE UL FIRE RESISTANCE DIRECTORY FOR INFORMATION REGARDING PRODUCT ORIENTATION AND FASTENING REQUIREMENTS.

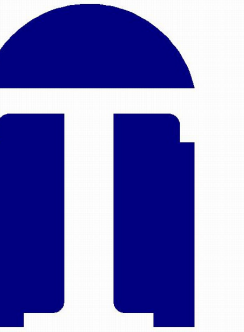

TDA
architects
LLC

125 West Columbus Street
Dadeville, Alabama 36853



Norwood Community Center
Anniston Housing Authority
Anniston, Alabama

Revision Table		Revised By		Description	
Number	Date				

Sections and
Details

TDA 445

DATE:
5/1/2023

SHEET:

A5