


GENERAL ROOFING NOTES

1. PROVIDE ICE & WATER @ ALL EAVE & RAKE LOCATIONS AS WELL AS ALL VALLEY & ROOF CHEEK WALL CONNECTIONS.
2. PROVIDE ALUMINUM Drip EDGE @ ALL EAVE & RAKE LOCATIONS
3. PROVIDE ALUMINUM STEP FLASHING @ ROOF TO CHIEK WALL CONNECTIONS.
4. AT LOW PITCH ROOFS (LESS THAN 4" RISE / 12" RUN) PROVIDE MECHANICALLY FASTENED & FULLY ADHERED EPDM ROOFING INSTALLED PER MFR'S SPECIFICATIONS
5. SEE ELEVATIONS FOR GUTTER/DOWNSPOUT LOCATIONS AND DETAILS.
6. ALUMINUM Drip EDGE @ ROOF EDGE SHALL NOT OBSTRUCT GROWN. PROVIDE BLOCKING AS NECESSARY.
7. ROOF SUBSTRATE SHALL BE 5/8" ZIP SYSTEM UNLESS OTHERWISE NOTED.

NOTE:
ALL RAFTERS SHALL BE 2X10 SPF #1/#2 AT 16" O.C. UNLESS NOTED OTHERWISE

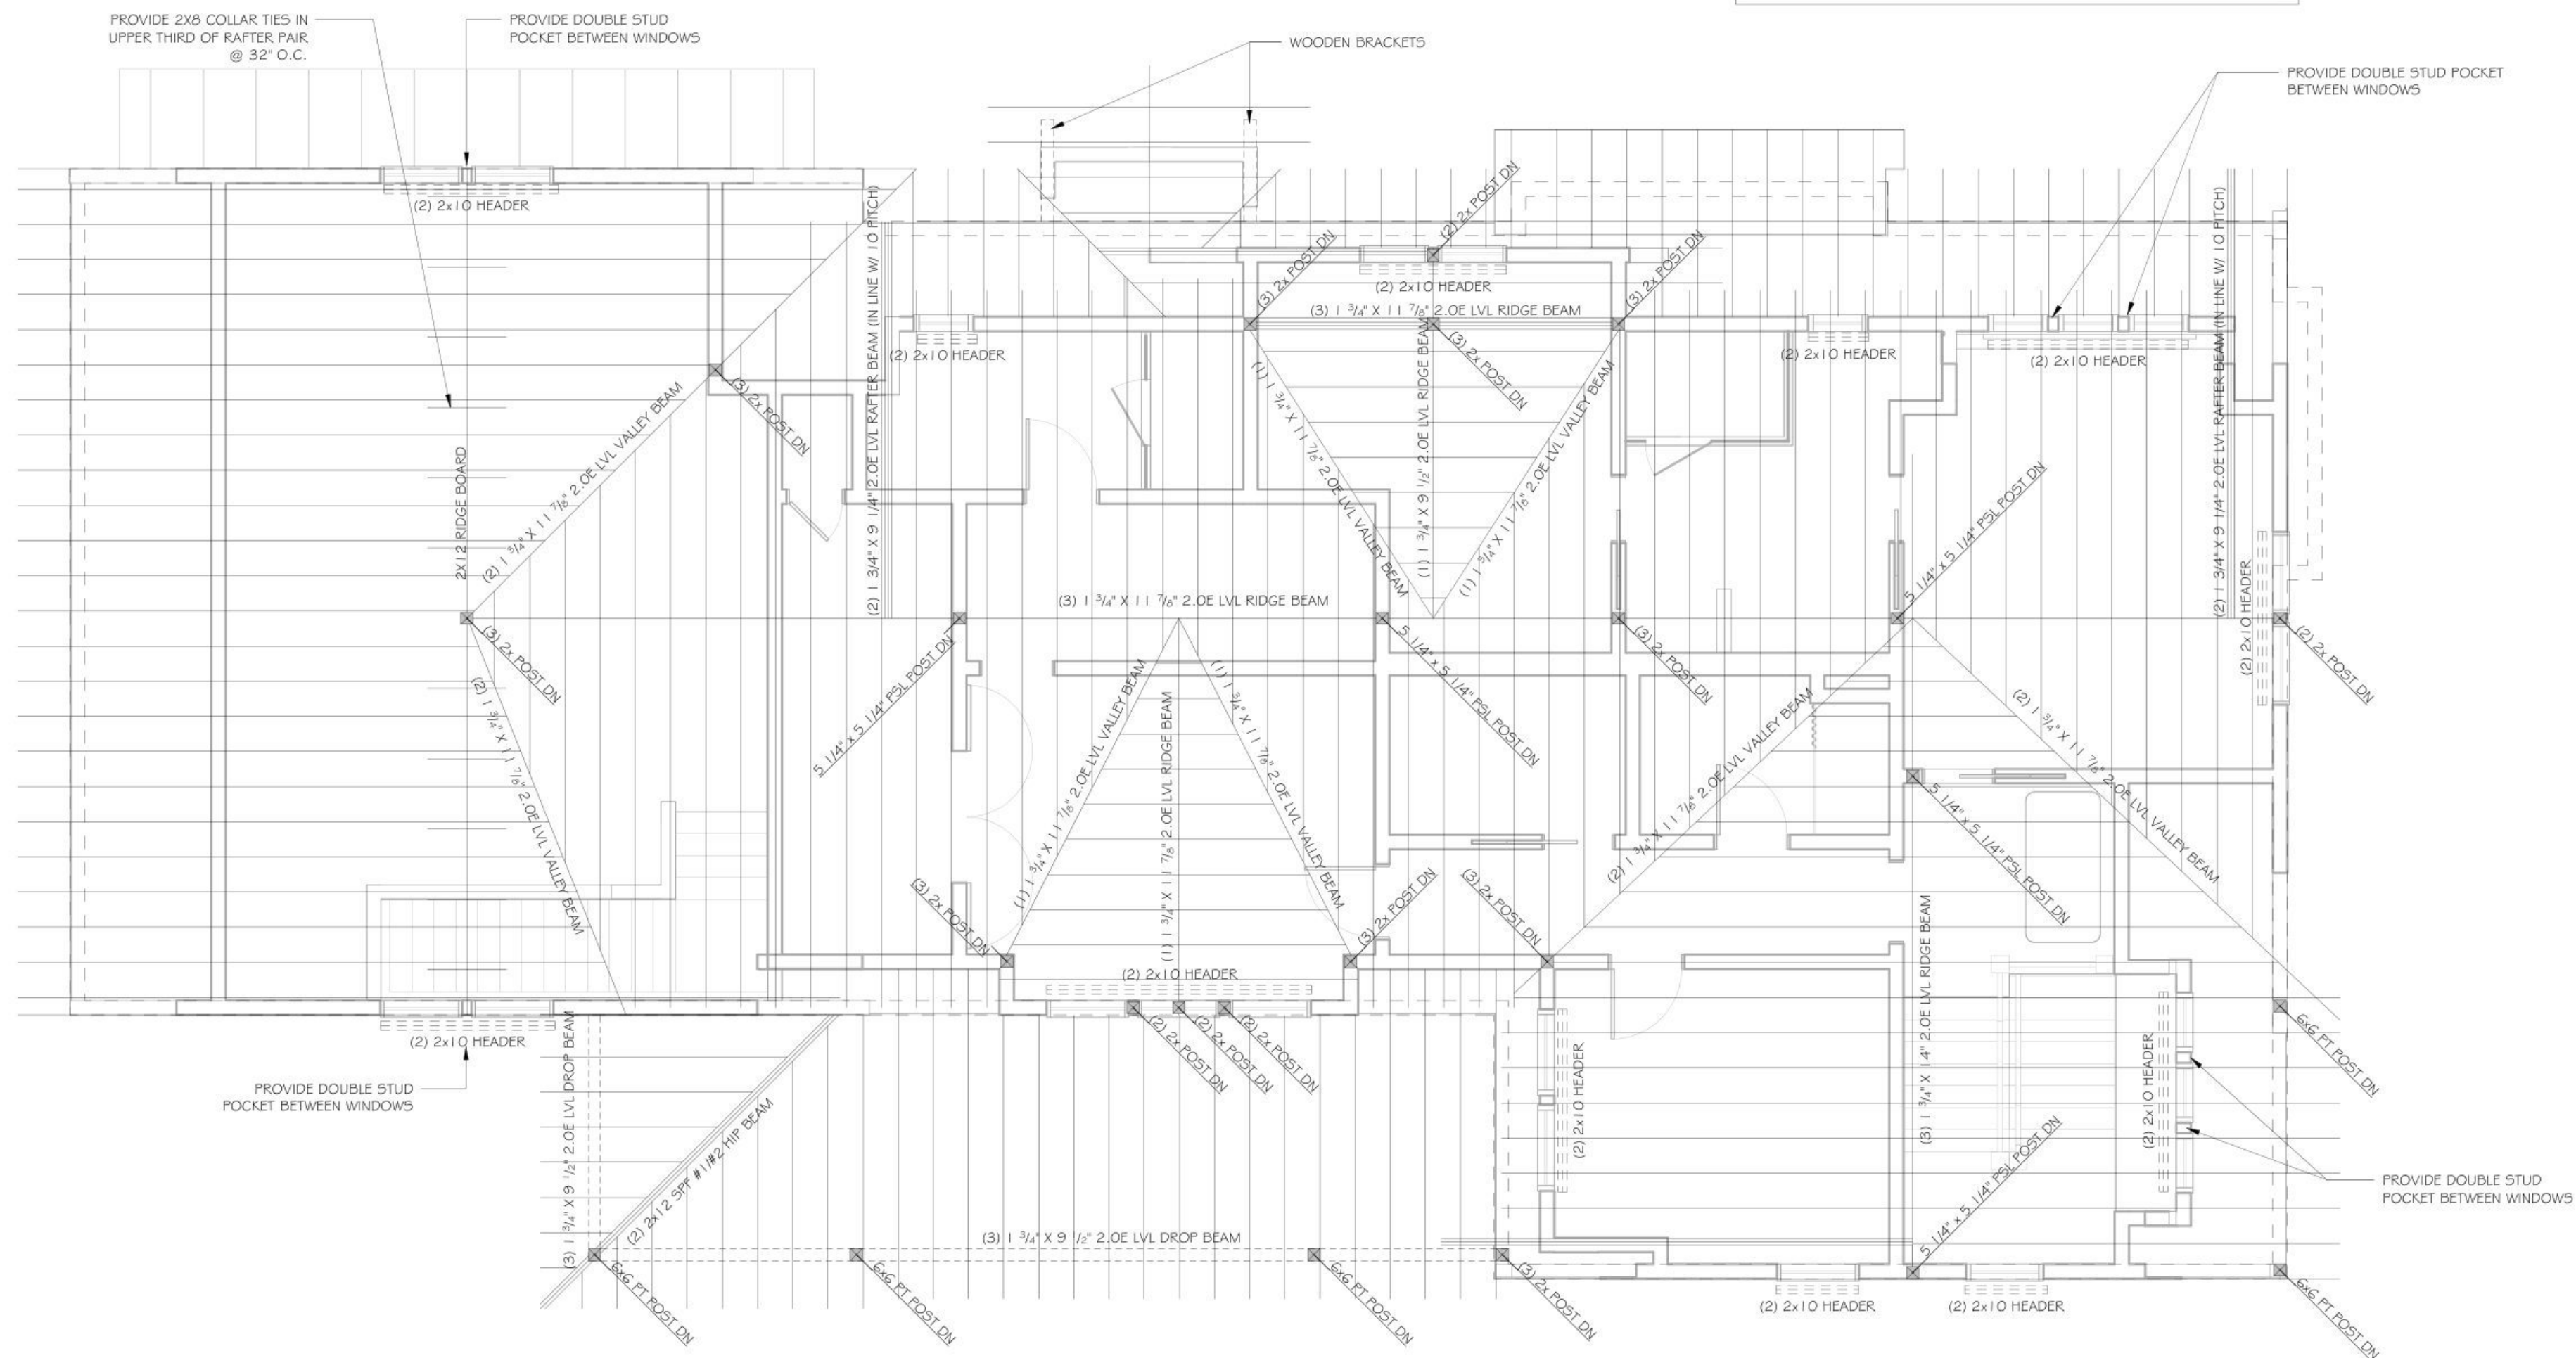

① ROOF FRAMING PLAN
1/4" = 1'-0"