


FOUNDATION KEYNOTES

- ① 4" REINFORCED CONCRETE SLAB ON GRADE OVER 10 MIL VAPOR BARRIER OVER 6" CAPILLARY BREAK REINFORCE SLAB WITH #4 AT 18" OC EACH WAY AT CL OF SLAB. SEE GEOTECHNICAL ENGINEERING REPORT FOR SUBBASE AND CAPILLARY BREAK REQUIREMENTS. REFERENCE ELEV 0.0'
- ② HATCHED REGION INDICATES ARCHITECTUALLY POLISHED CONCRETE AT EXPOSED SLAB ON GRADE LOCATIONS. PROVIDE 6" THICK CONCRETE SLAB AND SEE KEYNOTE 1 FOR CALLOUTS.
- ③ STEP FOOTING PER 6 / SA020
- ④ HOUSEKEEPING PAD PER MECH / ELECT - SEE 3 / SA301

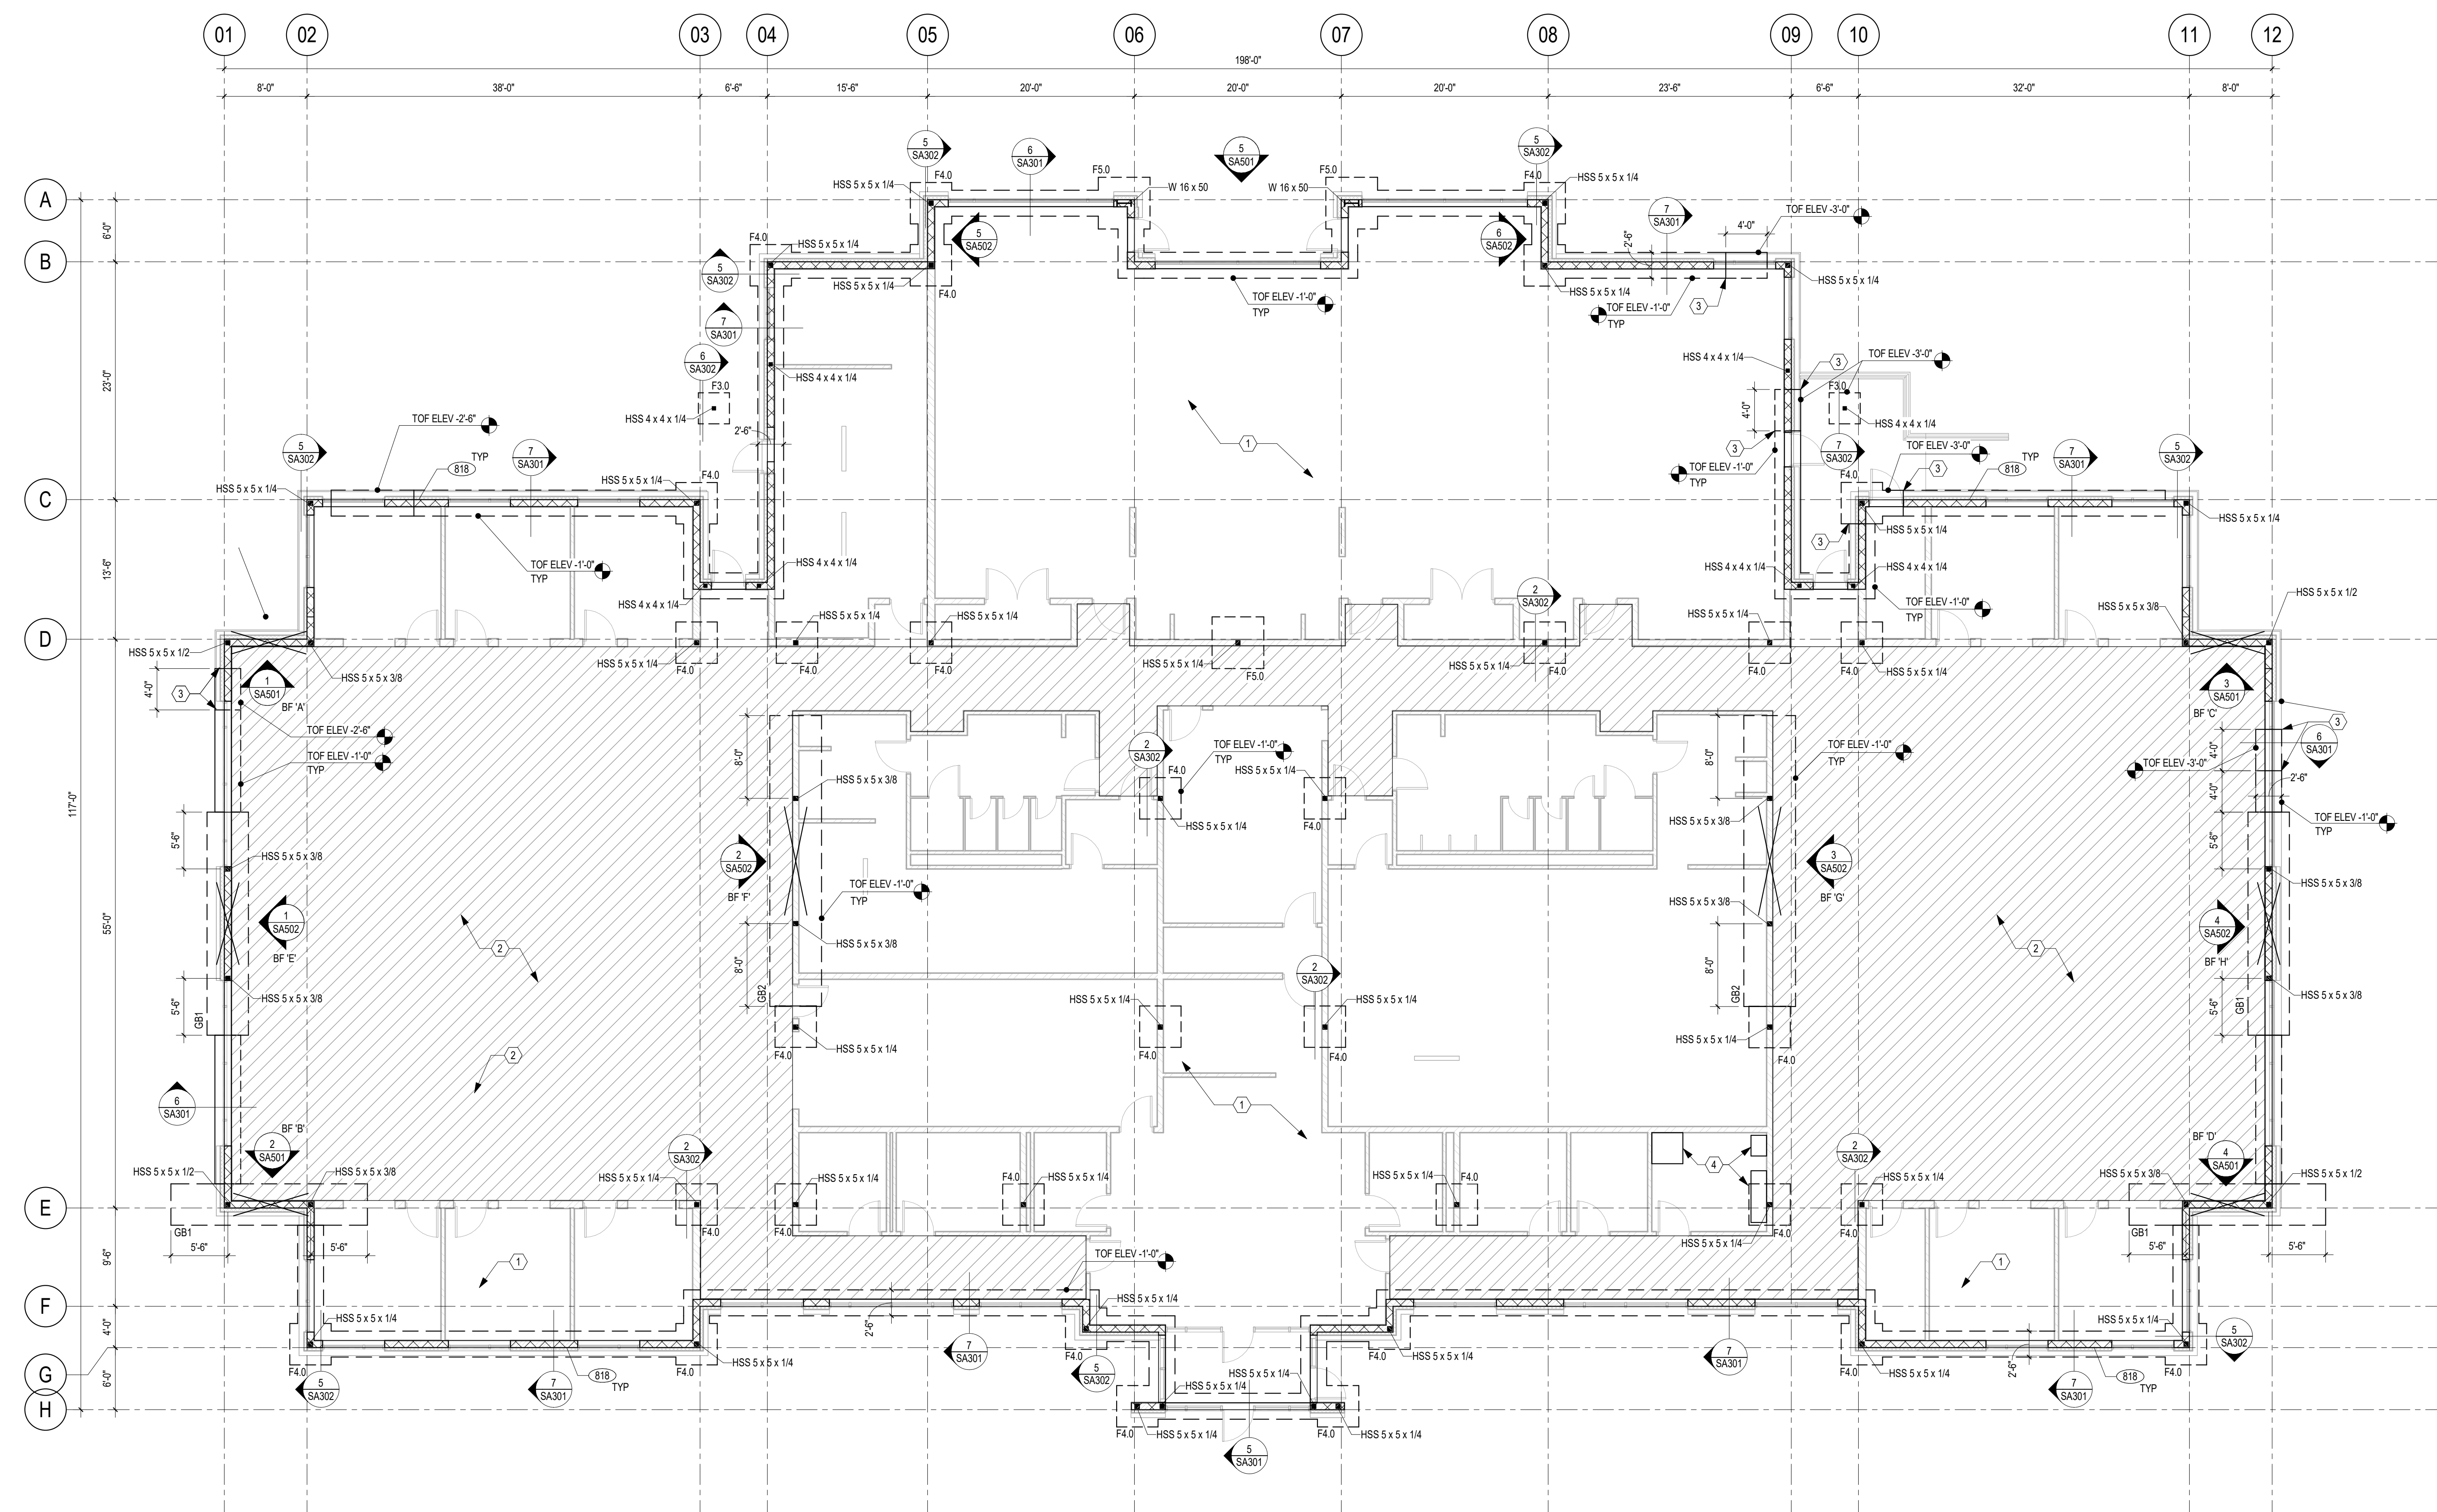

1/8" = 1'-0"

0 4' 8' 16'

SCALE IN FEET



UNOFFICIAL COPY Official bid documents, plan holder's list, and addenda (if applicable) are available on BXWA.com