

GENERAL NOTES ARE INTENDED TO SUPPLEMENT THE DRAWINGS AND SPECIFICATIONS. NOT ALL NOTES APPLY TO THIS PROJECT. SPECIFIC TRADE NOTES TAKE PRECEDENCE OVER THESE GENERAL NOTES.

1. DESIGN LOADS:

- A. BUILDING CODE - 2015 IRC
B. ROOF LIVE LOAD - 20 PSF
C. GROUND SNOW LOAD - 20 PSF
D. WIND SPEED BASIC - 115 MPH

2. FOUNDATIONS:

A. FOOTINGS ARE DESIGNED TO BEAR ON EXISTING NATURALLY OCCURRING SOILS OR ENGINEERED FILL CAPABLE OF SAFELY SUSTAINING 1,500 PSF.

B. BACKFILL AGAINST ANY WALLS OR CONSTRUCTION SHALL NOT BE PLACED UNLESS THE WALLS ARE ADEQUATELY BRACED TO WITHSTAND THE LOADS IMPOSED DUE TO BACKFILLING. FOOTING SIZES SHALL BE ADJUSTED IF REQUIRED BY SOILS ENGINEER. ALL COMPACTED FILL INSTALLATION SHALL BE INSPECTED AND APPROVED BY A REGISTERED SOILS ENGINEER.

C. UNDERCUT BUILDING AREA AND INSTALL A MINIMUM OF 1 8" OF SELECT, LOW VOLUME CHANGE FILL BELOW ALL FLOOR SLABS. SEE SOIL REPORT.

D. RE: SPECIFICATIONS FOR OTHER DETAILED REQUIREMENTS FOR PLACING CONCRETE FOR FOUNDATIONS.

3. CONCRETE

A. ALL CONCRETE USED FOR FOUNDATIONS SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI IN 28 DAYS. ALL CONCRETE USED FOR SLABS ON GRADE SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI IN 28 DAYS.

B. ALL CONCRETE EXPOSED TO FREEZING SHALL BE AIR ENTRAINED. NO ALUMINUM ITEMS SHALL BE EMBEDDED IN ANY CONCRETE. CHLORIDES IN ANY FORM OR CONCENTRATION SHALL NOT BE ADDED TO ANY CONCRETE.

C. CONSTRUCTION JOINTS IN BEAMS, SLABS, AND GRADE BEAMS SHALL OCCUR AT MIDSFAN (MIDDLE THIRD). PROVIDE 2X4 HORIZONTAL KEYS AT CONSTRUCTION JOINTS.

D. ALL CONCRETE OPERATIONS, INCLUDING BUT NOT LIMITED TO MIX DESIGN, MIXING, TRANSPORTING, PLACING, REINFORCING DETAILING AND PLACING, CURING, AND TESTING SHALL BE DONE IN ACCORDANCE WITH THE PROVISIONS OF THE LATEST APPLICABLE RECOMMENDATION OF THE ACI MANUAL OF CONCRETE PRACTICE.

4. REINFORCING STEEL:

A. ALL REINFORCING STEEL SHALL BE A-615, GRADE 60 STEEL.

B. ALL WELDED WIRE FABRIC SHALL BE ASTM A105.

C. UNLESS OTHERWISE NOTED, STANDARD COVERAGE OF BARS SHALL BE:
WHERE EARTH FORMED - 3 INCHES
SLABS OR JOISTS - 3/4 INCH
BEAMS OR COLUMNS - 1-1/2 INCHES
OTHER - 2 INCHES

D. BARS MARKED CONTINUOUS AND ALL VERTICAL STEEL SHALL BE LAPPED OR EMBEDDED TO DEVELOP THE FULL TENSILE CAPABILITY OF THE BAR LAPS SHALL BE CLASS B. UNLESS SHOWN OTHERWISE SPLICE TOP BARS NEAR MIDSFAN AND SPLICE BOTTOM BARS OVER SUPPORTS.

E. AT CORNERS OF ALL WALLS AND GRADE BEAMS, SUPPLY CORNER BARS 4'-0" LONG MIN. (2'-0" IN EACH DIRECTION OR 30 BAR DIAMETERS) IN OUTSIDE FACE OF WALL MATCHING SIZE AND SPACING OF HORIZONTAL BARS. WHERE THERE ARE NO VERTICAL BARS IN OUTSIDE FACE OF WALL, SUPPLY THREE #4 VERTICAL SUPPORT BARS FOR CORNER BARS.

F. ALL CONCRETE IS REINFORCED CONCRETE UNLESS SPECIFICALLY CALLED OUT AS UNREINFORCED. REINFORCE ALL CONCRETE NOT OTHERWISE SHOWN WITH THE SAME STEEL AS IN SIMILAR SECTIONS OR AREAS. REFER TO EITHER ACI 318 OR ACI 318-08 FOR ANY DETAILS NOT SHOWN.

G. ALL SLABS AND STAIRS NOT SHOWN OTHERWISE SHALL BE 8" THICK WITH #4 BARS AT 6" O.C. EACH WAY. ALL EXTERIOR PORCHES AND STOOPS NOT OTHERWISE DETAILED MAY BE CONSTRUCTED IN ANY STANDARD MANNER, SOLID OR HOLLOW, BUT MUST BE REINFORCED WITH #4 BARS @ 12" O.C. EACH WAY MIN. PORCHES SHALL BE DOWELED TO ADJACENT WALLS OR GRADE BEAMS WITH #4 BARS AT 12" O.C. HOOKED OR EMBEDDED 30 DIAMETERS INTO BOTH MEMBERS. SLOPE PORCHES 1/8" PER FOOT FOR DRAINAGE UNLESS NOTED OTHERWISE.

H. CONTROL JOINTS IN EARTH FORMED SLABS TO BE AS SHOWN ON PLANS. WHERE NOT SHOWN, CONTROLLED AREAS SHALL NOT BE MORE THAN 300 SQUARE FEET, NOR SHALL THEY BE GREATER THAN 15 FEET ON ANY SIDE.

I. ACCESSORIES SHALL BE AS SPECIFIED IN LATEST EDITION OF CRSI DESIGN HANDBOOK. MAXIMUM ACCESSORY SPACING SHALL BE 4'-0" O.C.

J. AT ALL HOLES IN CONCRETE WALLS AND SLABS, ADD TWO #5 BARS (OPENING DIMENSION PLUS 60 DIAMETERS LONG) AT EACH OF FOUR SIDES AND ADD TWO #5 X 5'-0" DIAGONALLY AT EACH OF THE FOUR CORNERS OF THE HOLE. IN 8" WALL OPENINGS REINFORCE SAME, BUT ONE #5 INSTEAD OF TWO #55 RESPECTIVELY.

5. STRUCTURAL STEEL:

A. ALL STRUCTURAL STEEL USED FOR WIDE FLANGE SHAPES SHALL BE ASTM A992. PLATES, ANGLES AND CHANNELS SHALL BE ASTM A36, UNLESS NOTED OTHERWISE ON PLAN. PIPE SHALL BE ASTM A53. TUBE SHALL BE A500, GRADE B. FABRICATION AND ERECTION SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE AISC MANUAL OF STEEL CONSTRUCTION.

B. ALL BEAM CONNECTIONS SHALL BE WELDED OR BOLTED PER LATEST EDITION OF AISC HANDBOOK, FRAMED BEAM CONNECTIONS. BOLTS SHALL BE A-325N, EXCEPT AS NOTED. WELDS SHALL BE PERFORMED BY A CERTIFIED WELDER CONFORMING TO THE REQUIREMENTS OF AWS USING E-TO ELECTRODES.

C. LINTELS OVER ALL OPENINGS IN WALLS NOT OTHERWISE COVERED SHALL BE 6" X 3-1/2" X 5/16" ANGLE FOR EACH 4" OF MASONRY.

6. MASONRY:

A. CONCRETE BLOCK USED IN EXTERIOR WALLS OR LOAD BEARING WALLS SHALL BE A MINIMUM COMPRESSIVE STRENGTH, FM, OF 1,350 PSI. MASONRY SHALL BE LAID UP USING TYPE N MORTAR ONLY.

B. ALL BOND BEAMS AND ANY BLOCK CELLS CONTAINING EMBEDMENTS, REINFORCING STEEL, ANCHORS, ETC., SHALL BE FILLED WITH 3,000 PSI CONCRETE.

C. ALL VERTICAL WALL REINFORCING SHALL EXTEND TO THE TOP OF THE WALL AND BE TERMINATED WITH A #4 HOOKED DOWEL AT THE TOP OF THE WALL UNLESS THE TOP OF THE WALL IS 16" OR HIGHER ABOVE JOIST BEARING OR ROOF DECK CONNECTION ELEVATION.

D. ALL CONCRETE MASONRY OPERATIONS SHALL BE DONE IN ACCORDANCE WITH THE PROVISIONS OF THE LATEST APPLICABLE RECOMMENDATIONS OF THE ACI MANUAL OF CONCRETE PRACTICE.

E. PROVIDE ADDITIONAL VERTICAL REINFORCING, MATCHING WALL REINFORCING, FULL HEIGHT AT EACH DOOR, JAMB, WINDOW JAMB, MECHANICAL OPENING, CONTROL JOINT, OR OTHER MASONRY DISCONTINUITY. LOCATE REINFORCING SO AS TO BE CONTINUOUS WITHOUT INTERFERING WITH LINTEL BEARING.

F. LAP ALL BARS 48 BAR DIAMETERS.

7. WOOD

WALLS

A. EXTERIOR WALLS AND LOAD BEARING WALLS: 5/8" EXTERIOR GYPSUM SHEATHING ON OUTSIDE PLUS 5/8" GYPSUM WALLBOARD ON INSIDE. ALL GYPSUM BOARD NAILED WITH 5D COOLER OR PARKER NAILS AT 7" O.C. AT ALL SHEET ENDS AND EDGES AND AT ALL INTERMEDIATE SUPPORTS.

B. OSB SHEAR WALLS: OSB THICKNESS, LOCATION AND NAILING PER PLAN. BLOCK ALL EDGES.

C. INTERIOR PARTITIONS NOT OTHERWISE DETAILED: 5/8" GYPSUM BOARD NAILED WITH 5D COOLER OR PARKER NAILS AT 7" O.C. TO ALL STUDS AND PLATES. BLOCKING IS NOT REQUIRED.

D. NAILING OF WALL MATERIALS SHALL BE AS REQUIRED FOR "EDGE CONDITION TO ANY STUD WHICH IS ANCHORED TO RESIST UPLIFT, REGARDLESS OF WHERE THE STUD OCCURS WITHIN THE SHEAR PANEL.

MINIMUM NAILING SCHEDULE

A. CONTRACTOR SHALL THOROUGHLY FAMILIARIZED HIMSELF WITH THE NAILING SCHEDULES FOUND IN THE BUILDING CODE. WHERE NOT SHOWN OTHERWISE ON PLANS OR IN SCHEDULE BELOW, ALL NAILING SHALL BE AS INDICATED IN THE BUILDING CODE.

B. COMMON NAILS SHALL BE USED UNLESS NOTED OTHERWISE.

C. OSB ROOF SHEATHING: NAIL WITH 10D COMMON NAILS AT 6" O.C. ALONG ALL EAVES, RIDGES, AND SUPPORTED EDGES OF PLYWOOD SHEETS. NAIL WITH 10D COMMON NAILS AT 12" O.C. TO INTERMEDIATE SUPPORTS, UNLESS NOTED OTHERWISE.

D. EAVE MEMBERS TO ENDS OF ROOF TRUSSES, FACE NAIL 2-16D TOP PLATE SPLICE, EACH SIDE OF BUTT JOINT 8-16D SOLE PLATE TO JOIST AND SQUASH BLOCKS, FACE NAIL 2-16D SOLE PLATE TO RIM OR BAND JOIST, FACE NAIL 16D AT 8" O.C. RIM OR BAND JOIST TO TOP PLATE, TOENAILS 16D AT 8" O.C. JOIST TO TOP PLATE, TOENAIL 3-12D DOUBLE STUDS, FACE NAIL 16D AT 12" O.C. BUILT-UP CORNER STUDS, FACE NAIL 16D AT 12" O.C. PLYWOOD SUBFLOOR-EDGE NAIL WITH 8D COMMON NAILS AT 6" O.C. ALONG ALL SUPPORTED EDGES OF PLYWOOD SHEETS AND AT 12" O.C. TO INTERMEDIATE SUPPORTS.

WOOD CONSTRUCTION

A. FLOOR JOISTS, HEADERS, ROOF RAFTERS, CEILING JOISTS, BLOCKING BETWEEN PLATES, AND ALL OTHER FRAMING LUMBER NOT OTHERWISE DESIGNATED SHALL BE NO. 2 SOUTHERN PINE S.D., 1 9/8 M.C. OR NO. 2 DOUGLAS FIR-LARCH.

B. MICROLAM BEAMS TO BE TRUSS JOIST CORPORATION'S 'MICROLAM' LUMBER BEAMS WITH MINIMUM E = 2000 KSI, MINIMUM FB = 2800 PSI, AND MINIMUM FX = 285 PSI.

C. STUDS IN EXTERIOR BEARING WALLS SHALL BE 2X6 STUDS @ 16" O.C. EXCEPT WHERE NOTED OTHERWISE. STUDS IN BEARING WALLS TO BE SPRUCE-PINE-FIR NO.1 / NO.2 1 9/8 M.C. OR SOUTHERN PINE SELECT STRUCTURAL STUDS IN INTERIOR SHALL BE 2X4S @ 16" O.C.

D. JAMBS: EXCEPT WHERE NOTED OTHERWISE, JAMBS TO BE TRIPLE STUDS (2 FULL + 1 TRIMMER). WRAP ALL SLEEPING ROOM DOOR OPENINGS WITH CLOSED CELL FOAM POLYETHYLENE (SILL SEALER) PRIOR TO FRAME INSTALLATION FOR NOISE REDUCTION.

E. TOP PLATES SUPPORTING ROOF TRUSSES OR FLOOR JOISTS ON INTERIOR AND BEARING WALL SHALL BE SPRUCE-PINE-FIR NO.1 / NO.2 OR S.D. FINE SELECT STRUCTURAL, 1 9/8 M.C. ALL OTHER PLATES MAY BE STUD GRADE DOUGLAS FIR-LARCH OR STUD GRADE SOUTHERN PINE, S.D. 1 9/8 M.C.

F. TOP PLATES IN BEARING WALLS SHALL BE DOUBLE END JOINTS IN DOUBLE TOP PLATES SHALL BE OFFSET AT LEAST 48" AT SPLICES. USE 16-16D COMMON NAILS EACH TOP PLATE SPLICE, 1/2 EACH SIDE OF SPLICE, UNLESS NOTED OTHERWISE.

G. SILL PLATES ON CONCRETE IN DIRECT CONTACT WITH EARTH SHALL BE TREATED. UNLESS SHOWN OTHERWISE IN THE SPECIFICATIONS, TREATED LUMBER SHALL BE TREATED WITH ZINC CHLORIDE OR MOLYBDAEN SALTS WITH ARSENIC CONTENT, APPLIED IN ACCORDANCE WITH STANDARD SPECIFICATIONS OF AMERICAN WOOD PRESERVERS ASSOCIATION.

H. SILL ANCHORS: INSTALL PER IRC 2303.3, BOLTS TO BE 1/2" DIAMETER F1554 GRADE 36 STANDARD J-BOLTS, STEEL BOLTS, OR APPROVED ANCHORS 1/4" AT LEAST 1" EMBEDMENT IN CONCRETE SLAB @ 6'-0" O.C.. INSTALL SILL WITH STANDARD CUT WASHER UNDER NUT.

I. ROOF SHEATHING TO BE 5/8" OSB SHEATHING OR BETTER.

J. PLYWOOD SUBFLOORING TO BE 3/4" T&G.

K. METAL HANGERS, TIEDOWNS, FRAMING CLIPS, BASES, CAPS, STRAPS, AND SIMILAR HARDWARE TO BE SIMPSON STRONG TIE, OR AN APPROVED EQUAL. WHERE EXPOSED TO WEATHER OR USED WITH TREATED WOOD, USE CORROSION RESISTANT TYPE.

L. ROOF TRUSSES SHALL BE AS SHOWN ON DRAWINGS AND SHALL BE SPACED ON 24" MAXIMUM CENTERS. TRUSSES SHALL BE DESIGNED BY THE SUPPLIER IN ACCORDANCE WITH THE REQUIREMENTS OF THE TRUSS PLATE INSTITUTE, AMERICAN INSTITUTE OF TIMBER CONSTRUCTION, AND THE INTERNATIONAL BUILDING CODE. WHERE REQUIREMENTS OF THESE AGENCIES DIFFER, THE STRICTER RULES SHALL GOVERN.

M. TRUSS MANUFACTURER TO PROVIDE CERTIFICATION FROM AN APPROVED QUALITY CONTROL AGENCY RETAINED BY THE MANUFACTURER, THAT ALL IN-PLANT OPERATIONS AND METHODS USED IN THE MANUFACTURING, HANDLING, AND DELIVERY OF THESE TRUSSES ARE IN COMPLIANCE WITH THE APPLICABLE REQUIREMENTS OF IRC.

N. WOOD TRUSS SUPPLIER SHALL SUPPLY COMPLETE DESIGN CALCULATIONS AND ERECTION DRAWINGS TO THE ARCHITECT. ALL DESIGN CALCULATIONS AND ERECTION DRAWINGS SHALL BE DONE BY OR UNDER THE DIRECT SUPERVISION OR, AND ALL DOCUMENTS SHALL BE SEALED BY A STRUCTURAL ENGINEER LICENSED TO PRACTICE IN THE STATE WHERE THE PROJECT IS LOCATED. CALCULATIONS AND DETAILS SHALL REFLECT ALL EFFECTS OF UPLIFT, RESCRIBED IN THE BUILDING CODE. ERECTION DRAWINGS SHALL BE COMPLETE WITH ALL BRACING, BRIDGING, AND ANCHORAGE DETAILS FOR ALL BRACING, TEMPORARY OR PERMANENT. ALL TRUSS TO TRUSS OR JOIST OR HEADER TO TRUSS CONNECTIONS SHALL BE DESIGNED, DETAILED, AND HARDWARE SHALL BE SPECIFIED BY THE TRUSS MANUFACTURER. TRUSSES SHALL BE DESIGNED SPECIFICALLY FOR THE HARDWARE SUPPLIED.

O. REQUIRED TRUSS OR GIRDER BEARING LENGTH SHALL NOT EXCEED WIDTH OF STUD WALL AND TRUSSES SHALL NOT EXCEED THOSE ALLOWED FOR THE SPECIES AND GRADE OF LUMBER USED FOR THE WALL CONSTRUCTION. GIRDER REACTIONS AND ANY SPECIAL BEARING DETAILS REQUIRED SHALL BE CLEARLY SHOWN ON THE ERECTION DRAWINGS.

P. BLOCK WITH SOLID BLOCKING BETWEEN TRUSSES AND RAFTERS OVER BEARING WALLS. SHAPE TOP OF BLOCKING TO FIT SLOPE OF OSB. NAIL OSB TO BLOCKING WITH 10D COMMON NAILS AT 6" O.C. NAIL BLOCKING TO PLATE WITH 12D NAILS @ 8" O.C. EACH SIDE, STAGGERED.

Q. BLOCK ALL VALLEYS, RIDGES, AND HIPPS. NAIL OSB TO BLOCKING WITH 10D COMMON NAILS AT 6" O.C. WHERE DORMERS OR ROOF INTERSECTIONS OCCUR, CONTINUE OSB SHEATHING TO EDGE OF LOWER ROOF AND BUILD DORMER OR UPPER ROOF OVER A COMPLETE SHEATHED DIAPHRAGM.

R. ROOF TIEDOWNS: TRUSS MANUFACTURER TO SPECIFY. OVER OPENINGS NAIL TOP PLATES TO HEADERS WITH 16D COMMON NAILS AT 8" O.C. TIE HEADERS TO SUPPORT WITH 16 GAGE GALVANIZED STRAP TIE EACH SIDE. USE 8-16D COMMON NAILS, 1/2 EACH END, EACH STRAP TIE.

NOTE: THESE DRAWINGS ARE FOR THIS SPECIFIC BUILDING AND NO OTHER USE IS AUTHORIZED. SEE ARCHITECTURAL AND MECHANICAL DRAWINGS FOR EMBEDDED ITEMS NOT SHOWN HEREIN AND TO VERIFY SIZE AND LOCATION OF ALL OPENINGS. BEFORE EXECUTING ANYTHING HEREIN SHOWING, THE CONTRACTOR SHALL EXAMINE ACTUAL JOB CONDITIONS AND REPORT TO THE ARCHITECT ANY ERROR, OMISSION, OR DIFFICULTY AFFECTING THE WORK.

COMPLY WITH REQUIREMENTS OF THE LOCAL GOVERNING AUTHORITY FOR ENTRANCE APRON FROM STREET. PROVIDE SMOOTH TRANSITION BETWEEN NEW PAVEMENT AND EXISTING.

NOTE:

THESE DRAWINGS, ALONG WITH THE PROJECT SPECIFICATIONS, REPRESENT A UNIFIED SET OF CONSTRUCTION DOCUMENTS. ALL BIDDERS SHALL BE RESPONSIBLE FOR FAMILIARIZING THEMSELVES WITH ALL DRAWINGS IN THIS SET REGARDLESS OF SHEET NUMBER AND DISCIPLINE, AND SHALL BE RESPONSIBLE FOR COORDINATING THEIR WORK WITH THE WORK OF OTHER TRADES. ANY APPARENT DISCREPANCIES BETWEEN DRAWINGS OR BETWEEN THE DRAWINGS AND SPECIFICATIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR TO BIDDING.

DO NOT BID FROM PARTIAL SETS OF BID DOCUMENTS.

BY SUBMITTING A BID, BIDDERS REPRESENT THAT THEY HAVE VISITED THE SITE, BECOME FAMILIAR WITH THE BID DOCUMENTS IN THEIR ENTIRETY, AND WITH LOCAL CONDITIONS UNDER WHICH THE WORKS IS TO BE PERFORMED AND HAVE CORRELATED THE BIDDER'S PERSONAL OBSERVATIONS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.



CITY OF SEDALIA HOUSING HOUSE A SEDALIA, MISSOURI

CODE INFORMATION	2015 INTERNATIONAL RESIDENTIAL CODE (IRC)	DESIGN TEAM:
ONE FAMILY DWELLING		ARCHITECT: ROBERT ROLLINGS ARCHITECTS LLC 1806 WEST BROADWAY SEDALIA, MO 65301 660.829.9751 FAX: 660.829.9752

PROJECT LOCATION	PROJECT OWNER	SHEET ORDER	SHEET NUMBER	SHEET NAME
SEDALIA, MISSOURI	CITY OF SEDALIA	1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18	GO.0 S1.01 S1.02 A1.01 A1.02 A1.03 A1.04 A1.21 A2.01 A3.01 A4.01 A4.02 A5.01 A7.01 M1.01 E1.01 P1.01 F1.02	COVER SHEET FOUNDATION PLAN & DETAILS FRAMING PLANS FLOOR PLANS & NOTES DIMENSION PLANS REFERENCE PLANS & WALL TYPES HOUSE A OPTIONS REFLECTED CEILING PLANS & ROOF PLAN EXTERIOR ELEVATIONS & AREA PLANS BUILDING SECTIONS WALL SECTIONS WALL SECTIONS TYPICAL DETAILS INTERIOR ELEVATIONS & SCHEDULES SCHEMATIC HVAC PLANS SCHEMATIC ELECTRICAL PLANS SCHEMATIC WATER PLANS SCHEMATIC SEWER PLANS

DRAWING NUMBER	4	SHEET NAME WHERE DRAWING IS FOUND
EXTERIOR ELEVATION	A2.01	ROOM/SPACE NAME AND REF. NUMBER
INTERIOR ELEVATION	A3.01	DOOR NUMBER
BUILDING SECTION OR DETAIL SECTION	A3.01	WINDOW TYPE
DETAILED SECTION OR PLAN CALL-OUT	A4.01	KEYED NOTE
		EQUIPMENT NUMBER
		SPOT ELEVATION OR FLOOR ELEVATION
		PLAN NORTH
FIRE EXTINGUISHER CABINET	F.E.C.	CONTROL JOINT

DISCIPLINE	SERIES
G GENERAL	0 GENERAL INFORMATION
C CIVIL	1 PLANS
D DEMOLITION	2 EXTERIOR ELEVATIONS
S STRUCTURAL	3 BUILDING SECTIONS
A ARCHITECTURAL	4 WALL SECTIONS
Q EQUIPMENT	5 DETAILS
M MECHANICAL	6 ENLARGED PLANS
F6 FUEL GAS	7 INTERIOR ELEVATIONS
P PLUMBING	8 STAIRS AND ELEVATORS
E ELECTRICAL	9 SCHEDULES
4	SHEET NAMING CONVENTION
A1.01	SHEET NAMES DO NOT DEFINE LIMITS OF WORK

CITY OF SEDALIA HOUSING - HOUSE A

COPYRIGHT © 2021



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 82.9. 9751
Fax: 660. 82.9. 9752

CROCKETT

ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS 202000151304
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2000003930-0

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	


CITY OF SEDALIA
HOUSING - HOUSE A

4TH & NEW YORK,
SEDALIA, MO

COVER SHEET


DRAWN BY	.
CHECKED BY	Approver
SHEET NUMBER:	

GO.0
80.168

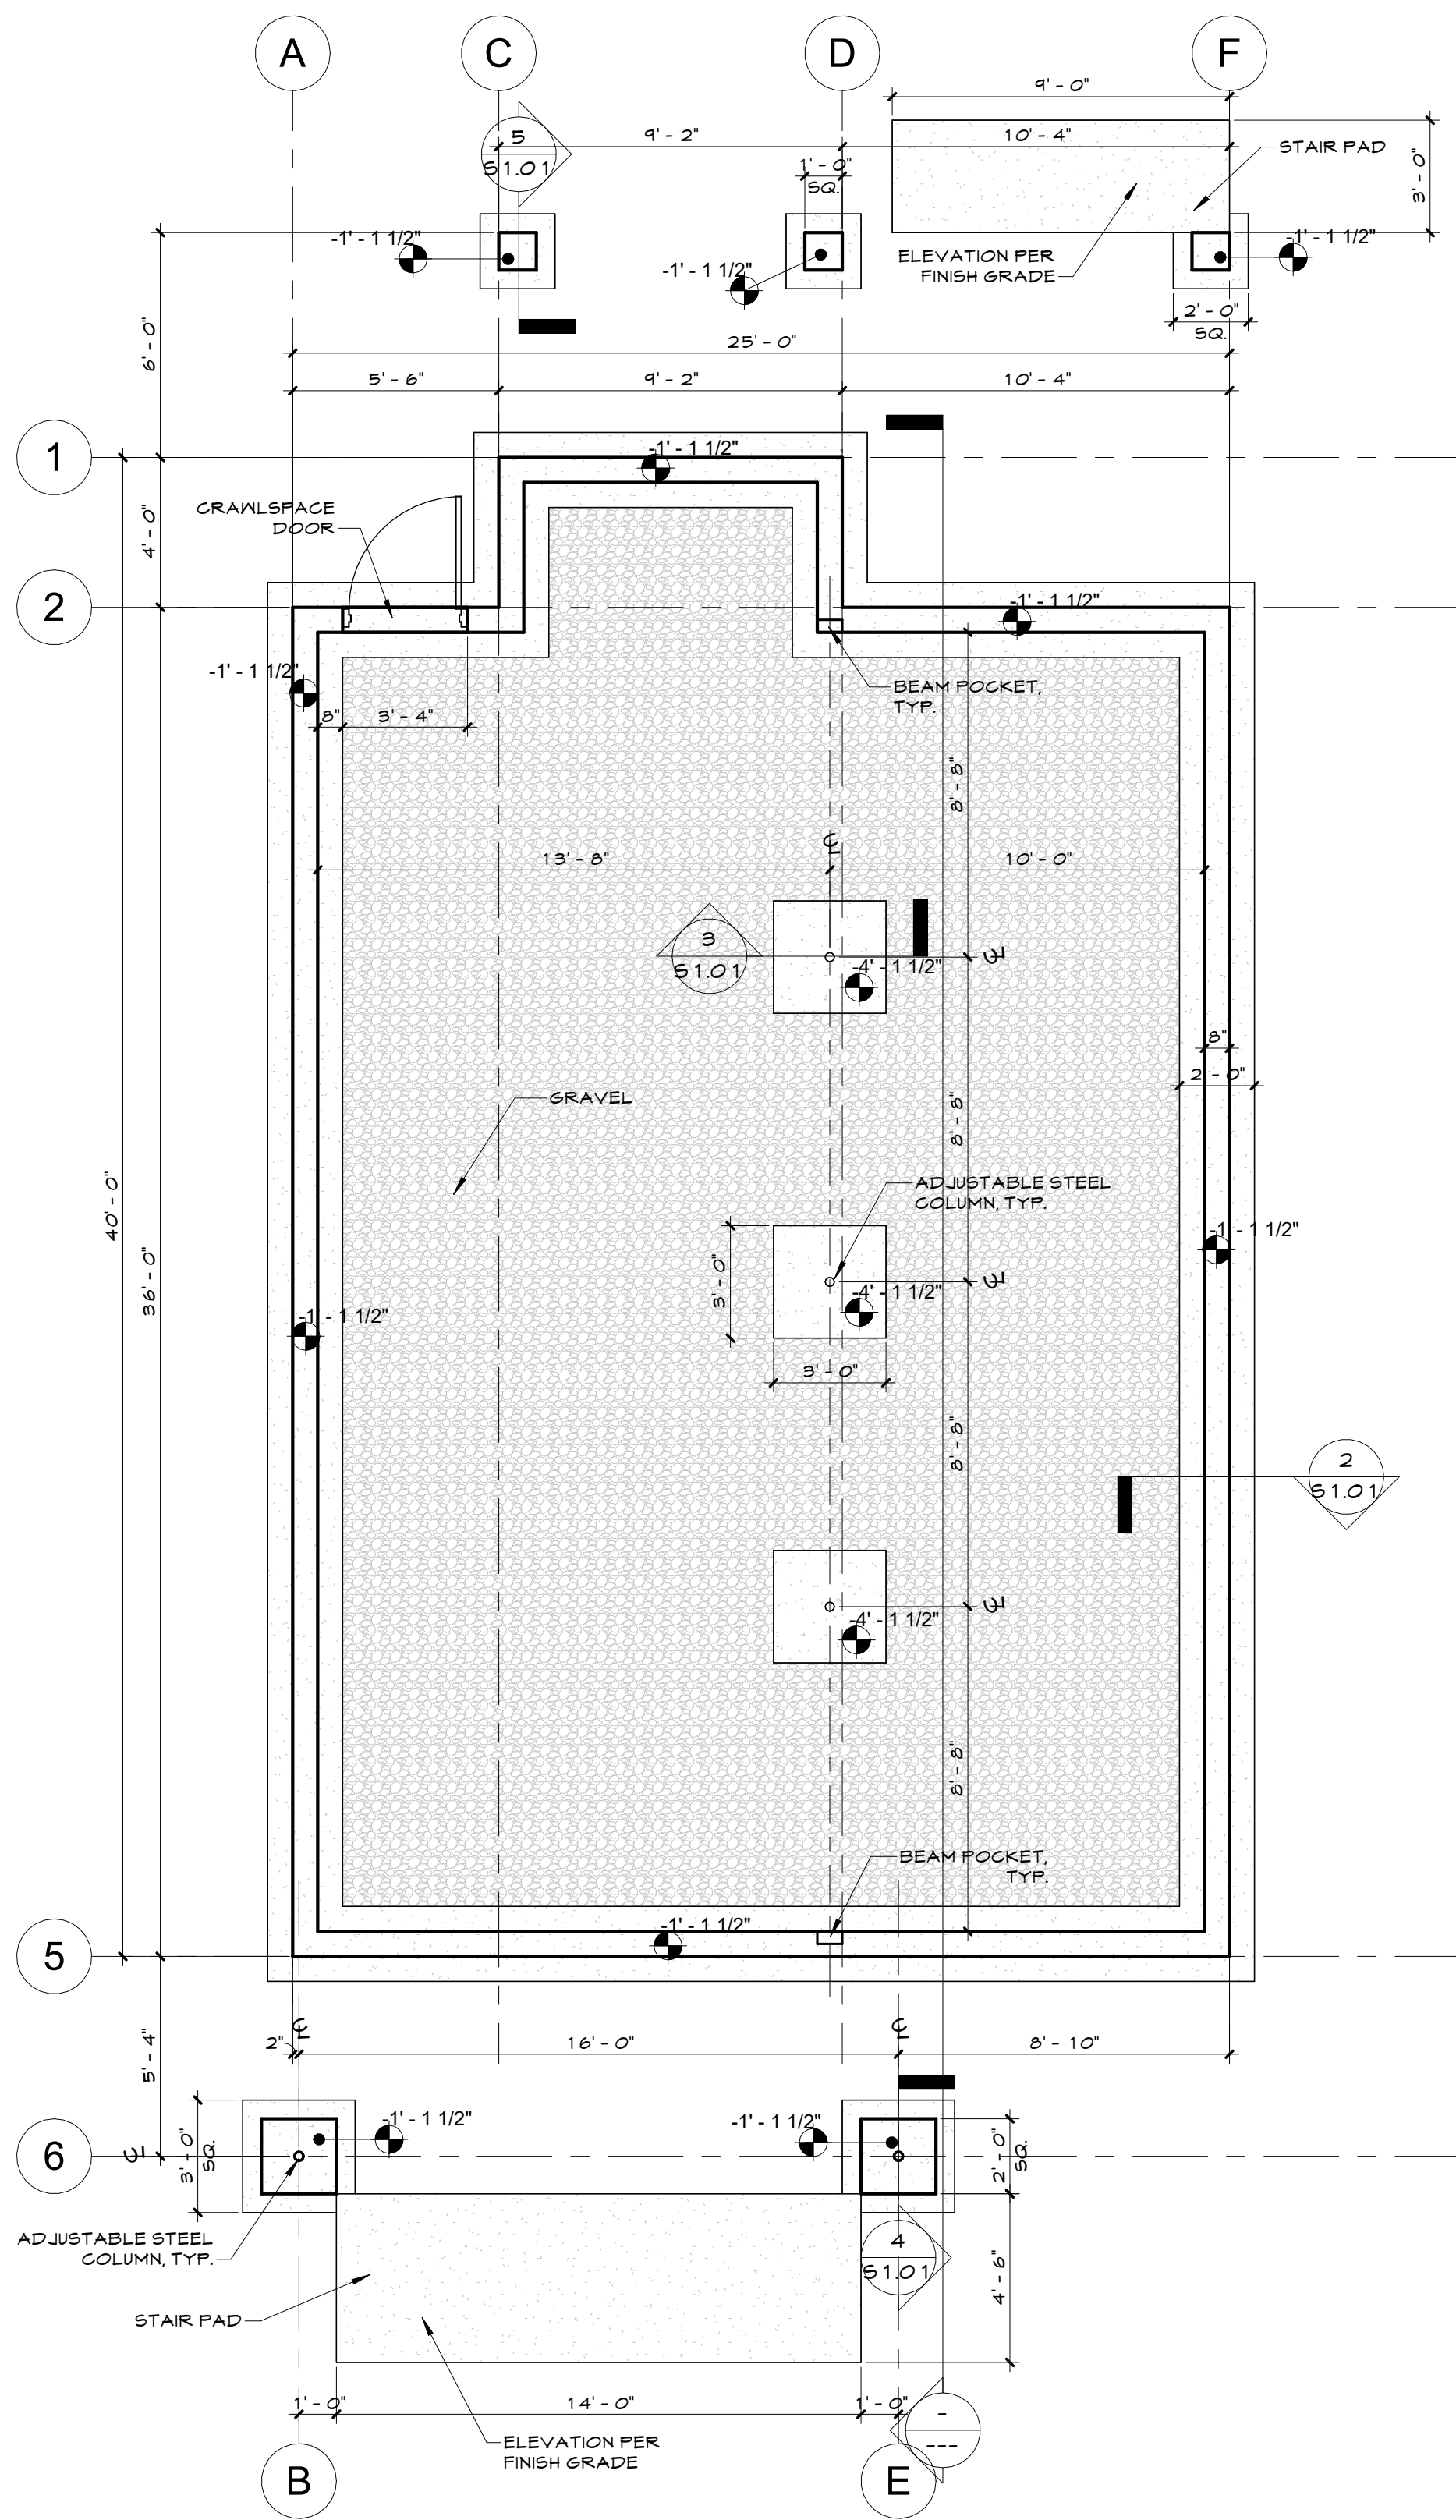


1 FOUNDATION PLAN
1/4" = 1'-0"


CRAWL SPACE FOUNDATION VENTING
TO BE INSTALLED AT 1 S.F. PER 150 S.F.
CRAWL SPACE. (1) VENT TO BE
PLACED WITH 3' OF EACH CORNER OF
BUILDING.

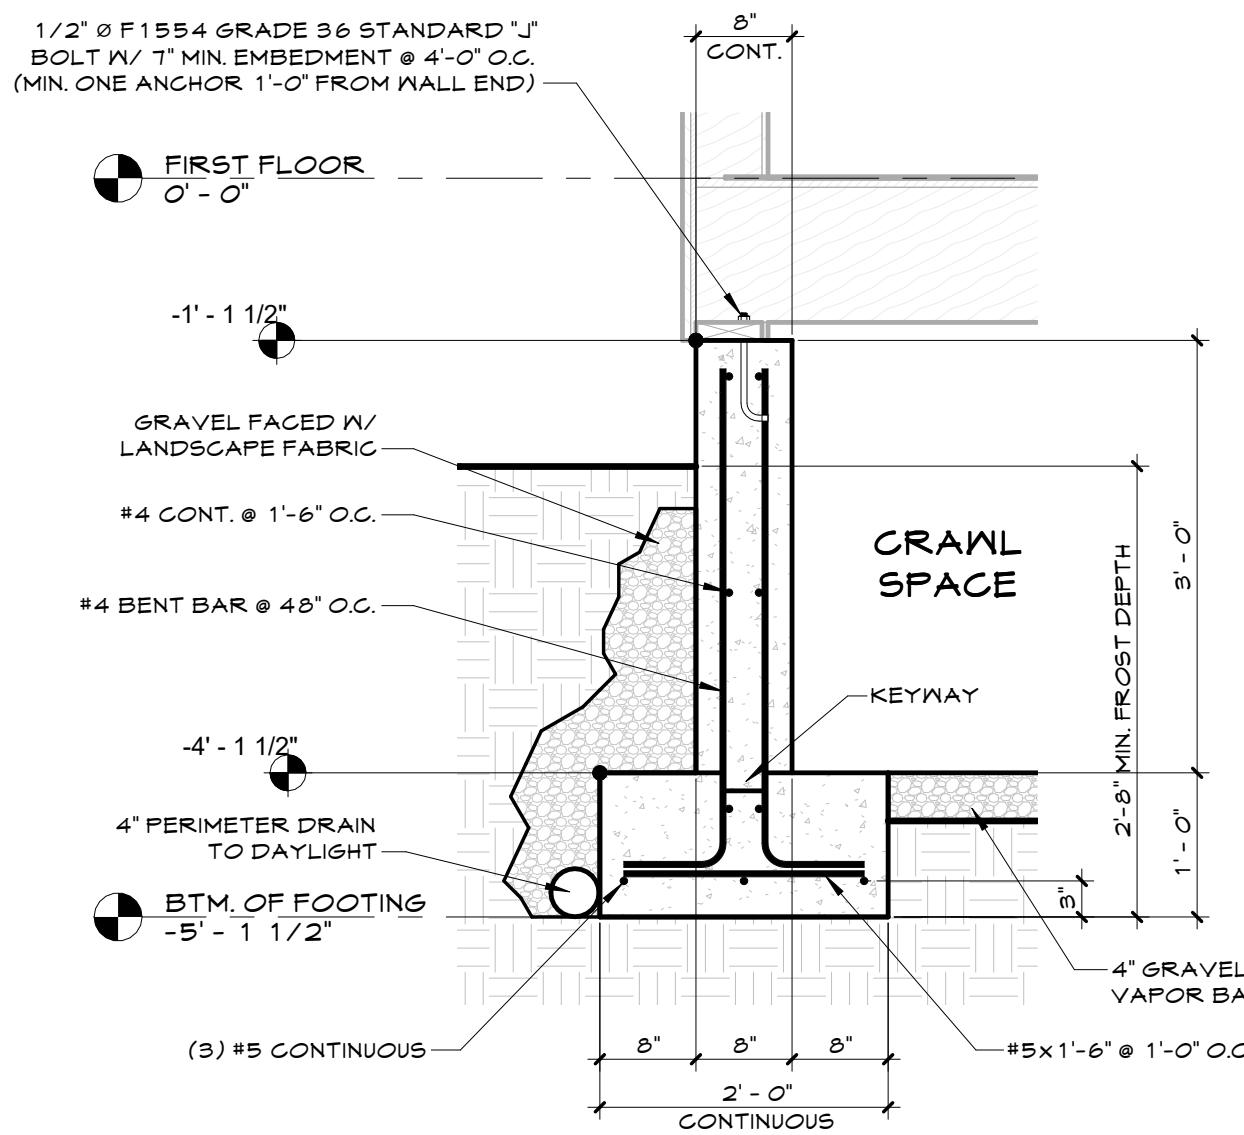


2 HOUSE FOOTING DETAIL
3/4" = 1'-0"

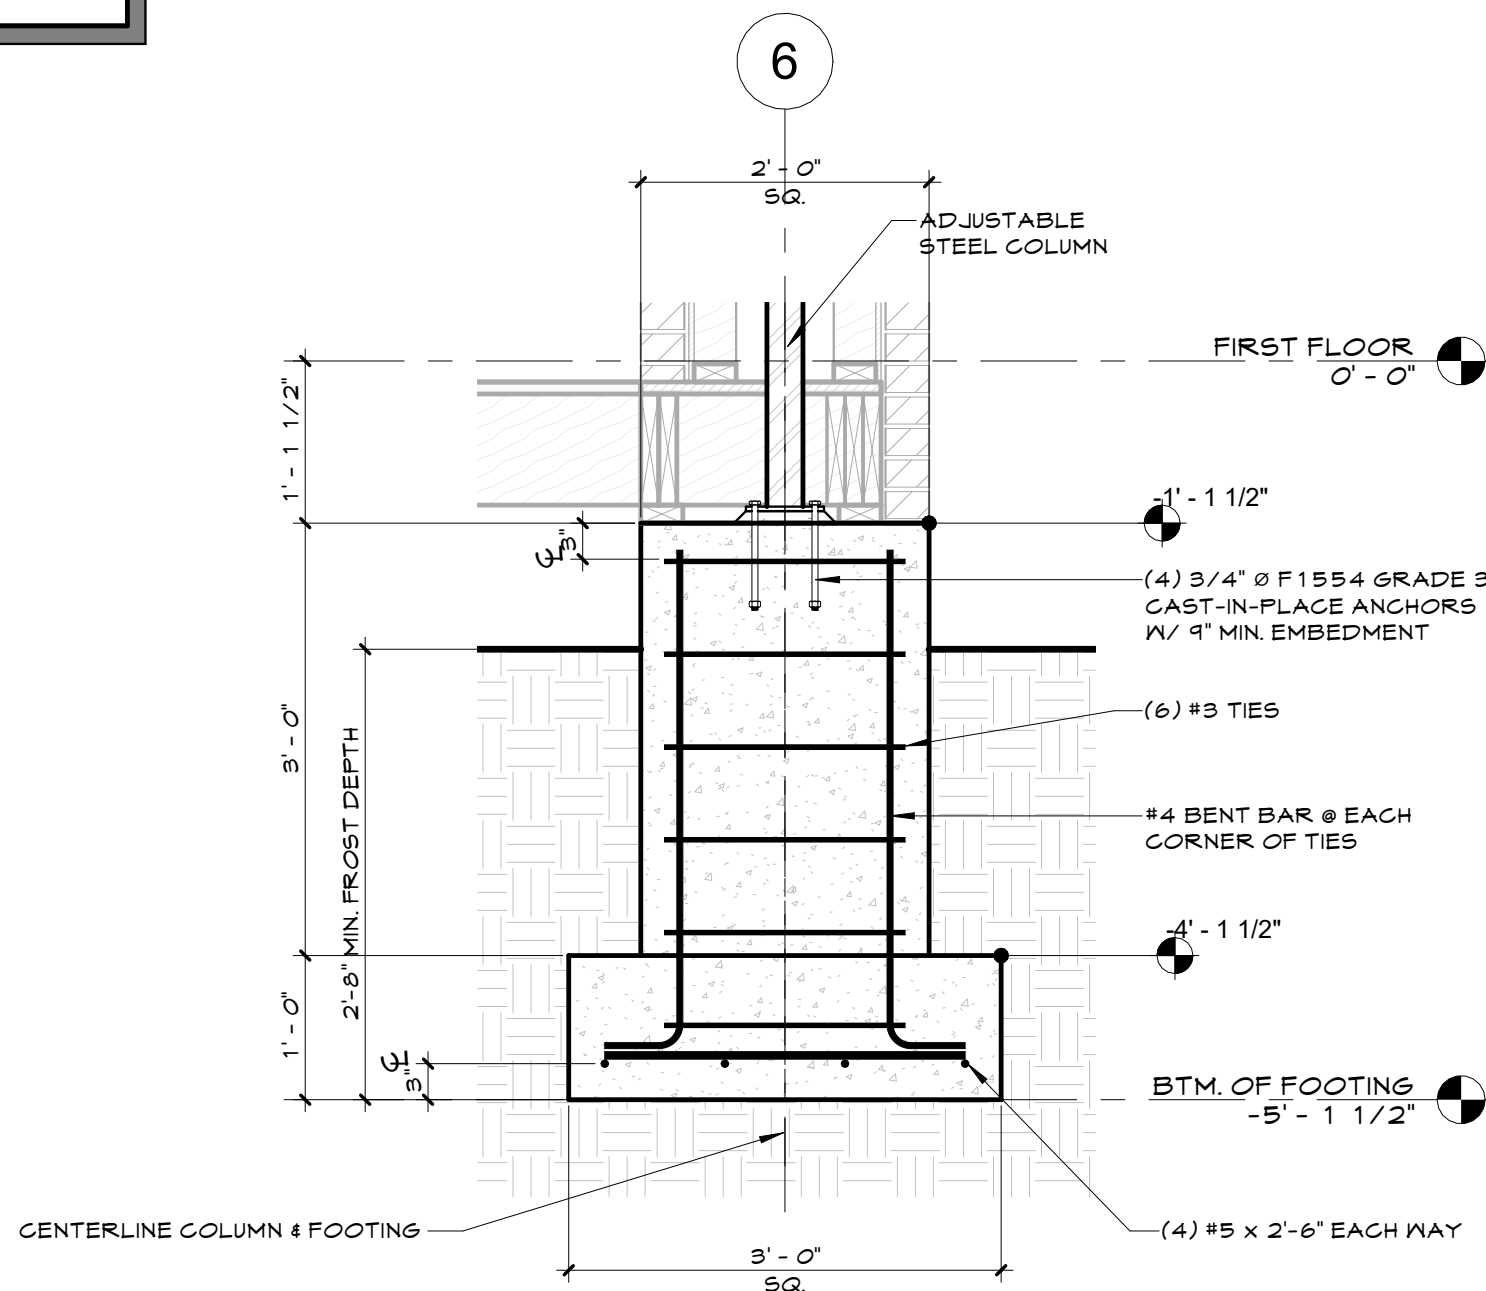

4 PORCH COLUMN FOOTING DETAIL
3/4" = 1'-0"

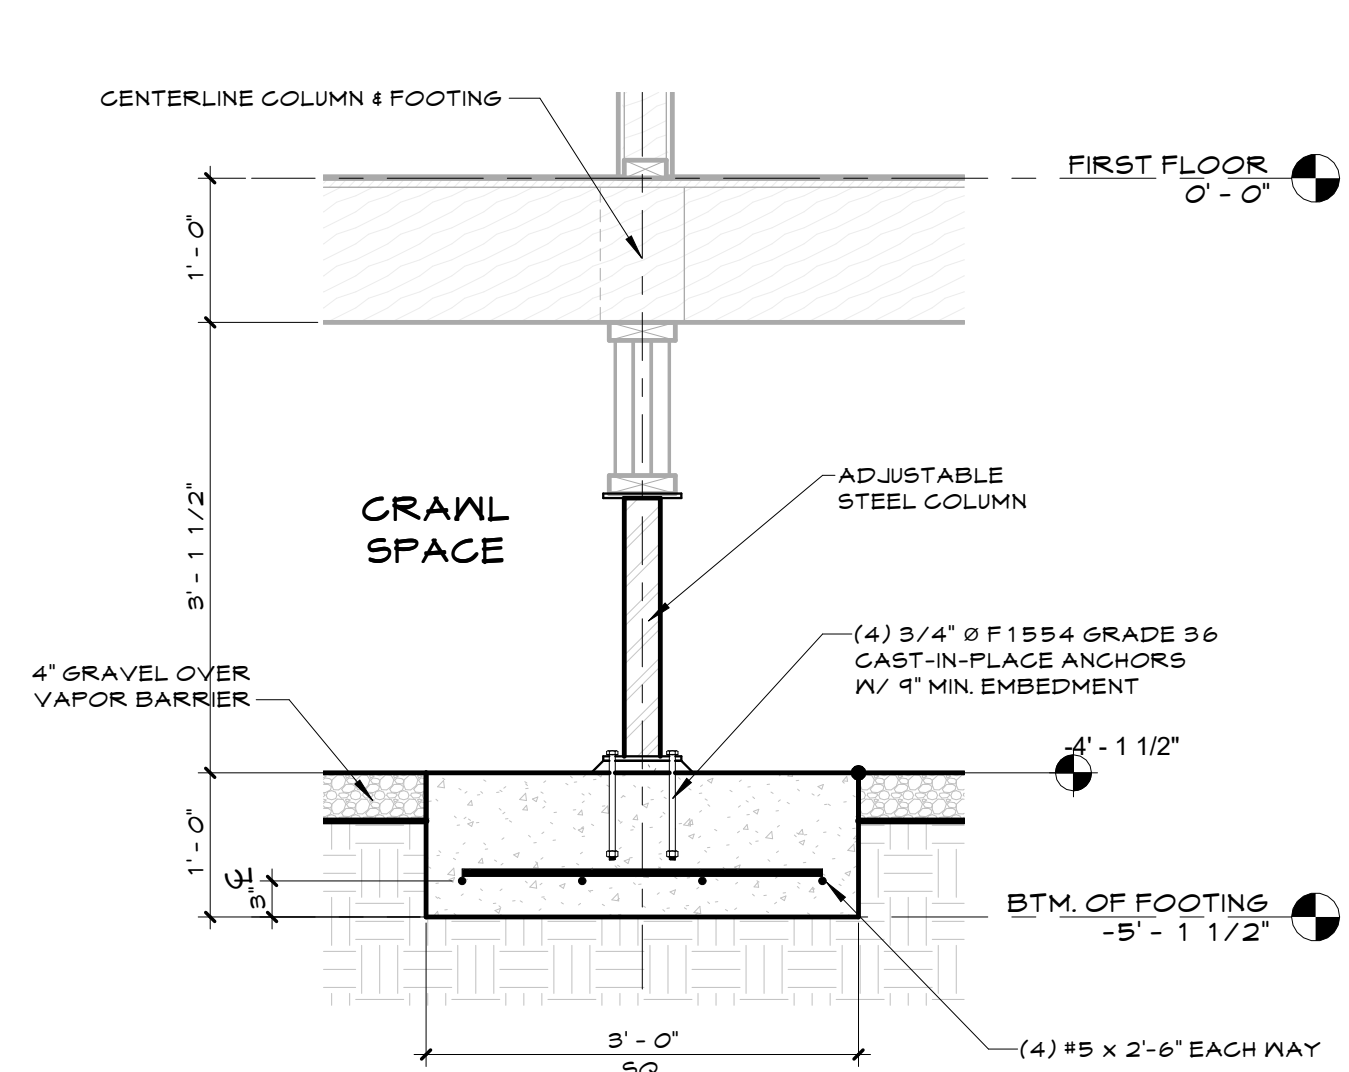

3 CRAWLSPACE COLUMN FOOTING DETAIL
3/4" = 1'-0"

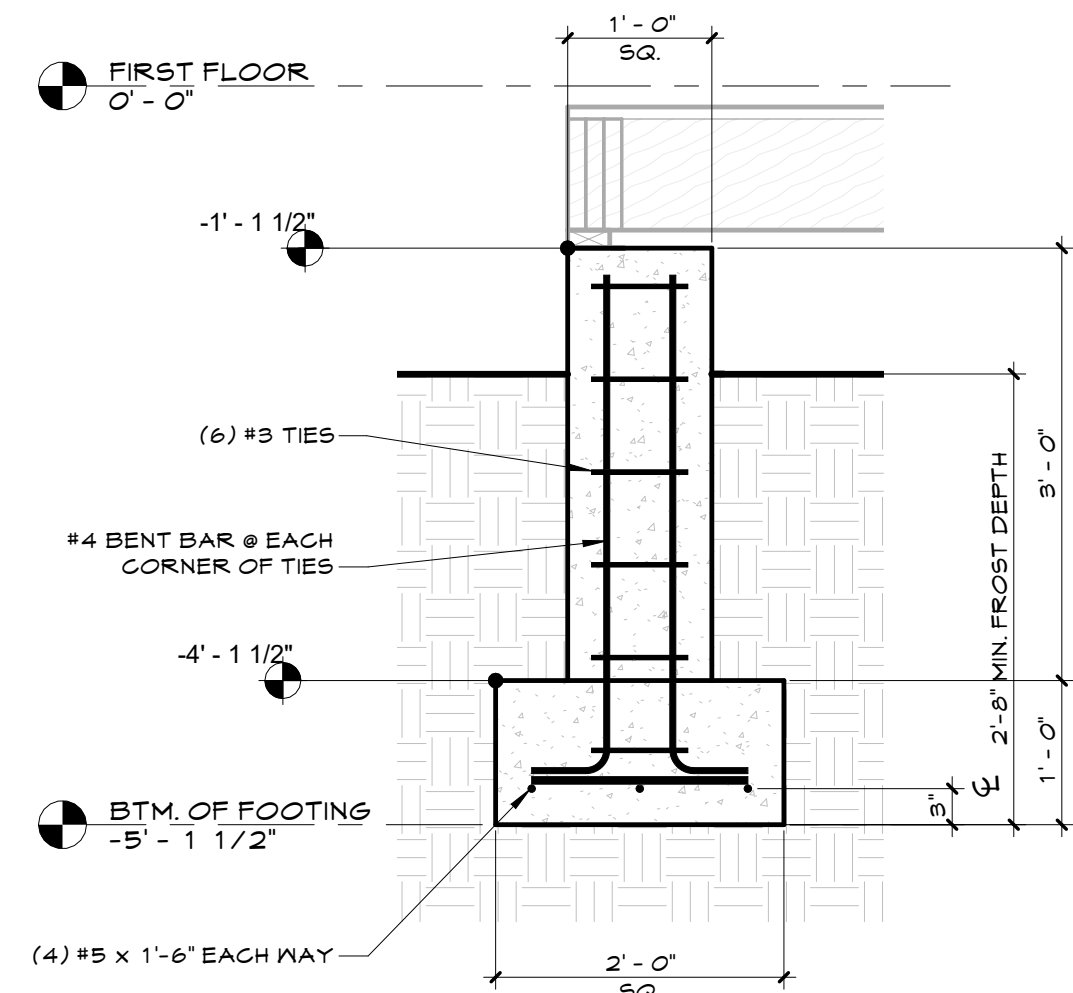

5 DECK COLUMN FOOTING DETAIL
3/4" = 1'-0"

SCHEMATIC STRUCTURAL DRAWINGS
DEVELOPED PER STANDARD HOUSE
PRACTICES. FINAL DESIGN & SIZING OF
FOUNDATION TO BE BY CONTRACTOR.
SCHEMATIC STRUCTURAL DRAWINGS
HAVE NOT BEEN DESIGNED BY A
LICENSED ENGINEER.



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 82.9. 9751
Fax: 660. 82.9. 9752

CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS 2020001500
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2000003310-0

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2023	

CITY OF SEDALIA
HOUSING - HOUSE A


4TH & NEW YORK,
SEDALIA, MO

FOUNDATION PLAN
& DETAILS


DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:


S1.01
80.168

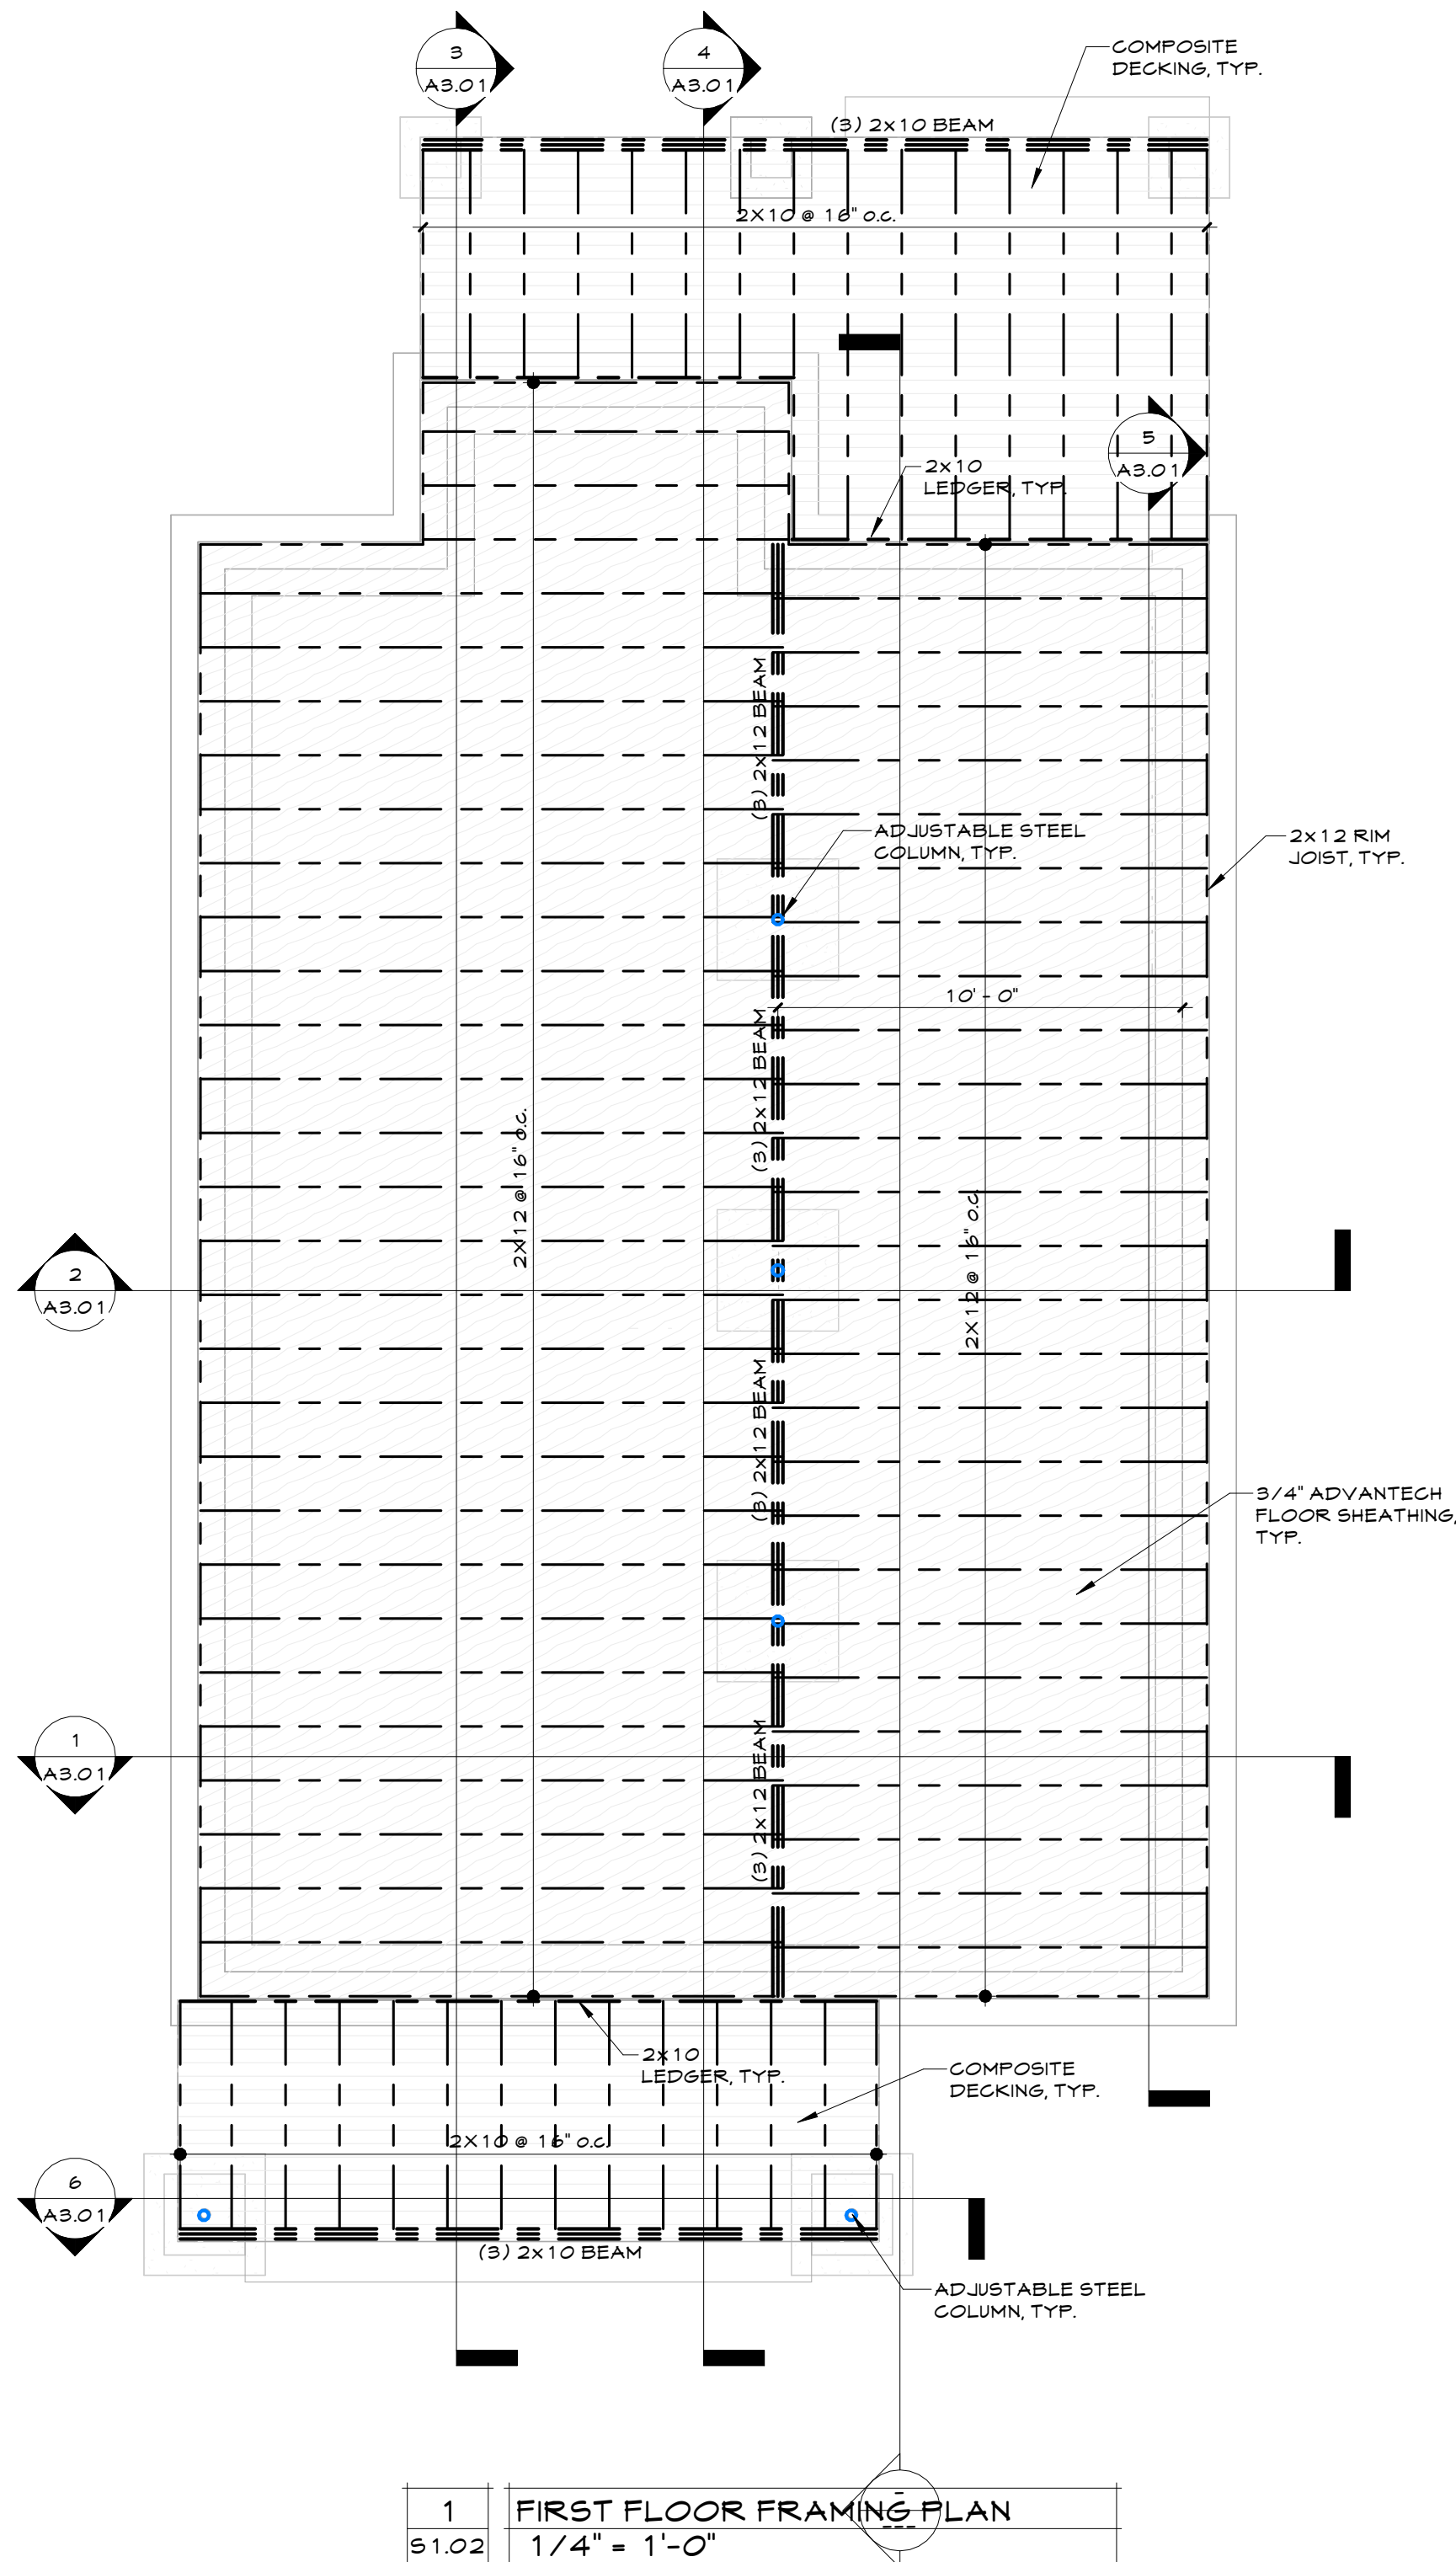

1 FIRST FLOOR FRAMING PLAN
1/4" = 1'-0"

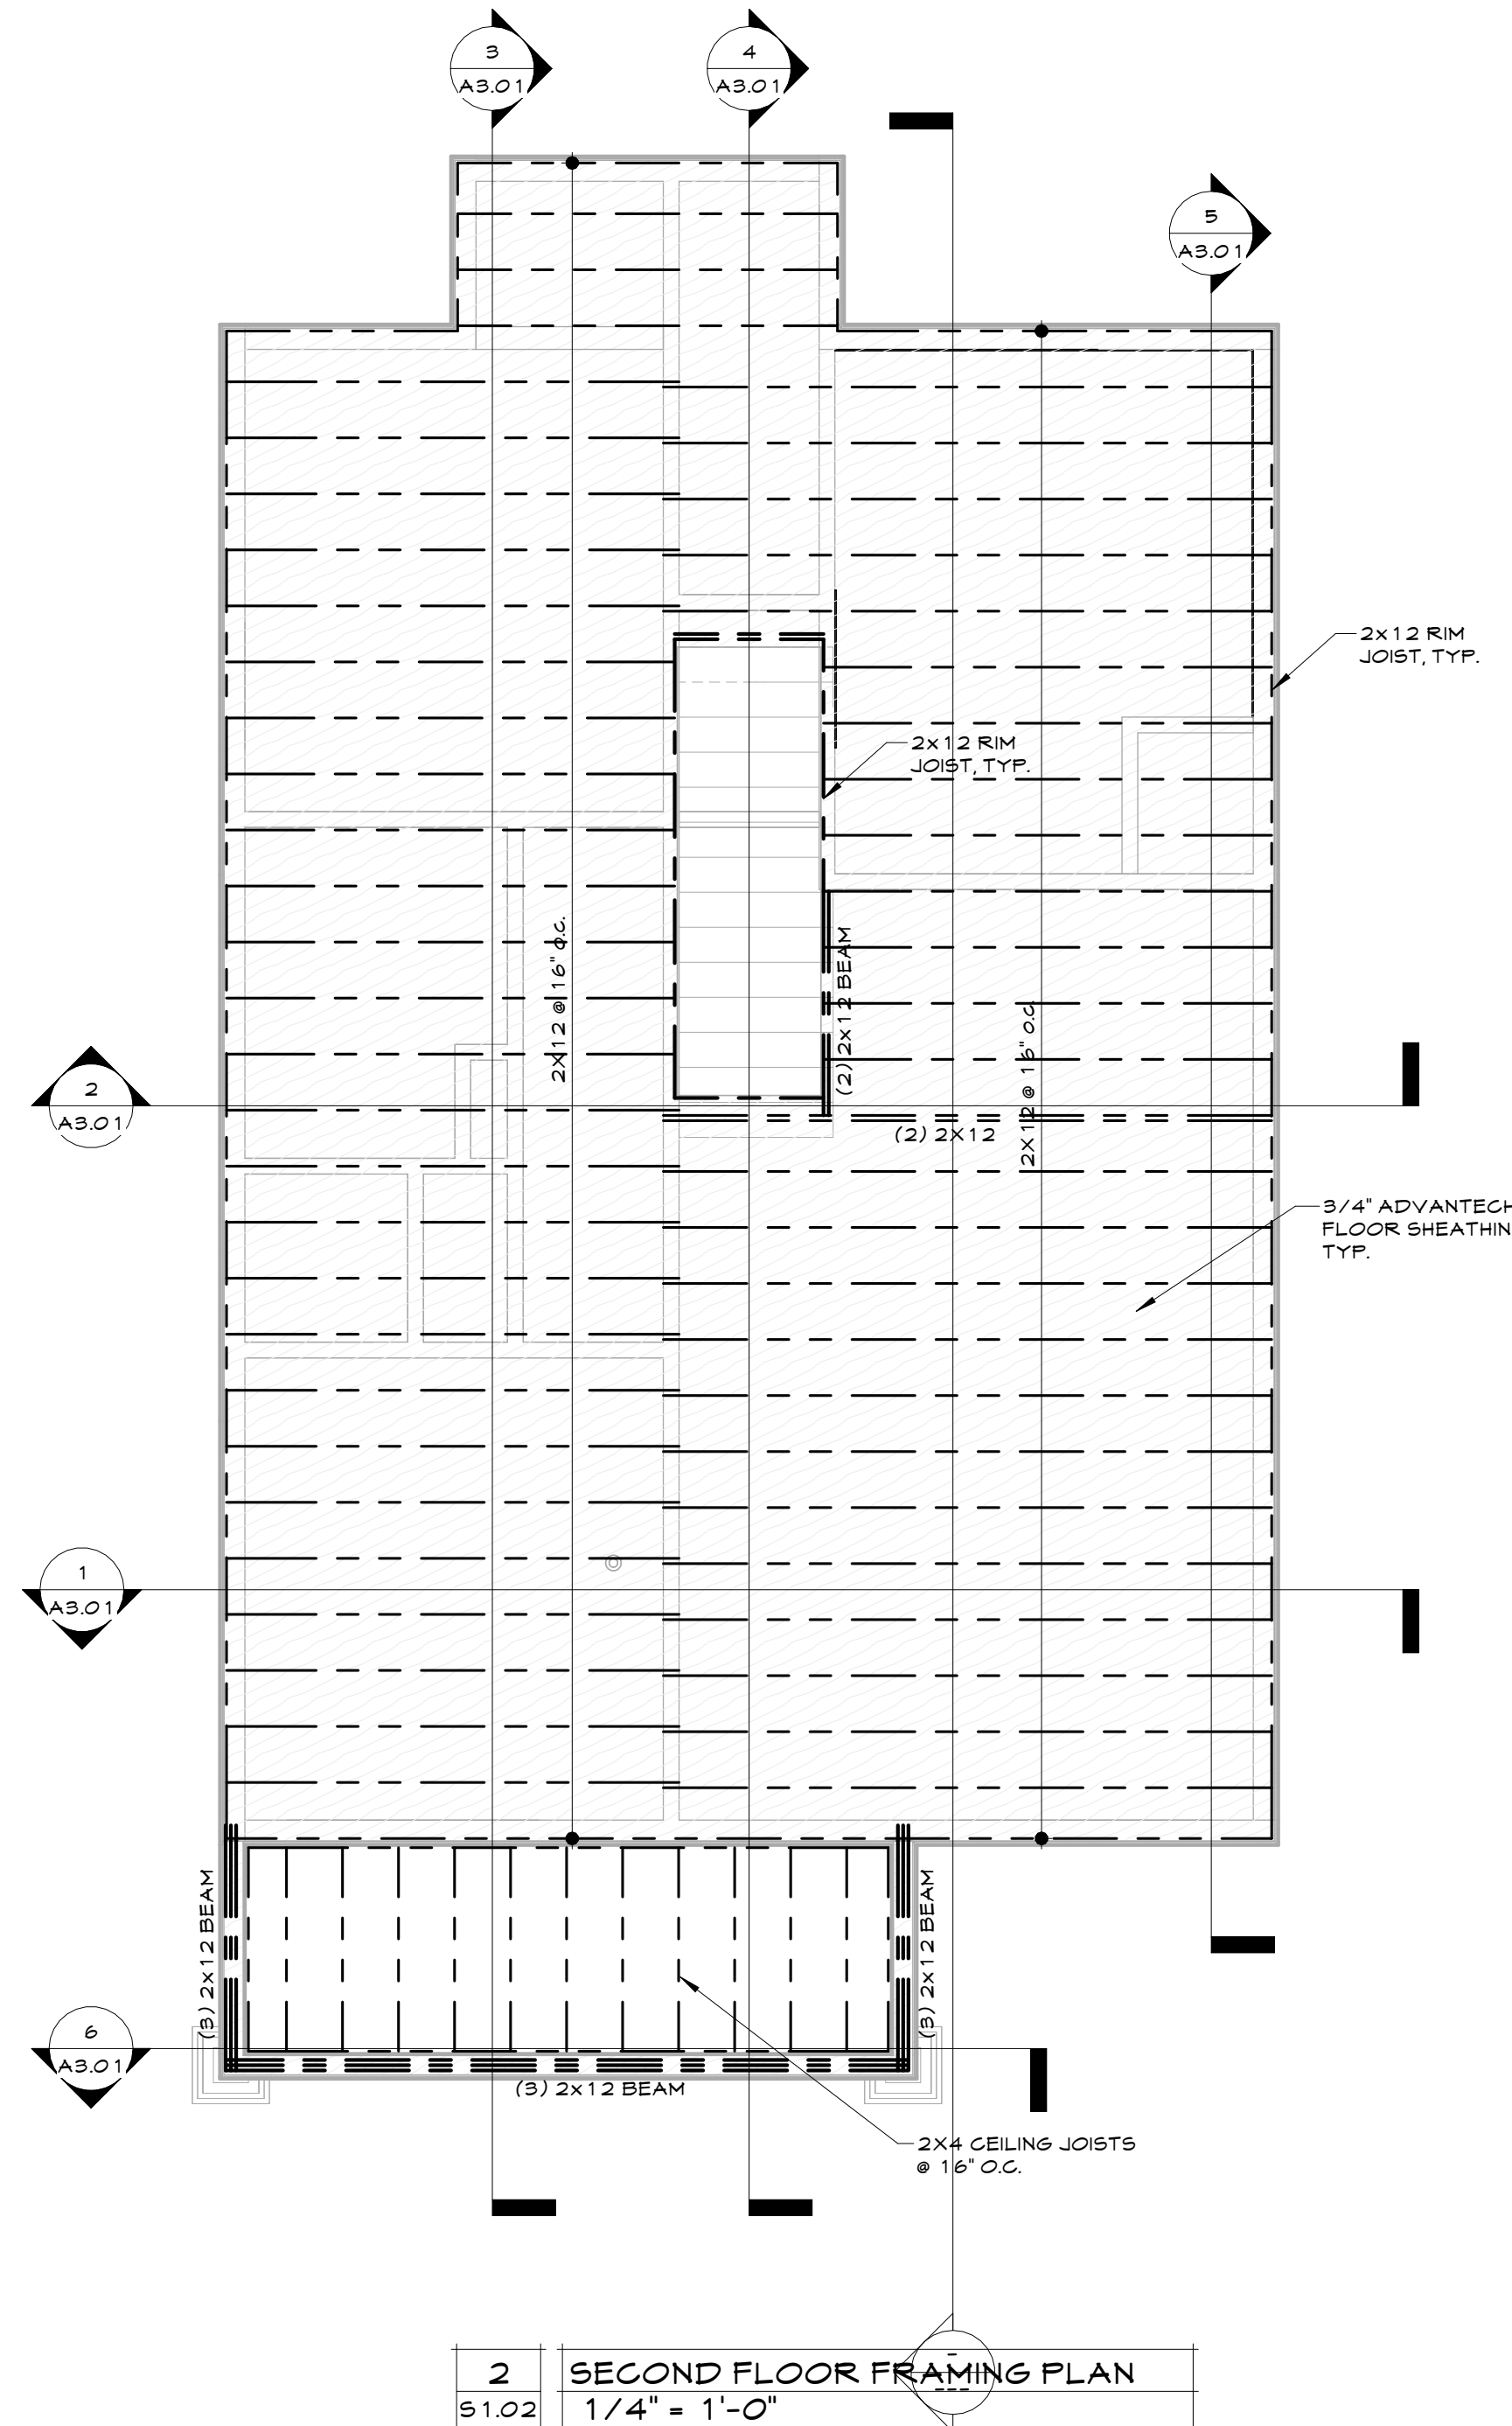

2 SECOND FLOOR FRAMING PLAN
1/4" = 1'-0"

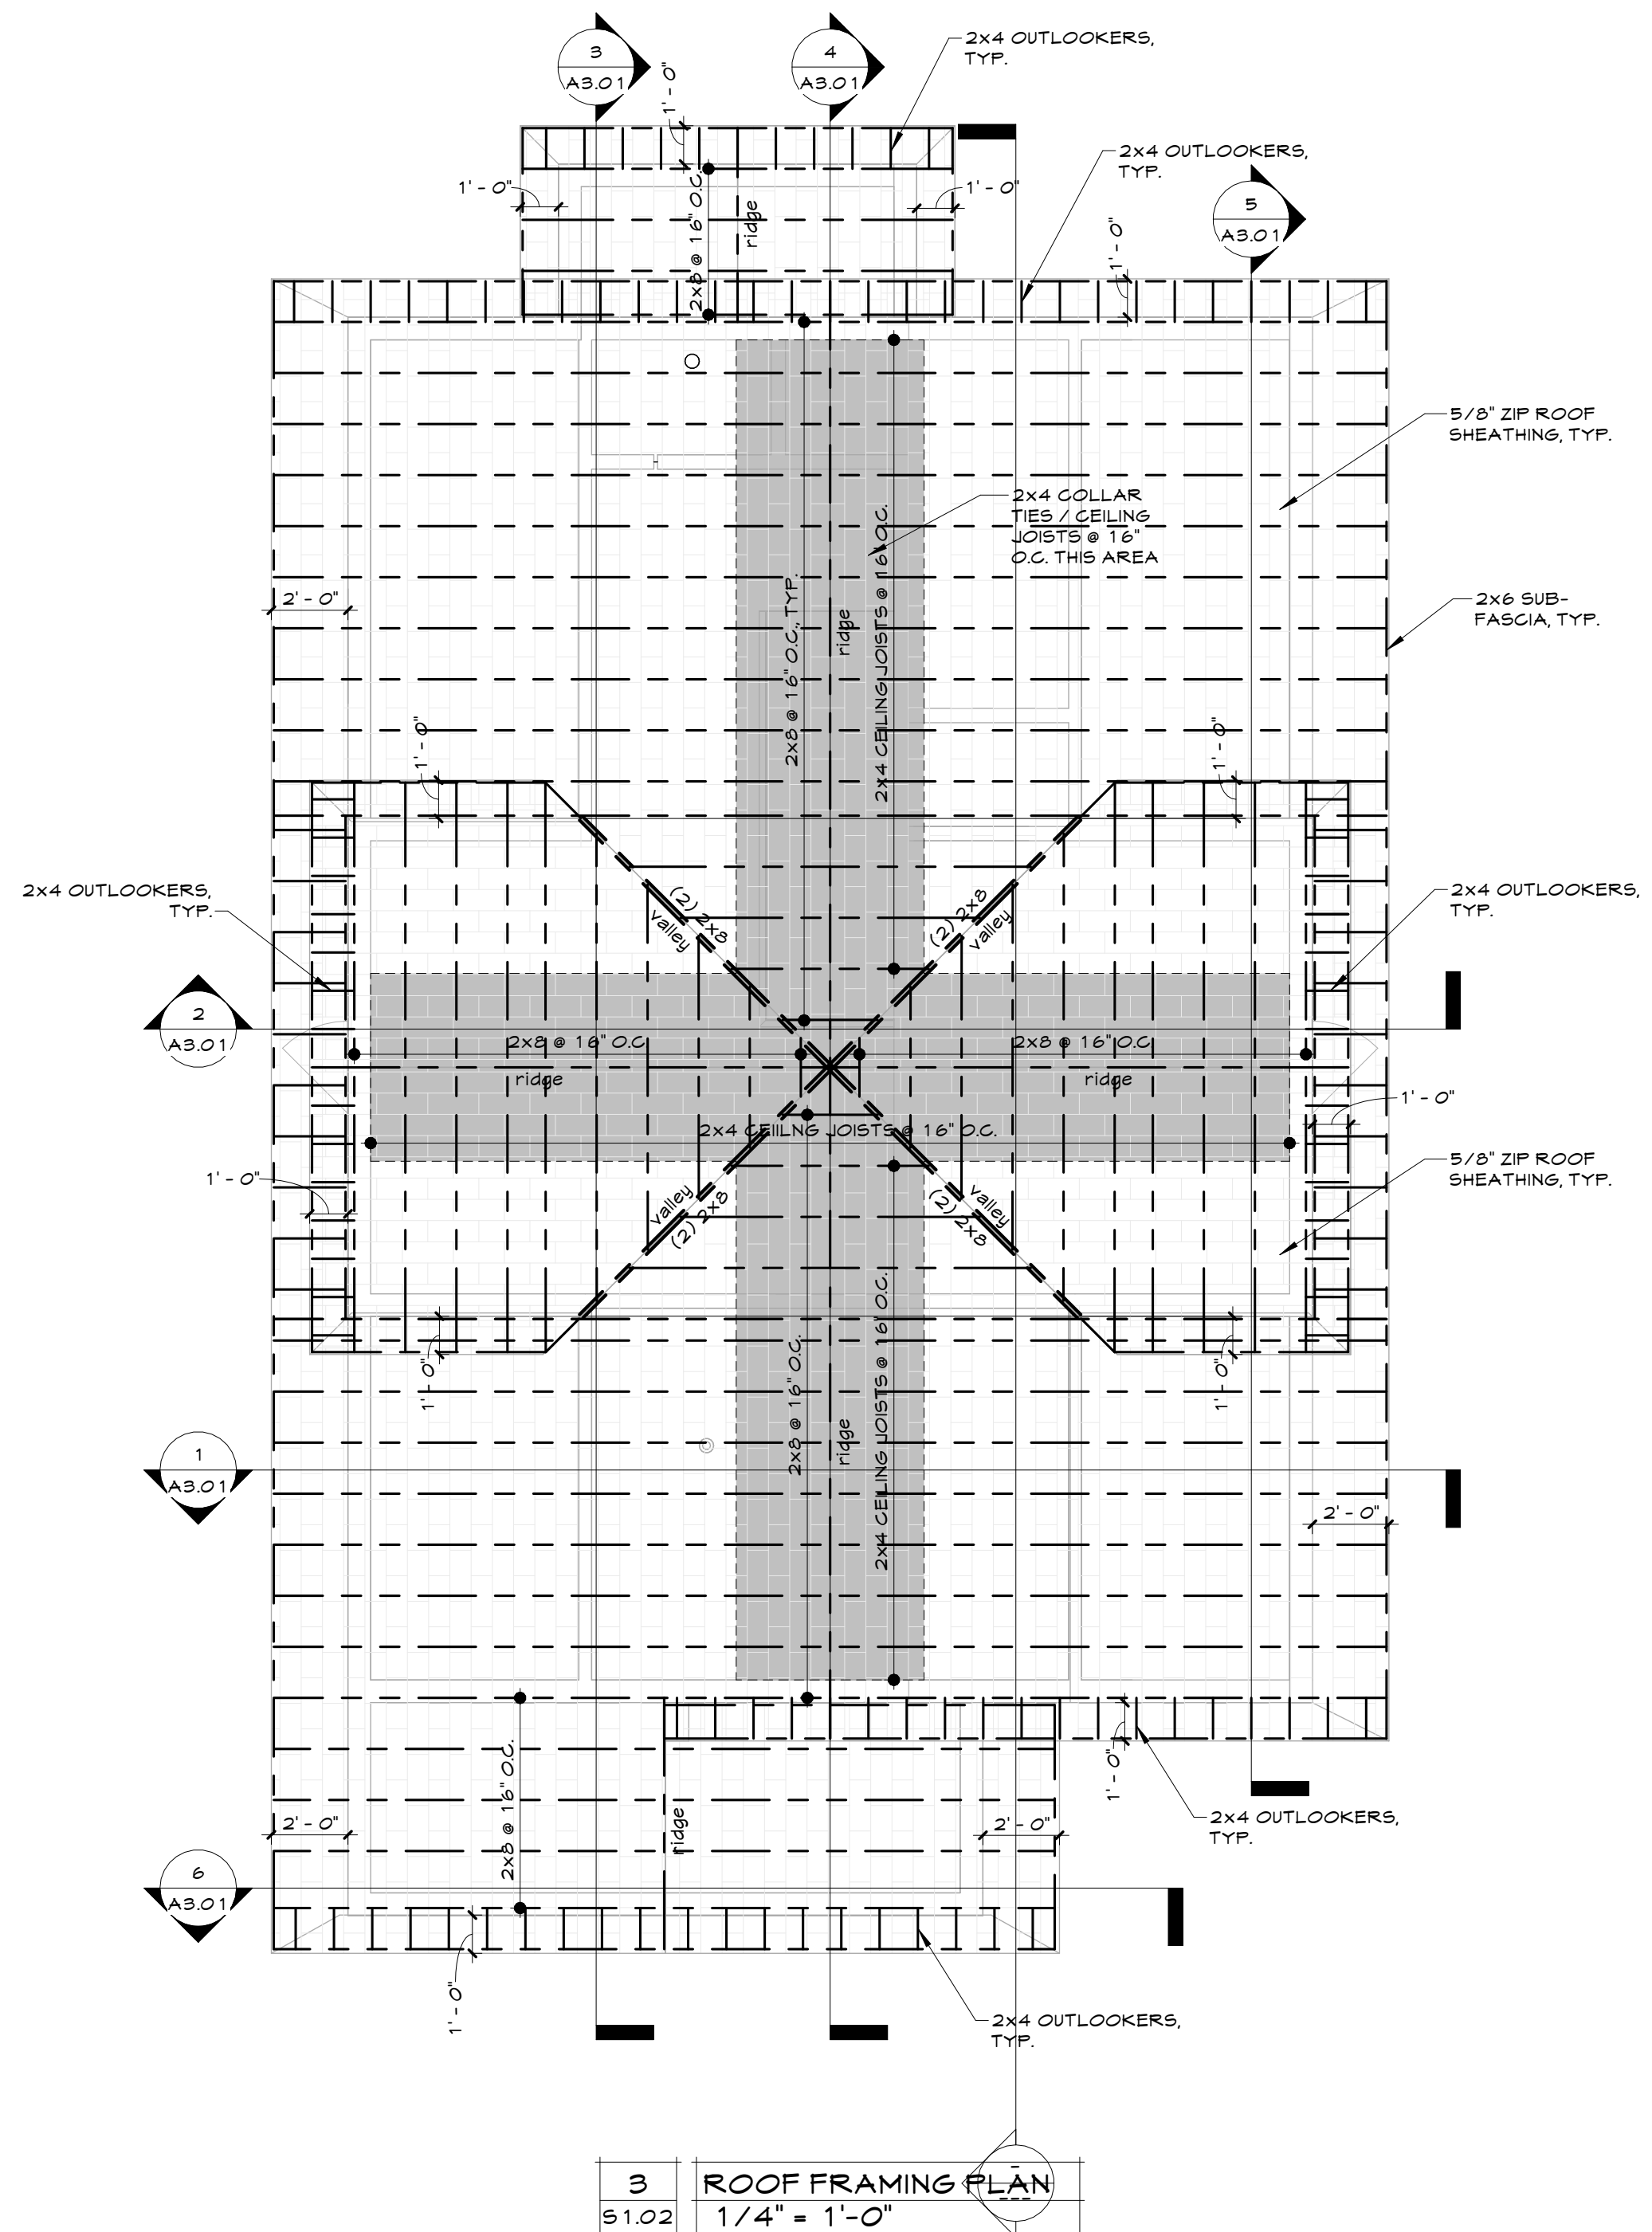

3 ROOF FRAMING PLAN
1/4" = 1'-0"

SCHEMATIC STRUCTURAL DRAWINGS DEVELOPED PER STANDARD HOUSE PRACTICES AND SPAN TABLES. FINAL DESIGN & SIZING OF MEMBERS TO BE BY CONTRACTOR. SCHEMATIC STRUCTURAL DRAWINGS HAVE NOT BEEN DESIGNED BY A LICENSED ENGINEER.



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 82.9. 9751
Fax: 660. 82.9. 9752

CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT P. ROLLINGS 2008021508
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-200800335 TO-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2023	

CITY OF SEDALIA
HOUSING - HOUSE A


4TH & NEW YORK,
SEDALIA, MO

FRAMING PLANS

DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:

S1.02
80.168

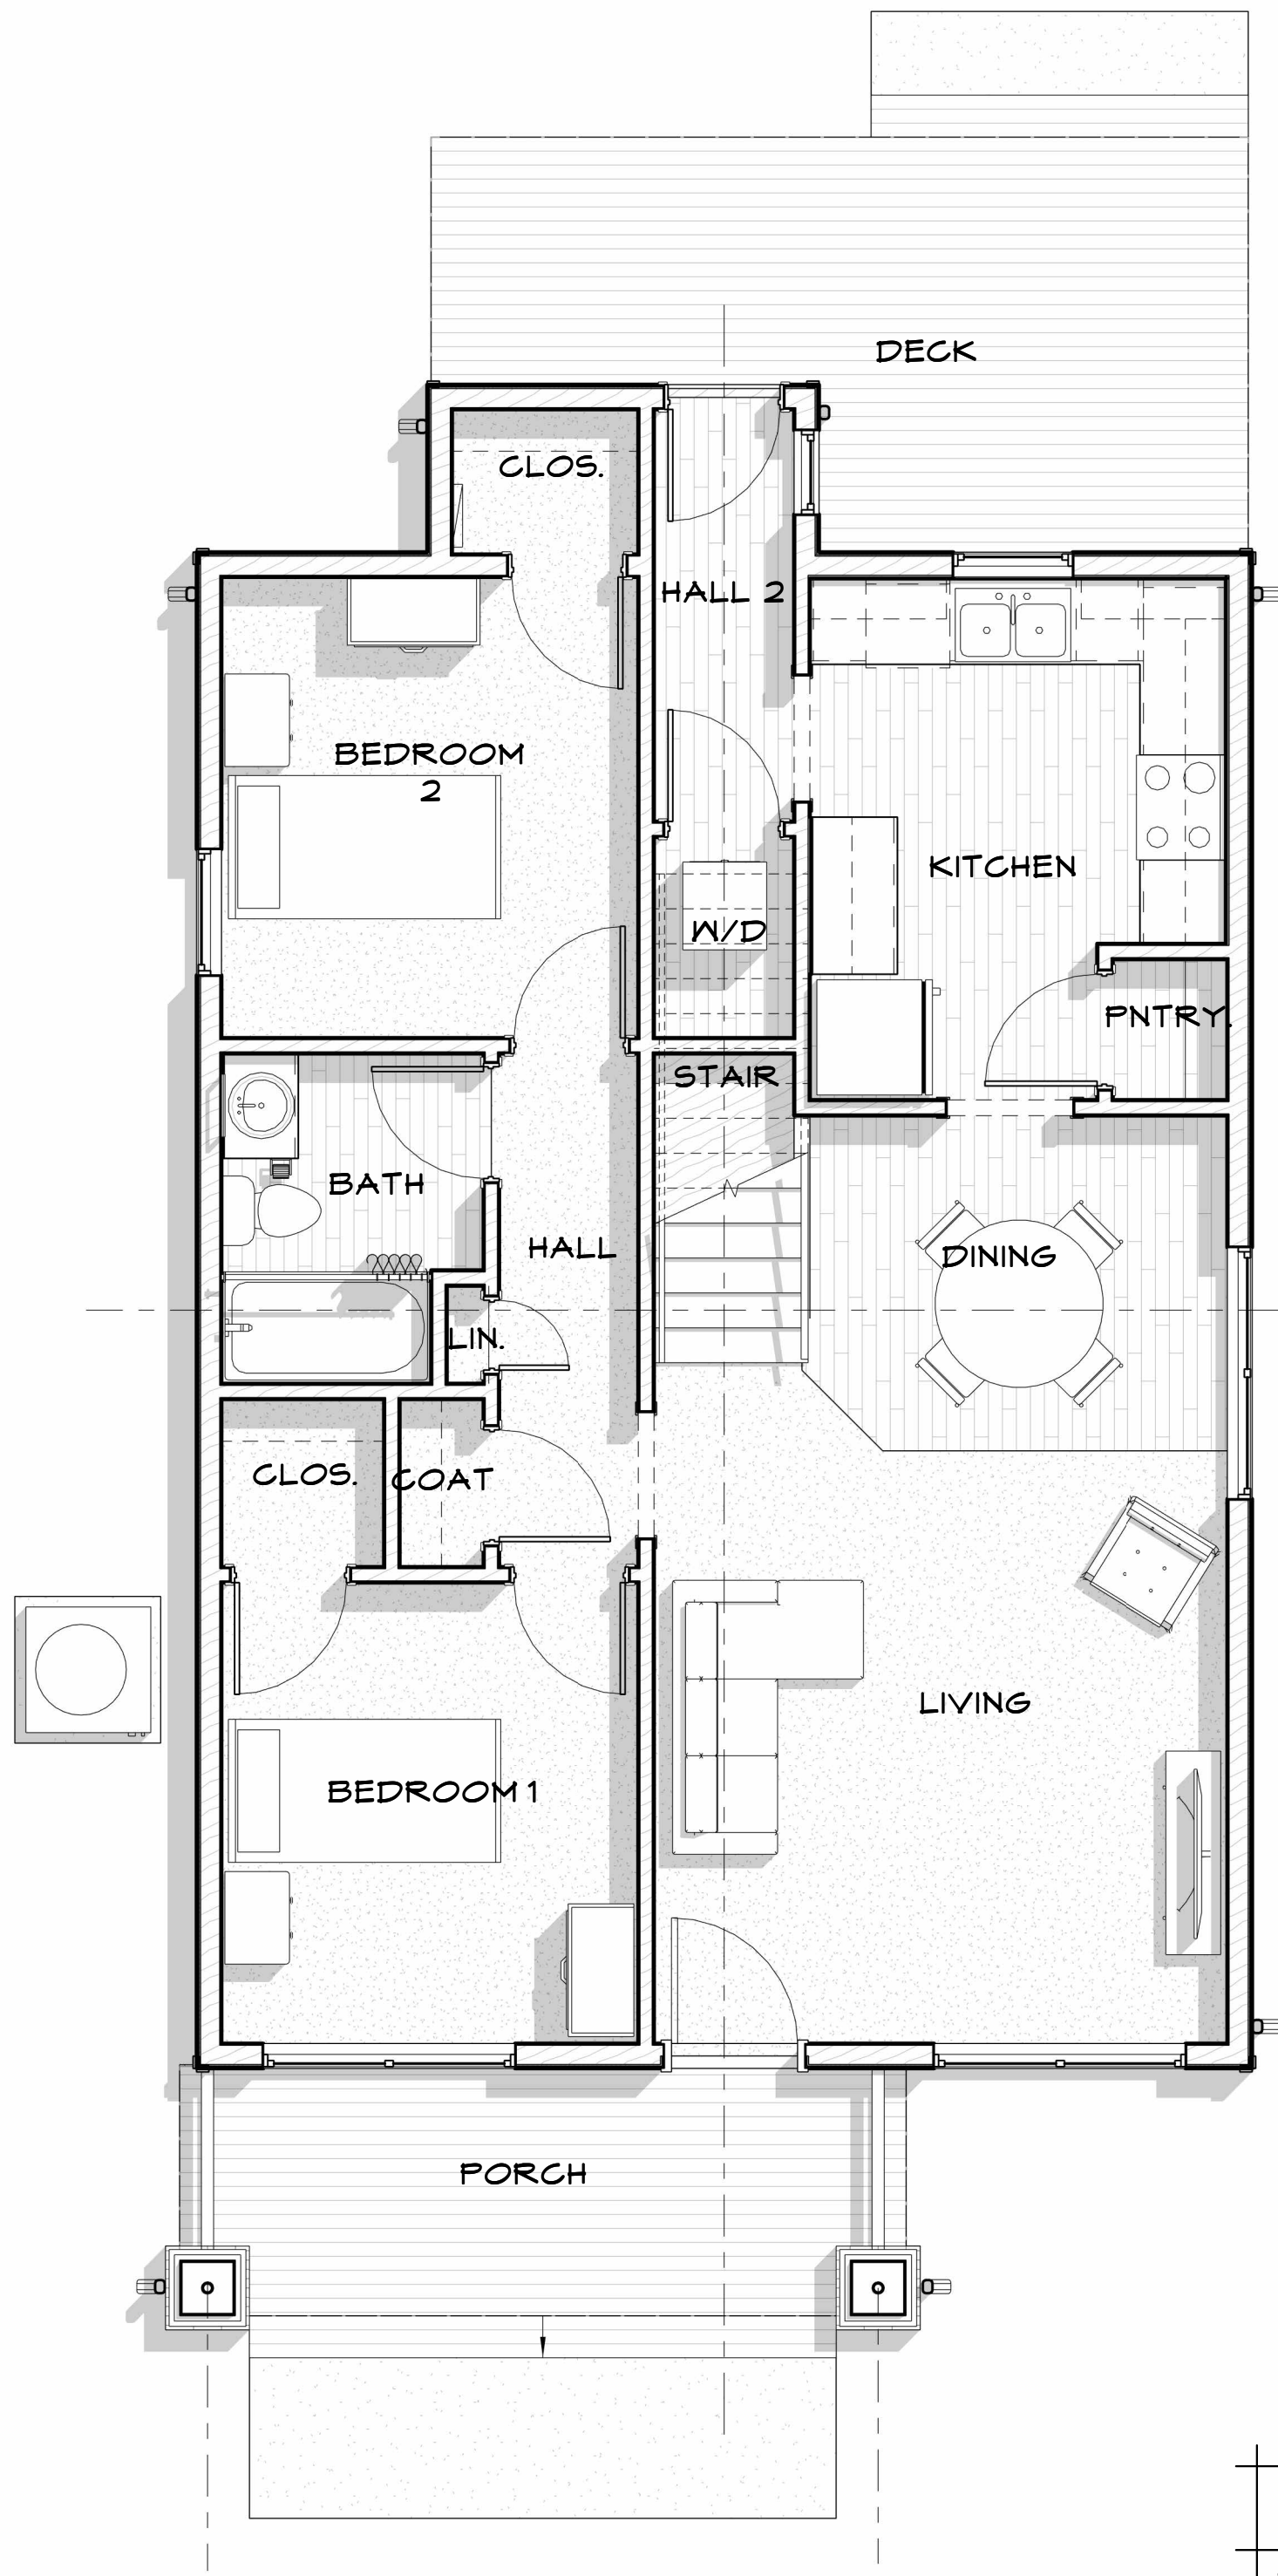

1	FIRST FLOOR PLAN
A1.01	1/4" = 1'-0"


GENERAL NOTES

- A. DO NOT SCALE DRAWINGS. DIMENSIONS ARE APPROXIMATE. VERIFY ALL DIMENSIONS IN FIELD.
B. NOTIFY OWNER OF ANY DISCREPANCIES BETWEEN PROJECT DOCUMENTS AND EXISTING CONDITIONS. ANY MODIFICATIONS DUE TO DIMENSIONAL CHANGES SHOULD BE PART OF THE PROJECT COST.
C. TYPICAL GROUND FINISH ELEVATION IS REFERENCED AS 0'-0". CONTRACTOR SHALL VERIFY GROUND FINISH ELEVATION WITH ACTUAL CONDITIONS.
D. LOCATIONS SHOWN ARE APPROXIMATE. COORDINATE EXACT LOCATIONS ON SITE.
E. CONTRACTOR TO FOLLOW ALL APPLICABLE LOCAL CODES.
F. DOOR LOCATIONS APPROXIMATE. VERIFY EXACT LOCATION IN FIELD.
G. GENERAL CONTRACTOR SHALL VERIFY EXACT DIMENSIONS OF EXISTING BUILDING.
H. ARCHITECTURAL DRAWING DIMENSIONS ARE APPROXIMATE. COORDINATE DISCREPANCIES WITH OWNER.
I. VERIFY FINISHES WITH OWNER.
J. SPECIFIC MODELS ARE SPECIFIED TO ESTABLISH QUALITY ONLY. SUBSTITUTIONS MAY BE MADE WITH DESIGNER'S APPROVAL.
K. LAYOUTS AND ROUTINGS SHOWN ON THE PLANS ARE APPROXIMATE AND GENERAL IN NATURE. CONTRACTORS ARE REQUIRED TO INSPECT THE JOBSITE FOR INTERFERENCES, OBSTRUCTIONS, AND CONFLICTS AND NOTIFY THE OWNER OF THE SAME, AND INCLUDE IN THEIR BID AND WORK SCOPE ALL ASSOCIATED COSTS TO MODIFY THE LAYOUTS AND ROUTINGS AS NECESSARY TO ACCOMMODATE THE INSTALLATION OF THEIR WORK AROUND SUCH INTERFERENCES, OBSTRUCTIONS, AND CONFLICTS.
L. CONTRACTOR IS RESPONSIBLE FOR REVIEWING AND UNDERSTANDING ALL DRAWINGS AND ASPECTS OF THE PROJECT SCOPE, AND FOR INCLUDING IN HIS BID ALL WORK ASSOCIATED WITH HIS TRADE, REGARDLESS OF WHICH DRAWING OR SHEET IT IS SHOWN ON.
M. MOISTURE RESISTANT GYPSUM BOARD IS TO BE INSTALLED AT ALL WALLS IN BATHROOMS (ALL NET WALLS).
N. GYP. BD. TO BE HELD 1" AFF. IN ALL NET AREAS.
O. PROVIDE DOUBLE JAMB (2-20 GA. STUDS MIN. AT METAL) (2-FULL + 1 CRIPPLE AT WOOD) AT ALL DOOR JAMBS, TYP.
P. PREPARE ALL SURFACES FOR FINISHES AS REQUIRED BY PRODUCT MANUFACTURER.
Q. FIREBLOCKING IS TO BE INSTALLED AS PER RESIDENTIAL CODE REQUIREMENTS.

PLAN NOTES

- A. REFER TO DIMENSION PLANS FOR DIMENSION NOTES.
B. REFER TO STRUCTURAL DRAWINGS FOR STRUCTURAL DETAILS.
C. PROVIDE SOUND BATT. INSULATION FULL HEIGHT TO MATCH FRAMING THICKNESS. REFER TO REFLECTED CEILING PLAN FOR LOCATIONS.
D. REFER TO REFLECTED CEILING PLAN FOR RATED WALL LOCATIONS OR COORDINATE W/ ARCHITECT IF NOT SHOWN.
E. PROVIDE PLYWOOD BACKING FOR ALL WALLS WITH WALL MOUNTED ELECTRICAL EQUIPMENT, CASEWORK, BATHROOM ACCESSORIES, ALL WALLS IN KITCHEN AND OPEN SHELVES SPECIFIED AS REQUIRED. REFER TO ELECTRICAL PLANS AND INTERIOR ELEVATIONS FOR LOCATIONS.
F. PROVIDE 6" WALL FRAMING AT ALL ELECTRICAL PANELS. EXTEND TO NEAREST INSIDE OR OUTSIDE CORNER. REFER TO ELECTRICAL DRAWINGS FOR LOCATIONS.
G. LOCATE ALL PLUMBING FIXTURES AS PER INTERIOR ELEVATION DIMENSIONS AS NOTED FROM CENTERLINE OF FIXTURE TO WALL FINISH. REFER TO INTERIOR ELEVATIONS.
H. CONTROL JOINTS TO BE LOCATED ON GYP. BD. WALL AND CEILING SPANS OVER 22' IN LENGTH WITHOUT A BREAK IN WALL RUN. REFER TO REFERENCE PLAN FOR LOCATIONS.
I. SEE REFLECTED CEILING PLAN FOR WALL HEIGHTS.
J. FLOOR FINISH CHANGES ARE TYPICALLY AT DOORWAYS UNLESS NOTED OTHERWISE. REFER TO FINISH SCHEDULE AND REFERENCE PLAN.
K. REFER TO TYPICAL DETAIL SHEET FOR TYPICAL MOUNTING HEIGHTS, ADA DOOR CLEARANCES AND VARIOUS DETAILS.

3	GENERAL NOTES
A1.01	1/2" = 1'-0"

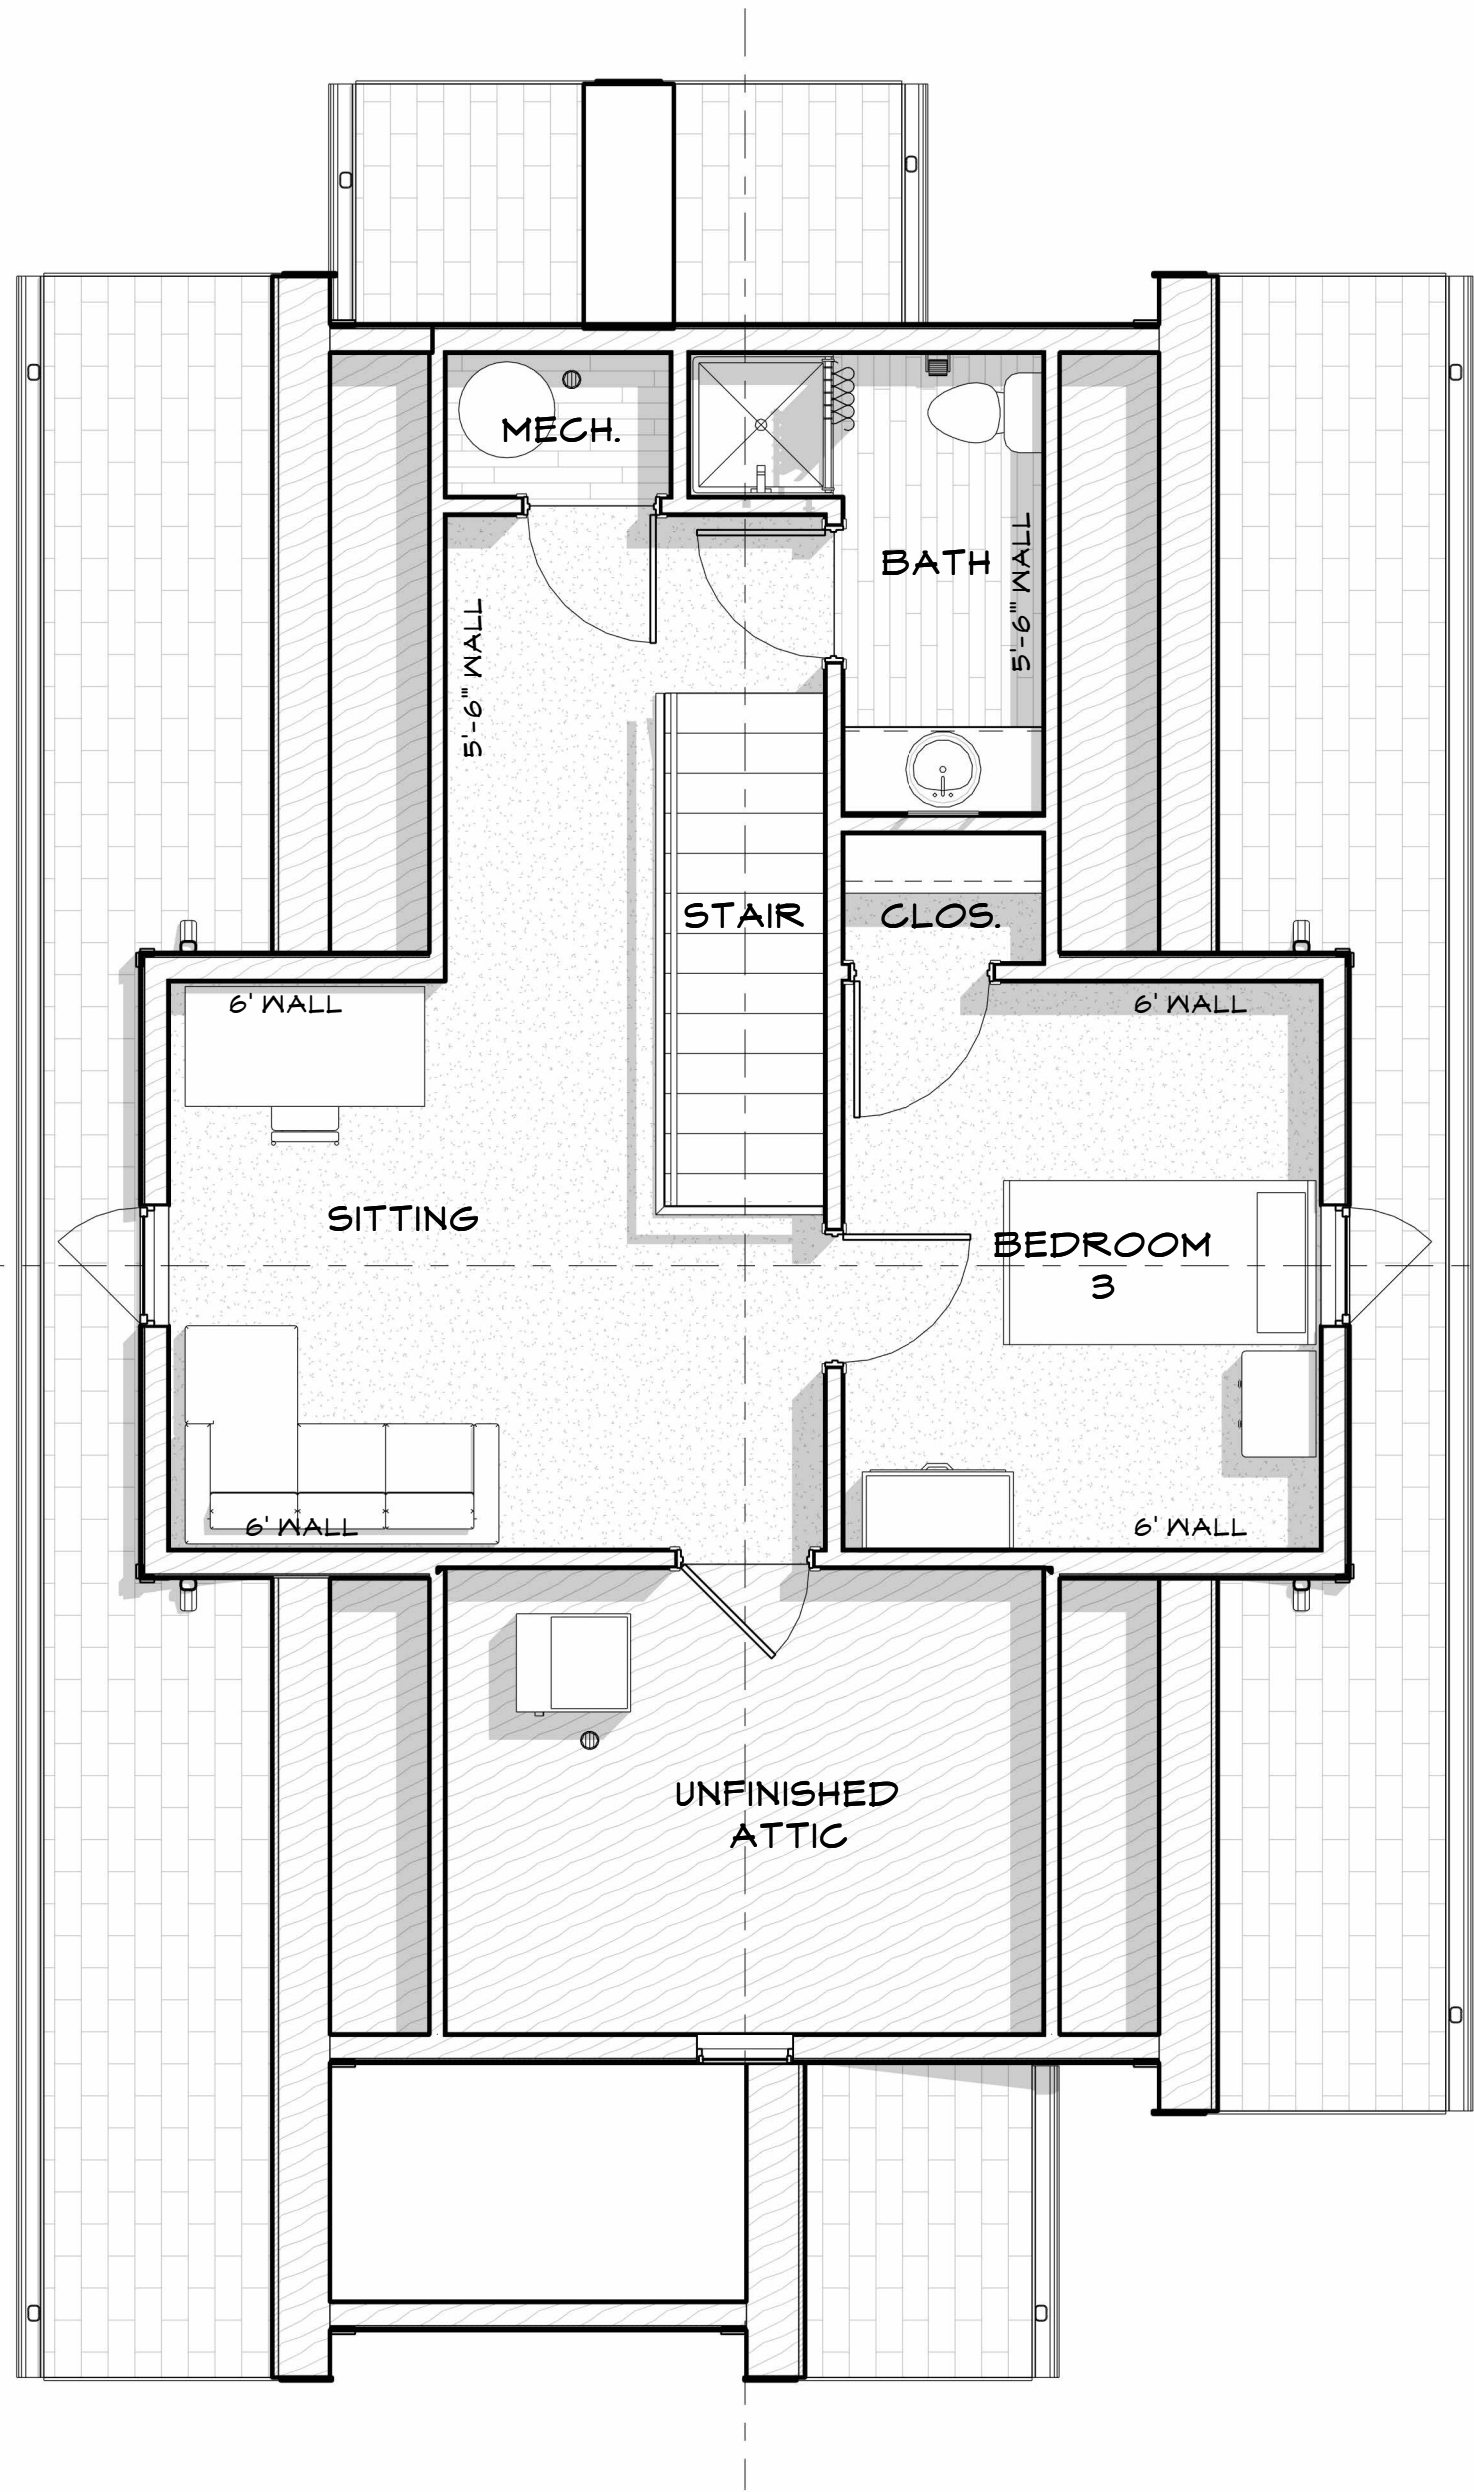

2	SECOND FLOOR PLAN
A1.01	1/4" = 1'-0"

CITY OF SEDALIA HOUSING - HOUSE A

COPYRIGHT © 2021



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT

ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS - 2028021508
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-200800335 TO-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	

CITY OF SEDALIA
HOUSING - HOUSE A


4TH & NEW YORK,
SEDALIA, MO

FLOOR PLANS & NOTES


DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:

A1.01
80.168

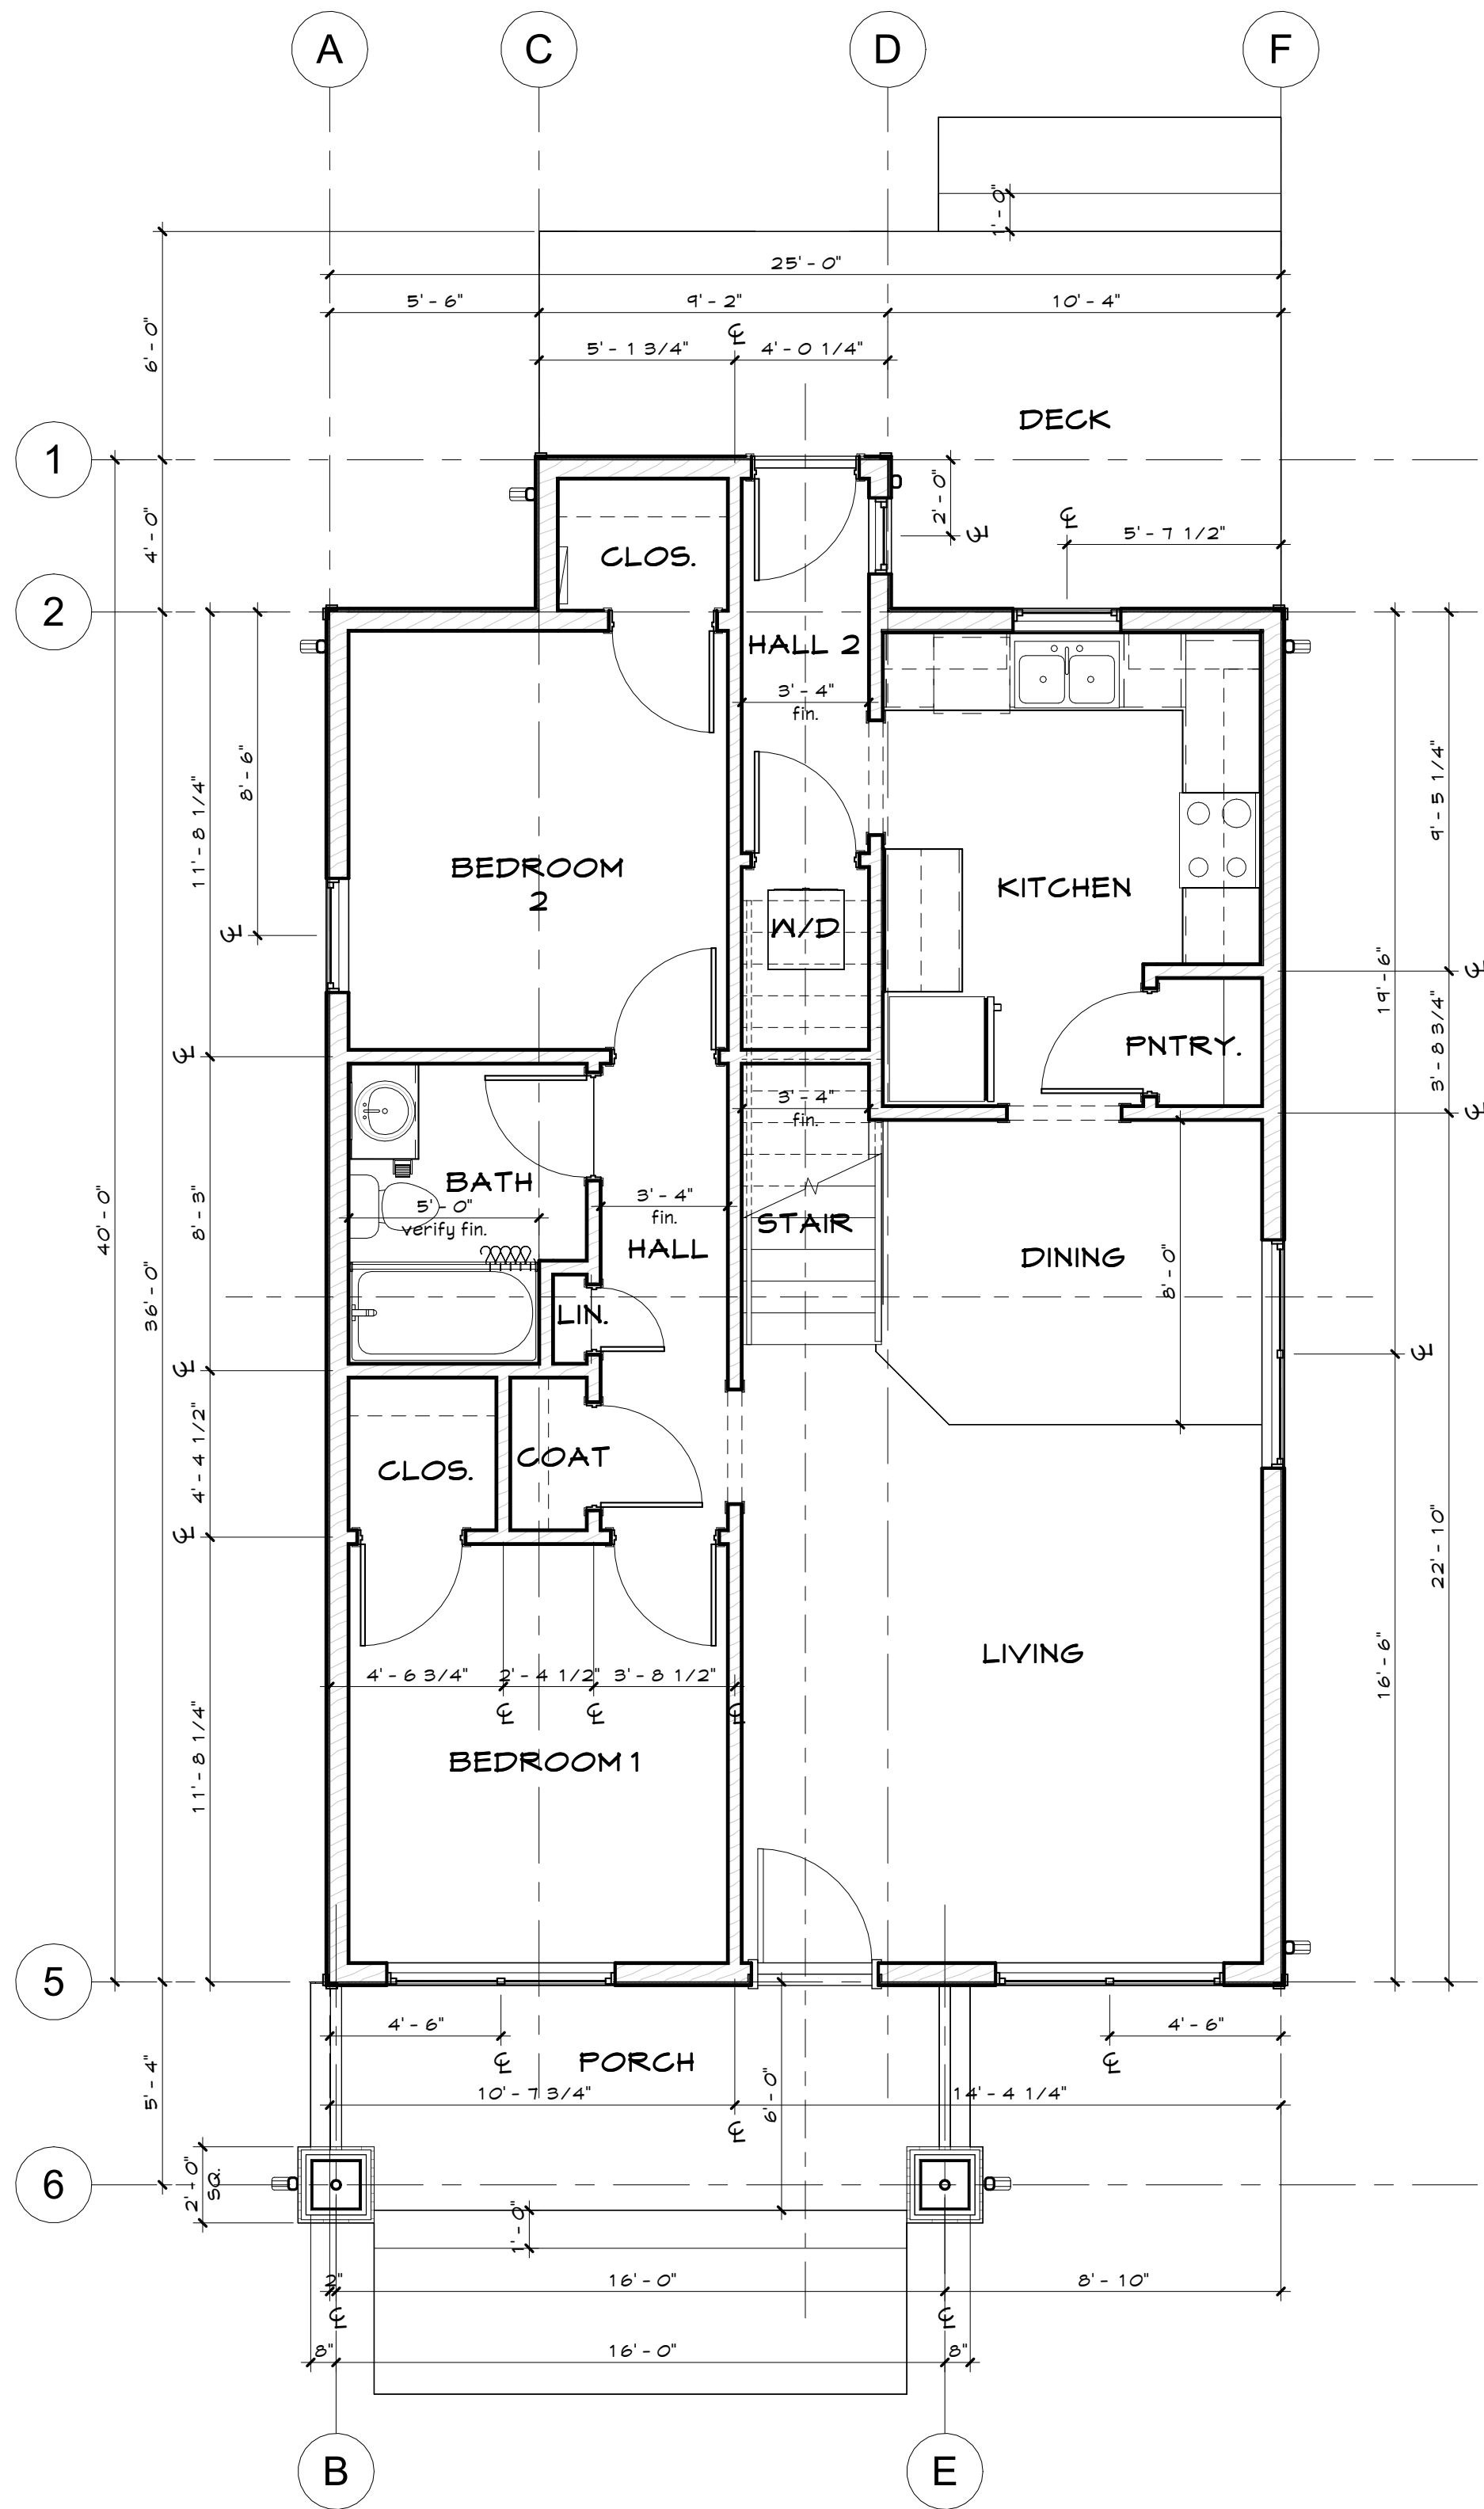

1	FIRST FLOOR DIMENSION PLAN
A1.02	1/4" = 1'-0"

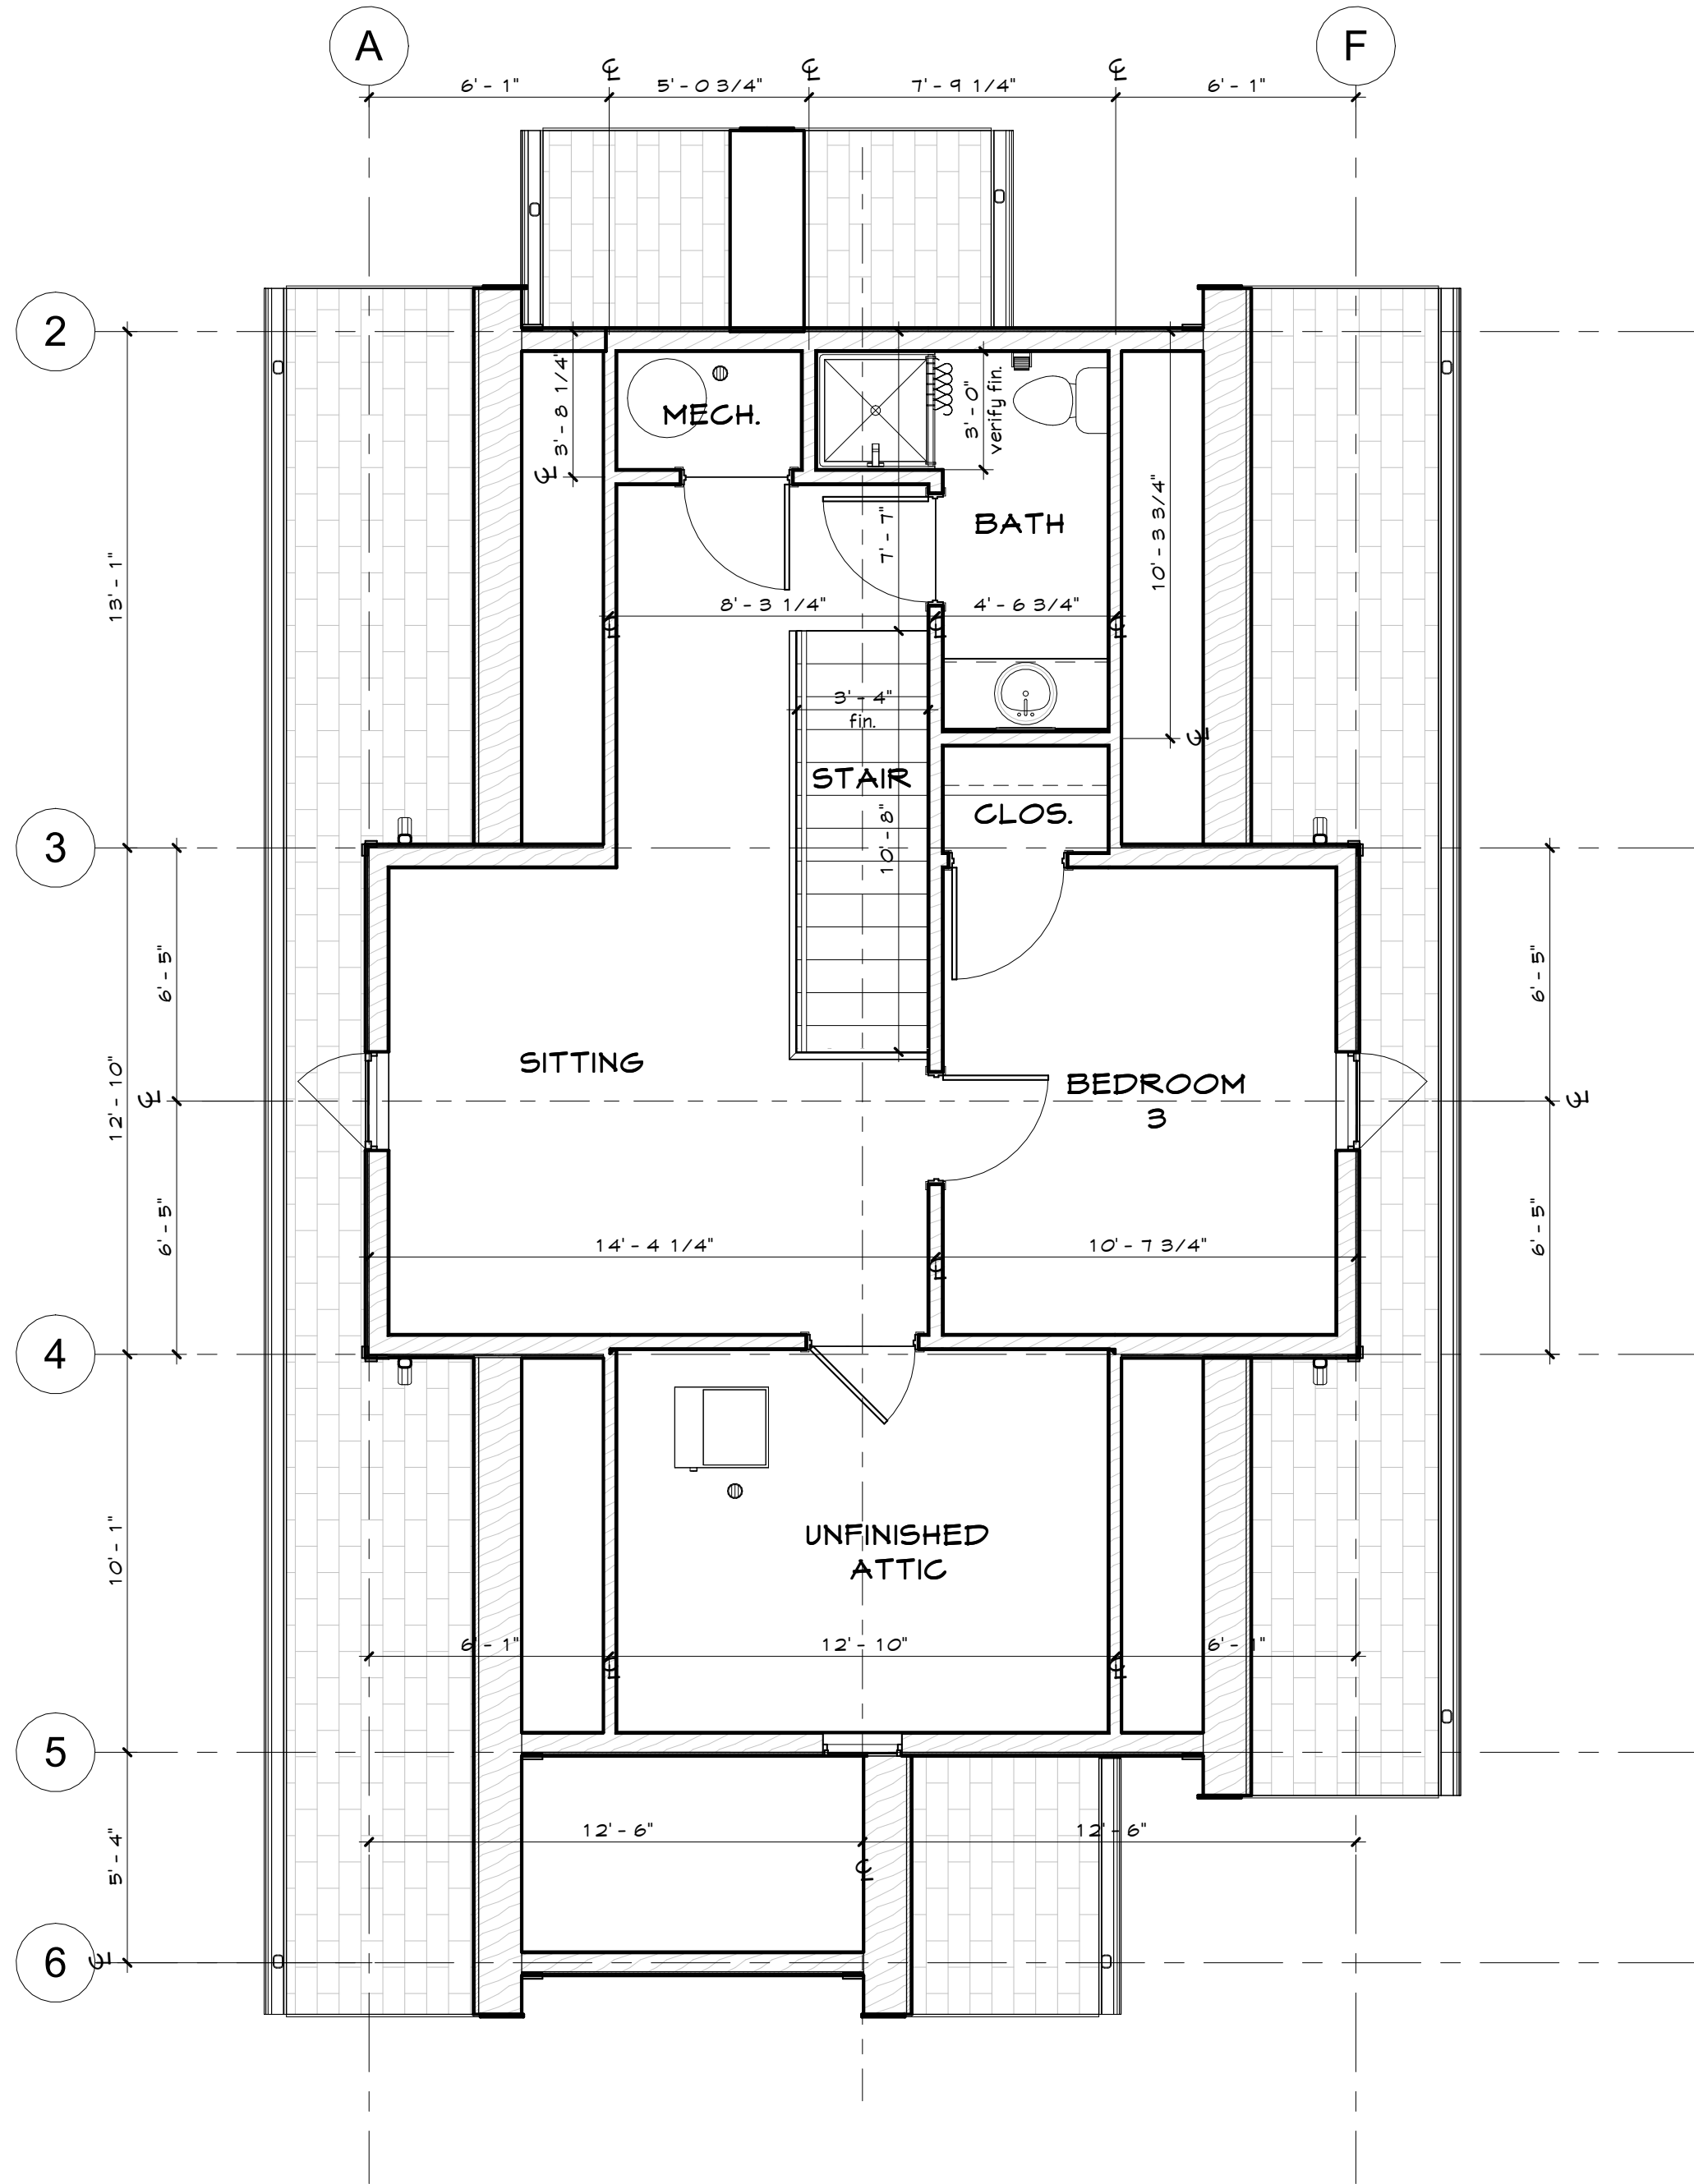

2	SECOND FLOOR DIMENSION PLAN
A1.02	1/4" = 1'-0"



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

**PRELIMINARY.
NOT FOR
CONSTRUCTION**

ROBERT D. ROLLINGS - 2028021508
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2028023510-0

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2023	

CITY OF SEDALIA
HOUSING - HOUSE A


4TH & NEW YORK,
SEDALIA, MO

DIMENSION PLANS


DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:


A1.02
80.168

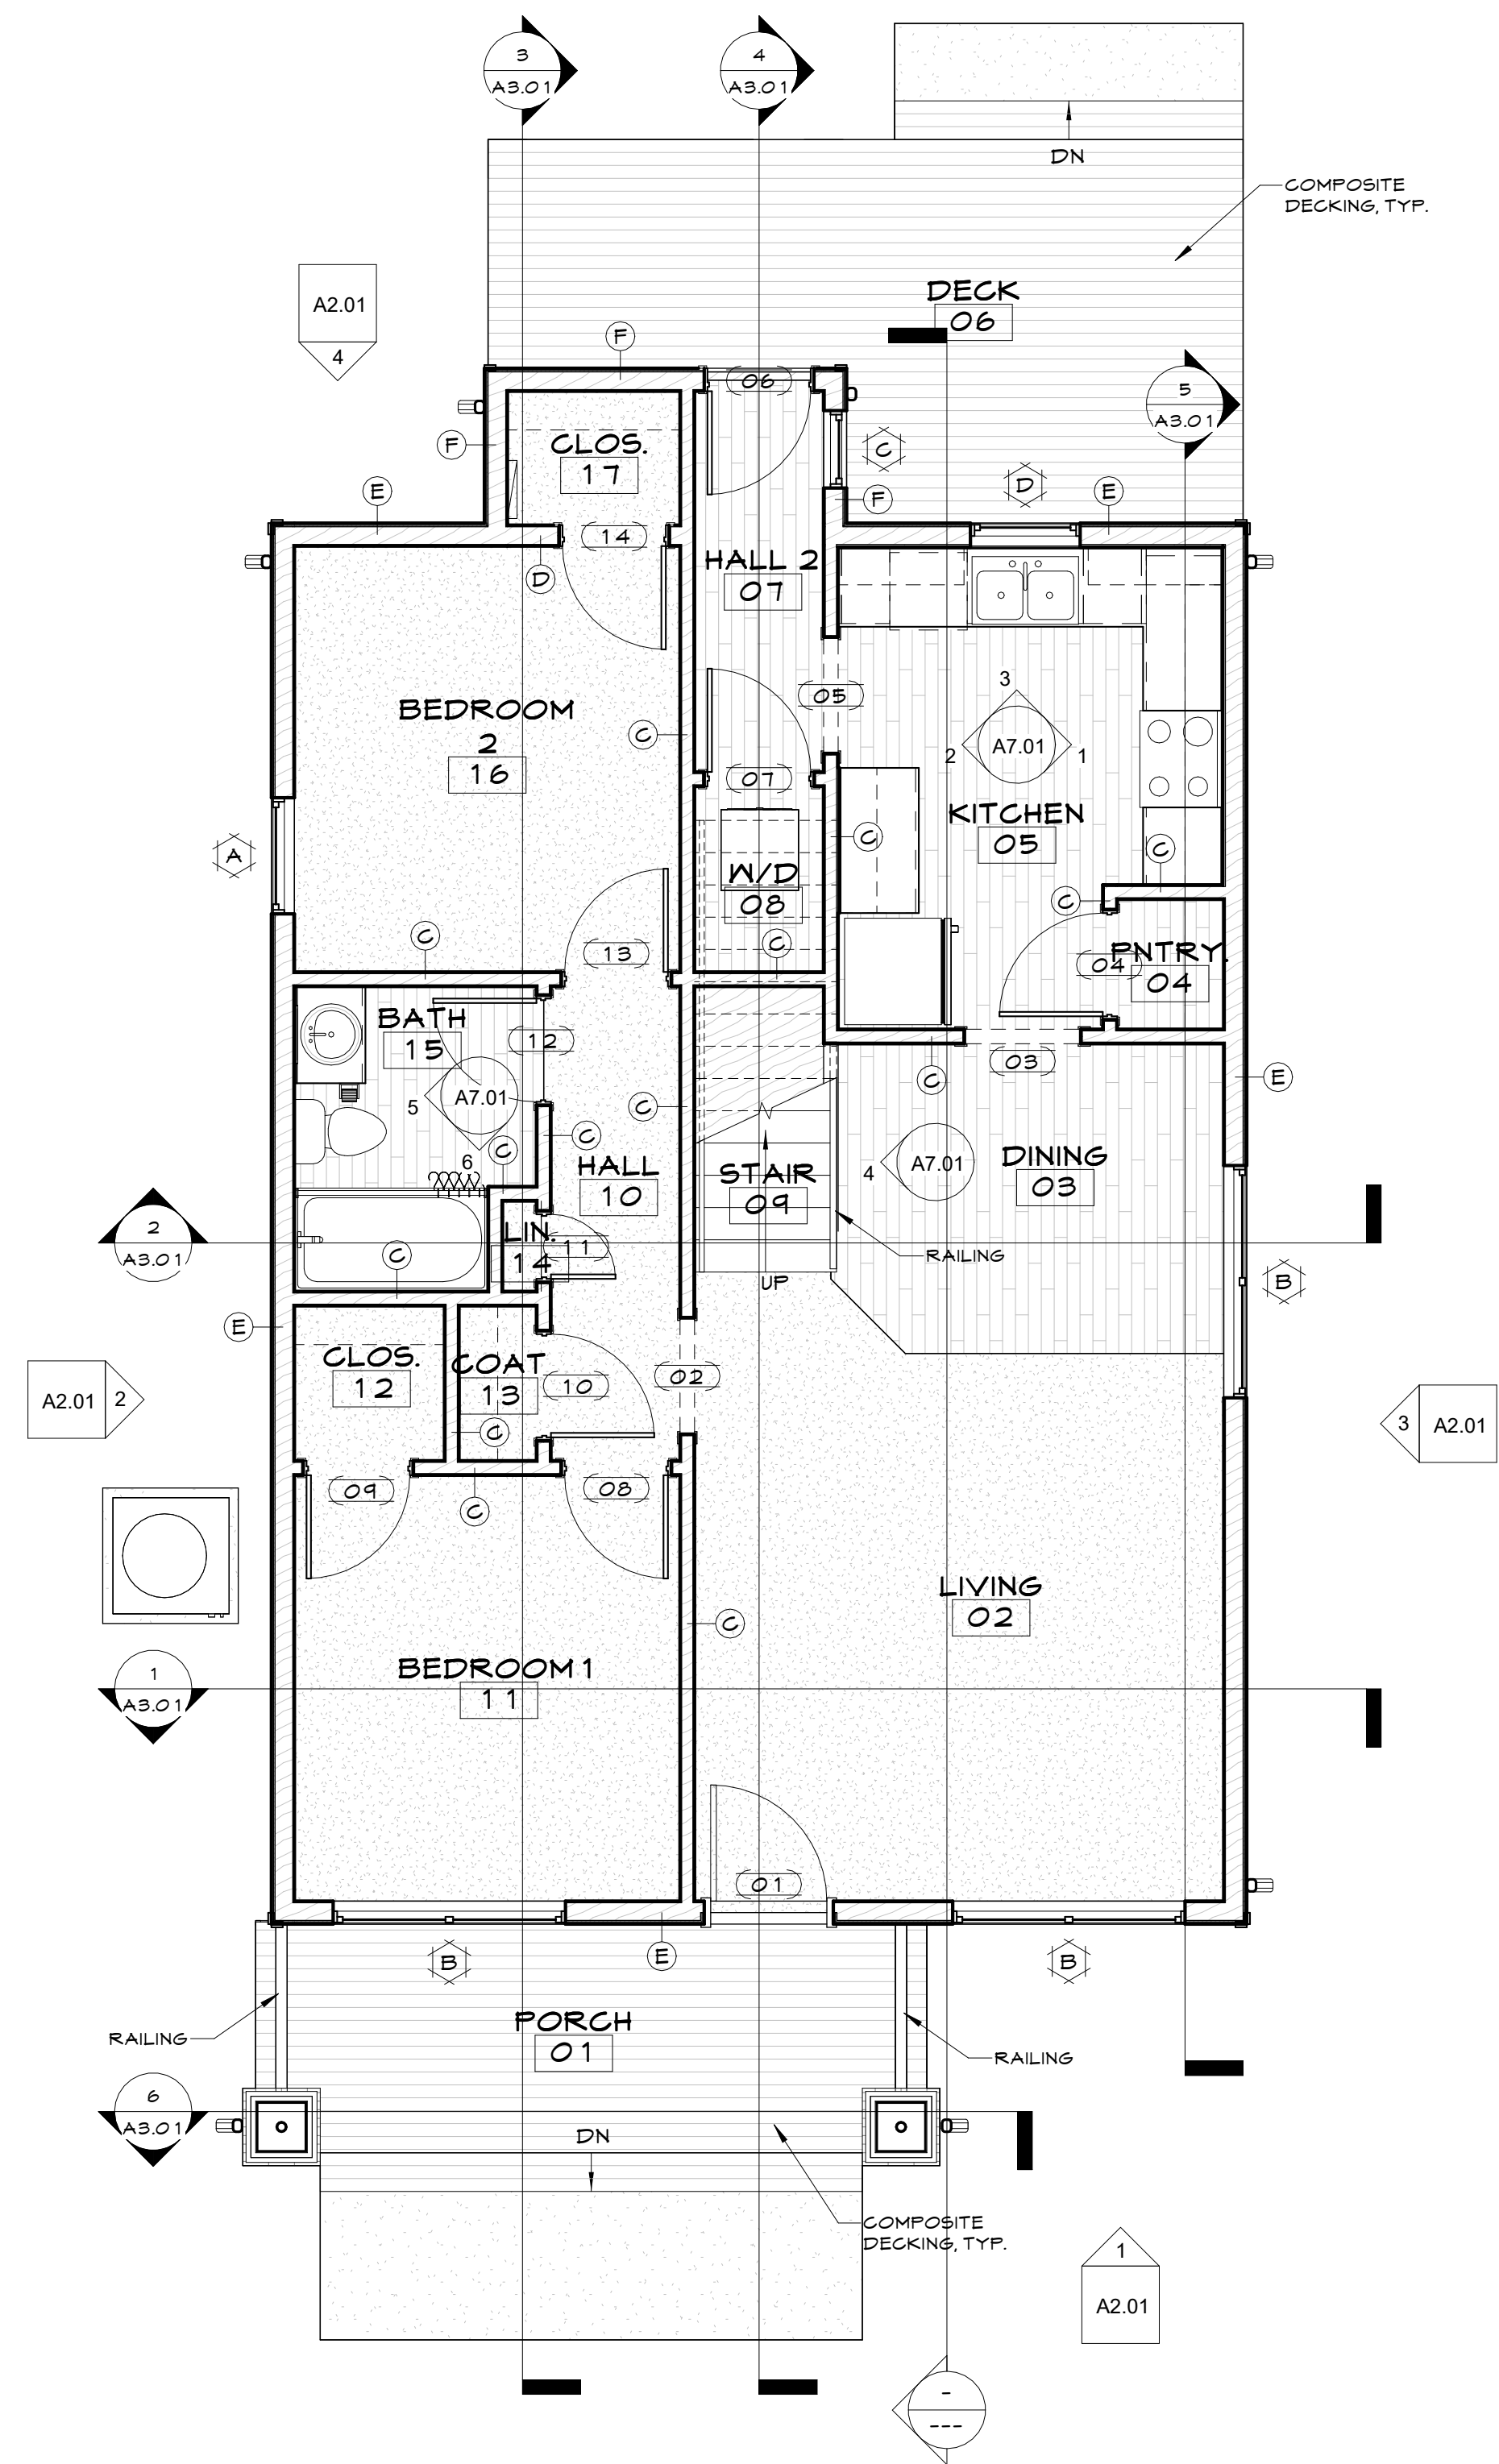

1 FIRST FLOOR REFERENCE PLAN
A1.03 1/4" = 1'-0"

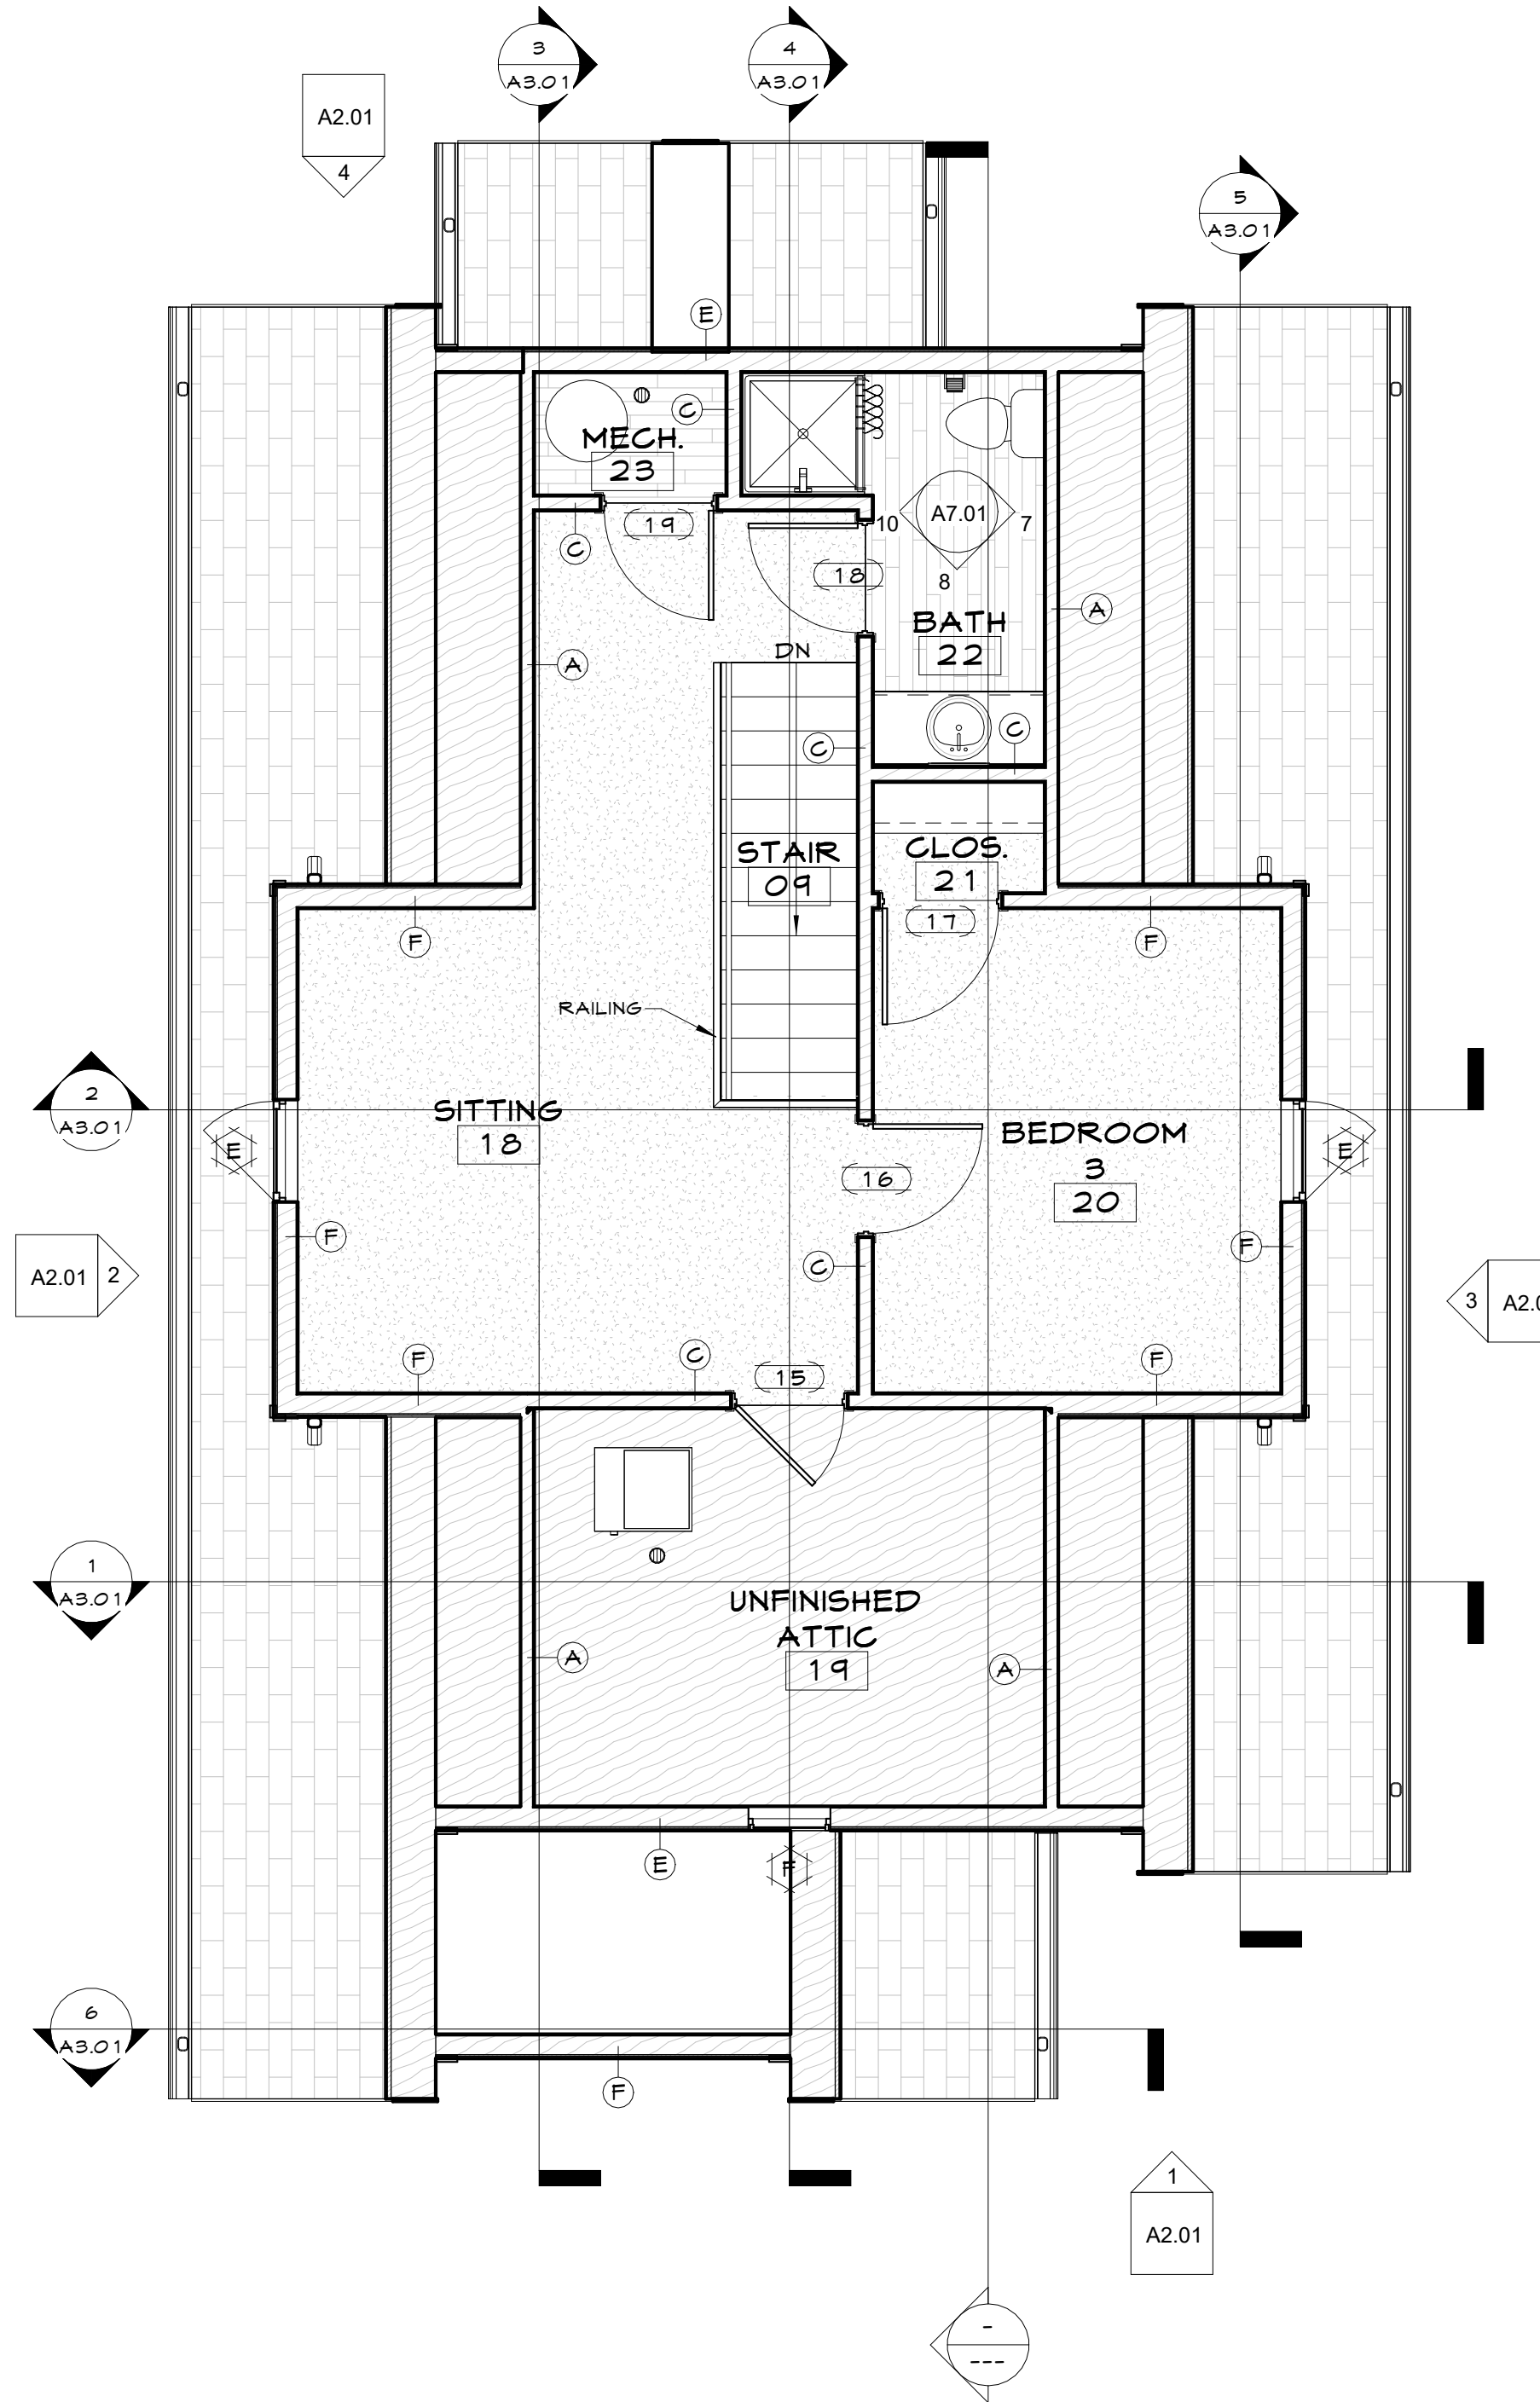

3 SECOND FLOOR REFERENCE PLAN
A1.03 1/4" = 1'-0"

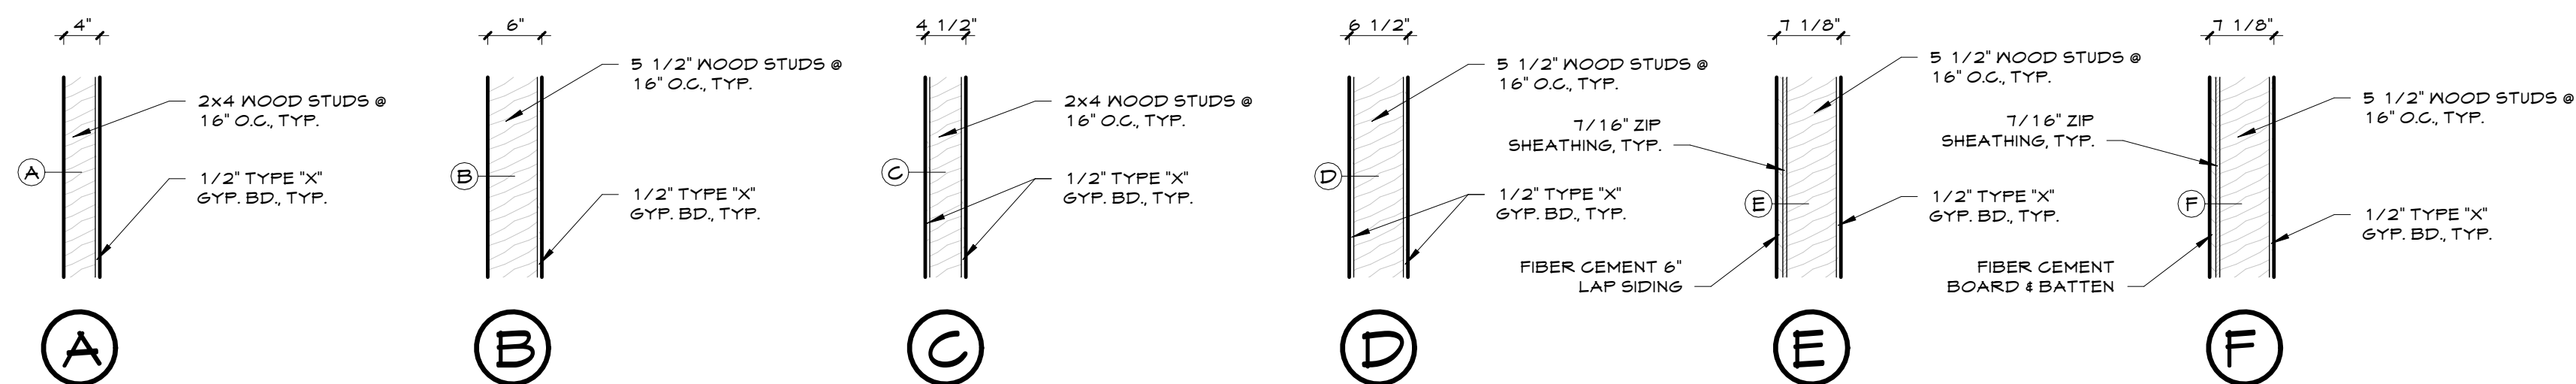

NOTE: REFER TO WALL SECTIONS FOR DETAILED WALL CONSTRUCTION. TYP. WALL SEGMENTS SHOWN ARE NOT COMPLETE.

2 WALL TYPES
A1.03 3/4" = 1'-0"



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 82.9. 9751
Fax: 660. 82.9. 9752

CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS - 2020021508
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2009003310-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	


CITY OF SEDALIA
HOUSING - HOUSE A
4TH & NEW YORK,
SEDALIA, MO

REFERENCE PLANS
& WALL TYPES

DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:


A1.03
80.168

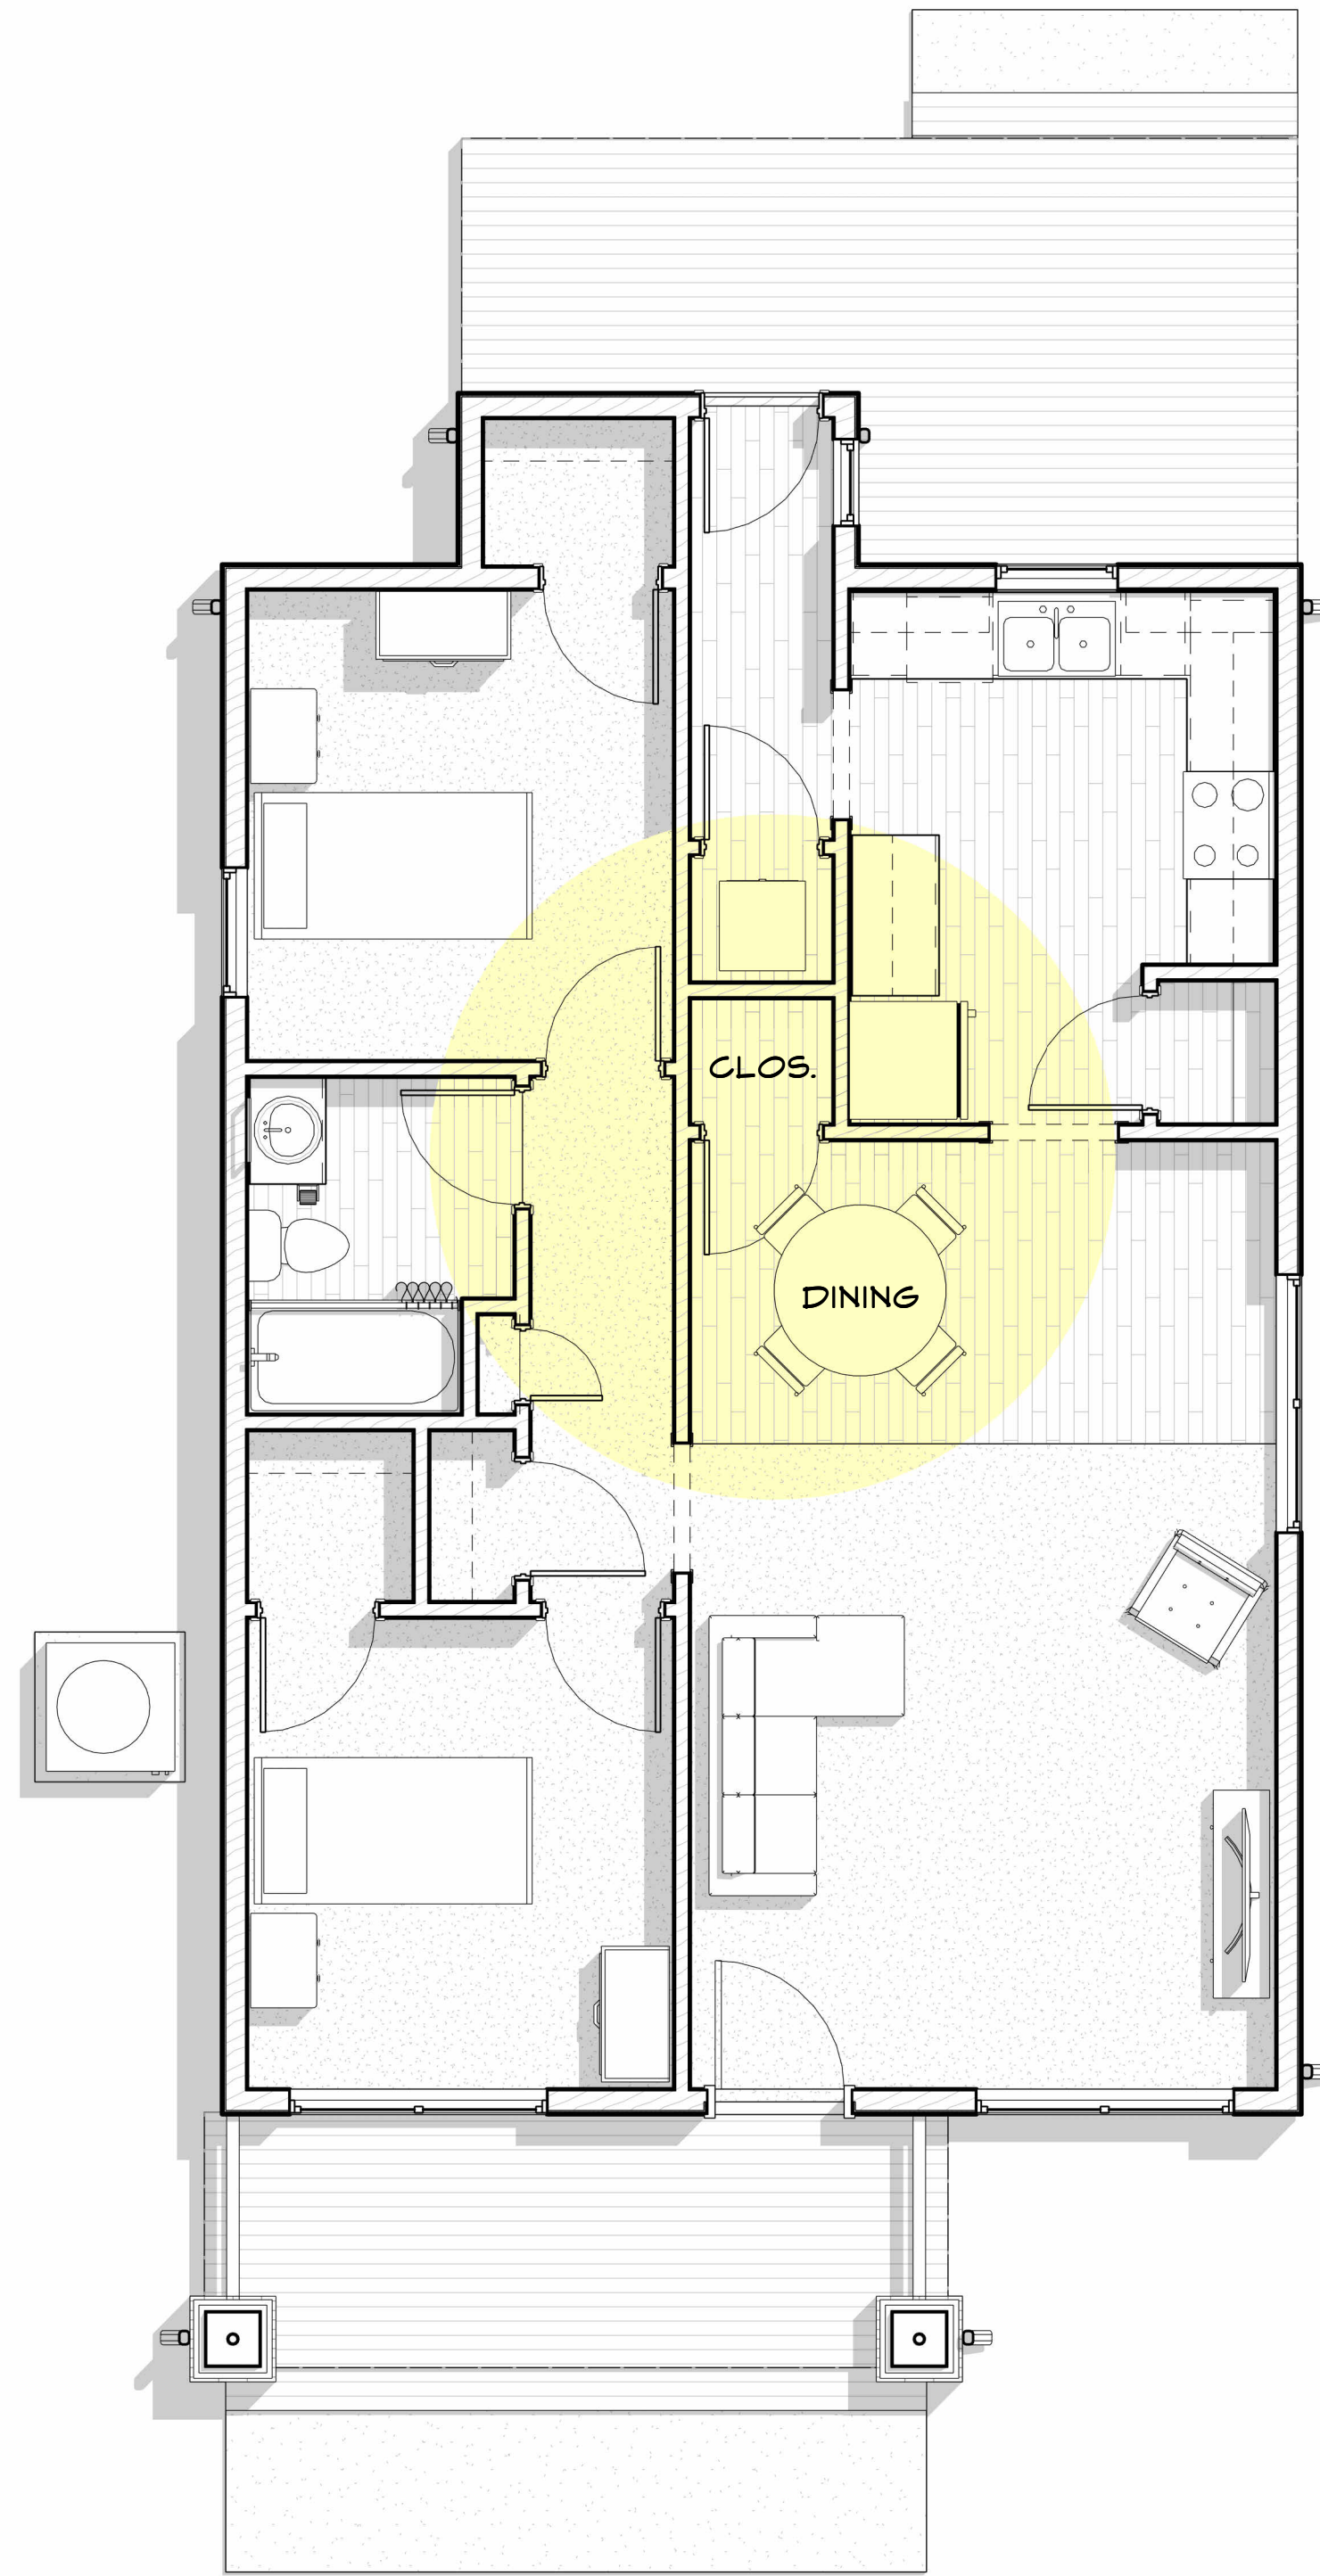

1	OPTION A-2
A1.04	1/4" = 1'-0"

HOUSE OPTION A-2

- SECOND FLOOR UNFINISHED W/ NO STAIR (FUTURE ACCESS AND FINISH)
- CLOSET ADDED OFF OF DINING ROOM
- DINING ROOM EXPANDED

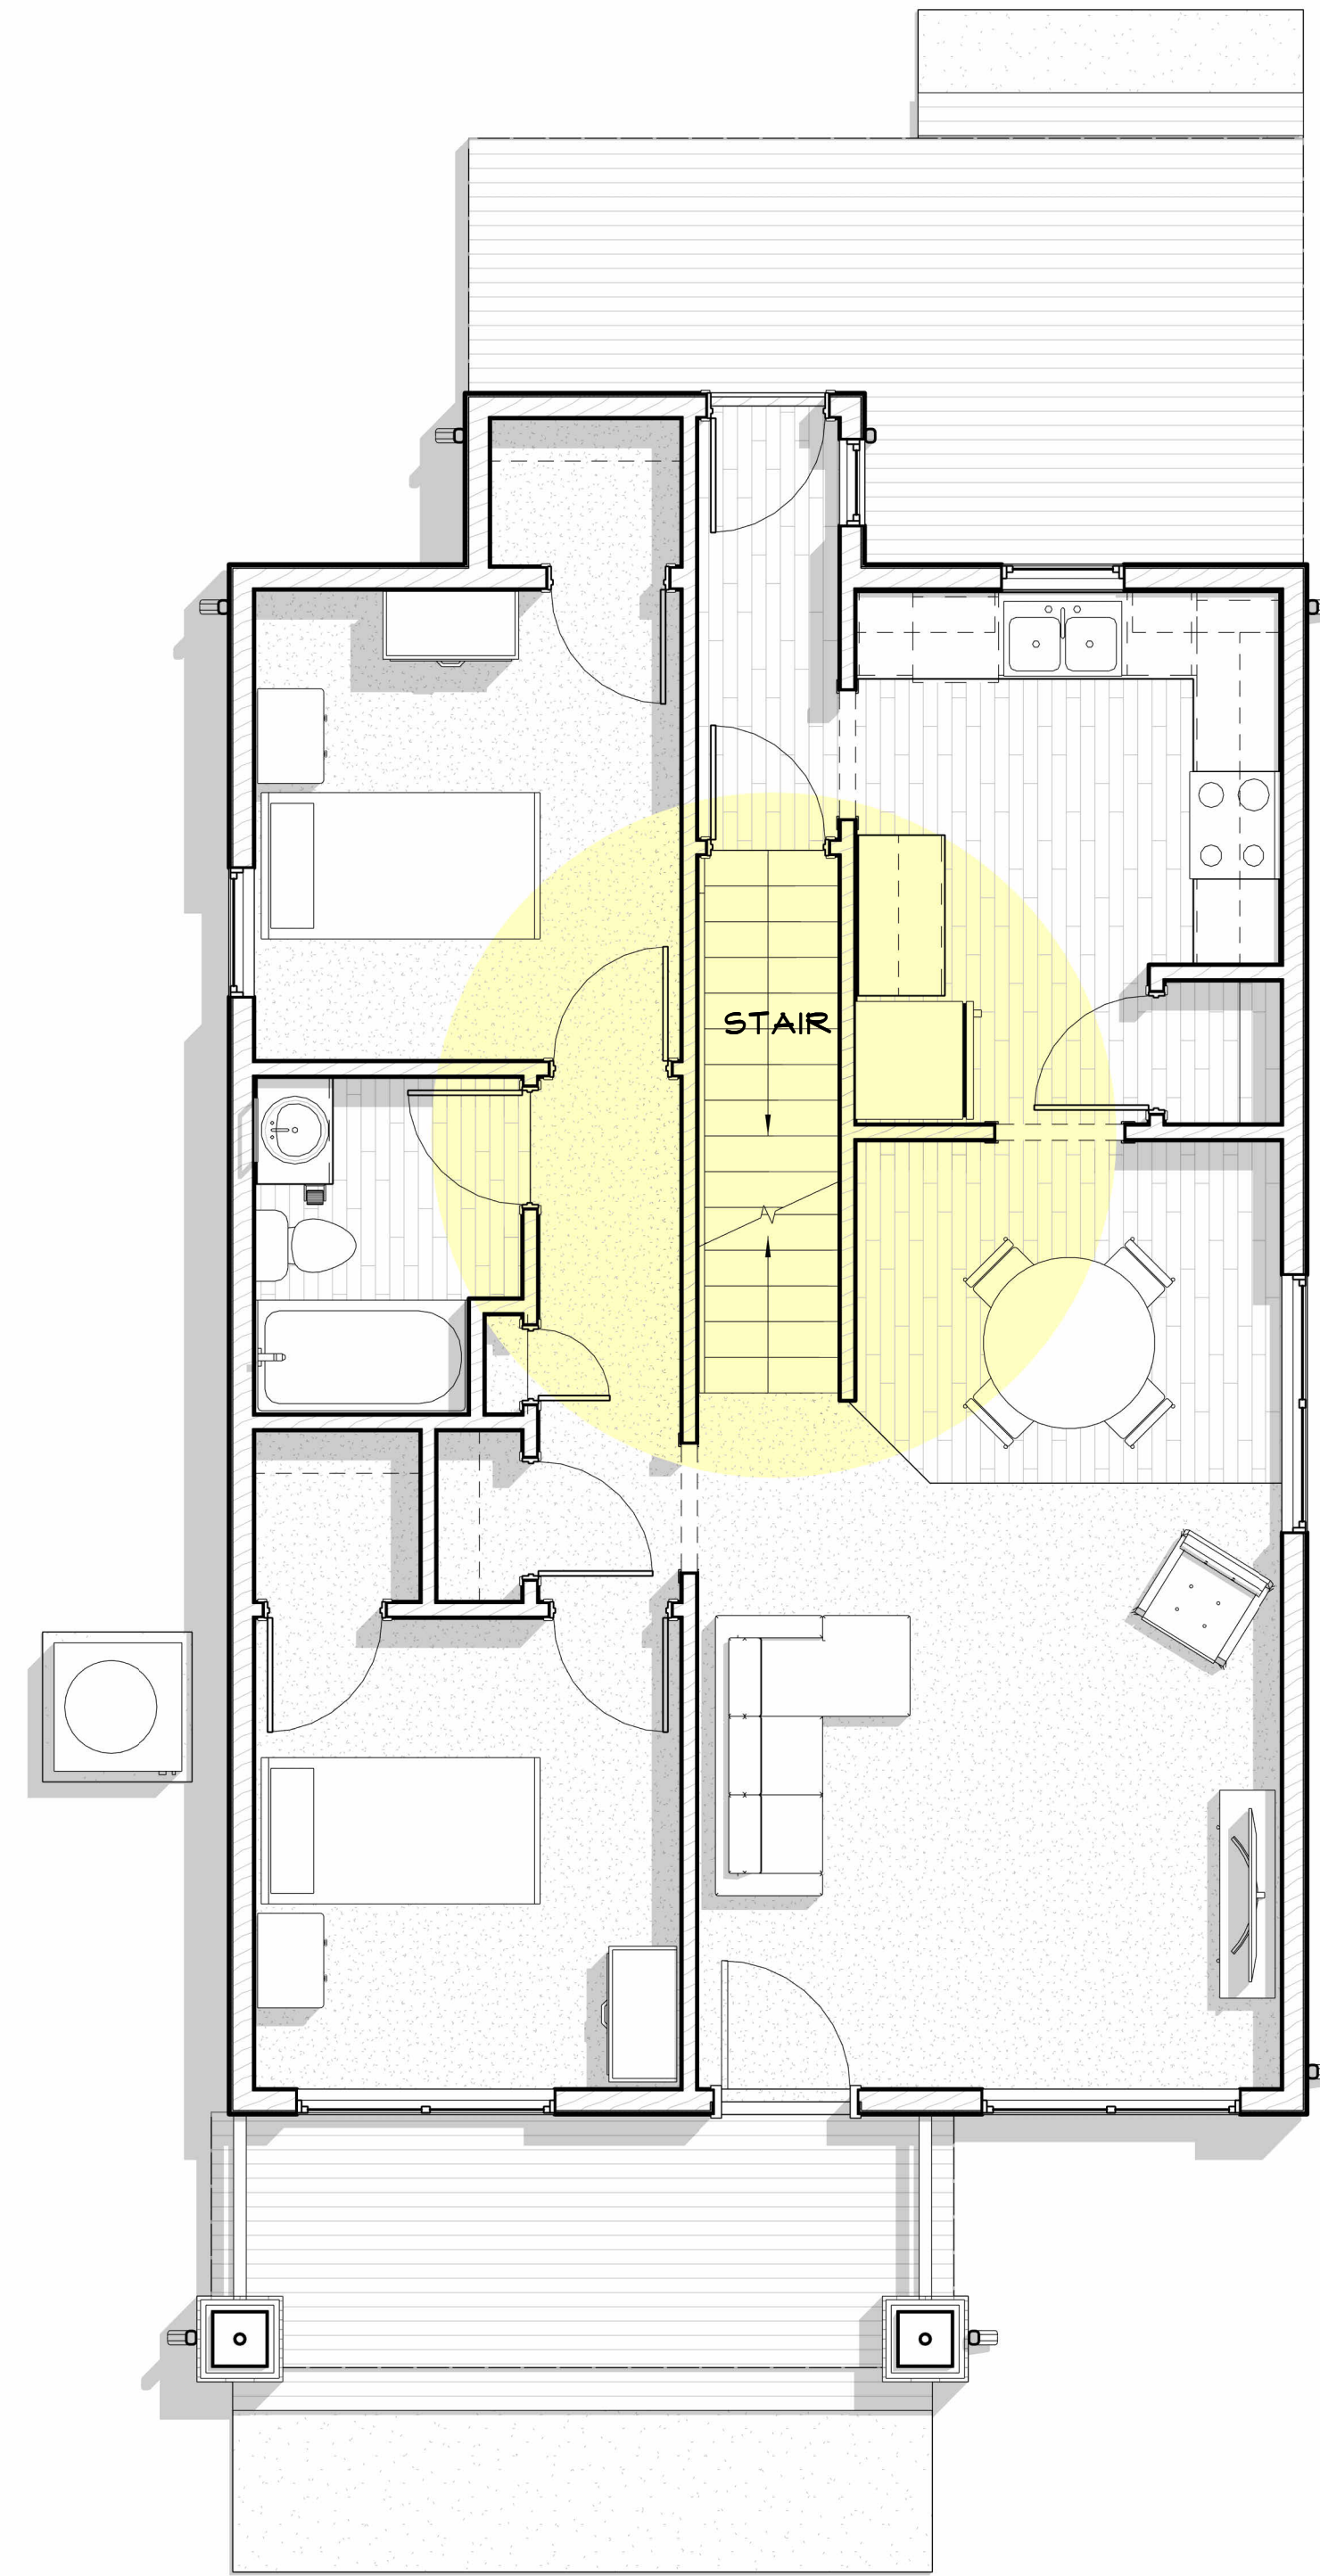

2	OPTION A-3
A1.04	1/4" = 1'-0"

HOUSE OPTION A-3

- BASEMENT W/ 9' WALLS IN LIEU OF A CRAWLSPACE
- STAIRS TO BASEMENT WITH DOOR OFF BACK HALL
- WASHER DRYER MOVES TO THE BASEMENT

CITY OF SEDALIA HOUSING - HOUSE A

COPYRIGHT © 2021



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT

ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS 2028021208
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL N/A-2028023510-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	

CITY OF SEDALIA
HOUSING - HOUSE A

4TH & NEW YORK,
SEDALIA, MO


HOUSE A OPTIONS


DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:


A1.04

80.168




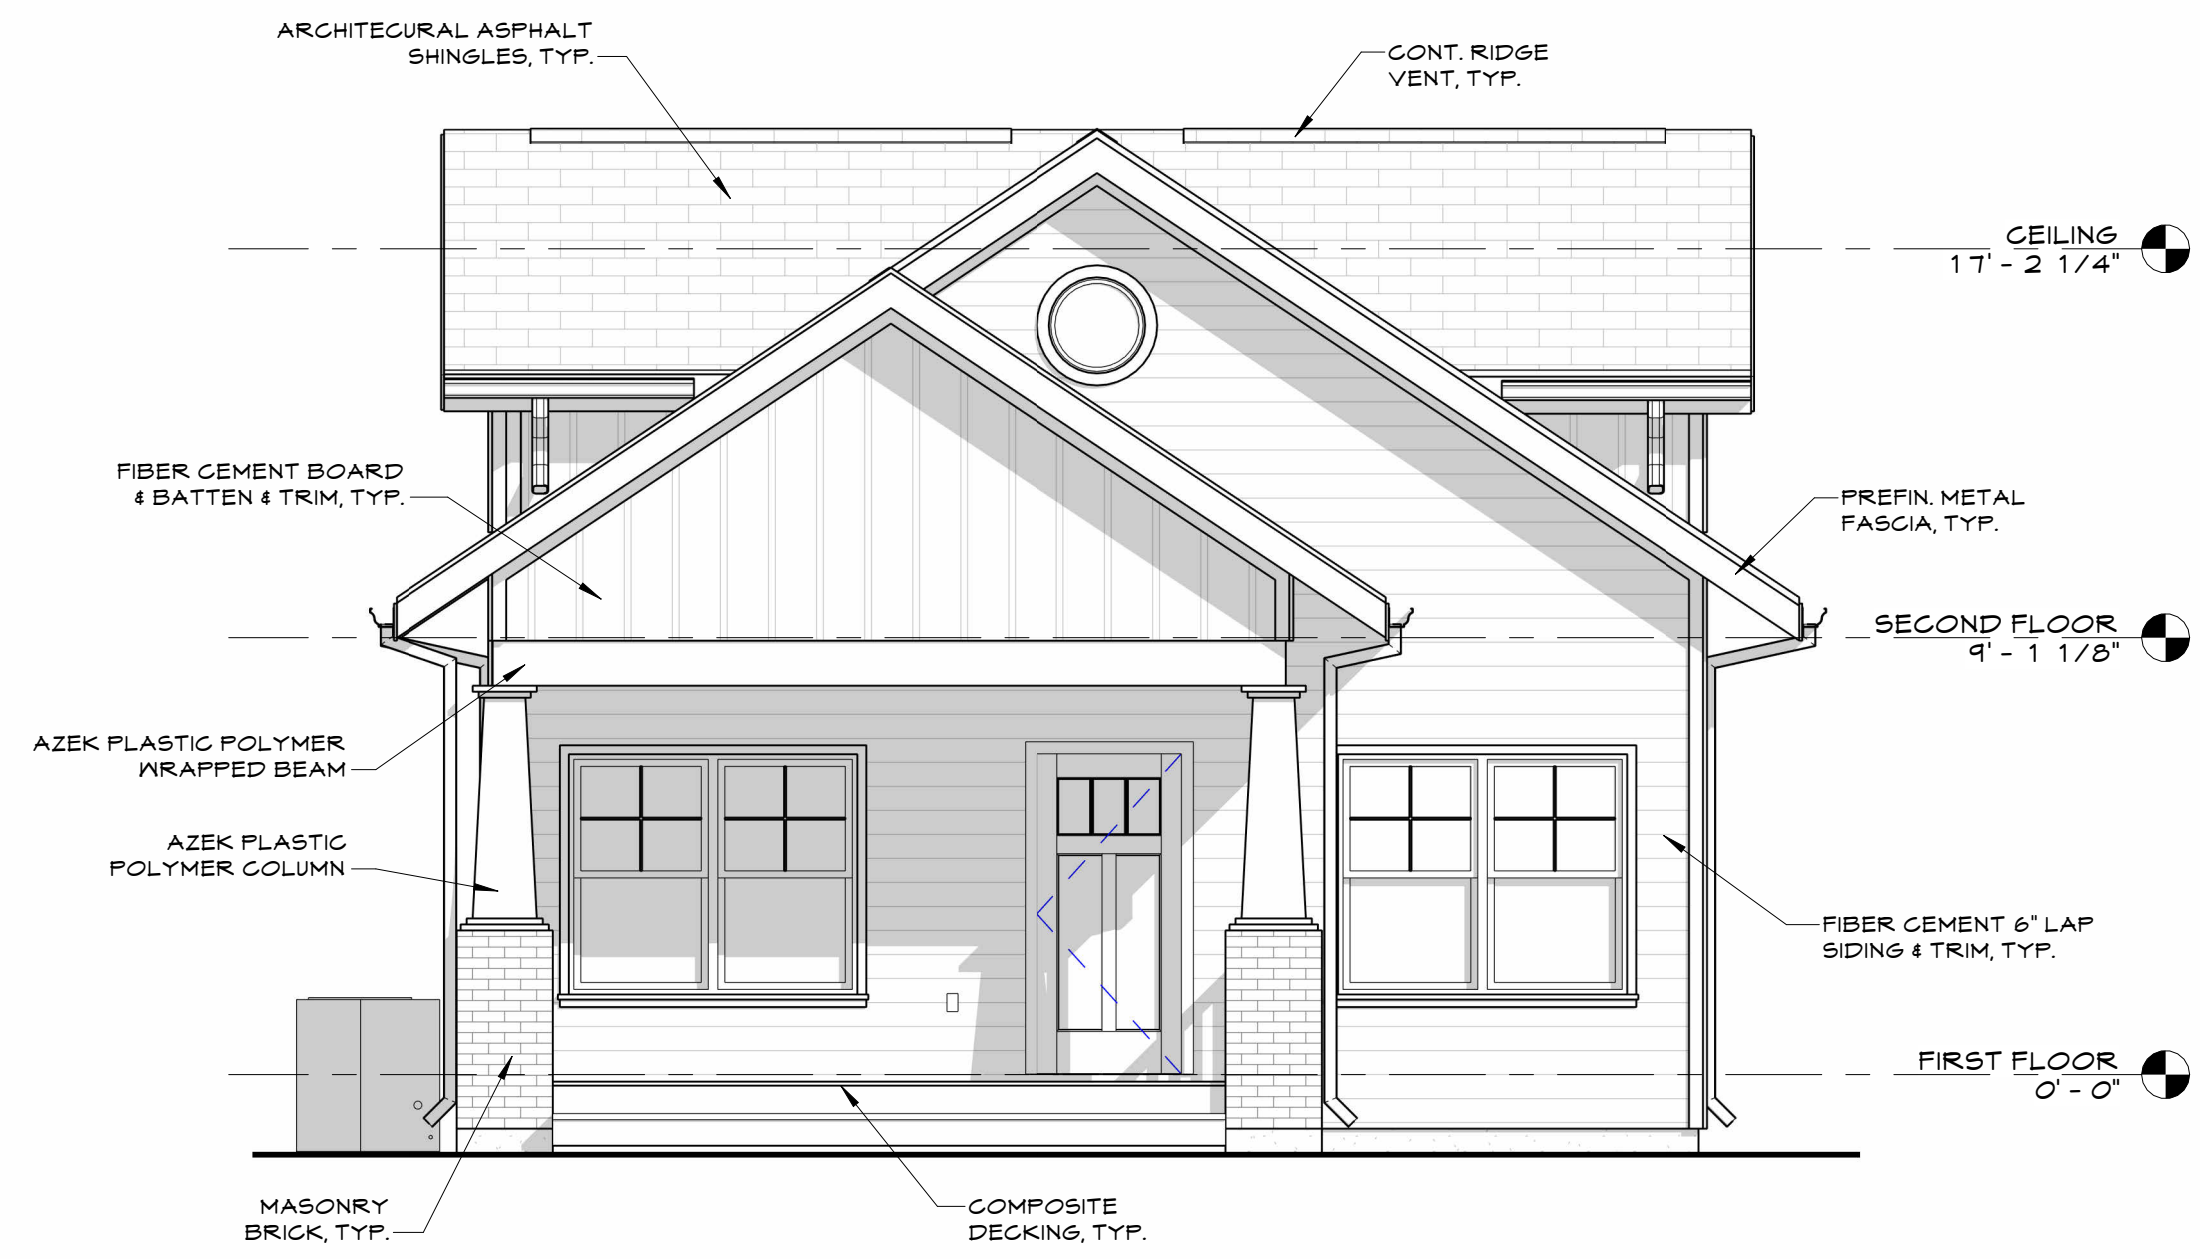


1
A2.01
FRONT ELEVATION
1/4" = 1'-0"

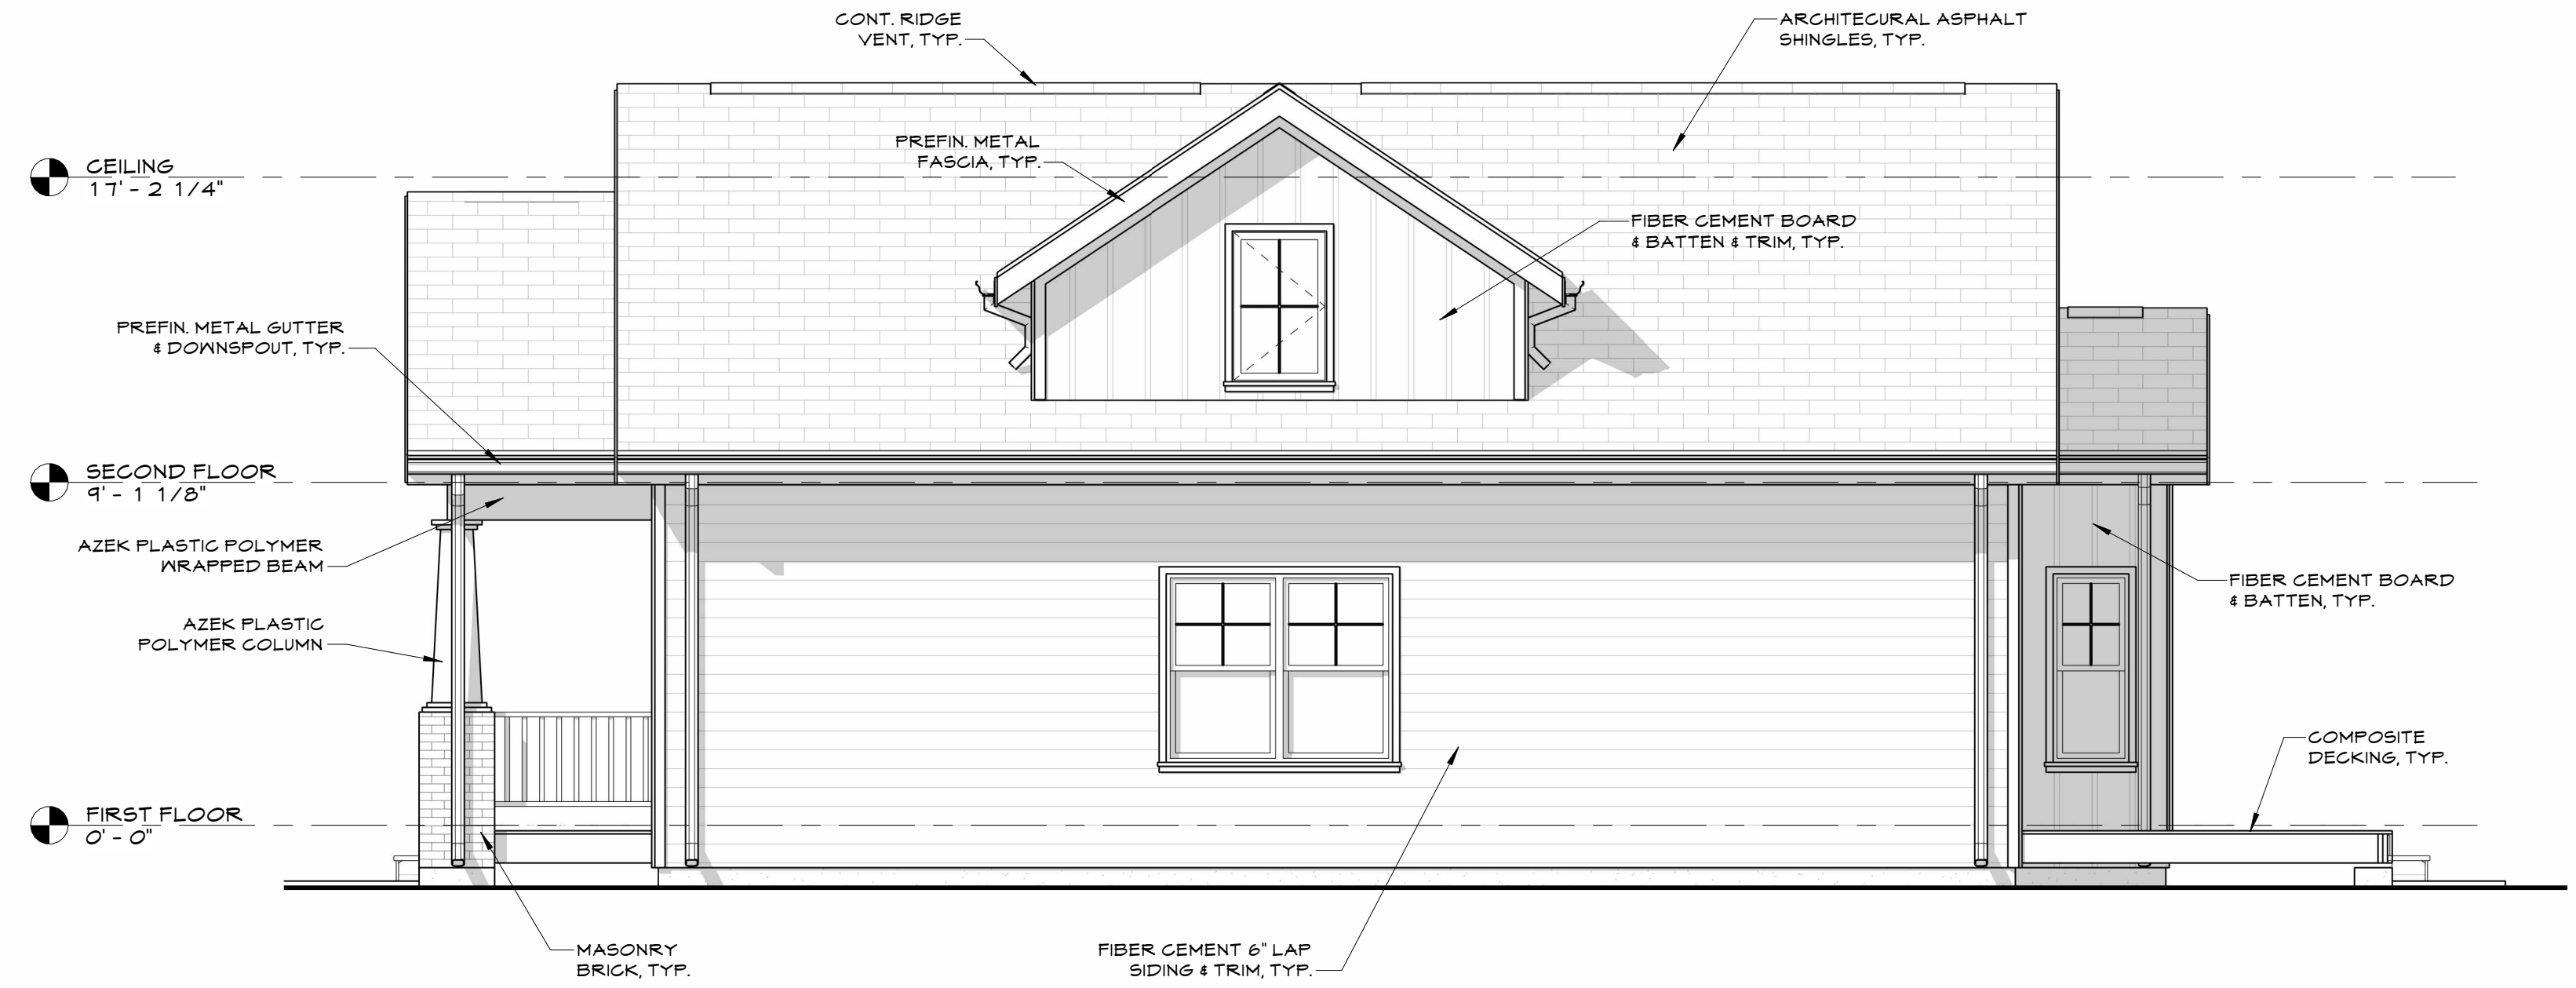


3
A2.01
RIGHT SIDE ELEVATION
1/4" = 1'-0"

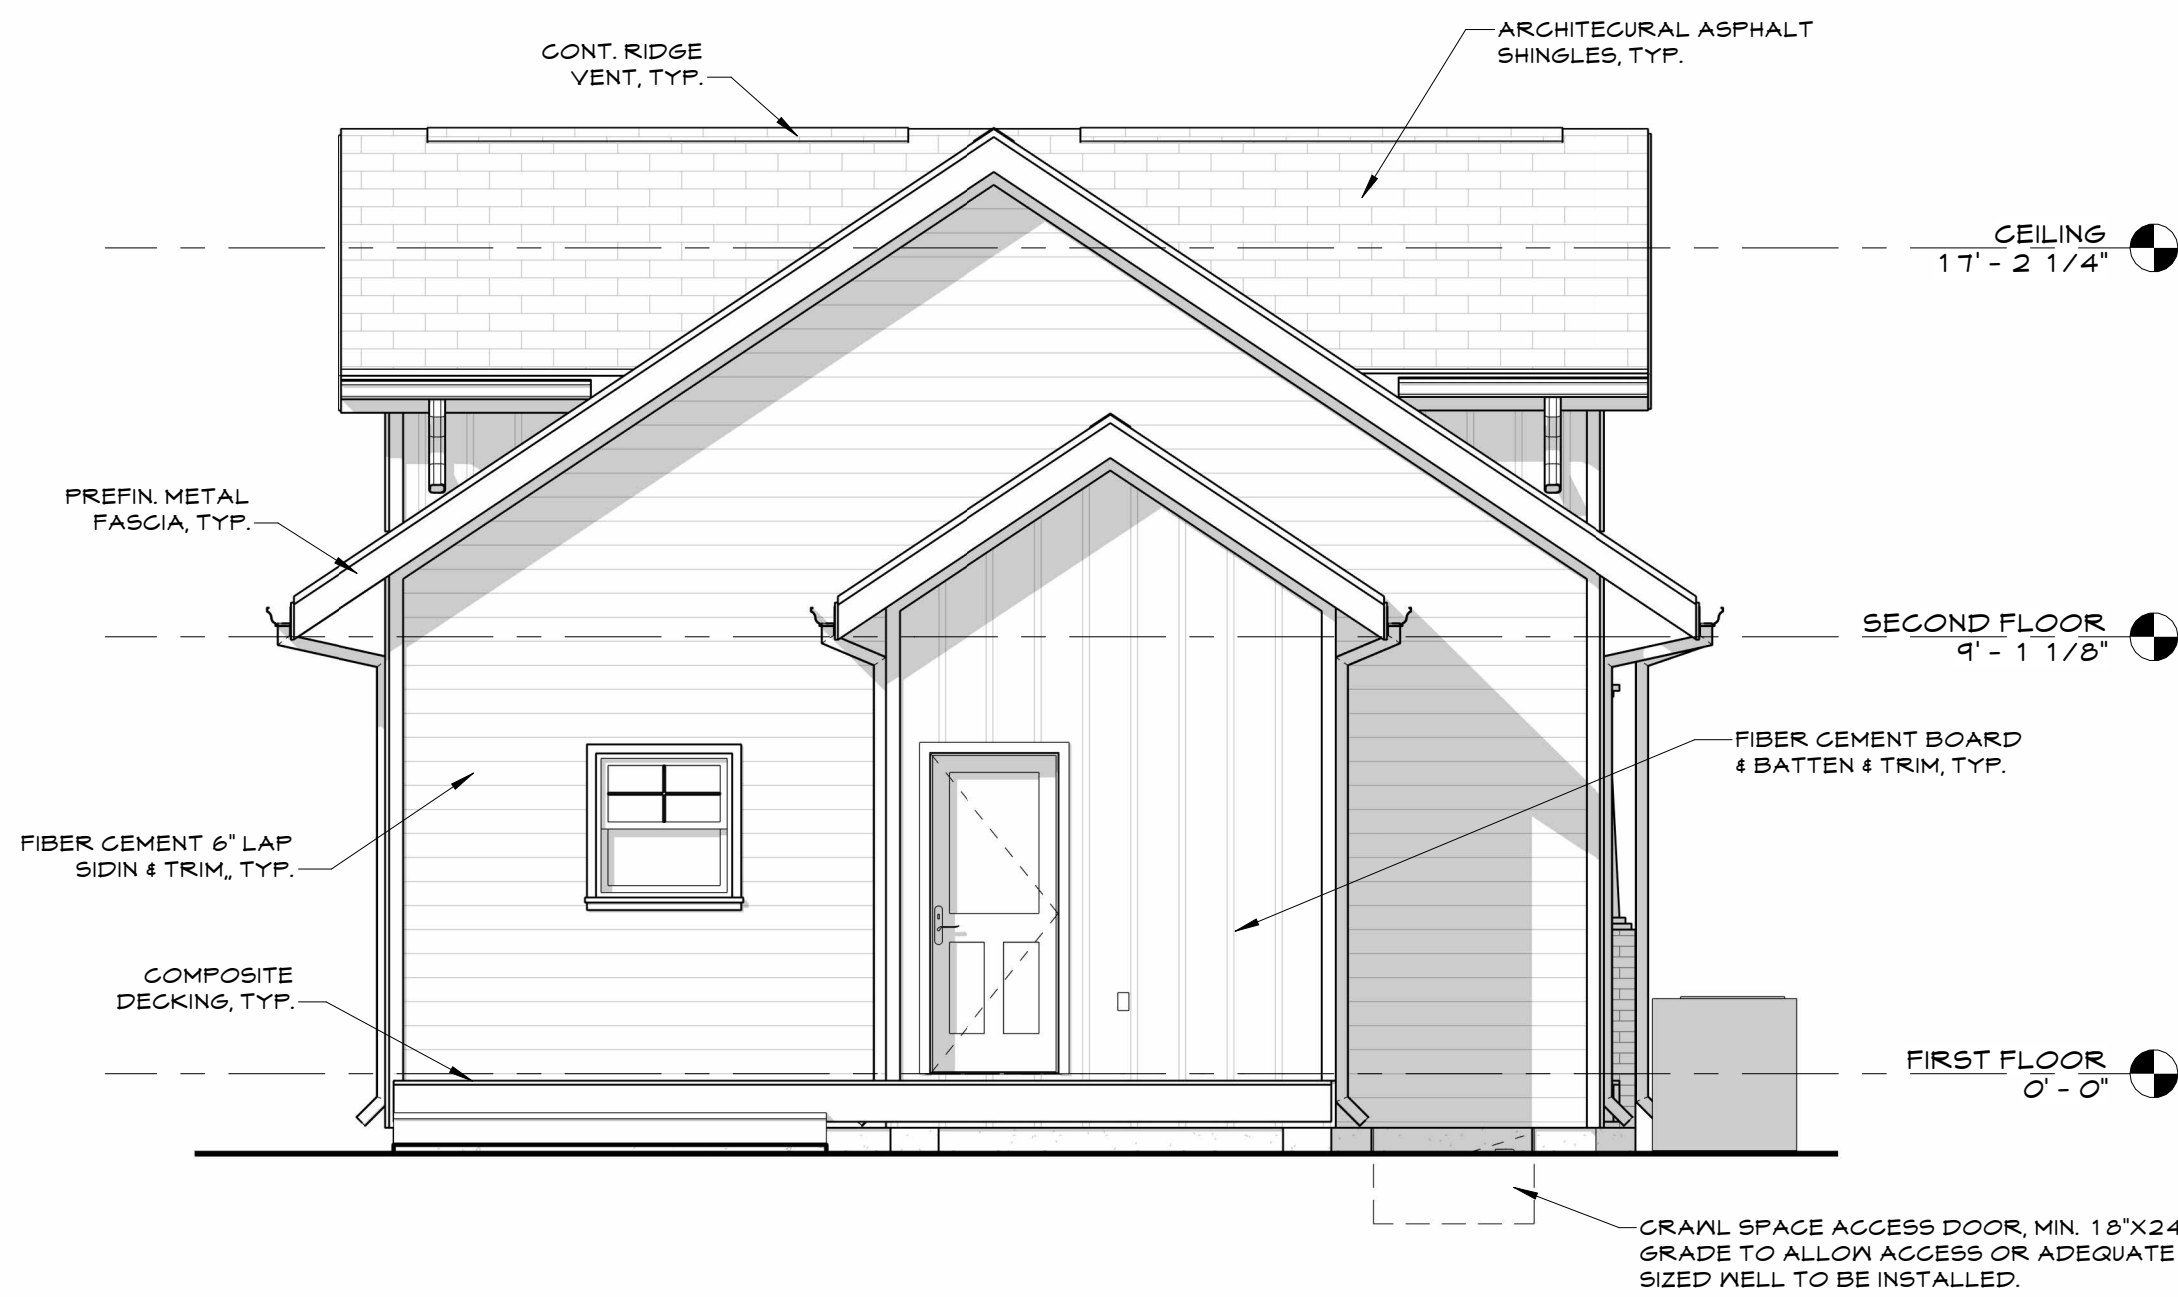


4
A2.01
BACK ELEVATION
1/4" = 1'-0"

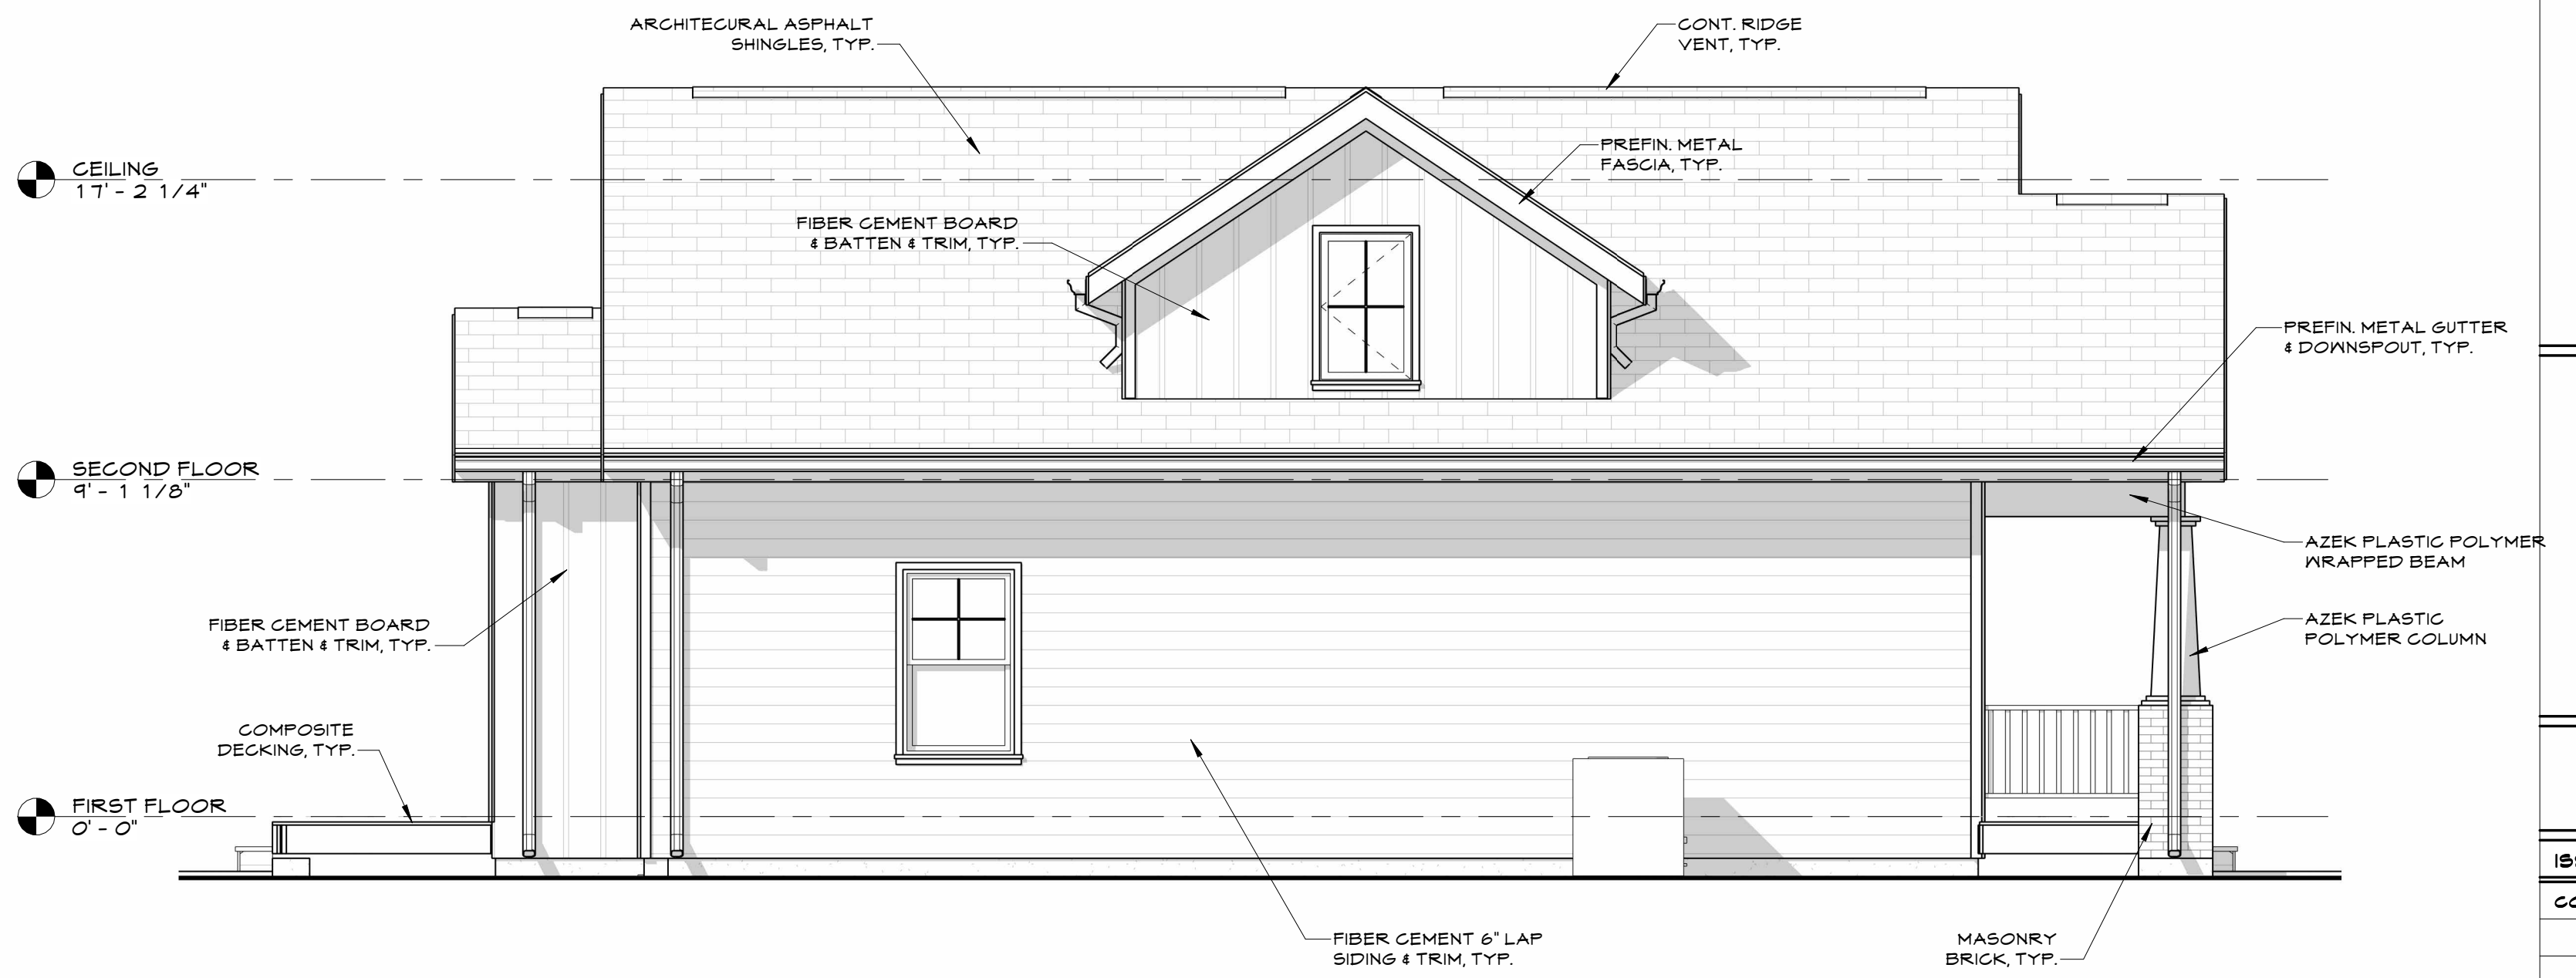

2
A2.01
LEFT SIDE ELEVATION
1/4" = 1'-0"

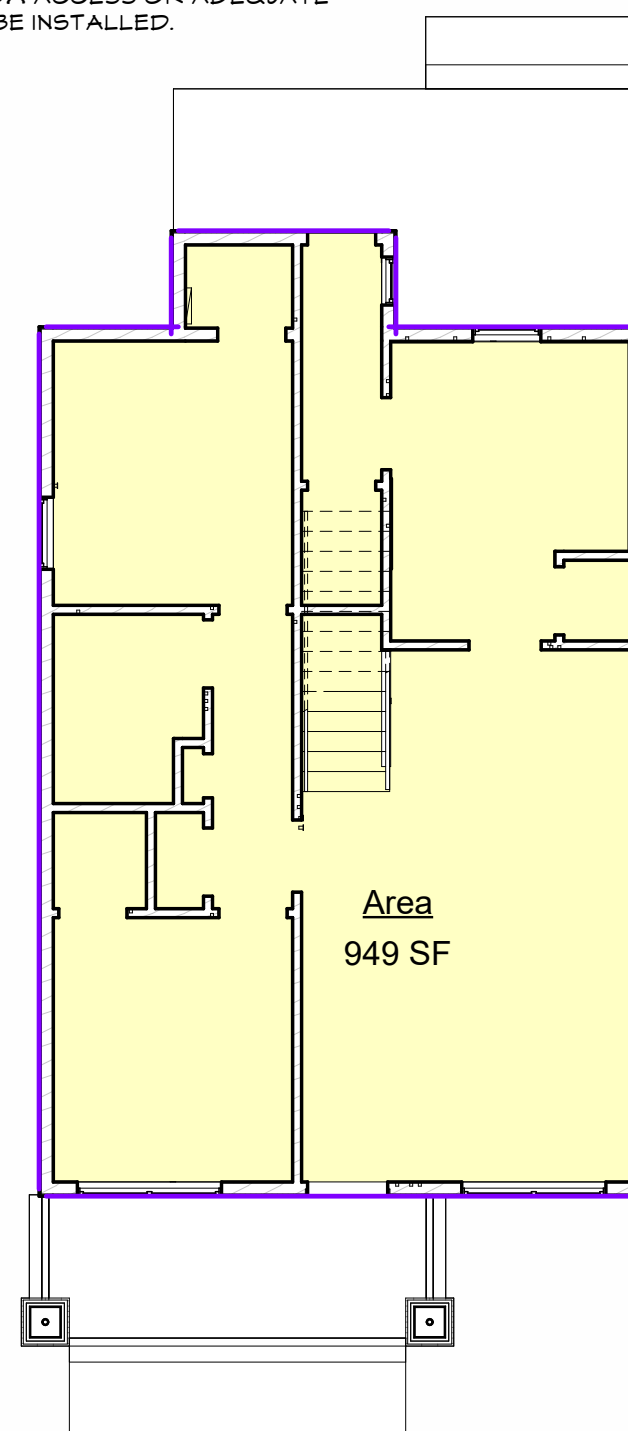

5
A2.01
FIRST FLOOR AREA
1/8" = 1'-0"

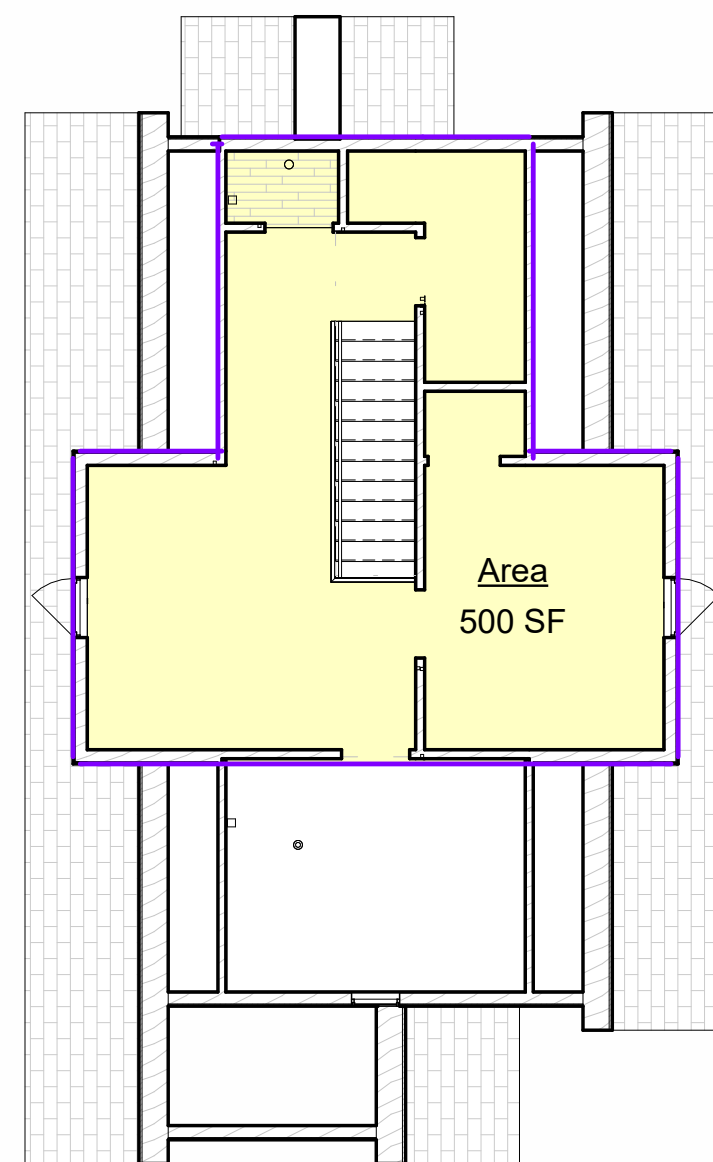

6
A2.01
SECOND FLOOR AREA
1/8" = 1'-0"



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT

ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS - 2028021509
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2004003310-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	

CITY OF SEDALIA
HOUSING - HOUSE A


4TH & NEW YORK,
SEDALIA, MO

EXTERIOR
ELEVATIONS &
AREA PLANS

DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:

A2.01
80.168

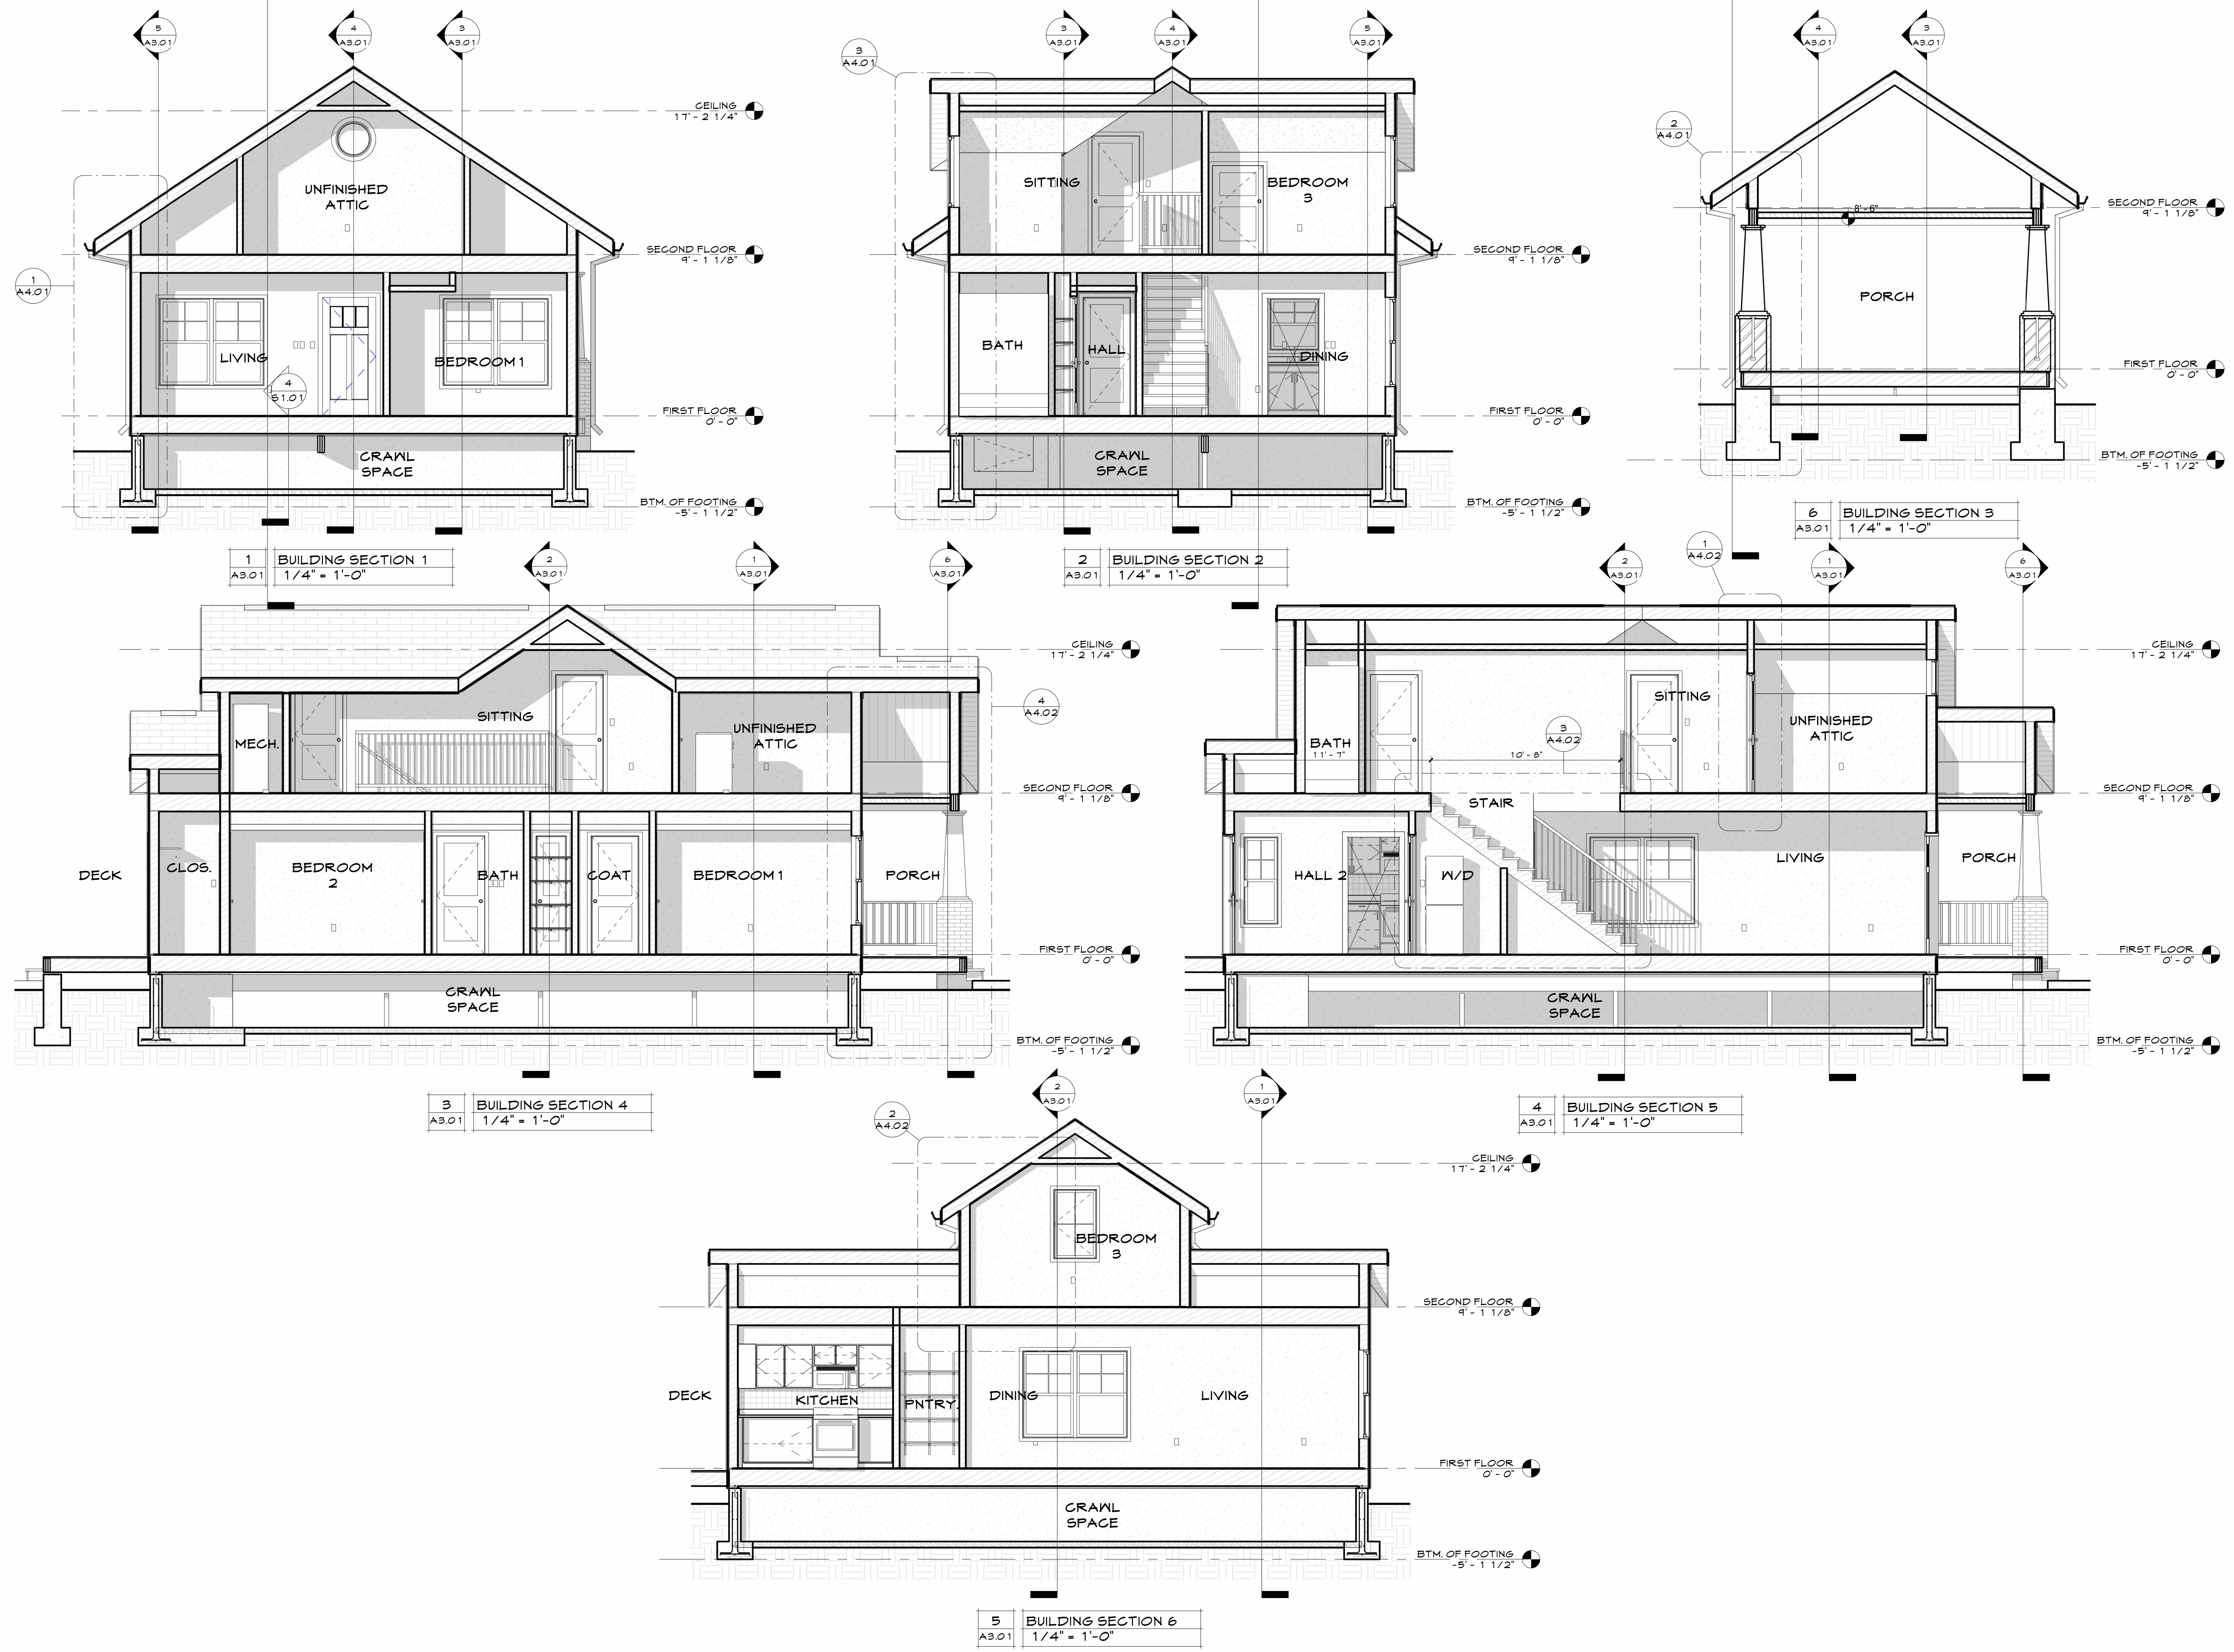

CITY OF SEDALIA HOUSING - HOUSE A
COPYRIGHT © 2021

**Robert Rollings
Architects LLC**
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

**PRELIMINARY.
NOT FOR
CONSTRUCTION**

ROBERT D. ROLLINGS - 2026021509
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL A-A-2026021509

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/4/2025	

CITY OF SEDALIA
HOUSING - HOUSE A

4TH & NEW YORK,
SEDALIA, MO

**BUILDING
SECTIONS**

DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:
A3.01
80.168



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT

ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS 2028021508
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2008003310-0

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	

CITY OF SEDALIA
HOUSING - HOUSE A

4TH & NEW YORK,
SEDALIA, MO


WALL SECTIONS

DRAWN BY	Author
CHECKED BY	Approver


SHEET NUMBER:

A4.01


80.168

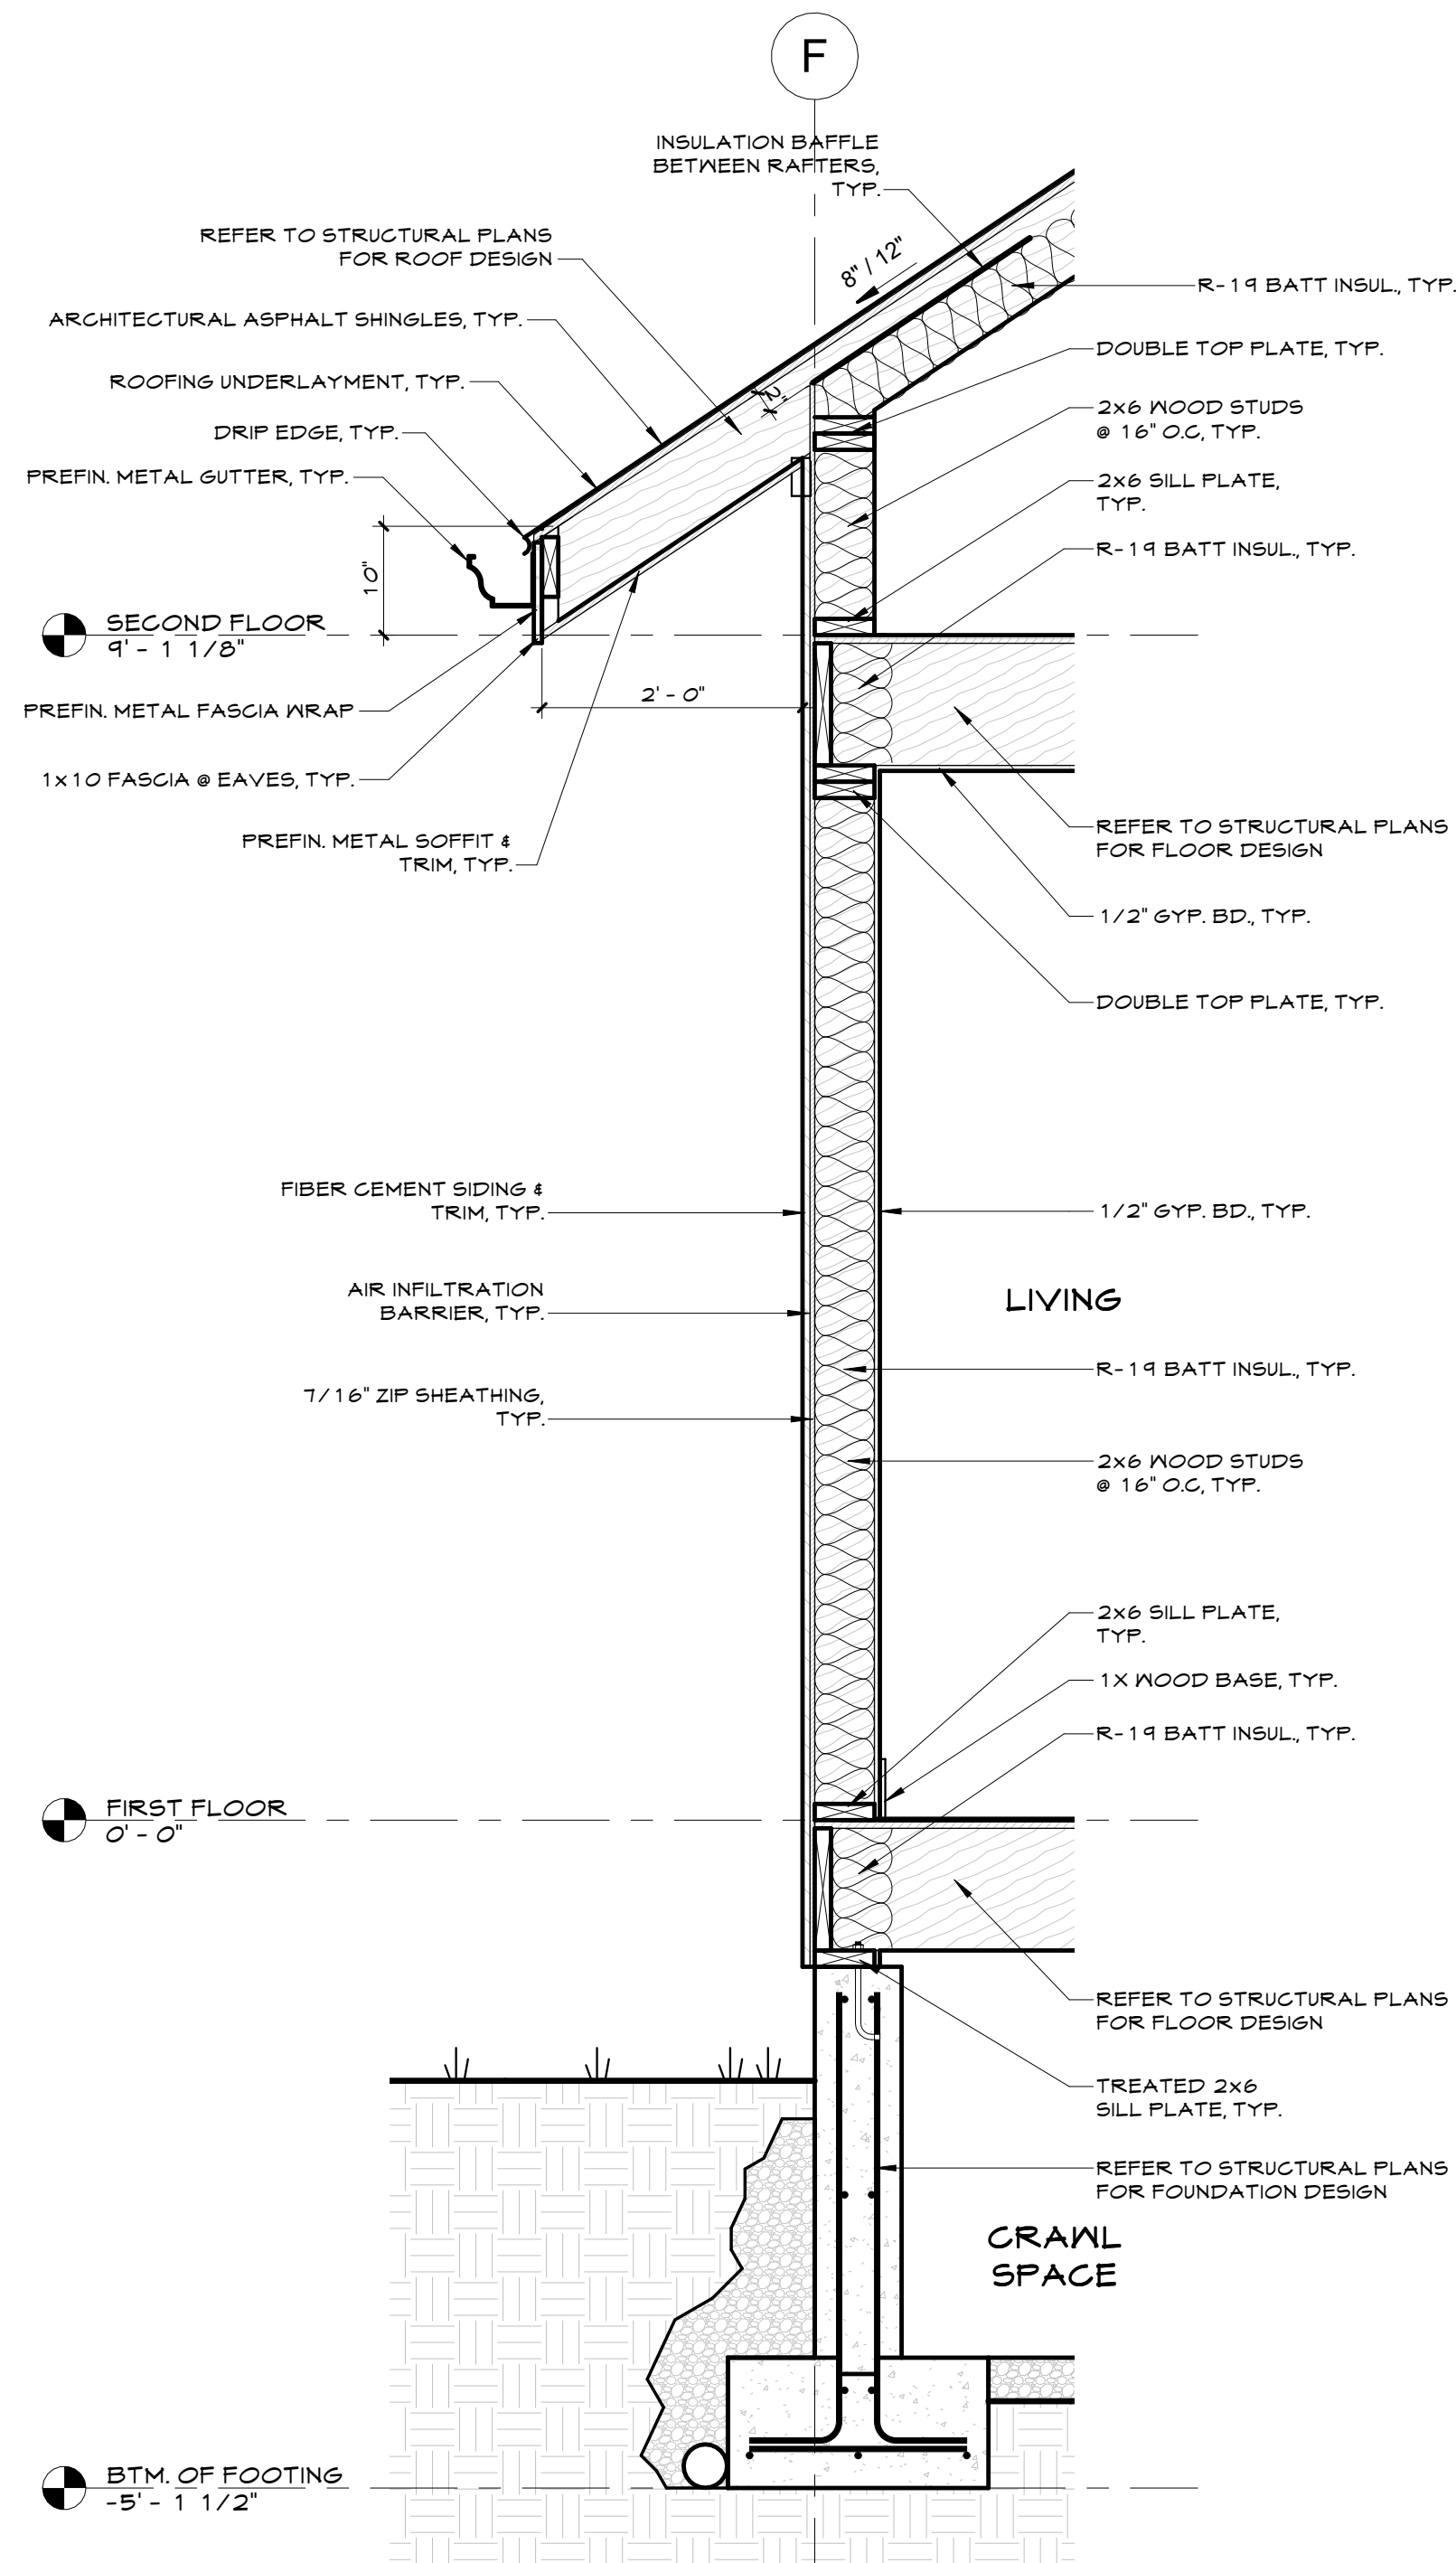




1	WALL SECTION 1-1
A4.01	3/4" = 1'-0"

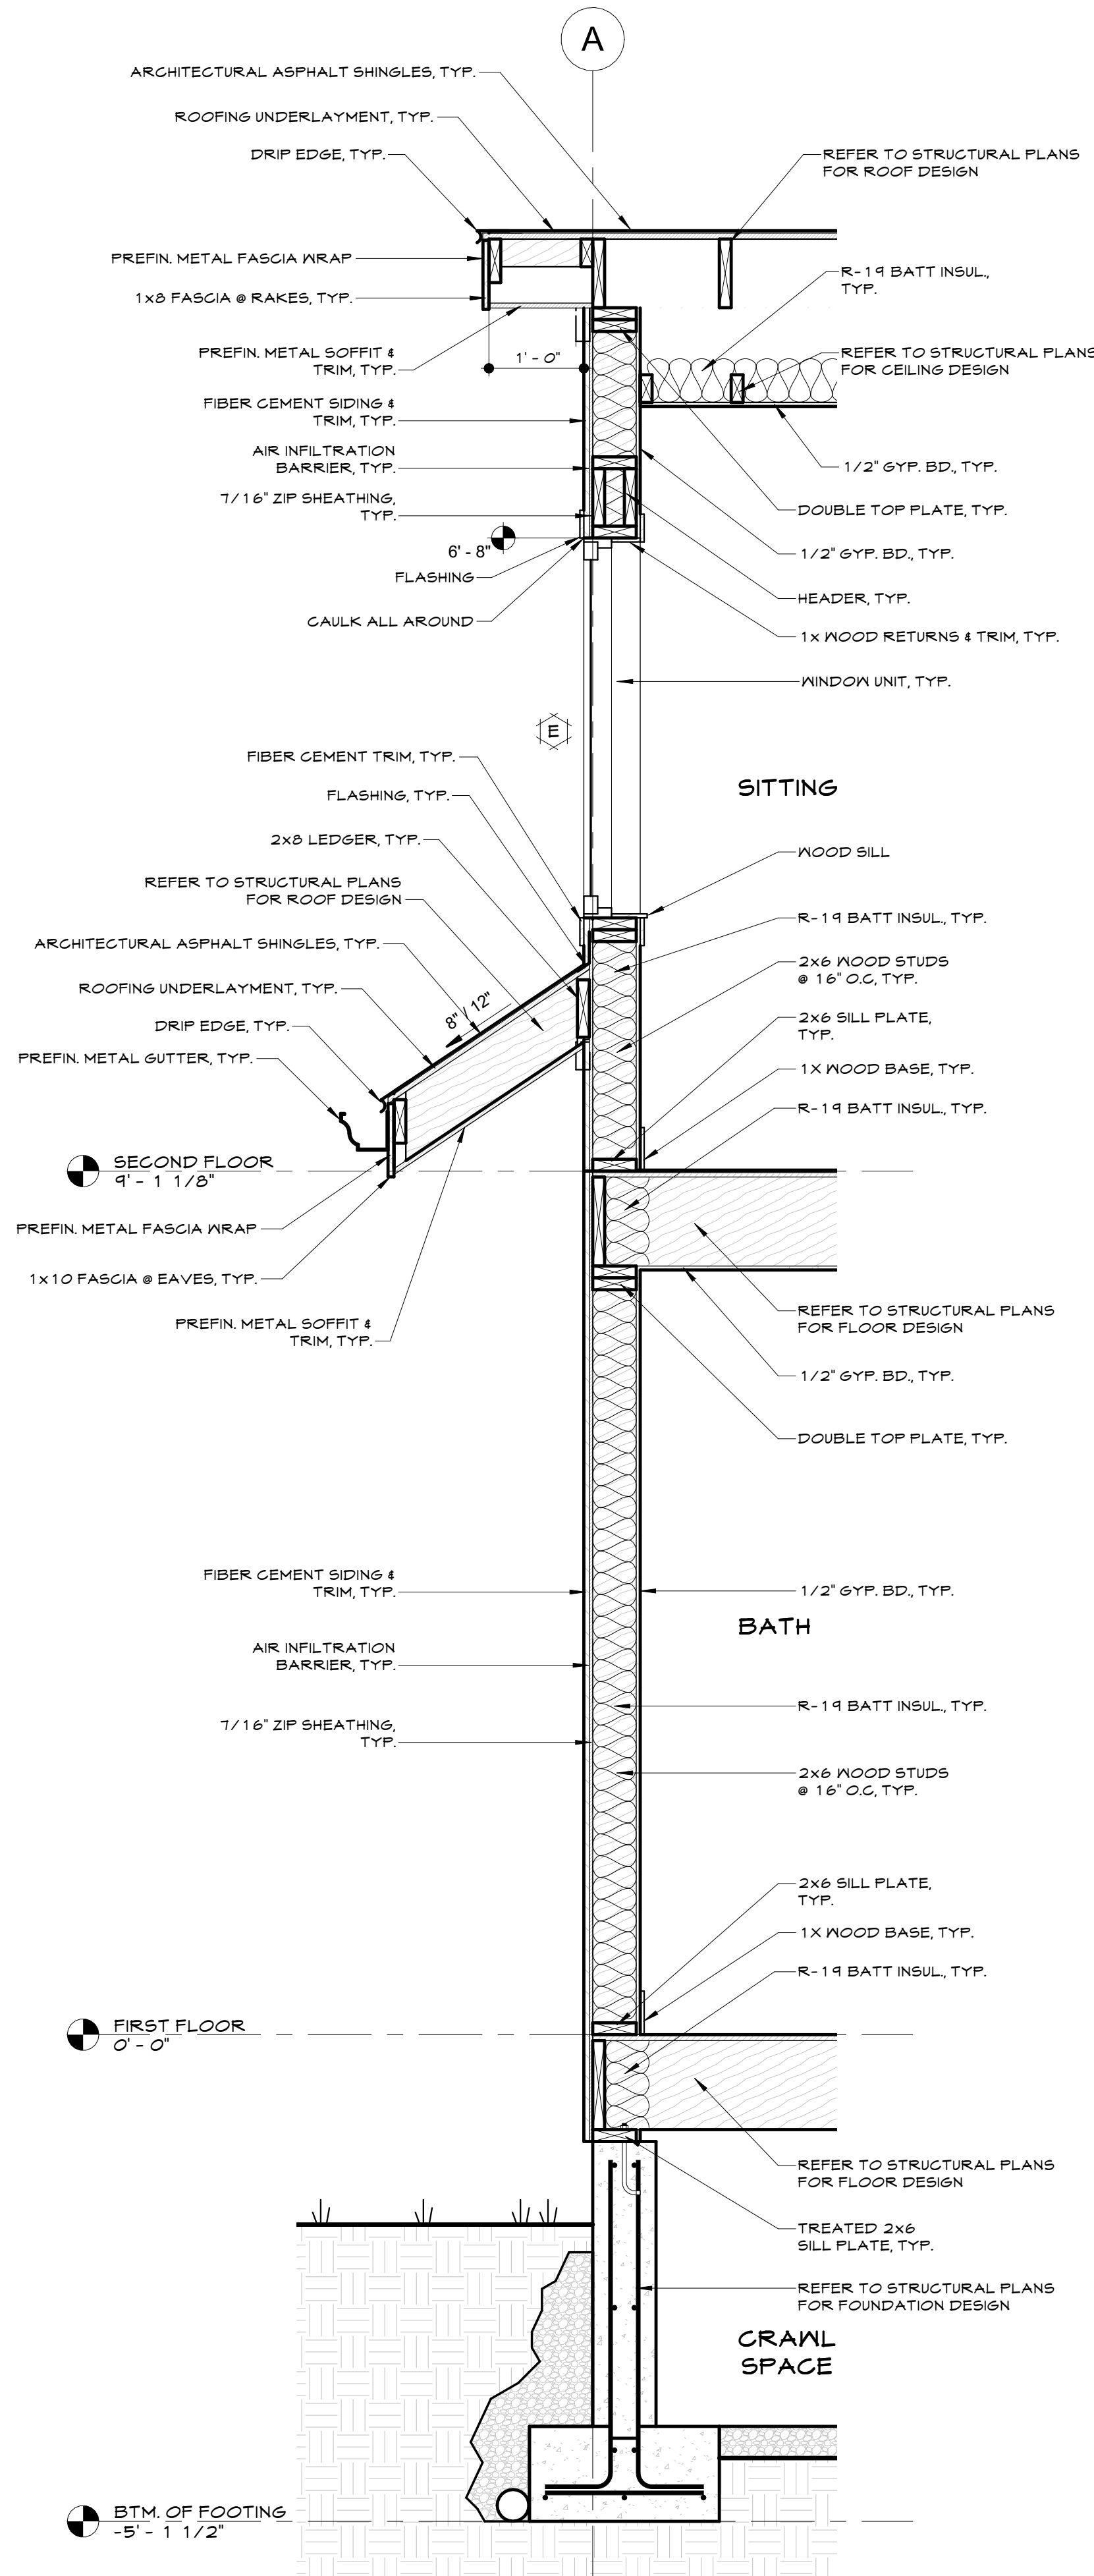

3	WALL SECTION 2-1
A4.01	3/4" = 1'-0"

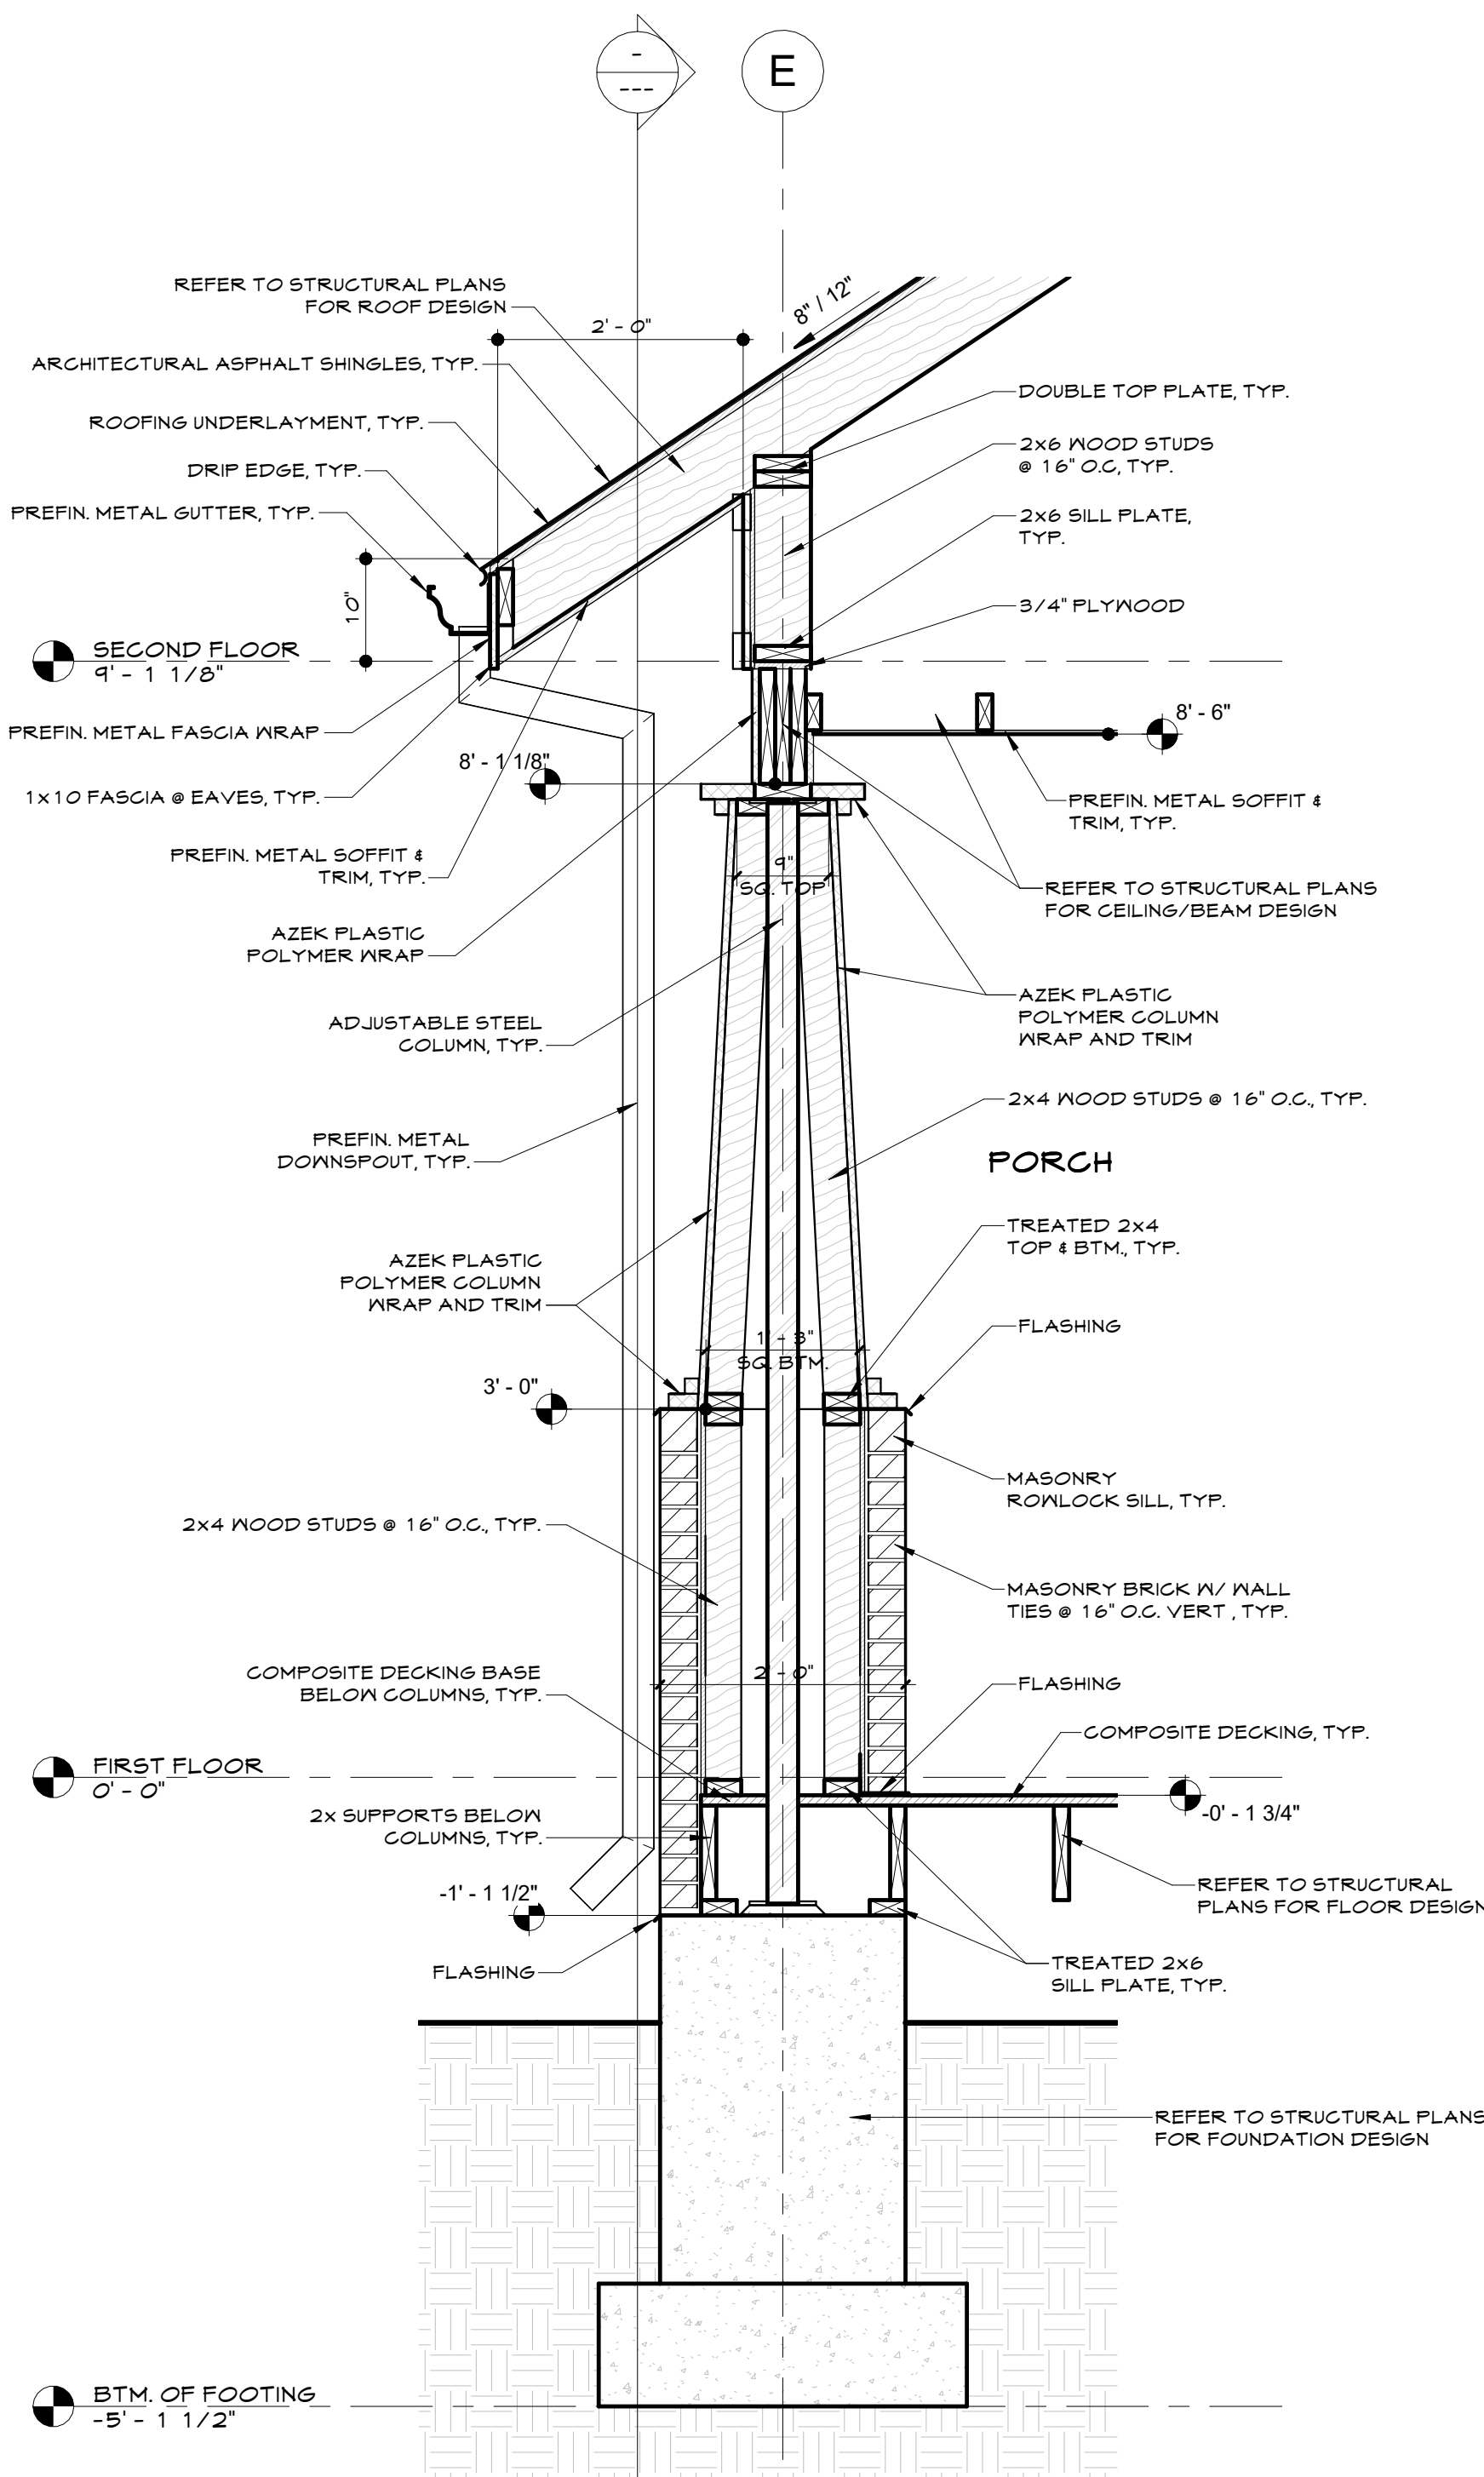

2	WALL SECTION 3-1
A4.01	3/4" = 1'-0"

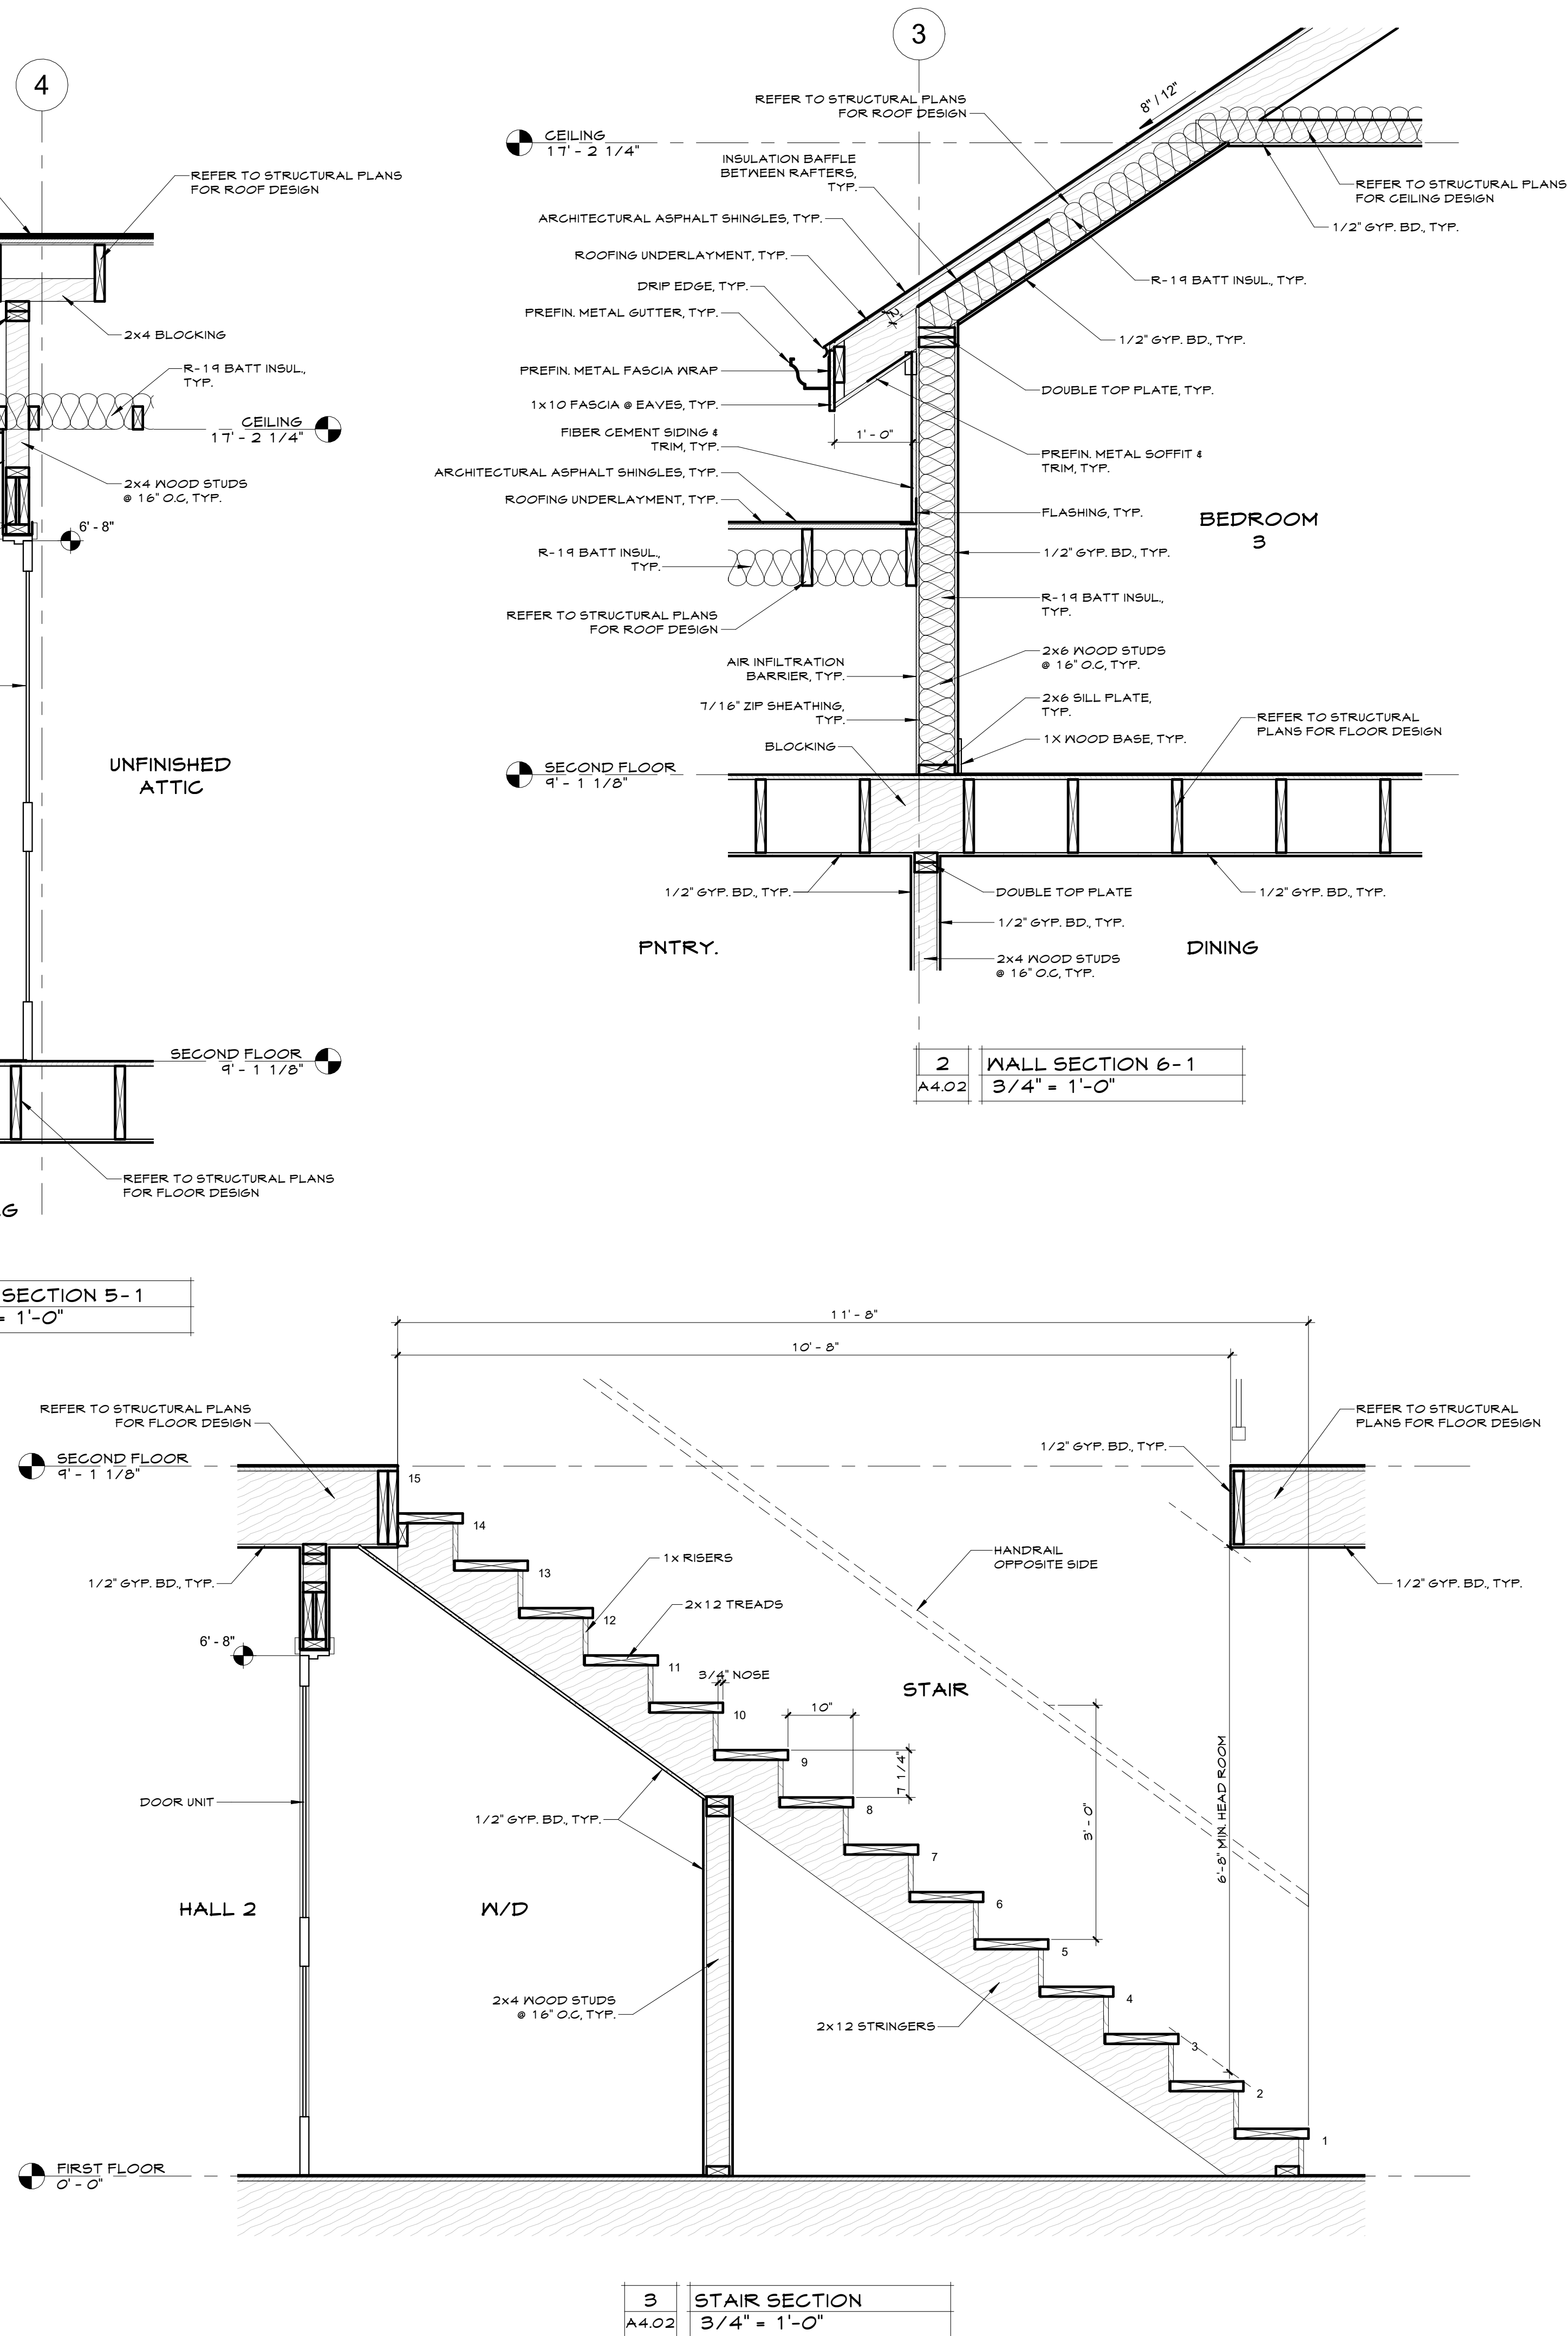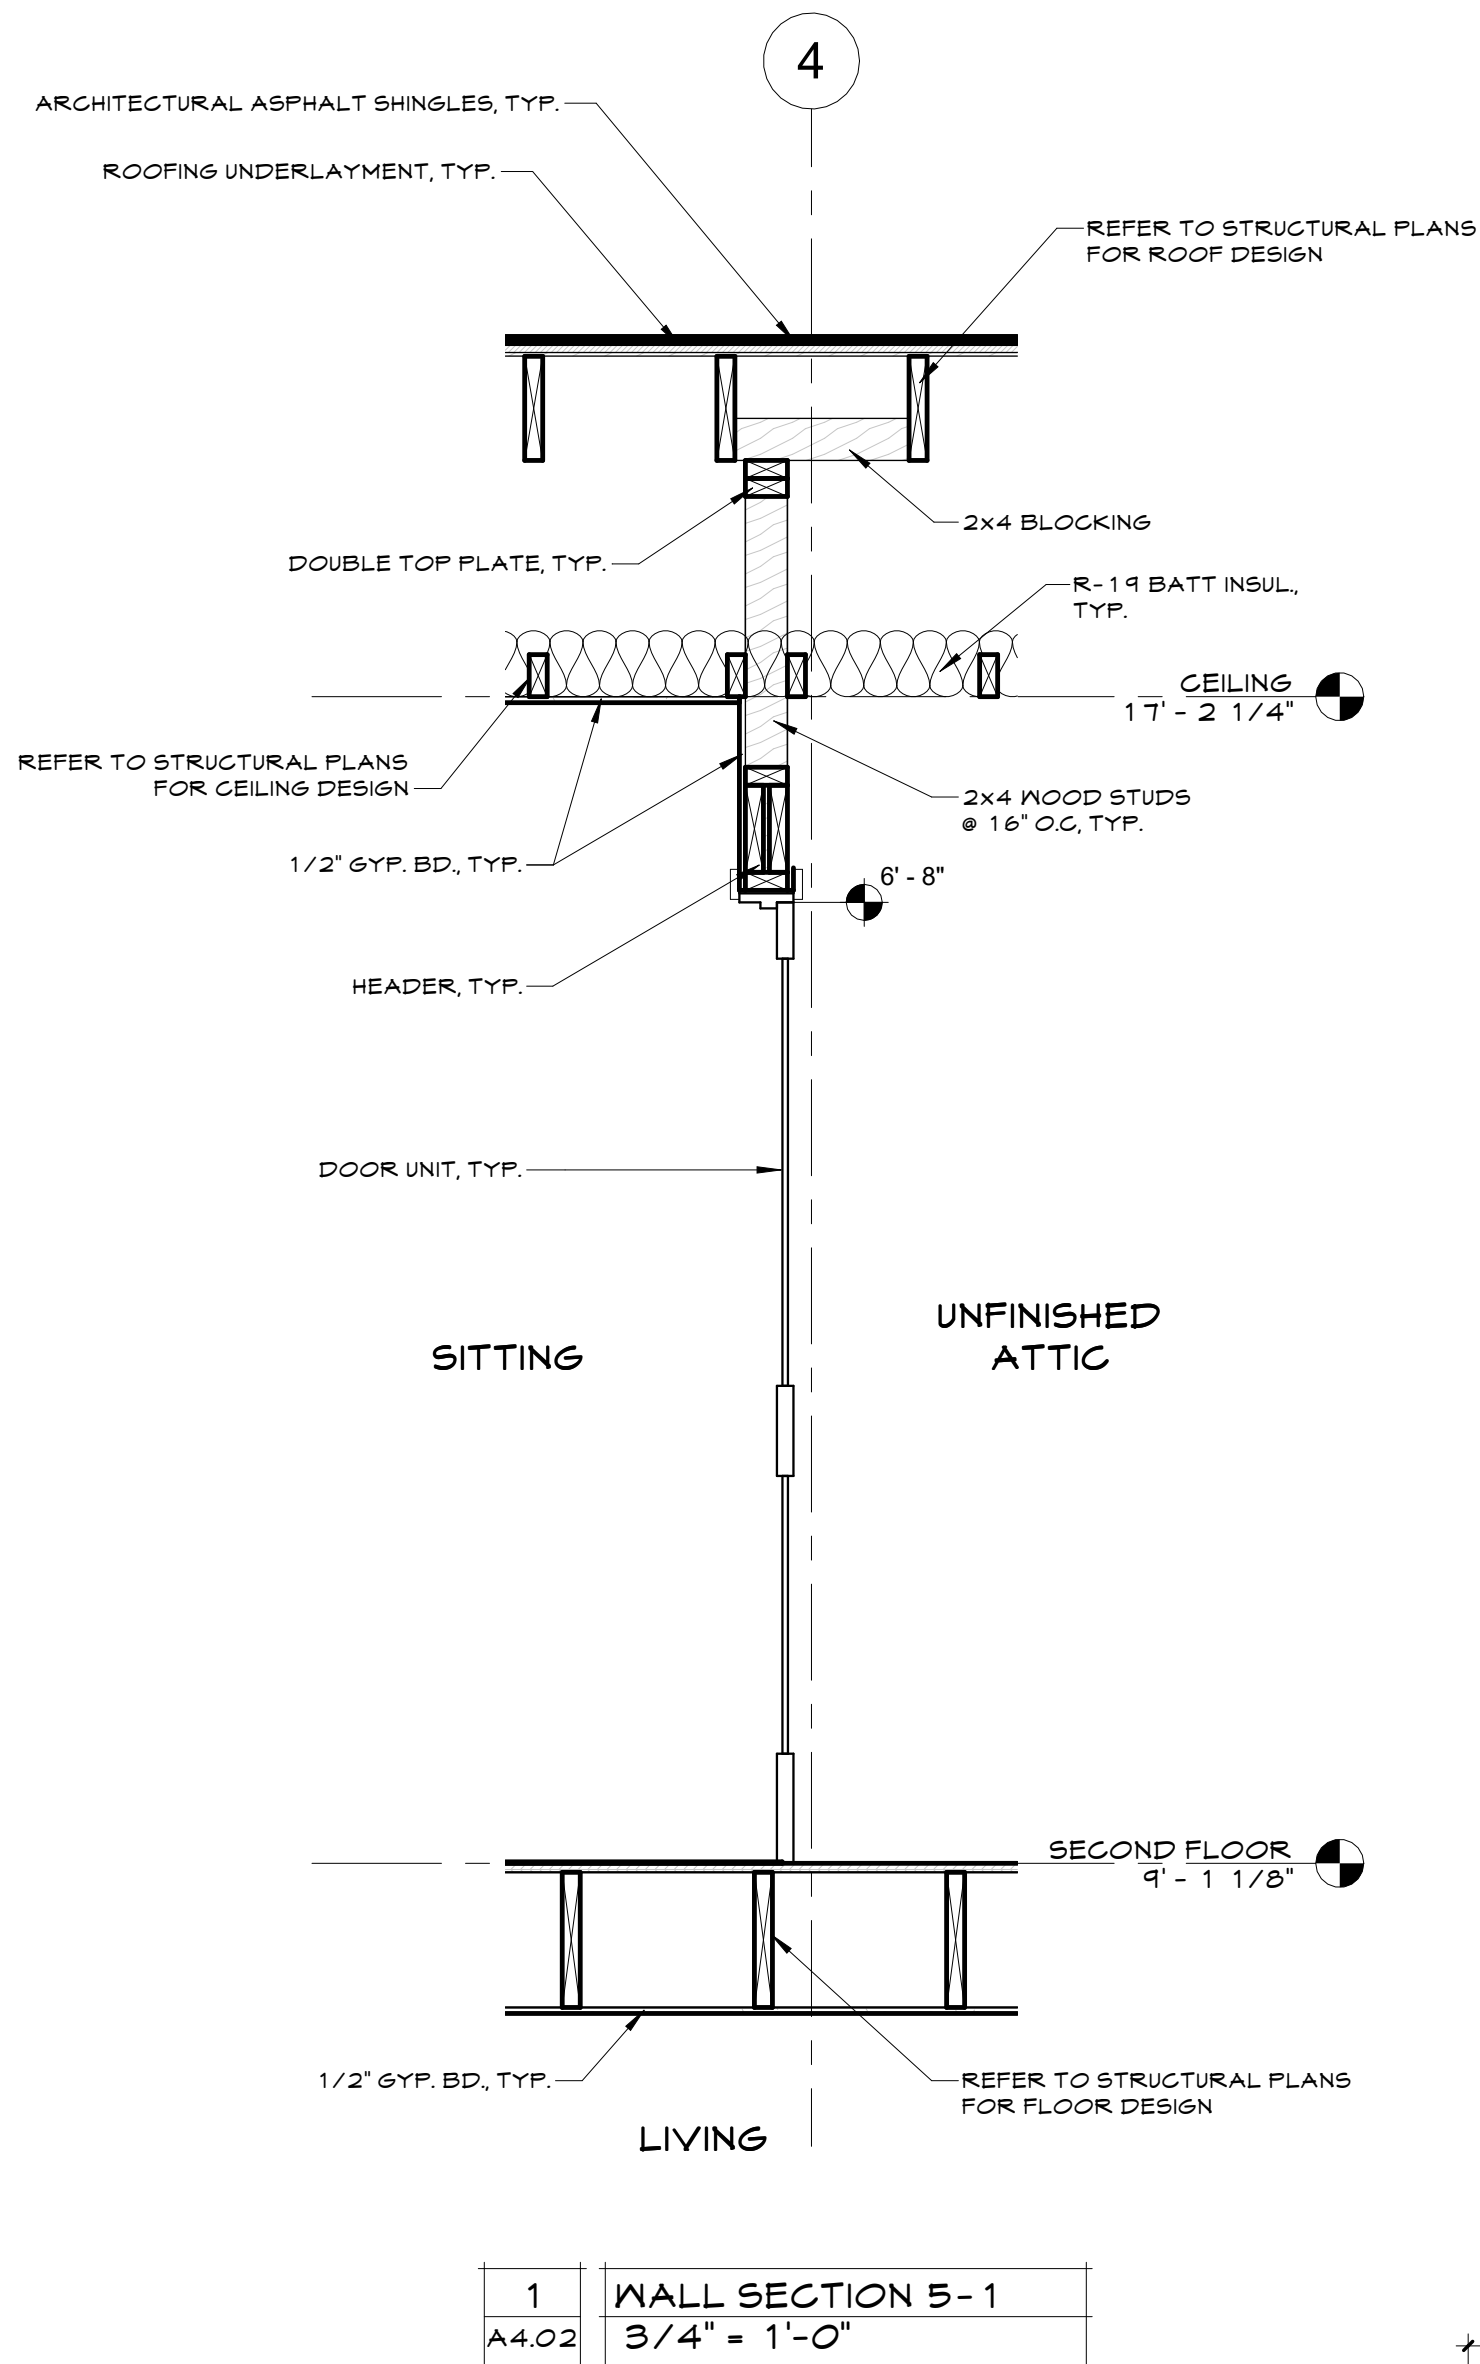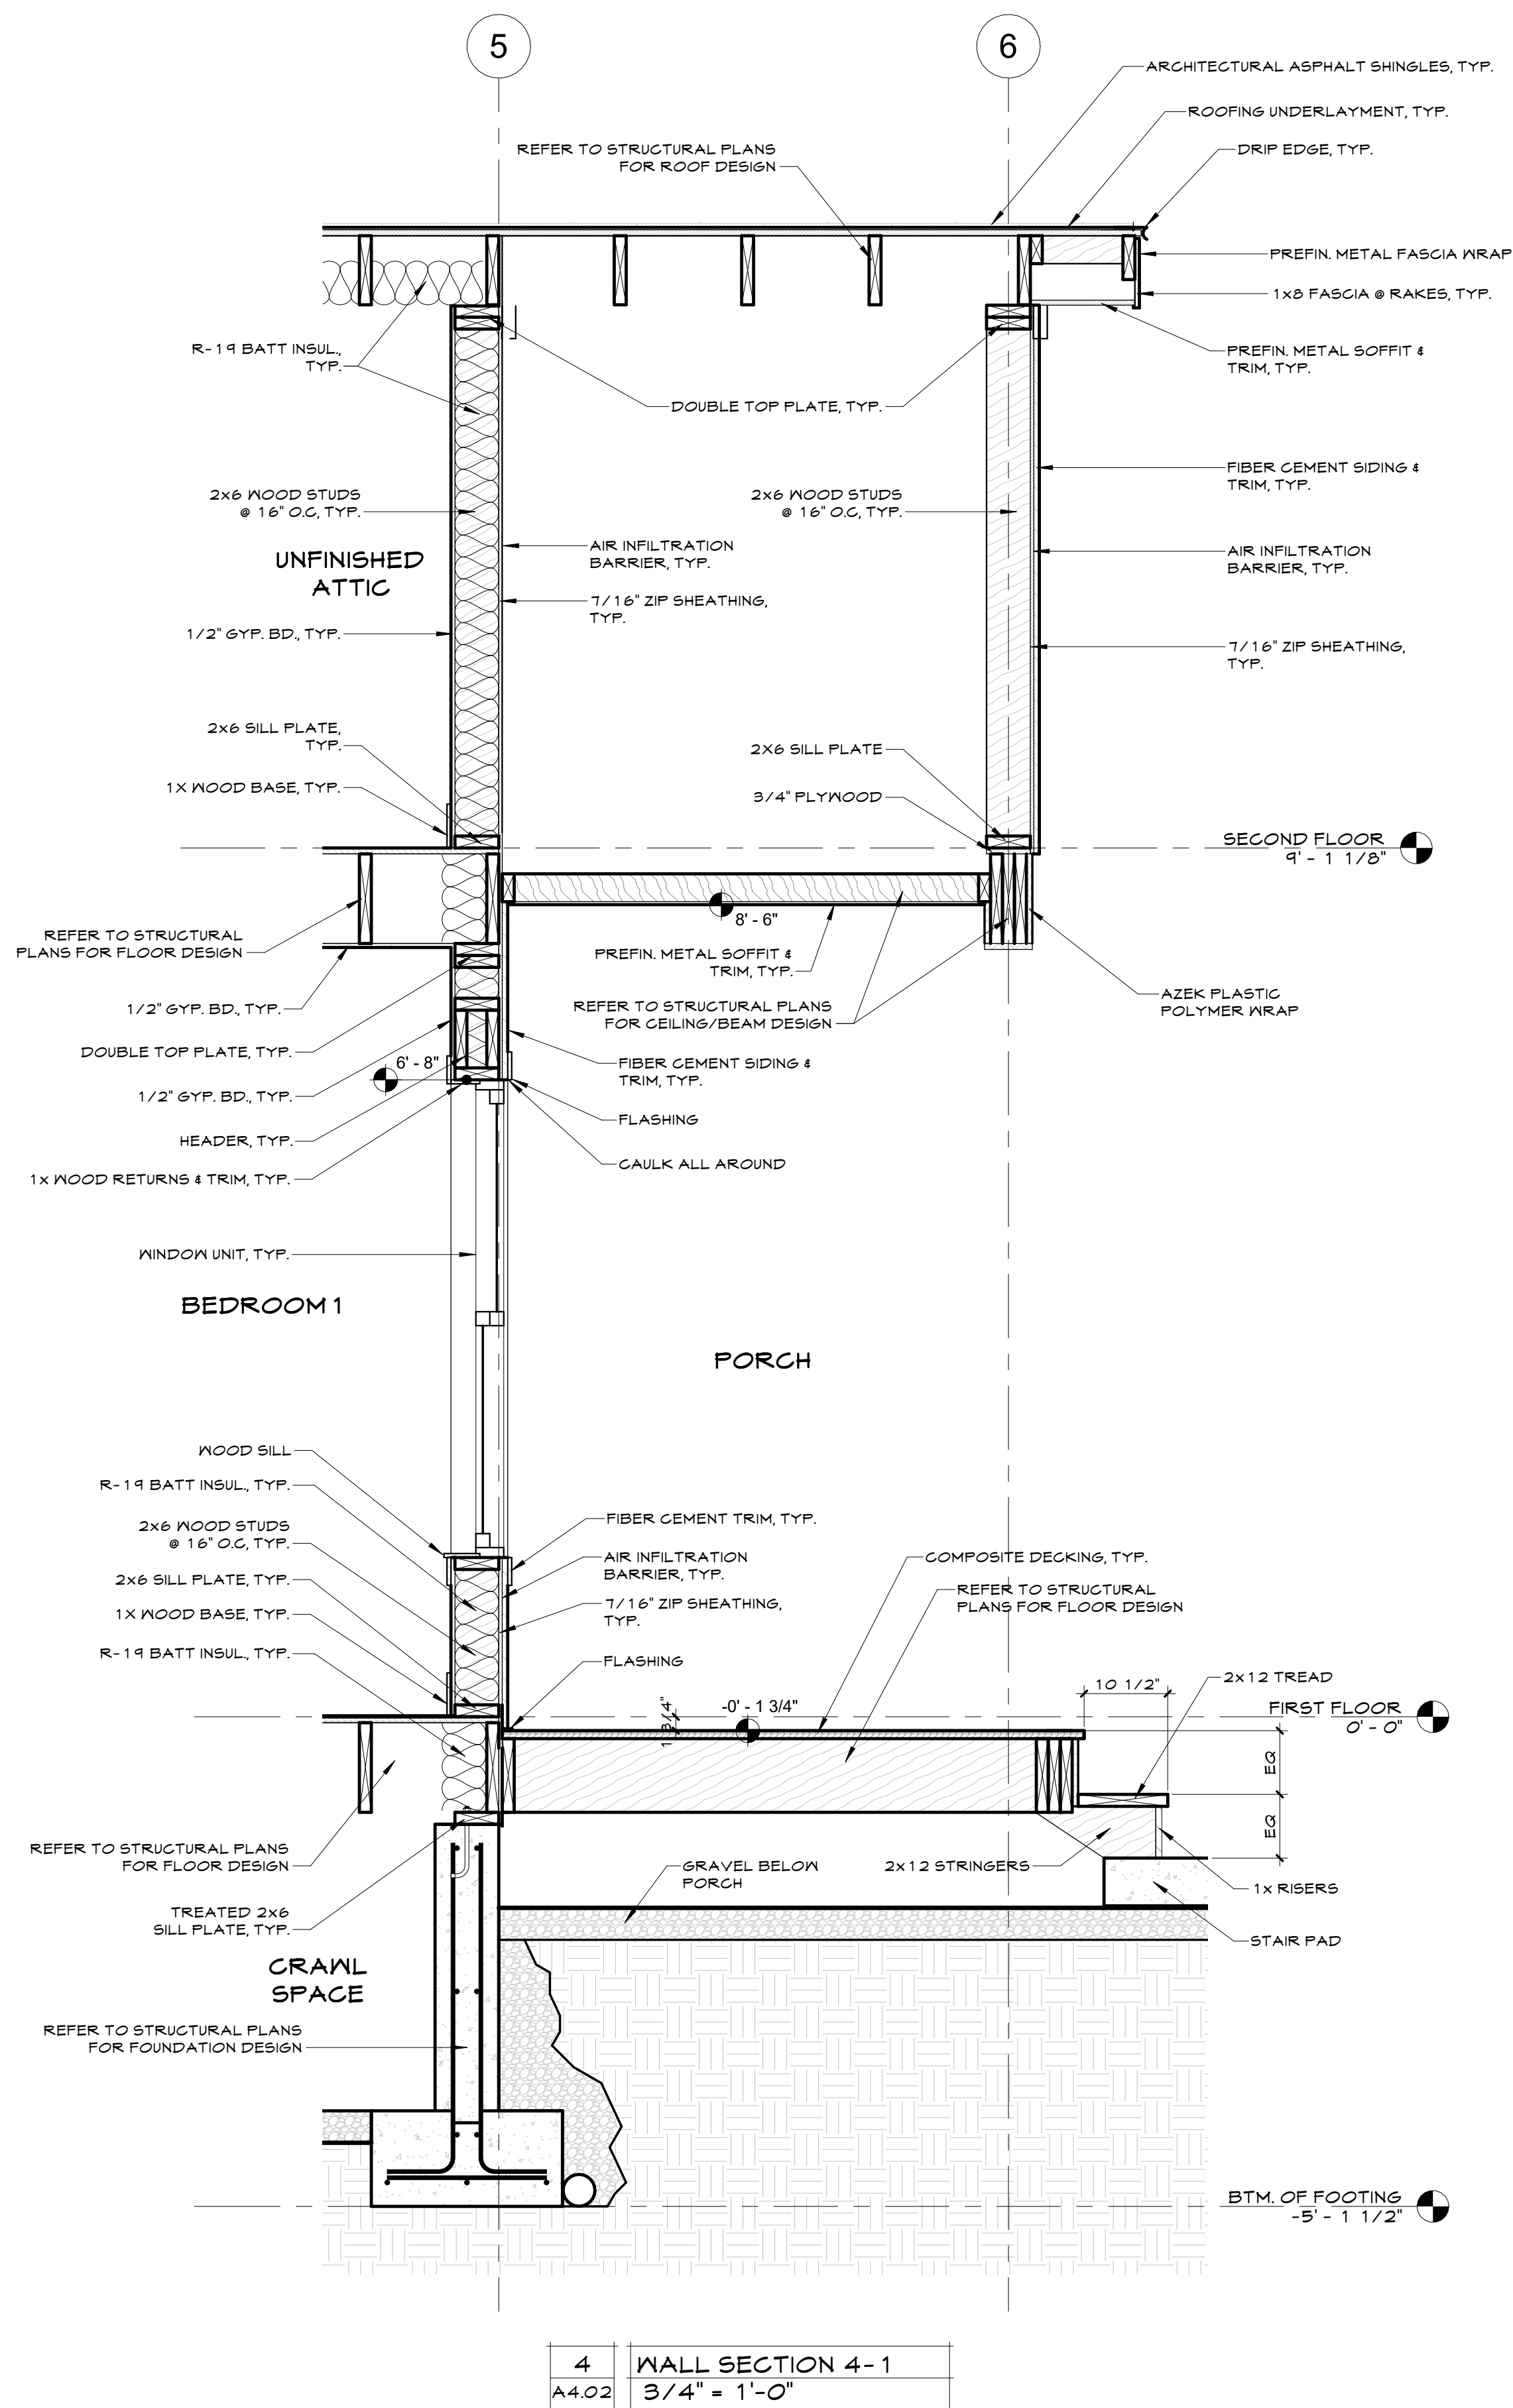

CITY OF SEDALIA HOUSING - HOUSE A
COPYRIGHT © 2021

Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS - 2028021508
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2028023510-0

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	


CITY OF SEDALIA
HOUSING - HOUSE A

4TH & NEW YORK,
SEDALIA, MO

WALL SECTIONS


DRAWN BY	Author
CHECKED BY	Approver
SHEET NUMBER:	

A4.02
80.168

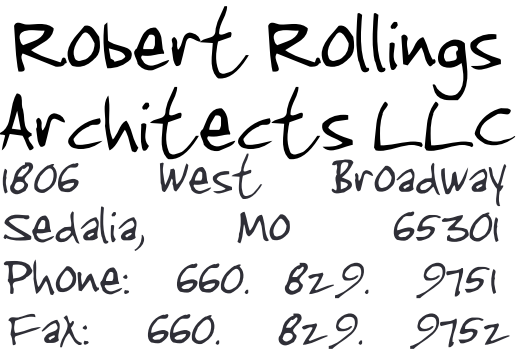


DETAILS AND DIMENSIONS BELOW BASED ON J.L. INDUSTRIES AMBASSADOR 1017 MODEL CABINETS RATED AND NON RATED. GC SHALL VERIFY DIMENSIONAL REQUIREMENTS OF SUPPLIED CABINET AND WALL CONSTRUCTION / RATING PRIOR TO ORDERING AND INSTALLING, TYP.

DETAILS BELOW ARE FOR ALTERNATE RATED
WALL INSTALLATION OF NON RATED BOX. GC
SHALL VERIFY DIMENSIONAL REQUIREMENTS OF
SUPPLIED CABINET AND WALL CONSTRUCTION /
RATING PRIOR TO CONSTRUCTION, TYP.

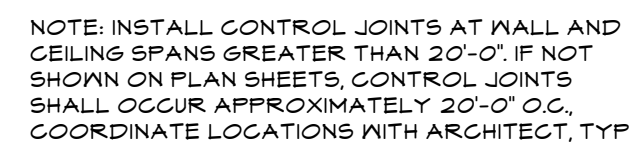

3	CONTROL JOINT DETAIL
A5.01	3" = 1'-0"

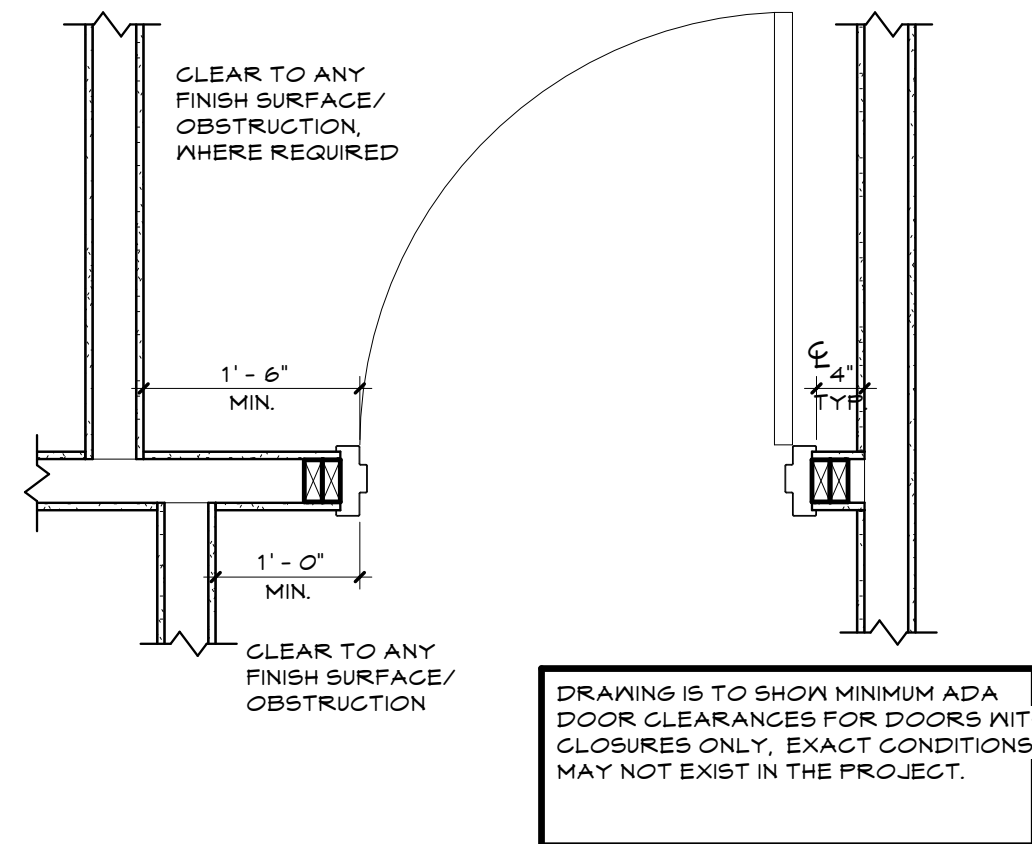

The drawings illustrate the construction of fire extinguisher cabinet enclosures. The left side shows a 'NON-RATED' cabinet, and the right side shows a 'RATED CABINET'.

PLAN VIEW (Left): Shows a top-down view of the cabinet. It is labeled '11-1/2" ROUGH DIMENSION NON-RATED' and '26-5/16" ROUGH DIMENSION RATED CABINET'. The width is dimensioned as 31" and 31 1/8". The text 'WOOD OR METAL STUDS' is indicated.

PLAN VIEW (Right): Shows a top-down view of the rated cabinet. It is labeled '5/8" TYPE "X" GYP. TYP.' and 'VERIFY R.O. IN FIELD'.

SECTION VIEW (Left): Shows a side view of the non-rated cabinet. It is labeled '2 - 1" ROUGH DIM. NON-RATED' and '26-5/16" ROUGH DIM. RATED CABINET'. The height is dimensioned as 31" and 31 1/8". The text 'WOOD OR METAL STUDS' is indicated.

SECTION VIEW (Right): Shows a side view of the rated cabinet. It is labeled '5/8" TYPE "X" GYP. TYP.' and 'VERIFY R.O. IN FIELD'. The height is dimensioned as 31" and 31 1/8".

GENERAL NOTES:

- FIRE EXTINGUISHER CABINET ENCLOSURE (SEMI-RECESSED). RE: SPECIFICATIONS FOR DETAILS, TYP.
- SURFACE MOUNTED BOXES MAY BE USED WHERE SHOWN OR UPON APPROVAL BY DESIGNER AND OWNER. GC SHALL VERIFY DIMENSIONAL AND MOUNTING REQUIREMENTS OF CABINET AND WALL CONSTRUCTION PRIOR TO INSTALLATION, TYP.

**PRELIMINARY.
NOT FOR
CONSTRUCTION**

ROBERT D. ROLLINGS 2005001205
 CERTIFICATE OF AUTHORITY
 TO OFFER ARCHITECTURAL
 SERVICES
 ROBERT ROLLINGS ARCHITECTS, LLC
 SERIAL #: A-2006005570-D

NOTE: ICE AND WATER SHIELD UNDERLAYMENT SHOULD EXTEND FROM THE EAVES TO A POINT 24" INSIDE THE EXTERIOR WALL.

NOTE: INSTALL PER MANUFACTURER'S RECOMMENDATIONS AND INDUSTRY BEST PRACTICES.

Diagram illustrating the installation of ice and water shield underlayment and pre-finish metal drip edge at the roof eave. The diagram shows the roof structure, roof sheathing, ice and water shield underlayment, pre-finish metal drip edge, fastening, gutter, and roof structure.

- ROOF SHEATHING, TYP.
- ICE AND WATER SHIELD UNDERLAYMENT, TYP.
- PRE-FIN METAL DRIP EDGE, TYP.
- FASTENING, TYP.
- GUTTER, TYP.
- ROOF STRUCTURE, TYP.

NOTE: IN VALLEYS ICE AND WATER SHIELD UNDERLAYMENT TO REMAIN INTACT AND EXTEND 18" EITHER SIDE.

NOTE: INSTALL PER MANUFACTURER RECOMMENDATIONS AND INDUSTRY BEST PRACTICES.

ICE AND WATER SHIELD UNDERLAYMENT, TYP.

ROOF SHEATHING, TYP.

ROOF STRUCTURE, TYP.

NOTE: INSTALL PER MANUFACTURER RECOMMENDATIONS AND INDUSTRY BEST PRACTICES.

ICE AND WATER SHIELD UNDERLAYMENT, TYP.

ROOF 4 DORMER STRUCTURE, TYP.

MET. CURB RECOMMENDED

9	TYPICAL ICE AND WATER SHIELD DORMER
A5.01	1" = 1'-0"

4TH & NEW YORK,
SEDALIA, MO

TYPICAL DETAILS

DRAWN BY	Author
CHECKED BY	Approver
SHEET NUMBER:	

A5.01
80.168














Diagram illustrating six window configurations (A through F) with dimensions and a note to verify window location between porch roof and second floor ceiling.

- Configuration A:** Single window, 3'-0" wide, 6'-0" high. Arrows indicate opening and closing directions.
- Configuration B:** Double window, 6'-0" wide, 6'-0" high. Arrows indicate opening and closing directions.
- Configuration C:** Single window, 2'-0" wide, 6'-0" high. Arrows indicate opening and closing directions.
- Configuration D:** Single window, 2'-10" wide, 6'-0" high. Arrows indicate opening and closing directions.
- Configuration E:** Single window, 2'-6" wide, 6'-0" high. Arrows indicate opening and closing directions.
- Configuration F:** Single window, 2'-6" wide, 6'-0" high. Arrows indicate opening and closing directions.

VERIFY WINDOW LOCATION BETWEEN PORCH ROOF AND SECOND FLOOR CEILING.

DOOR SCHEDULE									
MARK	WIDTH	HEIGHT	DOOR MATERIAL	DOOR TYPE	DOOR FINISH	FRAME MATERIAL	FRAME TYPE	FRAME FINISH	NOTES
01	3' - 0"	6' - 8'	FIBERGLASS	A	STAIN COLOR	WOOD	AA	PAINT	CRAFTSMAN, INSULATED FRAMED OPENING FRAMED OPENING
02	3' - 0"	6' - 8"	-	D	-	WOOD	AA	PAINT	
03	3' - 0"	6' - 8"	-	D	-	WOOD	AA	PAINT	
04	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	FRAMED OPENING TEMPERED, INSULATED
05	3' - 0"	6' - 8"	-	D	-	WOOD	AA	PAINT	
06	2' - 8'	6' - 8"	HOLLOW METAL	C	PAINT	WOOD	AA	PAINT	
07	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
08	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
09	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
10	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
11	1' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
12	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
13	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
14	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	SHORT DOOR
15	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
16	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
17	2' - 10'	5' - 0"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
18	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	
19	2' - 8'	6' - 8"	SOLID CORE WOOD	B	PAINT	WOOD	AA	PAINT	

[illegible]

**PRELIMINARY.
NOT FOR
CONSTRUCTION**

ROBERT D. ROLLINGS 2005001208
 CERTIFICATE OF AUTHORITY
 TO OFFER ARCHITECTURAL
 SERVICES.
 ROBERT ROLLINGS ARCHITECTS, LLC
 SERIAL #: A-2008003870-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	

CITY OF SEDALIA
HOUSING - HOUSE A


4TH & NEW YORK,
SEDALIA, MO

INTERIOR ELEVATIONS & SCHEDULES

DRAWN BY	Author
CHECKED BY	Approver


SHEET NUMBER:

A7.01
80.168

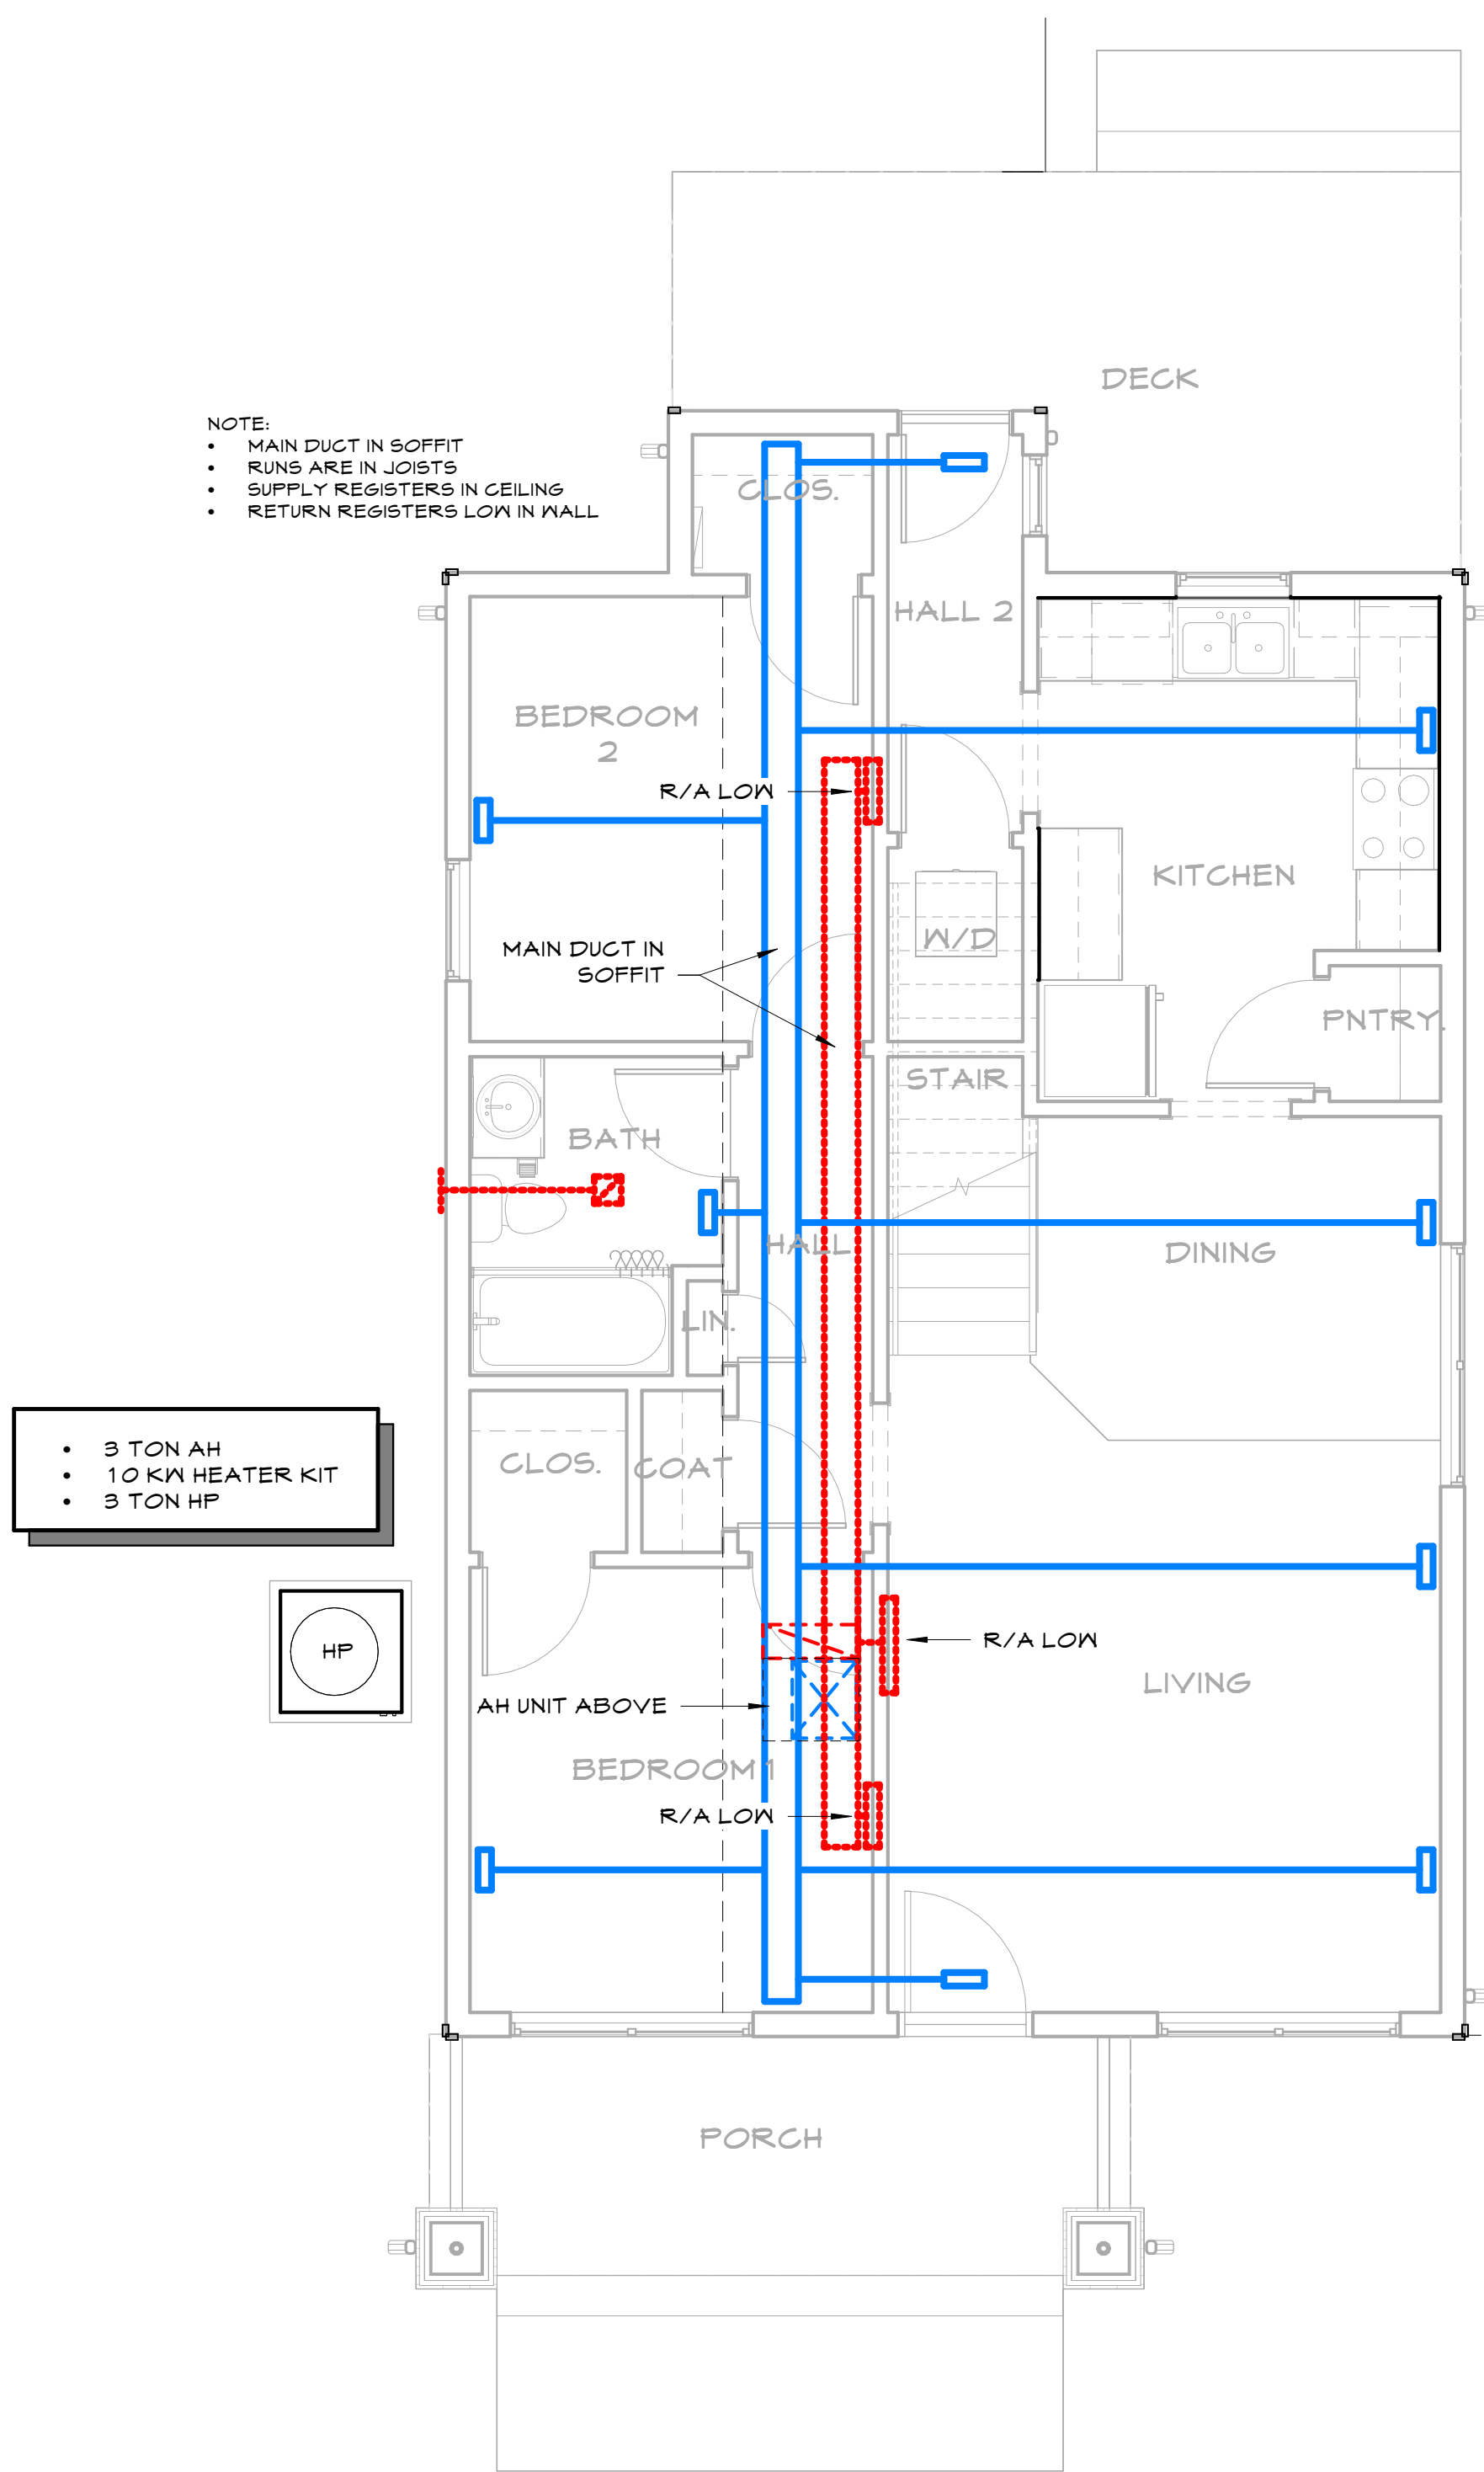

1 HVAC PLAN - FIRST FLOOR
M1.01 1/4" = 1'-0"

- GEN. MECH / ELEC NOTES
- ALL WORK SHALL BE DONE IN STRICT CONFORMANCE WITH THE LOCAL BUILDING CODES.
 - ALL MATERIALS SHALL BE NEW, FIRST CLASS, AND INSTALLED TO MANUFACTURER'S WRITTEN SPECIFICATIONS.
 - ALL SYSTEMS SHALL BE COMPLETE AND OPERABLE IN EVERY WAY.
 - DO ALL EXCAVATION, BACK FILLING, CUTTING, PATCHING, OFFSETTING, ADJUSTING, AND BALANCING AS REQUIRED TO COMPLETE THE JOB.
 - GUARANTEE ALL WORKMANSHIP AND MATERIALS FOR ONE YEAR FROM FINAL ACCEPTANCE. PROVIDE FIVE YEAR AIR CONDITIONING COMPRESSOR WARRANTY.
 - INSPECT JOB SITE PRIOR TO BIDDING TO DETERMINE EXACT JOB REQUIREMENTS. SEE ARCHITECTURAL DRAWINGS FOR CONSTRUCTION DETAILS.
 - CONTRACTOR IS TO INCLUDE COSTS FOR ALL PERMITS, INSPECTIONS, TAPS, AND METERS AND FUEL ASSOCIATED WITH HIS WORK.
 - CONTRACTOR IS RESPONSIBLE FOR REVIEWING AND UNDERSTANDING ALL DRAWINGS AND ASPECTS OF THE PROJECT SCOPE.
 - EXISTING ELECTRICAL CIRCUITS TO REMAIN, RELOCATE LIGHTS OUTLETS AND SWITCHES AS REQUIRED.
 - EXISTING HVAC SYSTEMS TO REMAIN, RELOCATE SUPPLY AND RETURN VENTS AS REQUIRED.
 - DESIGN AND INSTALLATION OF HOOD BY OTHERS AS A DEFERRED SUBMITTAL.

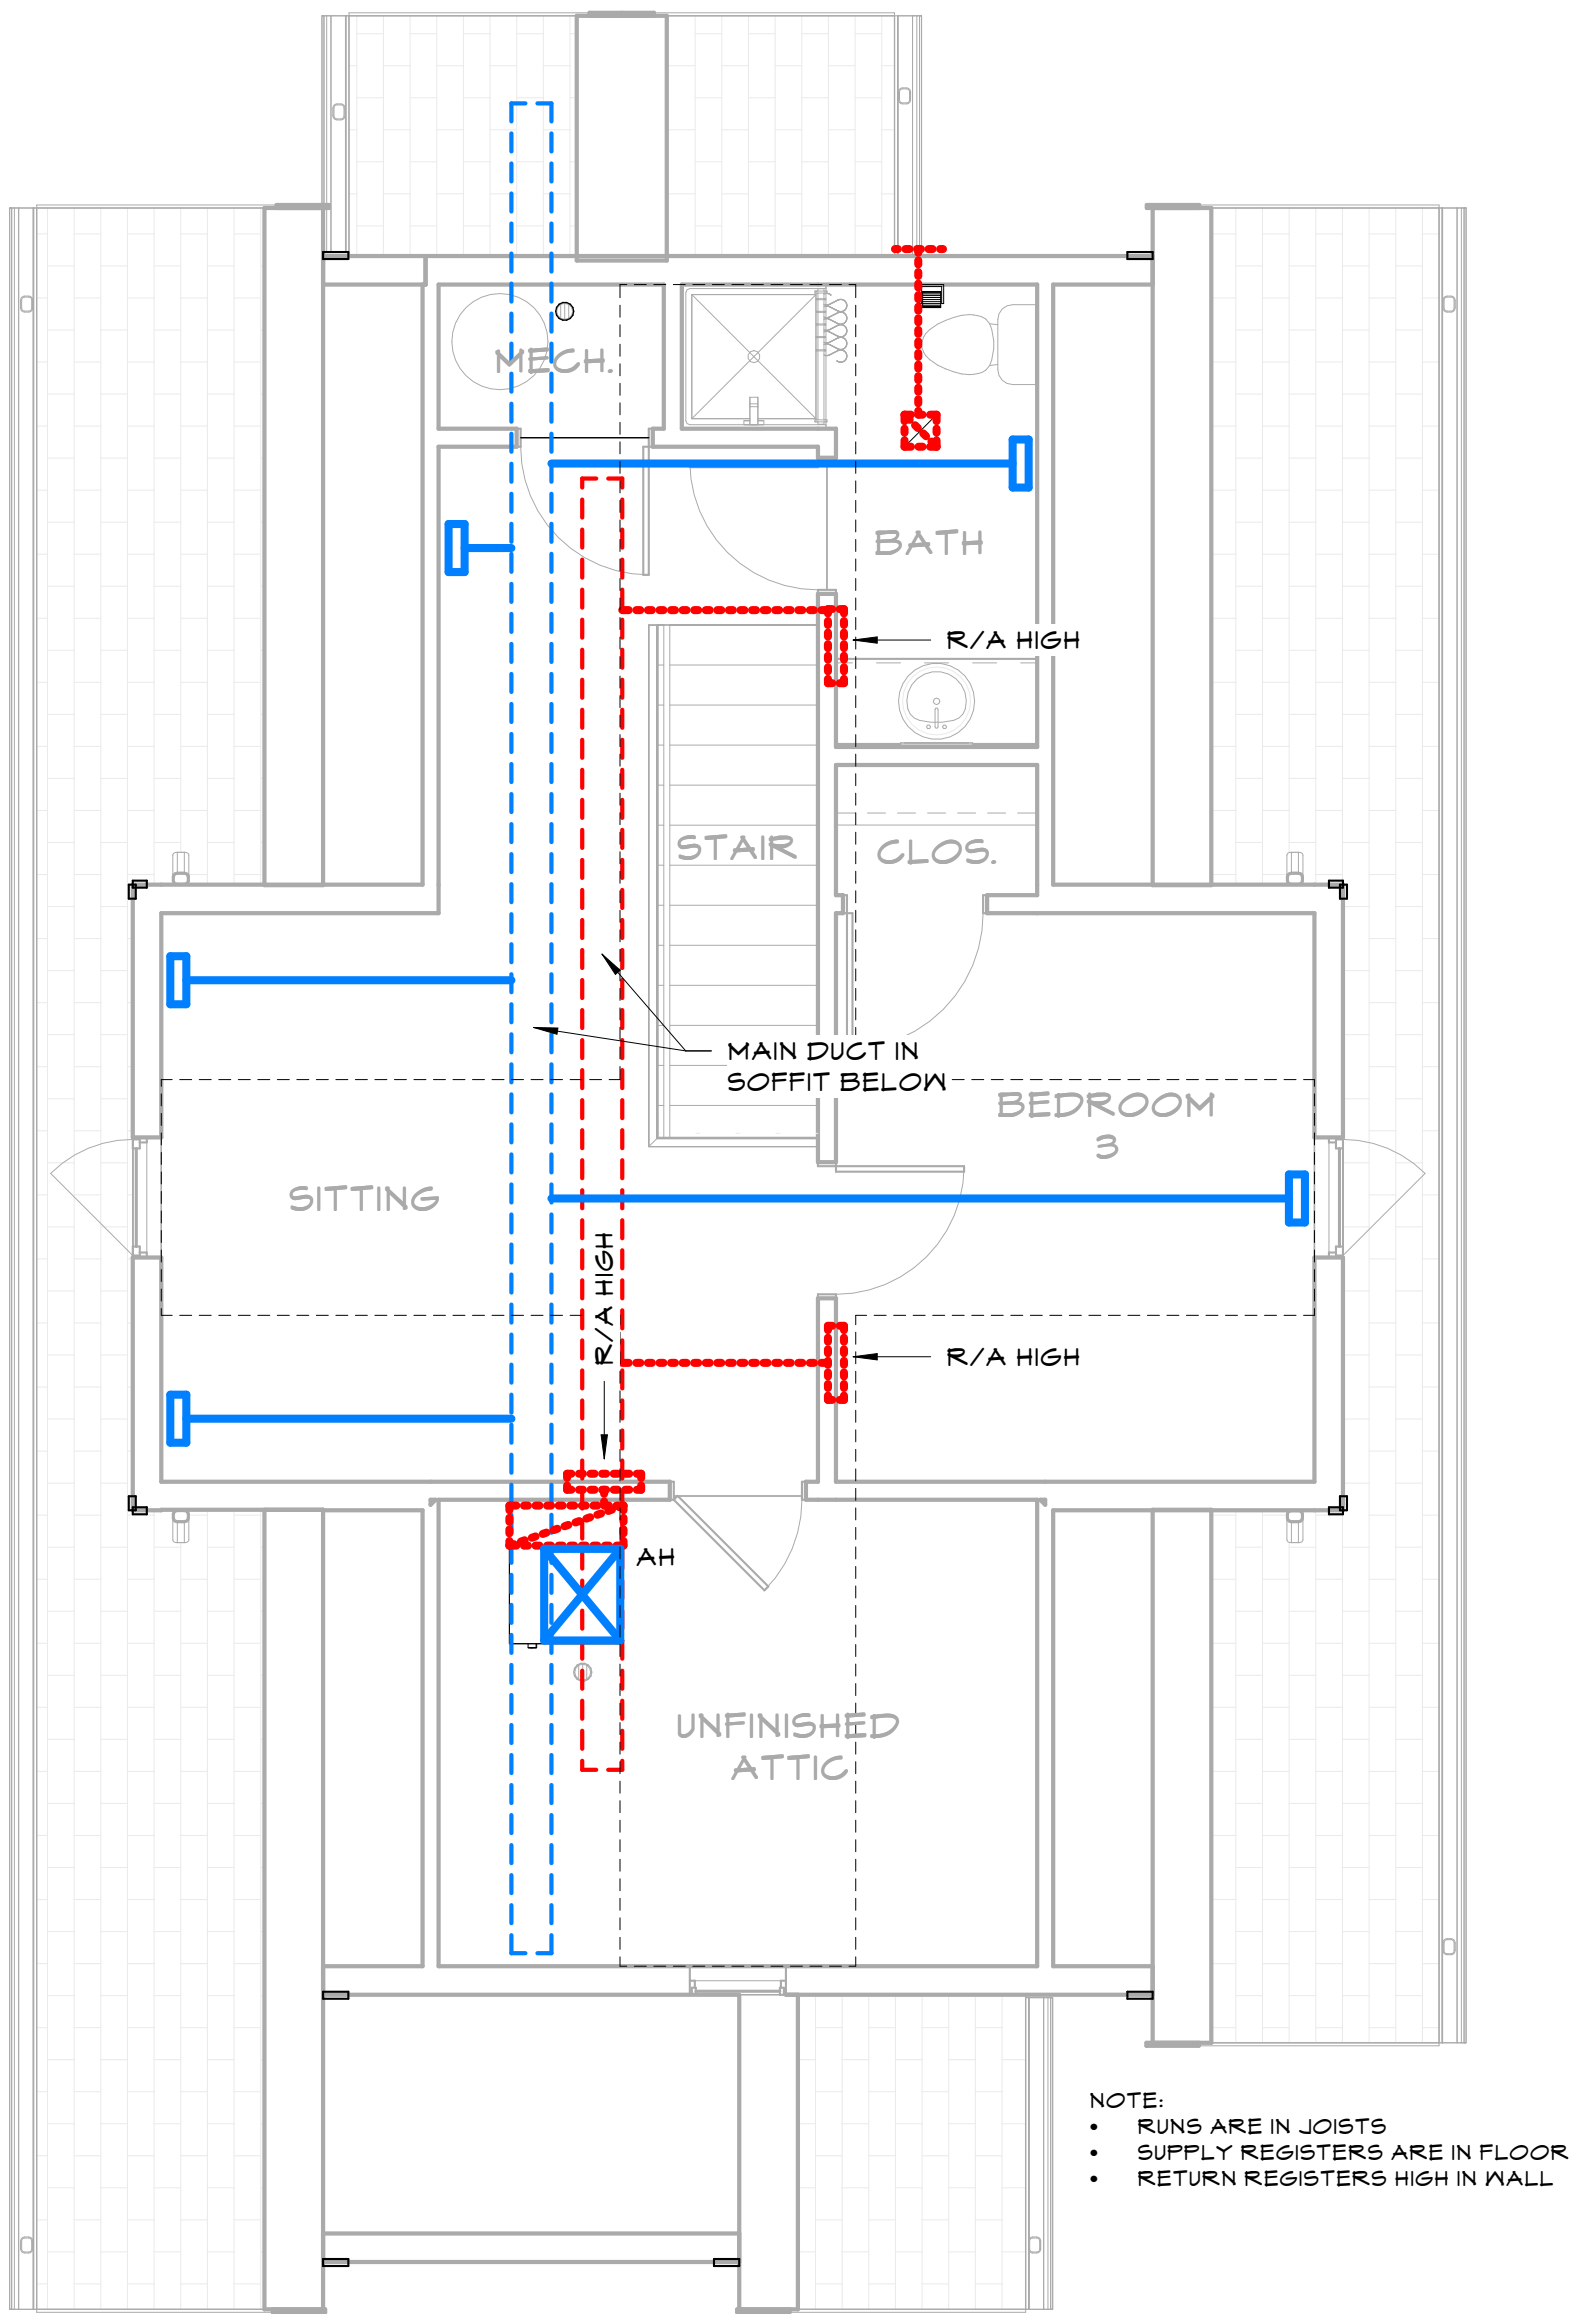

2 HVAC PLAN - SECOND FLOOR
M1.01 1/4" = 1'-0"

SCHEMATIC MEP DRAWINGS DEVELOPED PER STANDARD HOUSE PRACTICES. FINAL DESIGN & SIZING TO BE BY MEP CONTRACTOR. SCHEMATIC MEP DRAWINGS HAVE NOT BEEN DESIGNED BY A LICENSED ENGINEER.

CITY OF SEDALIA HOUSING - HOUSE A

COPYRIGHT © 2021



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT

ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS - 2026021509
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2009003310-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	

CITY OF SEDALIA
HOUSING - HOUSE A

4TH & NEW YORK,
SEDALIA, MO


SCHEMATIC HVAC
PLANS

DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:

M1.01

80.168

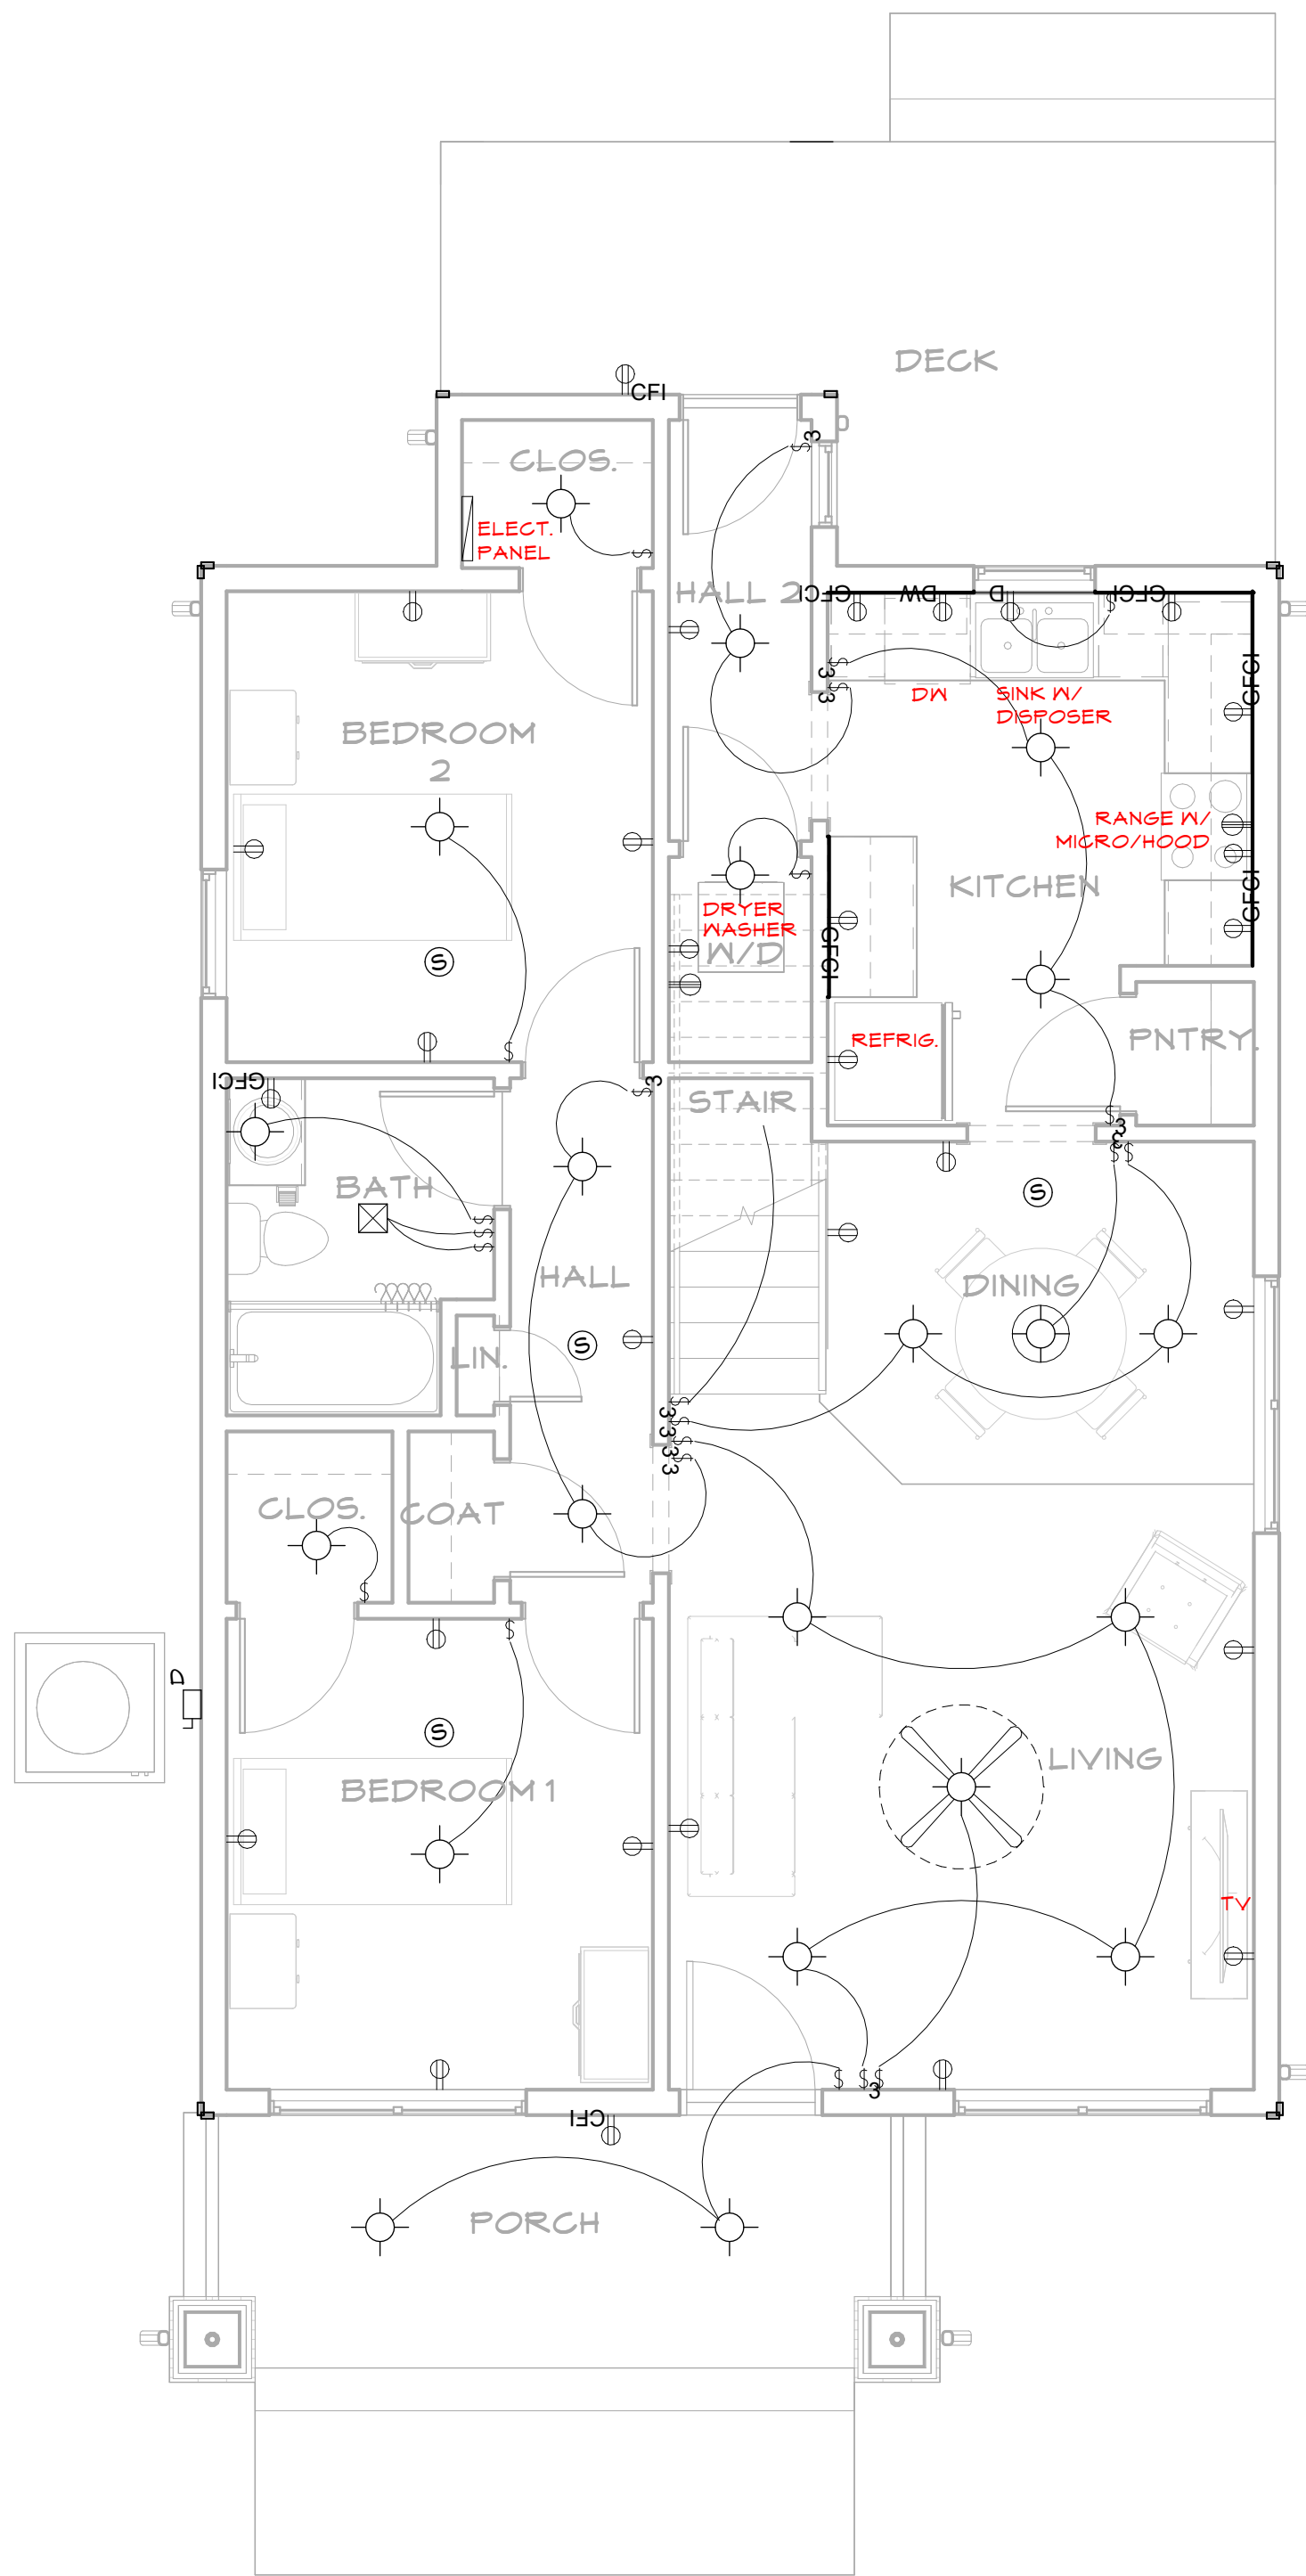

1
E1.01 ELECTRICAL PLAN - FIRST FLOOR
1/4" = 1'-0"


SCHEMATIC ELECTRICAL DRAWINGS DEVELOPED PER STANDARD HOUSE PRACTICES. FINAL DESIGN & SIZING TO BE BY ELECTRICAL CONTRACTOR. SCHEMATIC ELECTRICAL DRAWINGS HAVE NOT BEEN DESIGNED BY A LICENSED ENGINEER.

DATA/CABLE WIRING
THE LIVING ROOM AND ALL BEDROOMS SHALL CONTAIN TWO COAX CABLE OUTLETS AND TWO CAT 6 DATA CABLE OUTLETS IN LOCATION OF OWNER'S CHOICE WITH HOMERUNS TO THE UTILITY ROOM. EACH UTILITY ROOM SHALL HAVE ONE HOMERUN OF CAT 6 DATA AND COAX CABLE TO A COMMON LOCATION ON AN EXTERIOR WALL OF OWNER'S CHOICE.

CARBON MONOXIDE ALARMS
CARBON MONOXIDE ALARMS SHALL BE PROVIDED IF
• THE DWELLING CONTAINS A FUEL - FIRED APPLIANCE.
• THE DWELLING HAS AN ATTACHED GARAGE.
IT SHALL BE LOCATED OUTSIDE OF EACH SEPARATE SLEEPING AREA.

ELECTRICAL SPECS.

- A. ALL CONDUCTORS SHALL BE THHN COPPER ABOVE GRADE, XHHW-2 BELOW GRADE, MINIMUM #12 OR LARGER AS REQUIRED.
- B. ALL SERVICE WIRING, EXPOSED TO WEATHER, OR WIRING BELOW GRADE, SHALL BE IN RIGID GALVANIZED CONDUIT OR SCH. 40 PVC.
- C. ALL OTHER WIRING SHALL BE IN EMT, SCHEDULE 40 PVC, OR MC CABLE, UNLESS PROTECTED AND ENCLOSED WITHIN BUILDING MATERIALS, IN WHICH CASE TYPE NM CABLE MAY BE USED.
- D. WALL SWITCHES SHALL BE LEVITON #CS120 SERIES, OR APPROVED EQUAL, 20A, COLOR SHALL BE DETERMINED BY OWNER. DIMMER SWITCHES SHALL BE SELECTED BY CONTRACTOR TO BE COMPATIBLE WITH LIGHT FIXTURES PROVIDED, COLOR SHALL BE DETERMINED BY OWNER.
- E. DUPLEX RECEPTACLES SHALL BE TAMPER RESISTANT LEVITON #T580 SERIES, OR APPROVED EQUAL, 20A, GROUNDING, MATCHING COVER PLATE, COLOR AS DETERMINED BY OWNER. USE SIDE WIRING ONLY, WHERE REQUIRED BY CODE.
- F. ARC-FAULT CIRCUIT INTERRUPTER BREAKERS SHALL BE COMBINATION TYPE BY SQUARE D, AND SHALL HAVE A DEDICATED NEUTRAL WIRE THROUGHOUT THE CIRCUIT, WHERE REQUIRED BY CODE.
- G. THE ENTIRE SYSTEM SHALL BE ELECTRICALLY CONTINUOUS AND PROPERLY GROUNDED. EVERY FEEDER AND BRANCH CONDUIT SHALL HAVE CODE SIZED GREEN INSULATED GROUND CONDUCTOR.
- H. ALL 120V AND 277V, 20A LIGHTING AND RECEPTACLE CIRCUITS REQUIRING MORE THAN 100' OF CONDUCTORS (ONE WAY) SHALL BE #10 CONDUCTORS, MINIMUM.
- I. PROVIDE TYPEWRITTEN BREAKER SCHEDULE IN EACH PANELBOARD INDICATING ITEMS AND DEVICES SERVED BY ALL BREAKERS IN EACH PANEL.
- J. PERMANENTLY LABEL DISCONNECTS FOR HVAC EQUIPMENT WITH EQUIPMENT SERVED, AND PANEL AND CIRCUIT NUMBER.
- K. UNDERGROUND SPLICES TO BE MADE WITH DEVICES RATED FOR THAT APPLICATION.
- L. ALL ELECTRICAL PANELS AND DISCONNECTS SHALL HAVE A PERMANENT ARC-FLASH LABEL AFFIXED PER NEC 110.16.

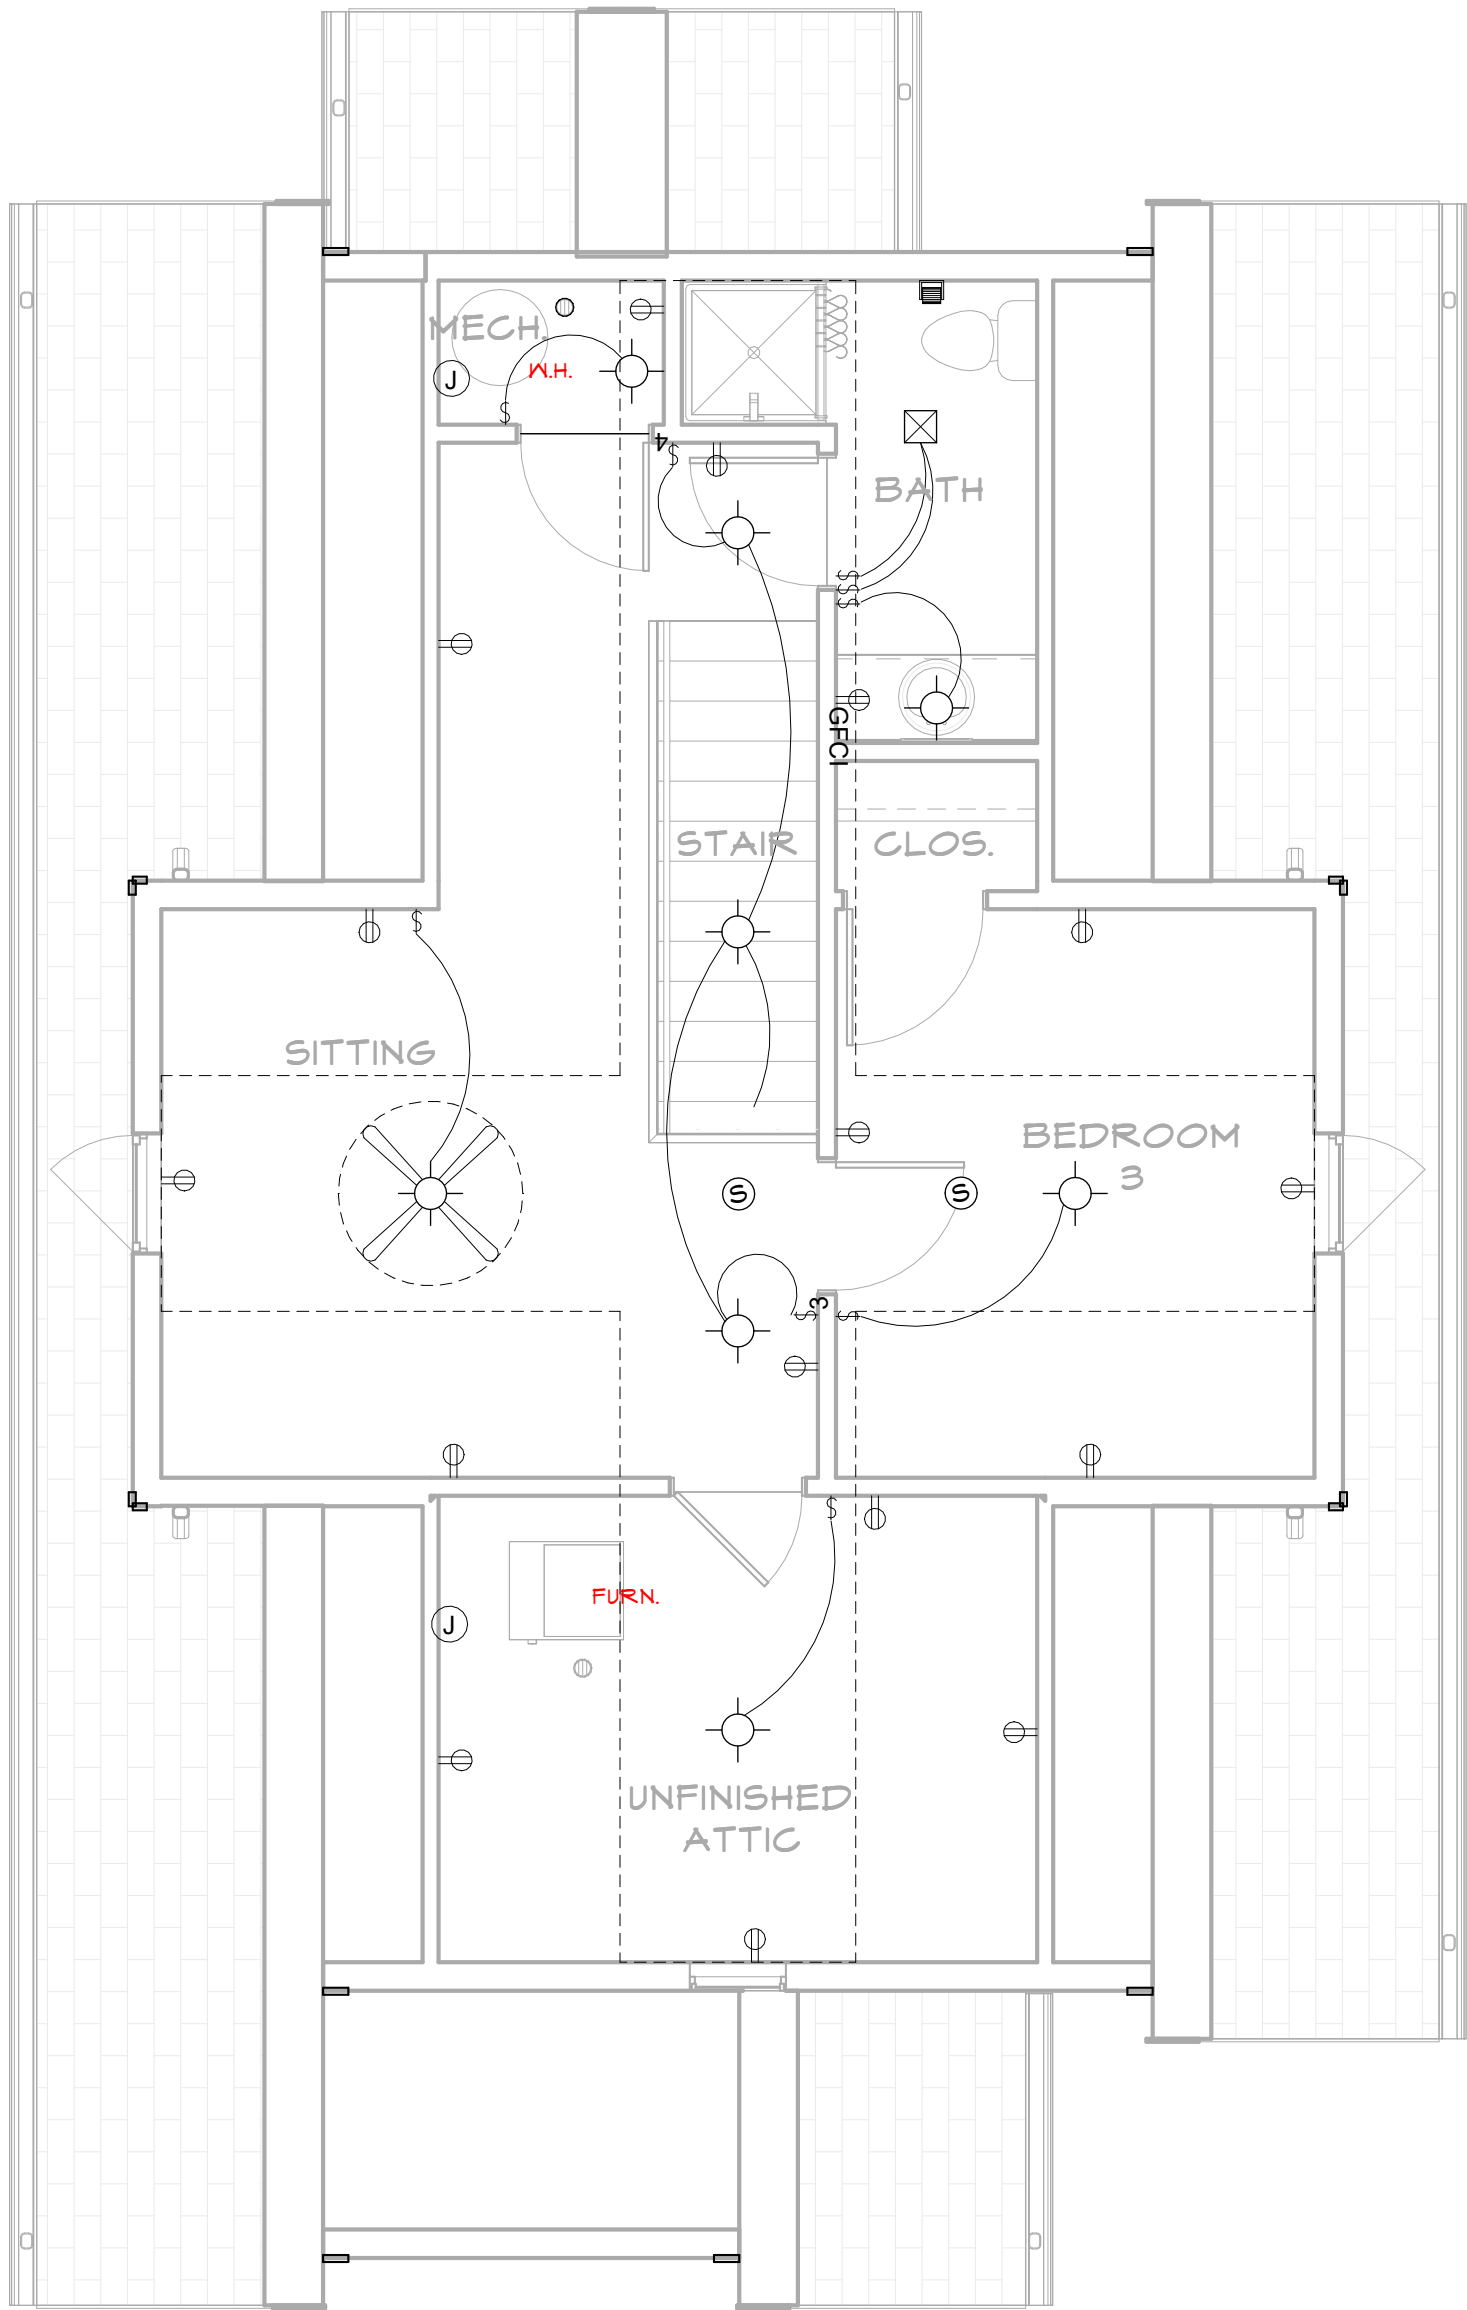

2
E1.01 ELECTRICAL PLAN - SECOND FLOOR
1/4" = 1'-0"



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS - 2026021508
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2009003310-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	

CITY OF SEDALIA
HOUSING - HOUSE A


4TH & NEW YORK,
SEDALIA, MO

SCHEMATIC
ELECTRICAL
PLANS

DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:

E 1.01
80.168

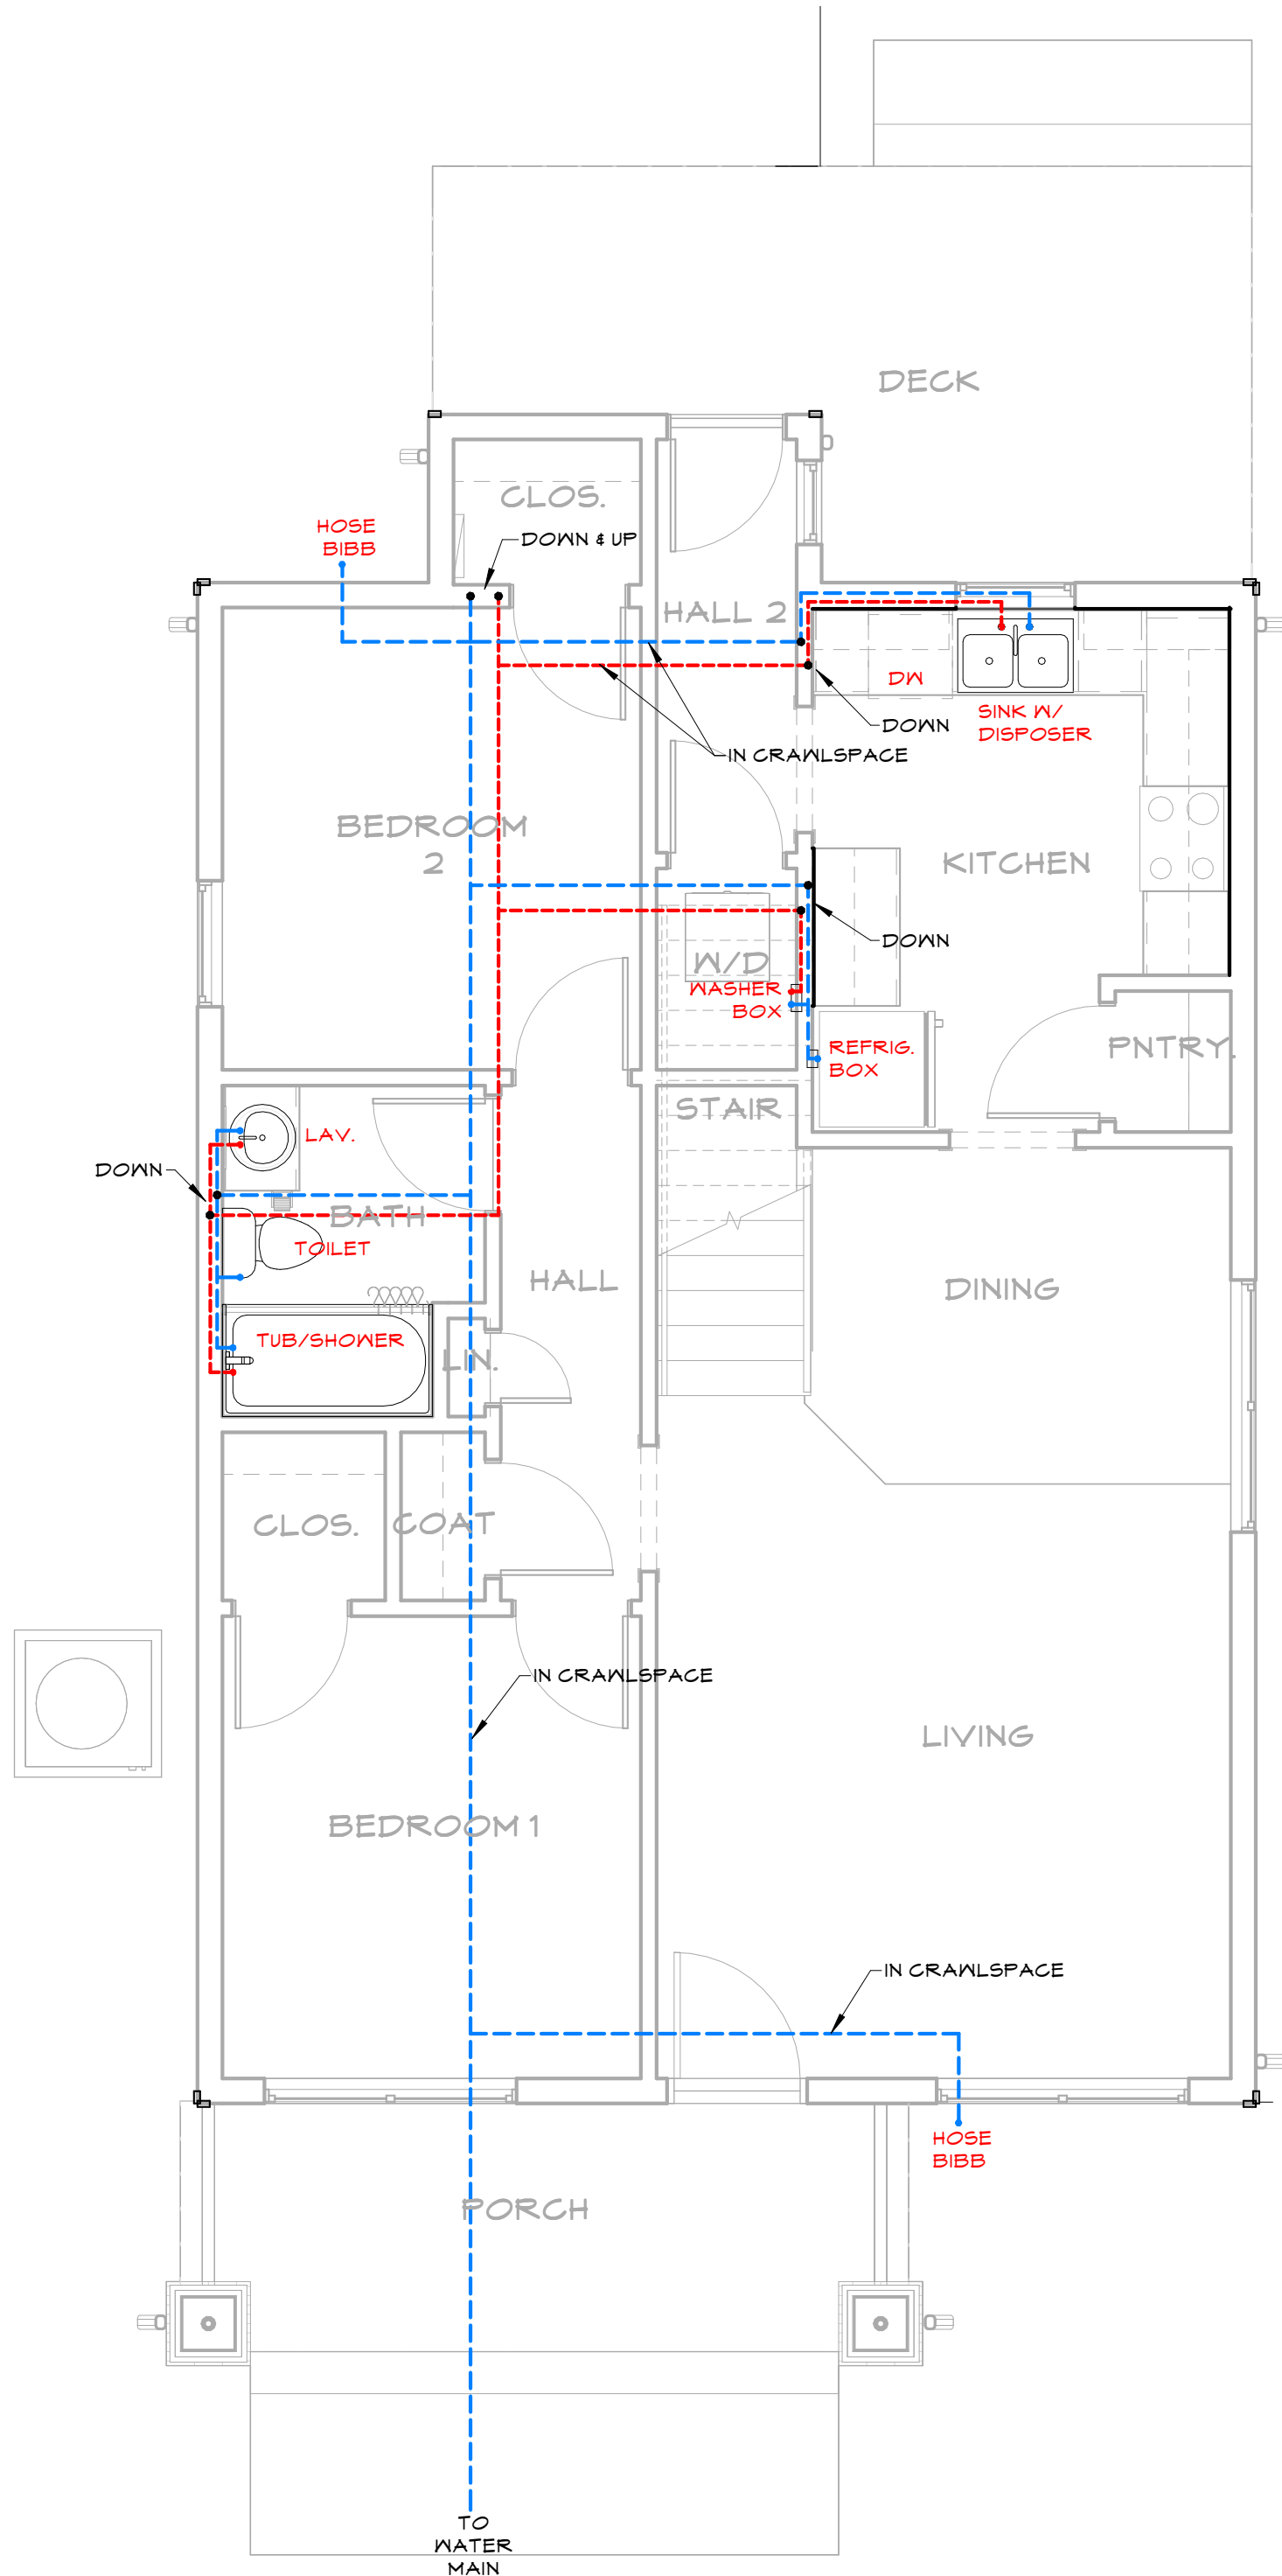


1
P.1.01 WATER PLAN - FIRST FLOOR
1/4" = 1'-0"

PLUMBING FIXTURE CONNECTION SCHEDULE					
FIXTURE	WATER		WASTE	VENT	WATER HAMMER ARRESTOR REQUIRED
	COLD	HOT			
LAVATORY	1/2"	1/2"	1 1/2"	1 1/4"	YES
WATER CLOSET - TANK	1/2"		4"	2"	YES
WATER CLOSET - FLUSH VALVE			4"	2"	YES
URINAL			2"	1 1/4"	NO
MOP SINK	1/2"	1/2"	3"	1 1/2"	NO
HAND SINK	1/2"	1/2"	2"	1 1/4"	NO
HAIR SINK	1/2"	1/2"	2"	1 1/4"	NO
SHOWER	1/2"	1/2"	3"	1 1/2"	NO
FLOOR DRAIN			3"	2"	
DF	1/2"		1 1/2"	1 1/4"	NO
NOTE: WASTE PIPING BELOW SLAB TO BE A MINIMUM OF 2". PROVIDE SHUTOFF VALVES IN CW & HW LINES AT EACH FIXTURE.					
VENT LINE			SEWAGE LINE		
COLD WATER			GAS LINE		
HOT WATER					

GEN. PLUMBING NOTES

- A. WASTE AND VENT PIPING INSIDE BUILDING SHALL BE SCH. 40 PVC DWV PLASTIC WITH SOLVENT WELD FITTINGS BELOW GRADE, AND SCH. 40 PVC DWV PVC, COPPER OR NO-HUB CAST IRON ABOVE GRADE. MINIMUM SLOPE: 1/4" PER FT 1 1/4" TO 2 1/2" PIPE, 1/8" PER FT 3" TO 6", 1/16" PER FT 8" AND LARGER. PVC TO BE SOLID CORE - CELLULAR CORE IS NOT ACCEPTABLE.
- B. WATER PIPING SHALL BE TYPE "K" COPPER BELOW GRADE, TYPE "L" COPPER ABOVE GRADE, OR PEX TUBING ABOVE OR BELOW GRADE. THERE SHALL BE NO JOINTS IN WATER PIPING BELOW SLABS. UNDERGROUND COPPER JOINTS TO BE SILVER SOLDERED. NO UNDERGROUND PEX JOINTS. IF PEX PIPING IS USED, PIPE SIZES MUST BE INCREASED BY ONE PIPE-SIZE ABOVE WHAT IS SHOWN ON THE PLANS, EXCEPT FOR THE LAST 6'-0" FEEDING A SINGLE FIXTURE, WHICH MAY BE THE SAME SIZE SHOWN ON PLAN.
- C. LP & NATURAL GAS PIPING ABOVE GRADE SHALL BE SCH. 40 BLACK STEEL PIPE WITH CLASS 150 MALLEABLE IRON THREADED FITTINGS. ALL NEW EXTERIOR GAS PIPING SHALL BE PAINTED TO MATCH BUILDING WHERE EXPOSED ON BUILDING FACE AND YELLOW IN ALL OTHER LOCATIONS. ROOFTOP MOUNTED PIPING SHALL BE FASTENED TO AND SUPPORTED BY "ROOFTOP BLOC".
- D. INSULATE ALL HOT AND COLD WATER PIPING, INCLUDING BELOW SLAB, WITH 1/2" THICK FLENUM RATED ARMAFLEX.
- E. PLUMBING FIXTURES SHALL BE AS INDICATED ON DRAWING. FURNISH AND INSTALL CHROME STOP VALVES, SUPPLIES, ESCUTCHEONS AND TRAPS AS REQUIRED FOR ALL FIXTURES.
- F. ALL SEWER VENT TERMINATIONS SHALL BE LOCATED MINIMUM 10' HORIZONTALLY OR 3' HIGHER THAN ANY AIR INTAKE. PLUMBER IS RESPONSIBLE TO REROUTE ANY VENT TERMINATIONS AS REQUIRED TO ACCOMPLISH THIS REQUIREMENT.

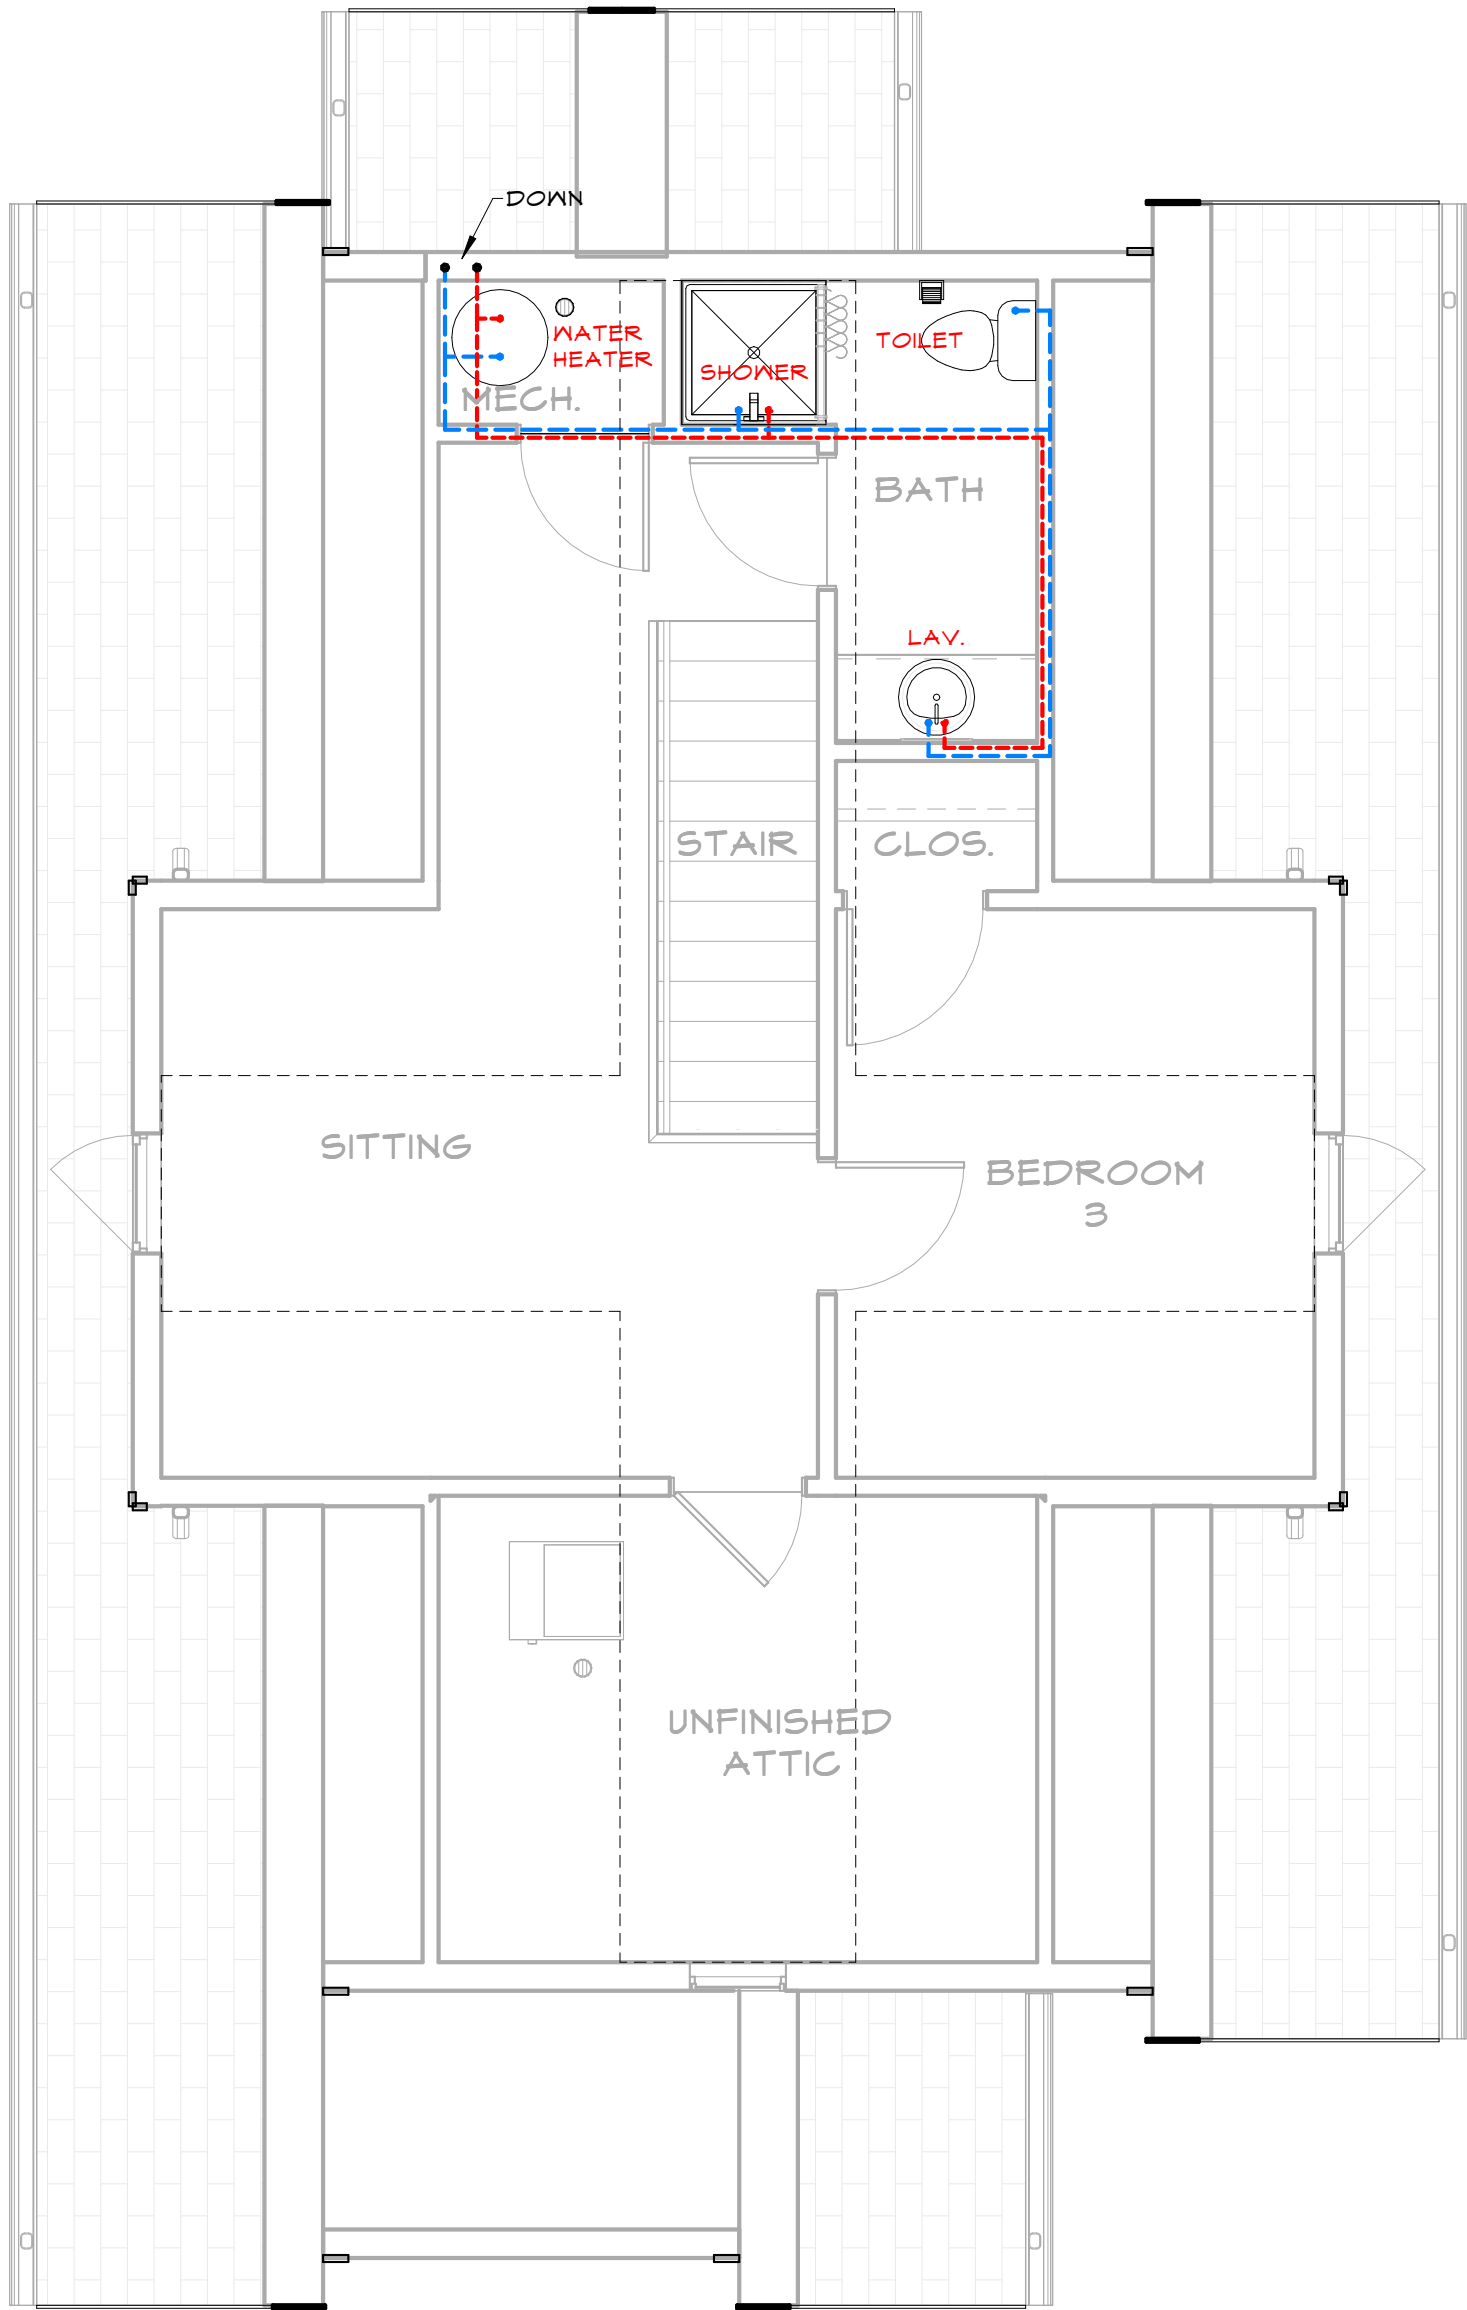

2
P.1.01 WATER PLAN - SECOND FLOOR
1/4" = 1'-0"

SCHEMATIC PLUMBING DRAWINGS DEVELOPED PER STANDARD HOUSE PRACTICES. FINAL DESIGN & SIZING TO BE BY PLUMBING CONTRACTOR. SCHEMATIC PLUMBING DRAWINGS HAVE NOT BEEN DESIGNED BY A LICENSED ENGINEER.



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT

ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS - 2026021509
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-20090033 TO-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	

CITY OF SEDALIA
HOUSING - HOUSE A

4TH & NEW YORK,
SEDALIA, MO


SCHEMATIC WATER
PLANS

DRAWN BY	Author
CHECKED BY	Approver

SHEET NUMBER:


P1.01
80.168

NOTE:
• WASTE LINES IN CRAWLSPACE
• VENT LINES IN JOISTS

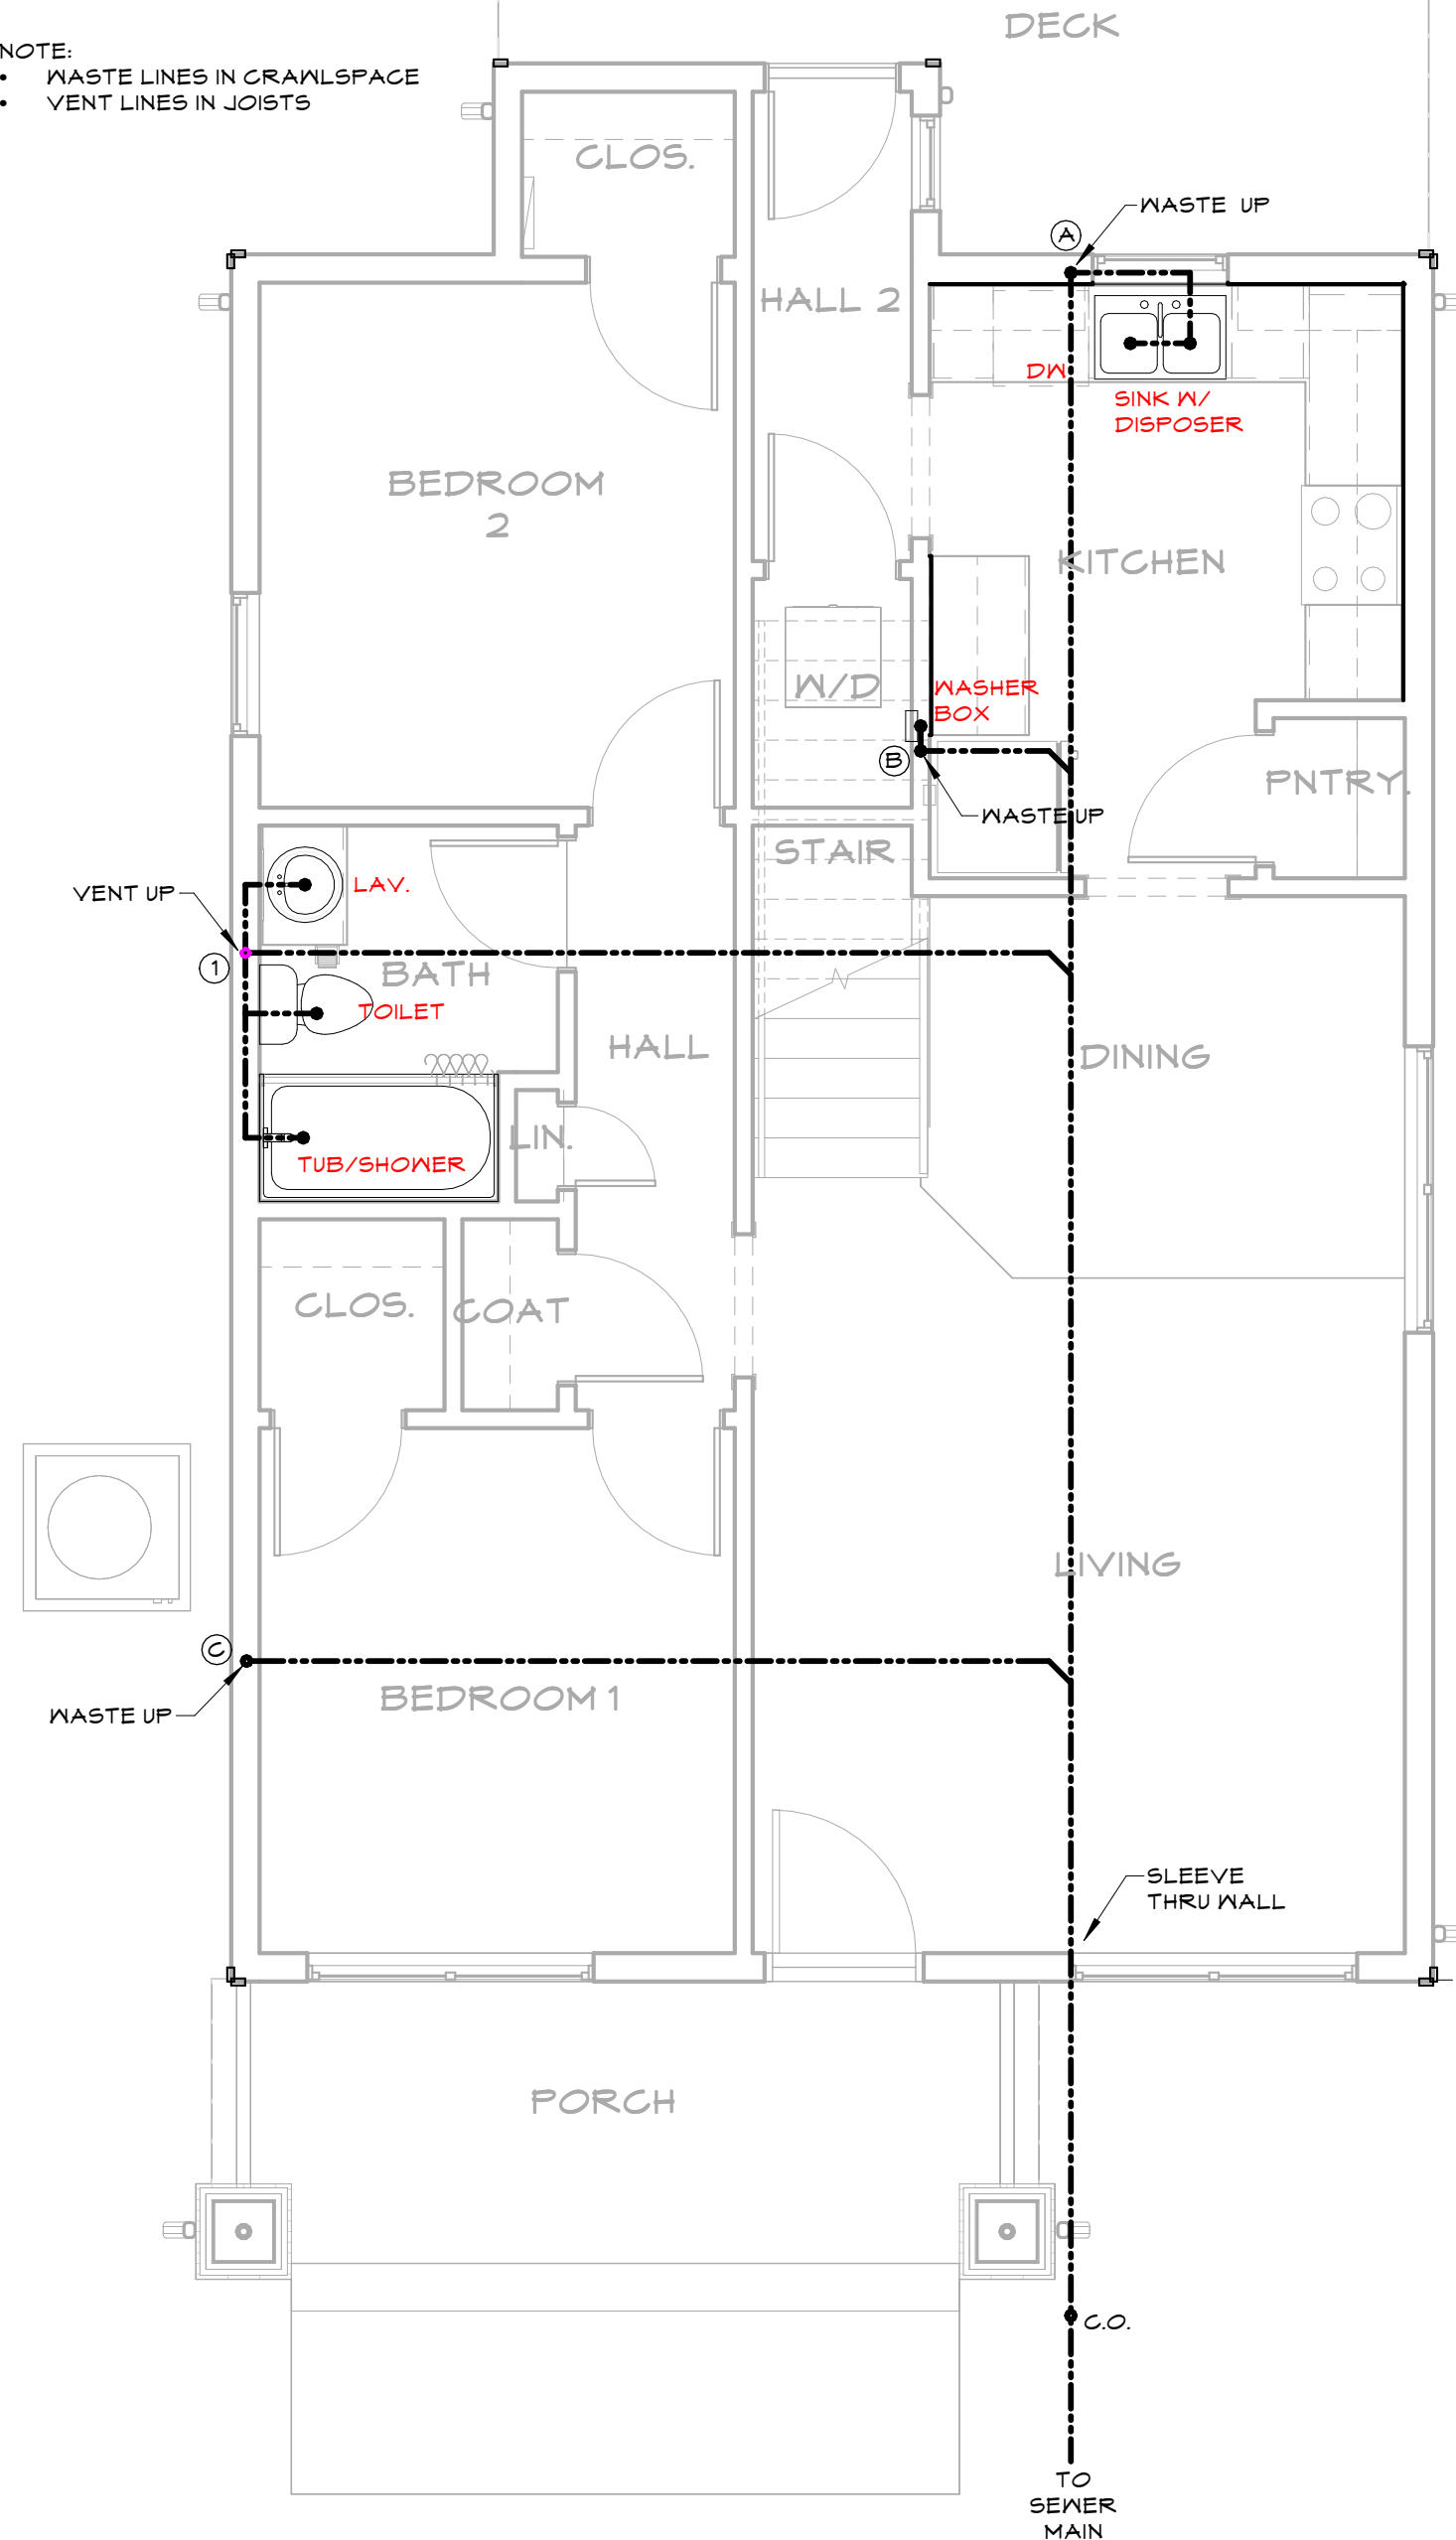


1
P.1.02
SEWER PLAN - FIRST FLOOR
1/4" = 1'-0"

SCHEMATIC PLUMBING DRAWINGS
DEVELOPED PER STANDARD HOUSE
PRACTICES. FINAL DESIGN & SIZING TO
BE BY PLUMBING CONTRACTOR.
SCHEMATIC PLUMBING DRAWINGS HAVE
NOT BEEN DESIGNED BY A LICENSED
ENGINEER.

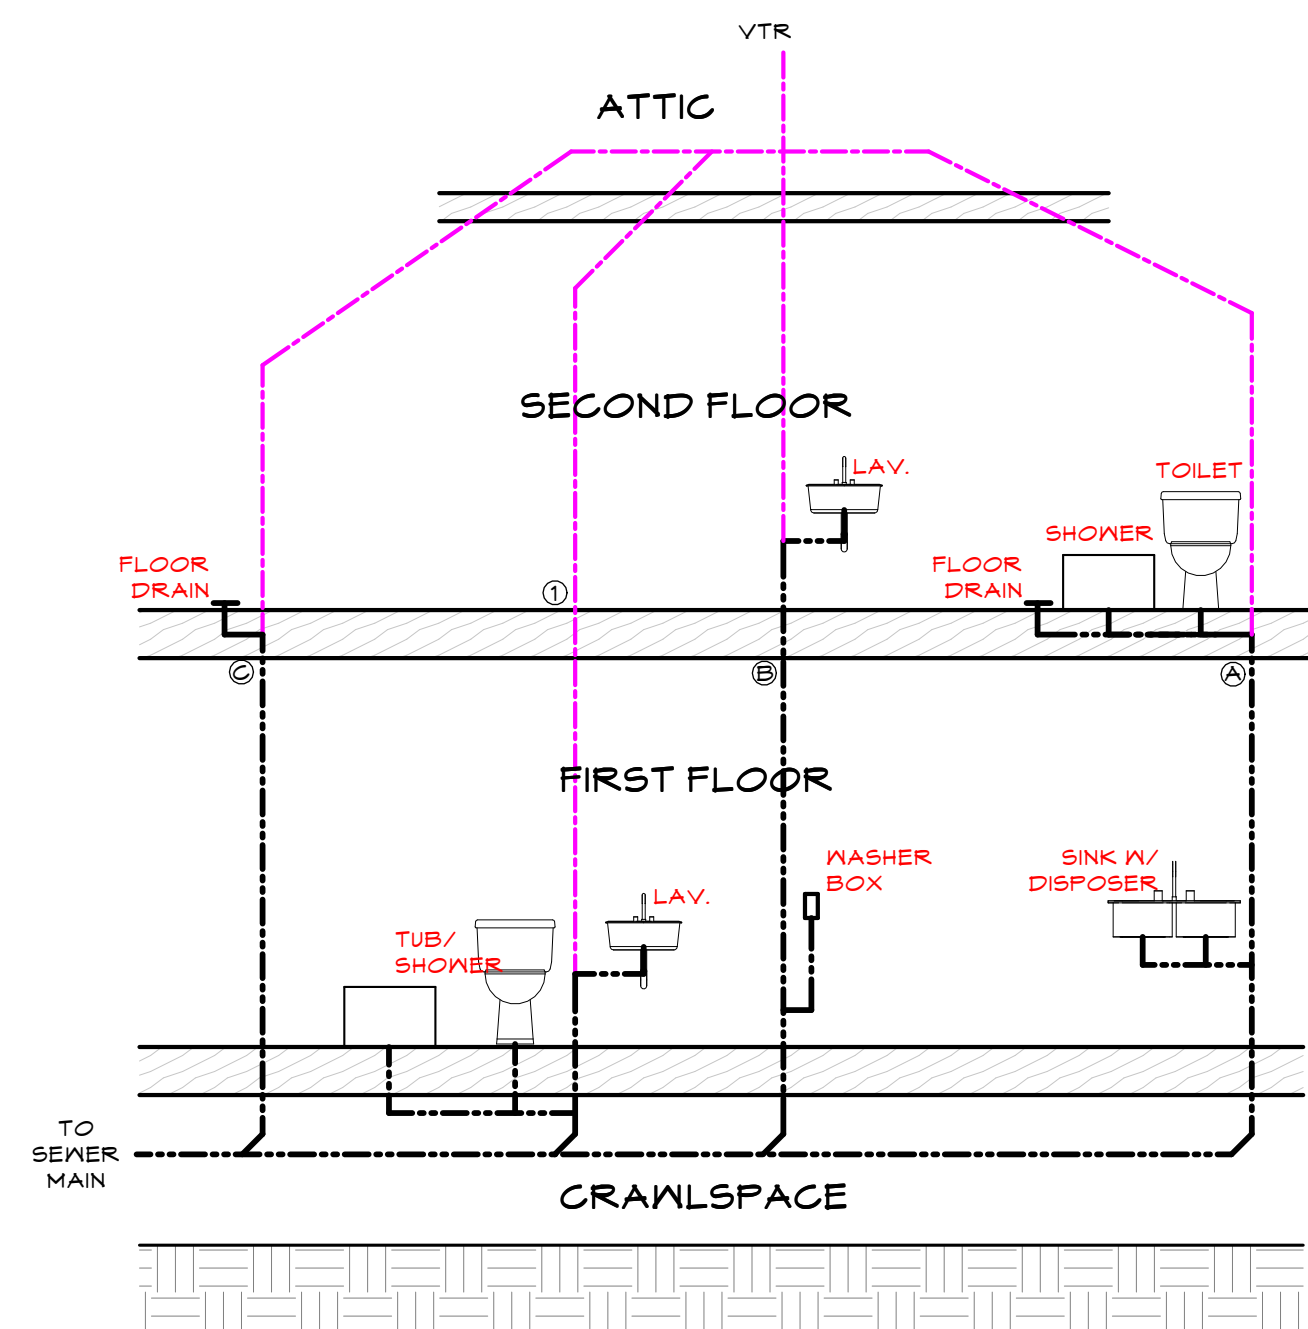

SCHEMATIC RISER DIAGRAM
1/4" = 1'-0"

NOTE:
• WASTE LINES IN JOISTS
• VENT LINES IN ATTIC

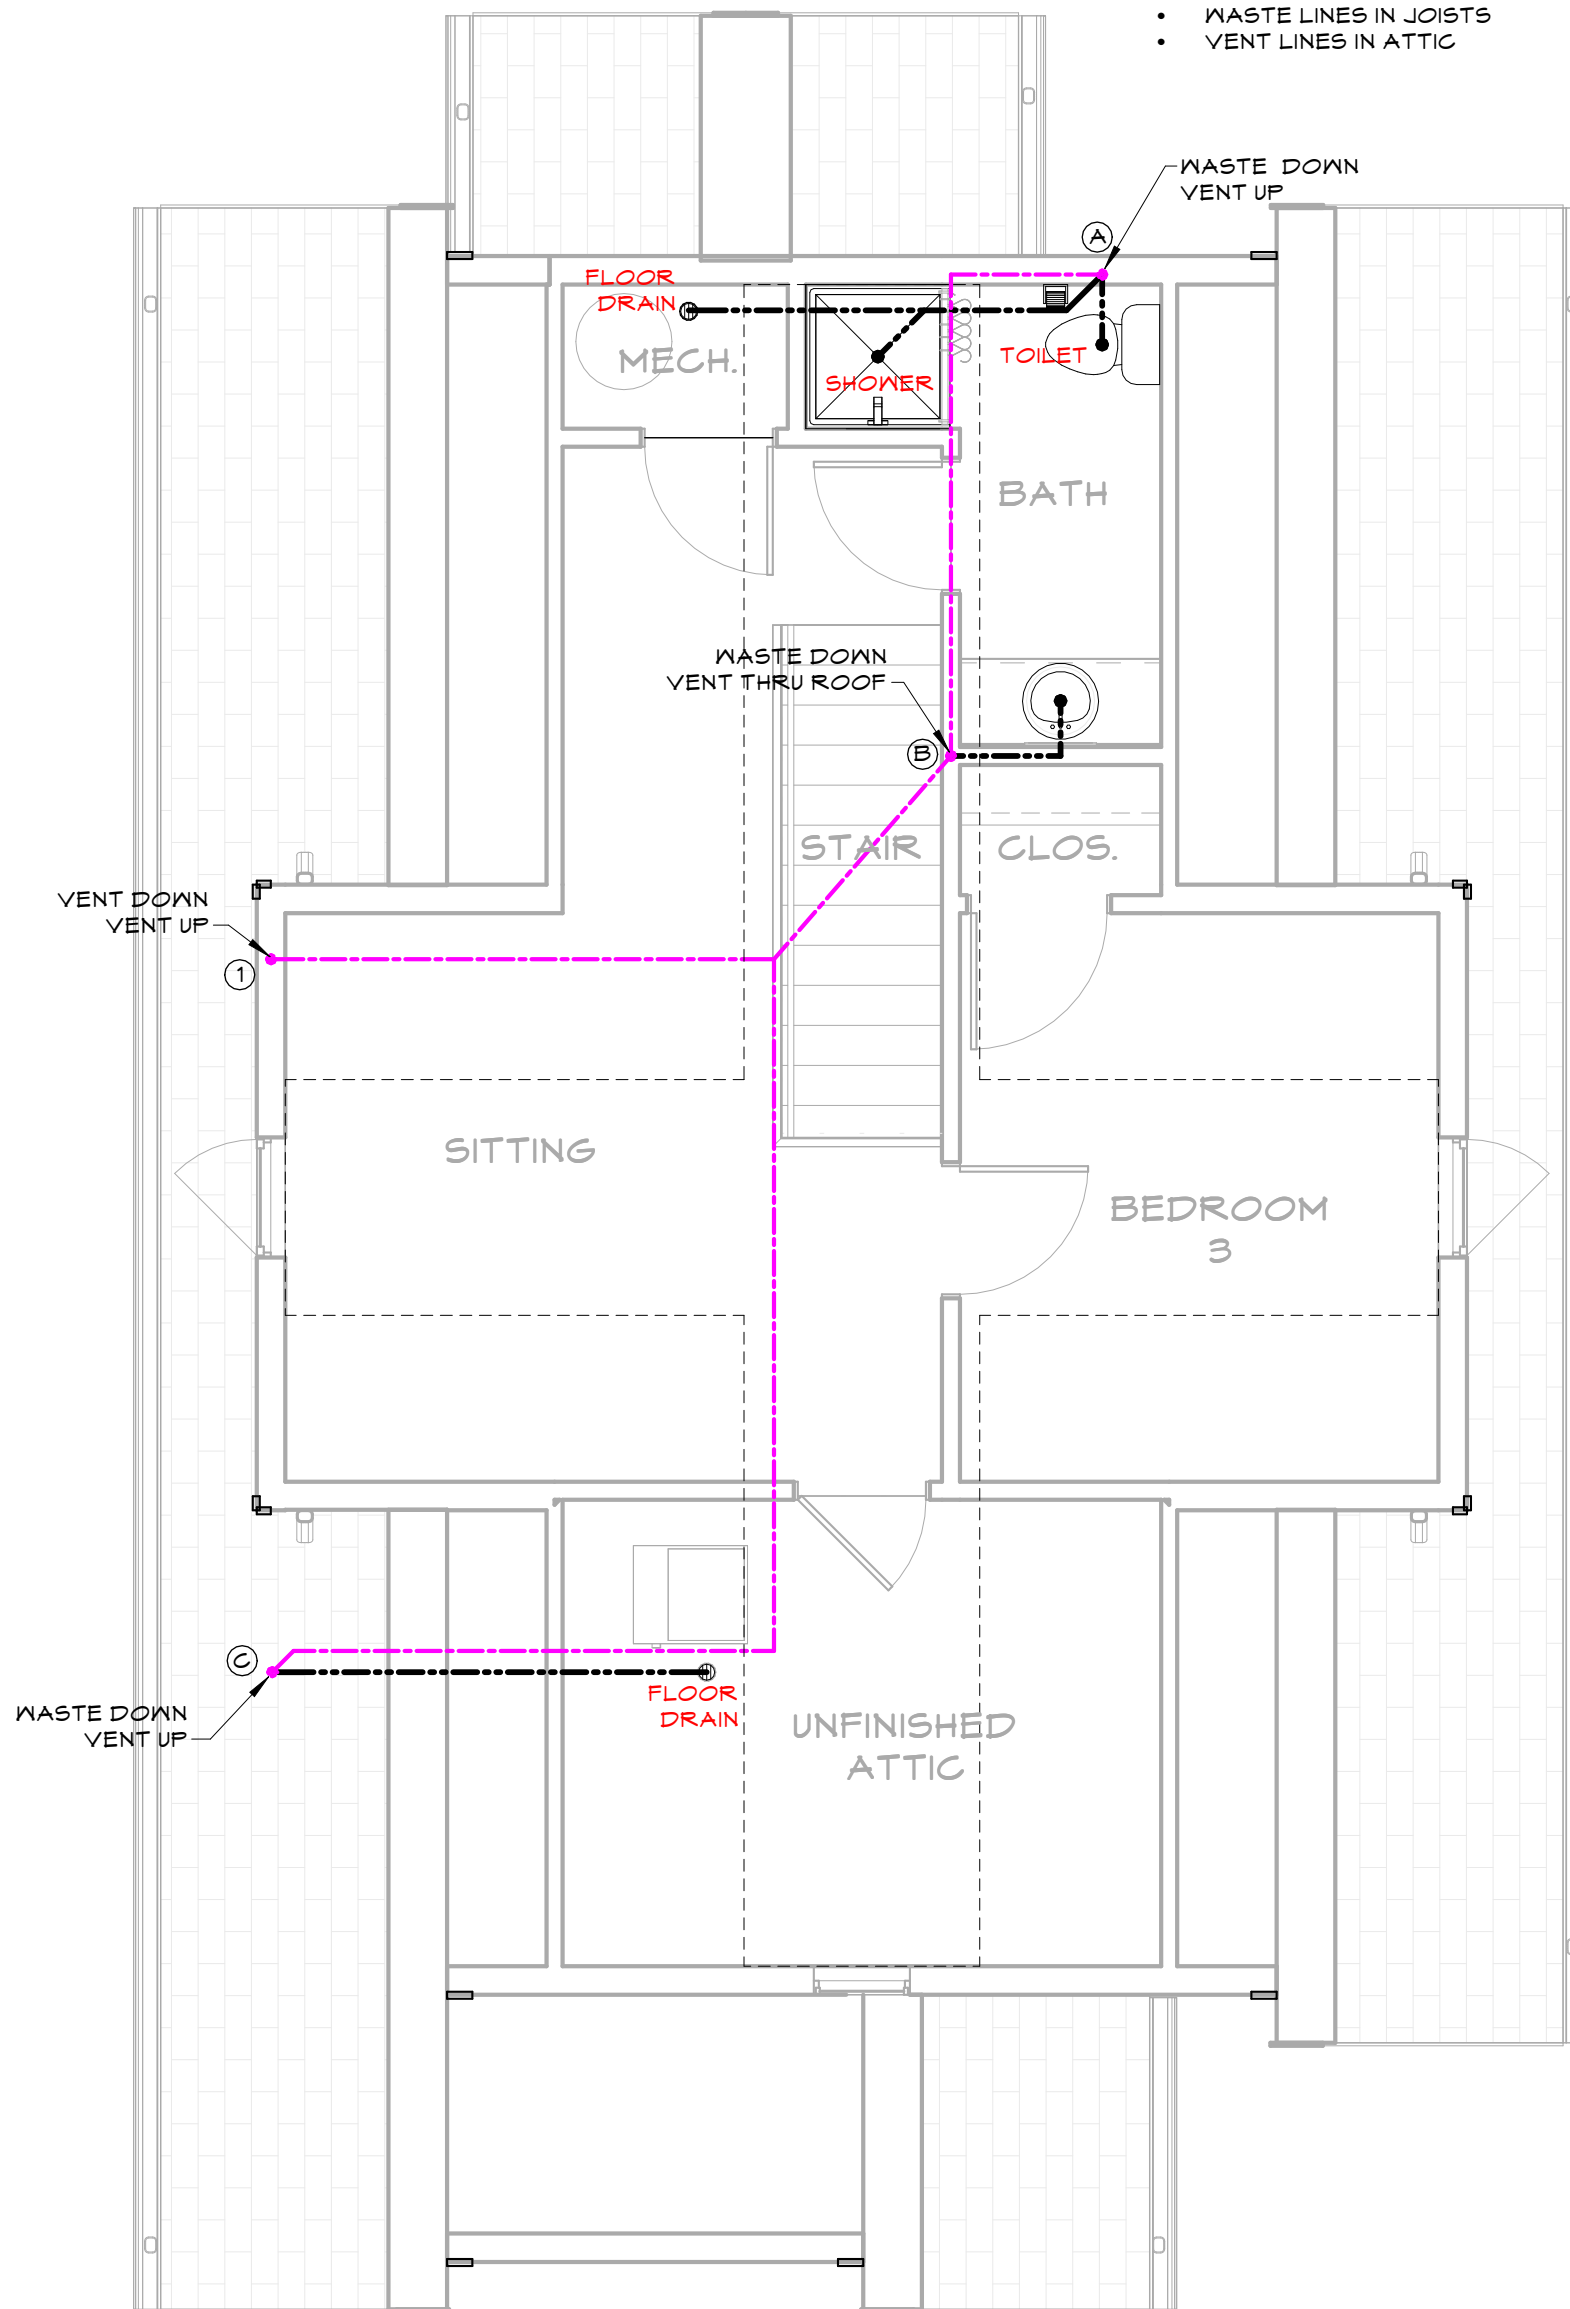

2
P.1.02
SEWER PLAN - SECOND FLOOR
1/4" = 1'-0"

CITY OF SEDALIA HOUSING - HOUSE A

COPYRIGHT © 2021



Robert Rollings
Architects LLC
1806 West Broadway
Sedalia, MO 65301
Phone: 660. 829. 9751
Fax: 660. 829. 9752

CROCKETT

ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1,
Columbia, Missouri 65202
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000151304

PRELIMINARY.
NOT FOR
CONSTRUCTION

ROBERT D. ROLLINGS - 2028021508
CERTIFICATE OF AUTHORITY
TO OFFER ARCHITECTURAL
SERVICES
ROBERT ROLLINGS ARCHITECTS, LLC
SERIAL # A-2008003310-D

ISSUE/REVISION	DATE	NO.
CONSTRUCTION SET	2/9/2025	

CITY OF SEDALIA
HOUSING - HOUSE A

4TH & NEW YORK,
SEDALIA, MO

SCHEMATIC SEWER
PLANS

DRAWN BY: Author
CHECKED BY: Approver

SHEET NUMBER:

P 1.02
80.168