

9/8/2023 12:55:19 PM Autodesk Docs://1230237 Port Wentworth Fire Station/1230237_Port Wentworth FS_STRC_v23.rvt

D
C
B
A

0
0.6
1
2
3
3.9
5

A
B
C
D

A1

SCALE: 1/8" = 1'-0"

FOUNDATION PLAN

SCALE: 1/8" = 1'-0"

COLUMN SCHEDULE		
COLUMN MARK	COLUMN SIZE	BASE PLATE
C1	HSS6x6x3/8	SEE B1/S-502
C2	HSS 7x7x1/2	SEE B1/S-502
C3	HSS 12x12x5/8	SEE B1/S-502
C4	HSS6X6X3/8	SEE B1/S-502
C5	HSS 6X6X3/8	SEE B1/S-502

FOUNDATION SCHEDULE		
FOOTING MARK	SIZE	REINFORCEMENT
F1	6'-0" x 6'-0" x 1'-6"	(6) #6 BARS E.W. T&B
F2	7'-0" x 7'-0" x 1'-6"	(8) #8 BARS E.W. T&B
F3	6'-0" x 6'-0" x 2'-0"	(6) #6 BARS E.W. T&B

FOUNDATION PLAN NOTES:

- SEE SHEETS S-001 AND S-002 FOR GENERAL STRUCTURAL NOTES AND ABBREVIATION KEY.
- SEE SHEET S-501 FOR TYPICAL FOUNDATION DETAILS.
- REFERENCE FLOOR ELEVATION OF 0'-0" CORRESPONDS TO USGS ELEVATION OF ###.###. SEE CIVIL DRAWINGS.
- TOP OF FIRST FLOOR SLAB ELEVATION = 0'-0" UNLESS NOTED OTHERWISE.
- TOP OF FOOTING ELEVATIONS = -2'-0", UNLESS NOTED OTHERWISE.
- SLAB ON GRADE SHALL BE 5" OR 6" CONCRETE AS INDICATED ON PLAN, REINFORCED WITH #5 @ 12" O.C. EA. WAY PLACED AT 1 1/2" FROM TOP OF SLAB. SLAB SHALL BE PLACED OVER 10 mil VAPOR RETARDER AND 4" STONE SUBGRADE.
- FOR ADDITIONAL REINFORCEMENT AT RE-ENTRANT CORNERS, SEE DETAIL B3/S-501
- CMU WALLS SHALL BE 12" THICK AND 8" THICK AT ELEVATOR/STAIRS, SEE PLAN
- SEE PLUMBING AND ARCHITECTURAL DRAWINGS FOR FLOOR DRAIN AND SLAB-ON-GRADE DEPRESSION LOCATIONS AND REQUIREMENTS.
- 8" CMU WALLS TO BE SOLID GROUT W/ #5'S VERT REINF. @ 24" O.C. AND #3'S HORIZ. REINF. @ 32" O.C.

FOUNDATION PLAN LEGEND:

- | | |
|--------|--|
| F# | FOOTING TYPE, SEE SCHEDULE ON S-101 |
| C# | COLUMN TYPE, SEE SCHEDULE ON S-101 |
| CJ | SLAB CONTROL JOINT, SEE DETAIL C1/S-501 |
| FD | SLAB REINFORCEMENT, SEE PLAN & NOTE 6 |
| FD | FLOOR DRAIN OR CLEANOUT, SEE PLUMBING DRAWINGS |
| E.O.S. | EDGE OF SLAB |
| SD | SLAB STEP DOWN |
| CMU | CMU WALL |
| CJ | CMU CONTROL JOINT, SEE DETAIL A1/S-503 |
| \$ | FOOTING STEP, SEE A4/S-501 |
| CF3 | 3'-0" WIDE CONTINUOUS FOOTING, SEE A3/S-302 |
| CF5 | 5'-0" WIDE CONTINUOUS FOOTING, SEE B3/S-302 |



3500 Parkway Lane
Suite 500
Peachtree Corners
Georgia 30092

Copyright © 2023 by Pond & Company. All rights reserved. No copying or duplication of these documents is allowed without the expressed written agreement of Pond & Company.

EOR/AOR SEAL

100% DESIGN
SUBMITTAL - NOT FOR
CONSTRUCTION

CLIENT INFORMATION

CITY OF PORT
WENTWORTH

PROJECT NAME

PORT
WENTWORTH
FIRESTATION



DRAWING ISSUE

DATE

DESCRIPTION

MARK

DESIGNED BY: MJF
DRAWN BY: MJF
CHECKED BY: RGN
SUBMITTED BY: MM
DATE: 9/08/2023
PROJECT #: 1230237


SHEET TITLE

FOUNDATION
PLAN

SHEET NUMBER

S-101

ORIGINAL SHEET SIZE:
22" X 34"

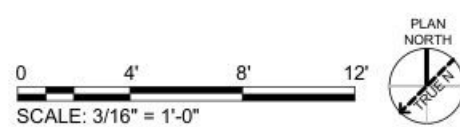

100% DESIGN SUBMITTAL - NOT FOR CONSTRUCTION