


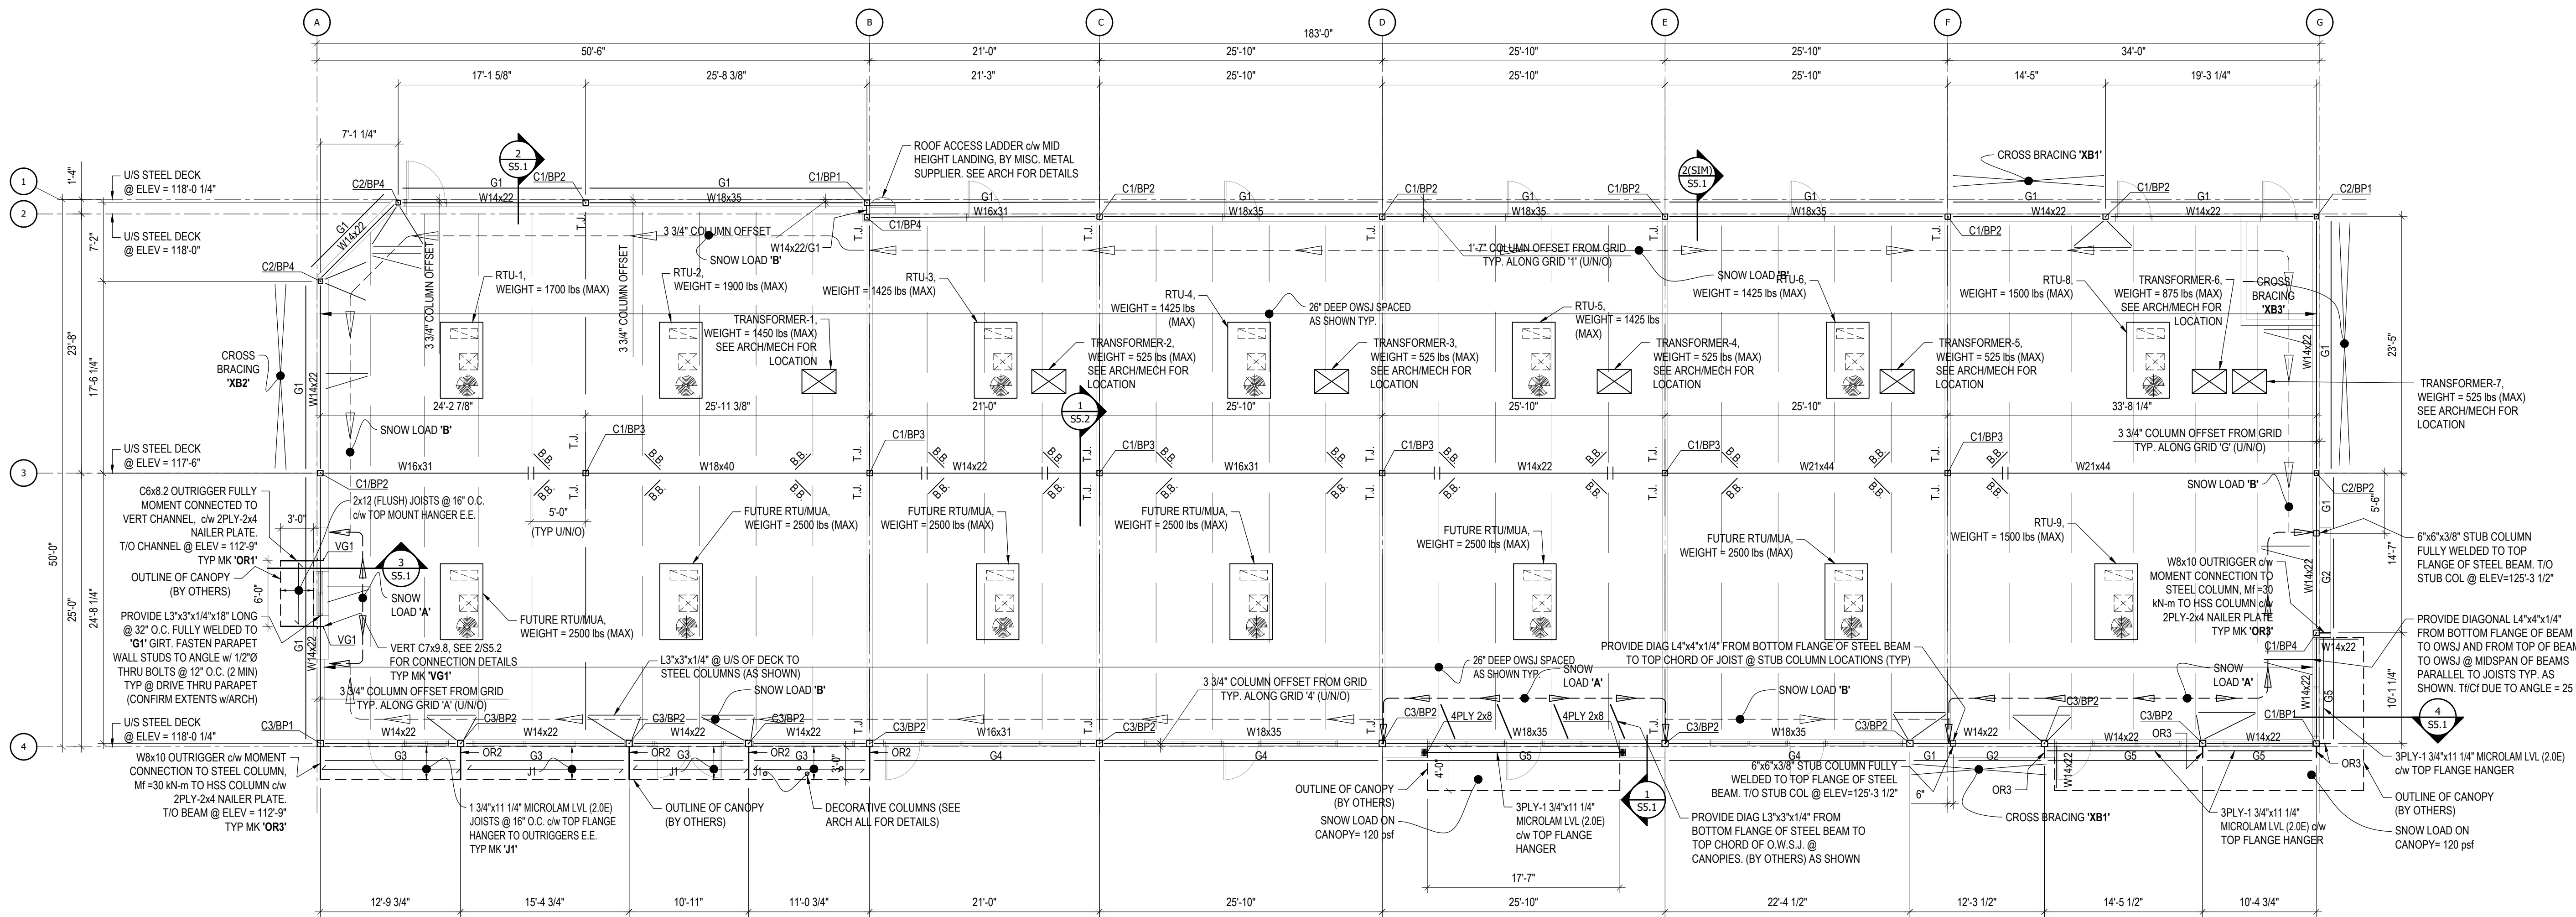

1 ROOF FRAMING PLAN

SCALE : 1/8"=1'-0"


- ROOF FRAMING PLAN NOTES:**
- CONFIRM ALL DIMENSIONS w/ARCH DWGS PRIOR TO CONSTRUCTION.
 - ALL DIMENSIONS ARE TAKEN FROM GRIDS (TYP UNO).
 - CONFIRM ALL STEEL ELEVATIONS w/ARCH DWGS PRIOR TO CONSTRUCTION.
 - STEEL IS ON FACE OF GRIDS (TYP UNO).

ROOF DESIGN NOTES:

- T/O STEEL @ ELEVATION = (SEE PLAN)
- SNOW LOAD = 1.72 kPa (36 psf) UNO
- DESIGN DEAD LOAD = 0.96 kPa (20 psf)
- DESIGN WIND LOAD = q 150 = 0.41 kPa (9.0 psf)
- GRIDS CENTRE OF STEEL UNO
- PROVIDE L4"x3"x8" ANGLES AROUND ALL DECK OPENINGS TYP.
- CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND PROVIDING MECHANICAL UNIT WEIGHTS AND LOCATIONS TO JOIST SUPPLIER PRIOR TO FABRICATION.
- ROOF DECKING TO BE DESIGNED FOR SNOW BUILD UP AROUND MECHANICAL UNITS.
- ALL EXPOSED STEEL TO BE GALVANIZED.
- SNOW BUILD UP TO BE IN ACCORDANCE WITH 2020 NATIONAL BUILDING CODE OF CANADA, CURRENT EDITION.
- PROVIDE C6x8.2 BELOW ALL R.T.U. CURBS.
- PROVIDE L 3"x3"x8" BELOW ALL CONDENSERS AND EXHAUST FANS.

ROOF NOTES:
STEEL DECK SUPPLIER TO ENSURE ALL DECK GAUGE IS SIZED APPROPRIATELY FOR SPACING OF SUPPORTS AND LOADS SHOWN ON THE ROOF FRAMING PLAN.

BUILT-UP-SNOW LOAD SCHEDULE

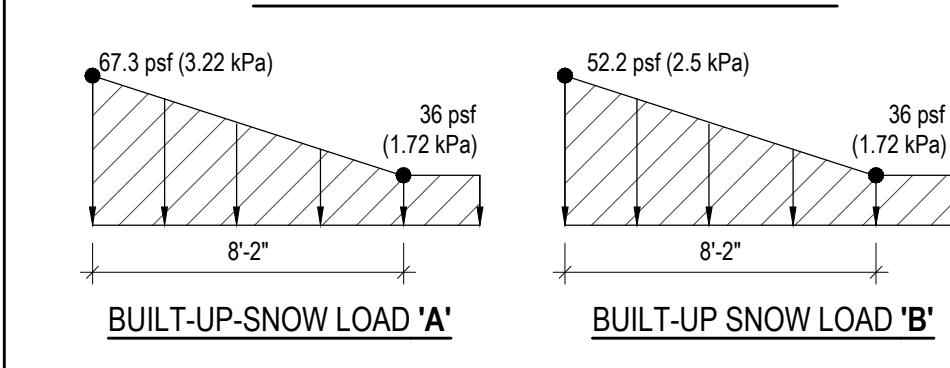

COLUMN & BASE PLATE SCHEDULE

MARK	SIZE & ELEVATION	BASE PLATE MARK & DESCRIPTION	BASE PLATE DIMENSIONS
C1*	HSS 6"x6"x1/4"	BP1* - 3/4" x BY DIMENSIONS SHOWN BASE PLATE ON 1" NON-SHRINK GROUT (35MPa) c/w (4) "AB1" ANCHOR BOLTS US B. PLATE @ 100'-1"	COL WIDTH + 6"
C2*	HSS 5"x5"x1/4"	BP1A* - 1" x BY DIMENSIONS SHOWN BASE PLATE ON 1" NON-SHRINK GROUT (35MPa) c/w (4) "AB2" ANCHOR BOLTS US B. PLATE @ 100'-1"	COL WIDTH + 6"
C3*	HSS 7"x7"x3/8"	BP2* - 3/4" x BY DIMENSIONS SHOWN BASE PLATE ON 1" NON-SHRINK GROUT (35MPa) c/w (4) "AB1" ANCHOR BOLTS US B. PLATE @ 100'-1"	COL WIDTH + 6"
C4*	HSS 5"x5"x1/4"	BP3* - 3/4" x BY DIMENSIONS SHOWN BASE PLATE ON 1" NON-SHRINK GROUT (35MPa) c/w (4) "AB1" ANCHOR BOLTS US B. PLATE @ 99'-1"	COL WIDTH + 6"
C5*	HSS 6"x6"x1/4"	BP4* - 1 1/4" x BY DIMENSIONS SHOWN BASE PLATE ON 1" NON-SHRINK GROUT (35MPa) c/w (4) "AB2" ANCHOR BOLTS US B. PLATE @ 100'-1"	COL WIDTH + 6"

CROSS BRACING SCHEDULE

MARK	DESCRIPTION	TOP FACTORED HORIZONTAL LOAD
XB1*	HSS 7"x7"x1/4"	40 kN
XB2*	HSS 7"x7"x5/16"	115 kN
XB3*	HSS 7"x7"x1/2"	115 kN


GIRT SCHEDULE

MARK	DESCRIPTION
G1*	HSS 5"x5"x1/4" T/O GIRT @ ELEVATION = 122'-3 1/2"
G2*	HSS 6"x6"x1/4" T/O GIRT @ ELEVATION = 125'-3 1/2"
G3*	HSS 5"x5"x1/4" T/O GIRT @ ELEVATION = 110'-1 1/2"
G4*	HSS 5"x5"x1/4" T/O GIRT @ ELEVATION = 122'-3 1/2"
G5*	HSS 7"x7"x3/8" T/O GIRT @ ELEVATION = 112'-1 1/2"
G6*	HSS 5"x5"x1/4" T/O GIRT @ ELEVATION = 122'-3 1/2"
G7*	HSS 7"x7"x3/8" T/O GIRT @ ELEVATION = 112'-1 1/2"
G8*	HSS 6"x6"x1/4" T/O GIRT @ ELEVATION = 125'-3 1/2"

- GIRT NOTES:**
- CONFIRM ALL ELEVATIONS w/ARCH. DRAWINGS PRIOR TO CONST.
 - PROVIDE 3/4"Ø SAG RODS @ MID SPAN ALL GIRTS @ OUTSIDE FACE OF BEAM (TYP)
 - DESIGN GIRT TO COLUMN CONNECTION FOR T/O = 25 kN (MIN.)

WOOD LITEL SCHEDULE

R.O. SIZE	DESCRIPTION
0'-0" TO 4'-0"	2PLY-2x8 c/w 2x8 SILL PLATE c/w 1-JACK, 1-KING EACH SIDE OF R.O.
4'-1" TO 8'-0"	2PLY-2x8 c/w 2x8 SILL PLATE c/w 1-JACK, 2-KING EACH SIDE OF R.O.

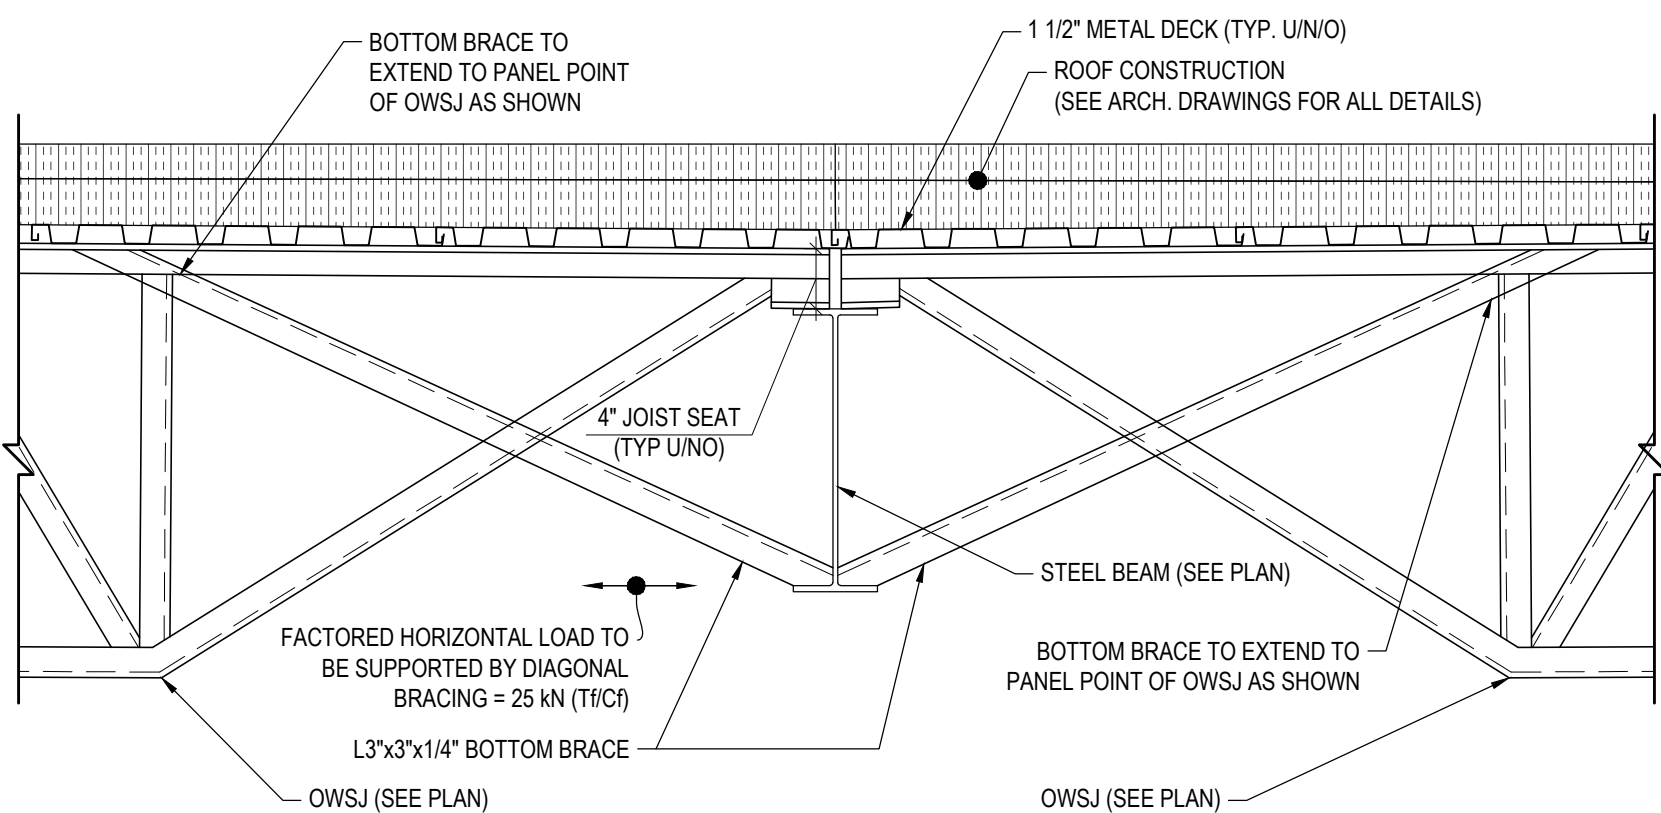

A BOTTOM BRACE 'BB' DETAIL

SCALE : 3/4"=1'-0"

NOT FOR CONSTRUCTION



ARCCADD ARCHITECTURE INC

109-340 Waterfront Drive R3B 0M3 Winnipeg, Manitoba R2M 3S9
p. 204.772.6011 • f. 204.772.2043 • www.arccadd.com

Client: GS HOMES

Project: SELKIRK CRU
287 MAIN STREET
SELKIRK, MANITOBA

Drawing: ROOF FRAMING PLAN & SCHEDULES

Issued For: 99% REVIEW

Revision Description: N/A

Project: 25-1346-CG-223

Scale: AS NOTED

Issued Date: 05-DEC-2025

Revision Date: N/A

S2.2