







SNOW LOAD ACCUMULATION

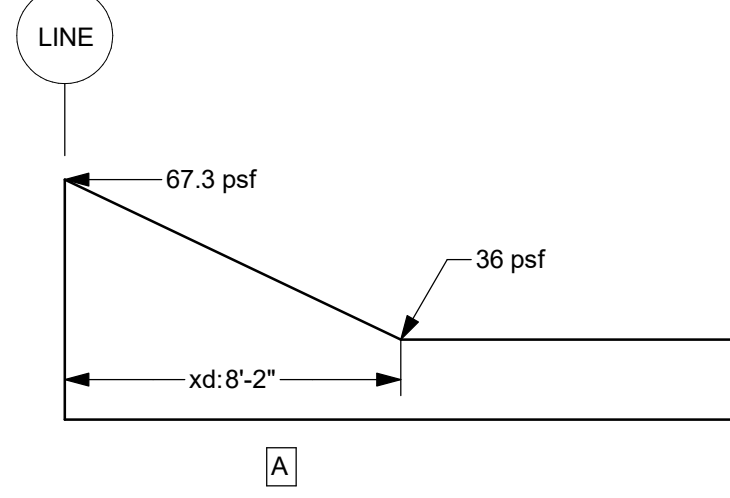

SNOW LOAD ACCUMULATION

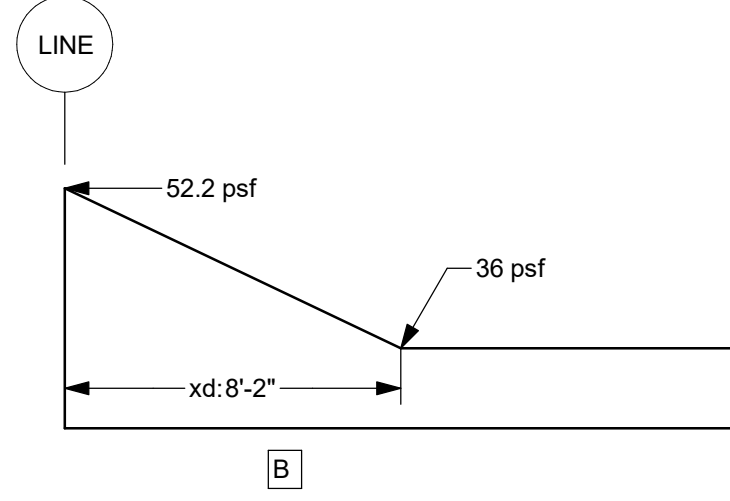


RAIN LOAD + ADDITIONNAL LIVE LOAD

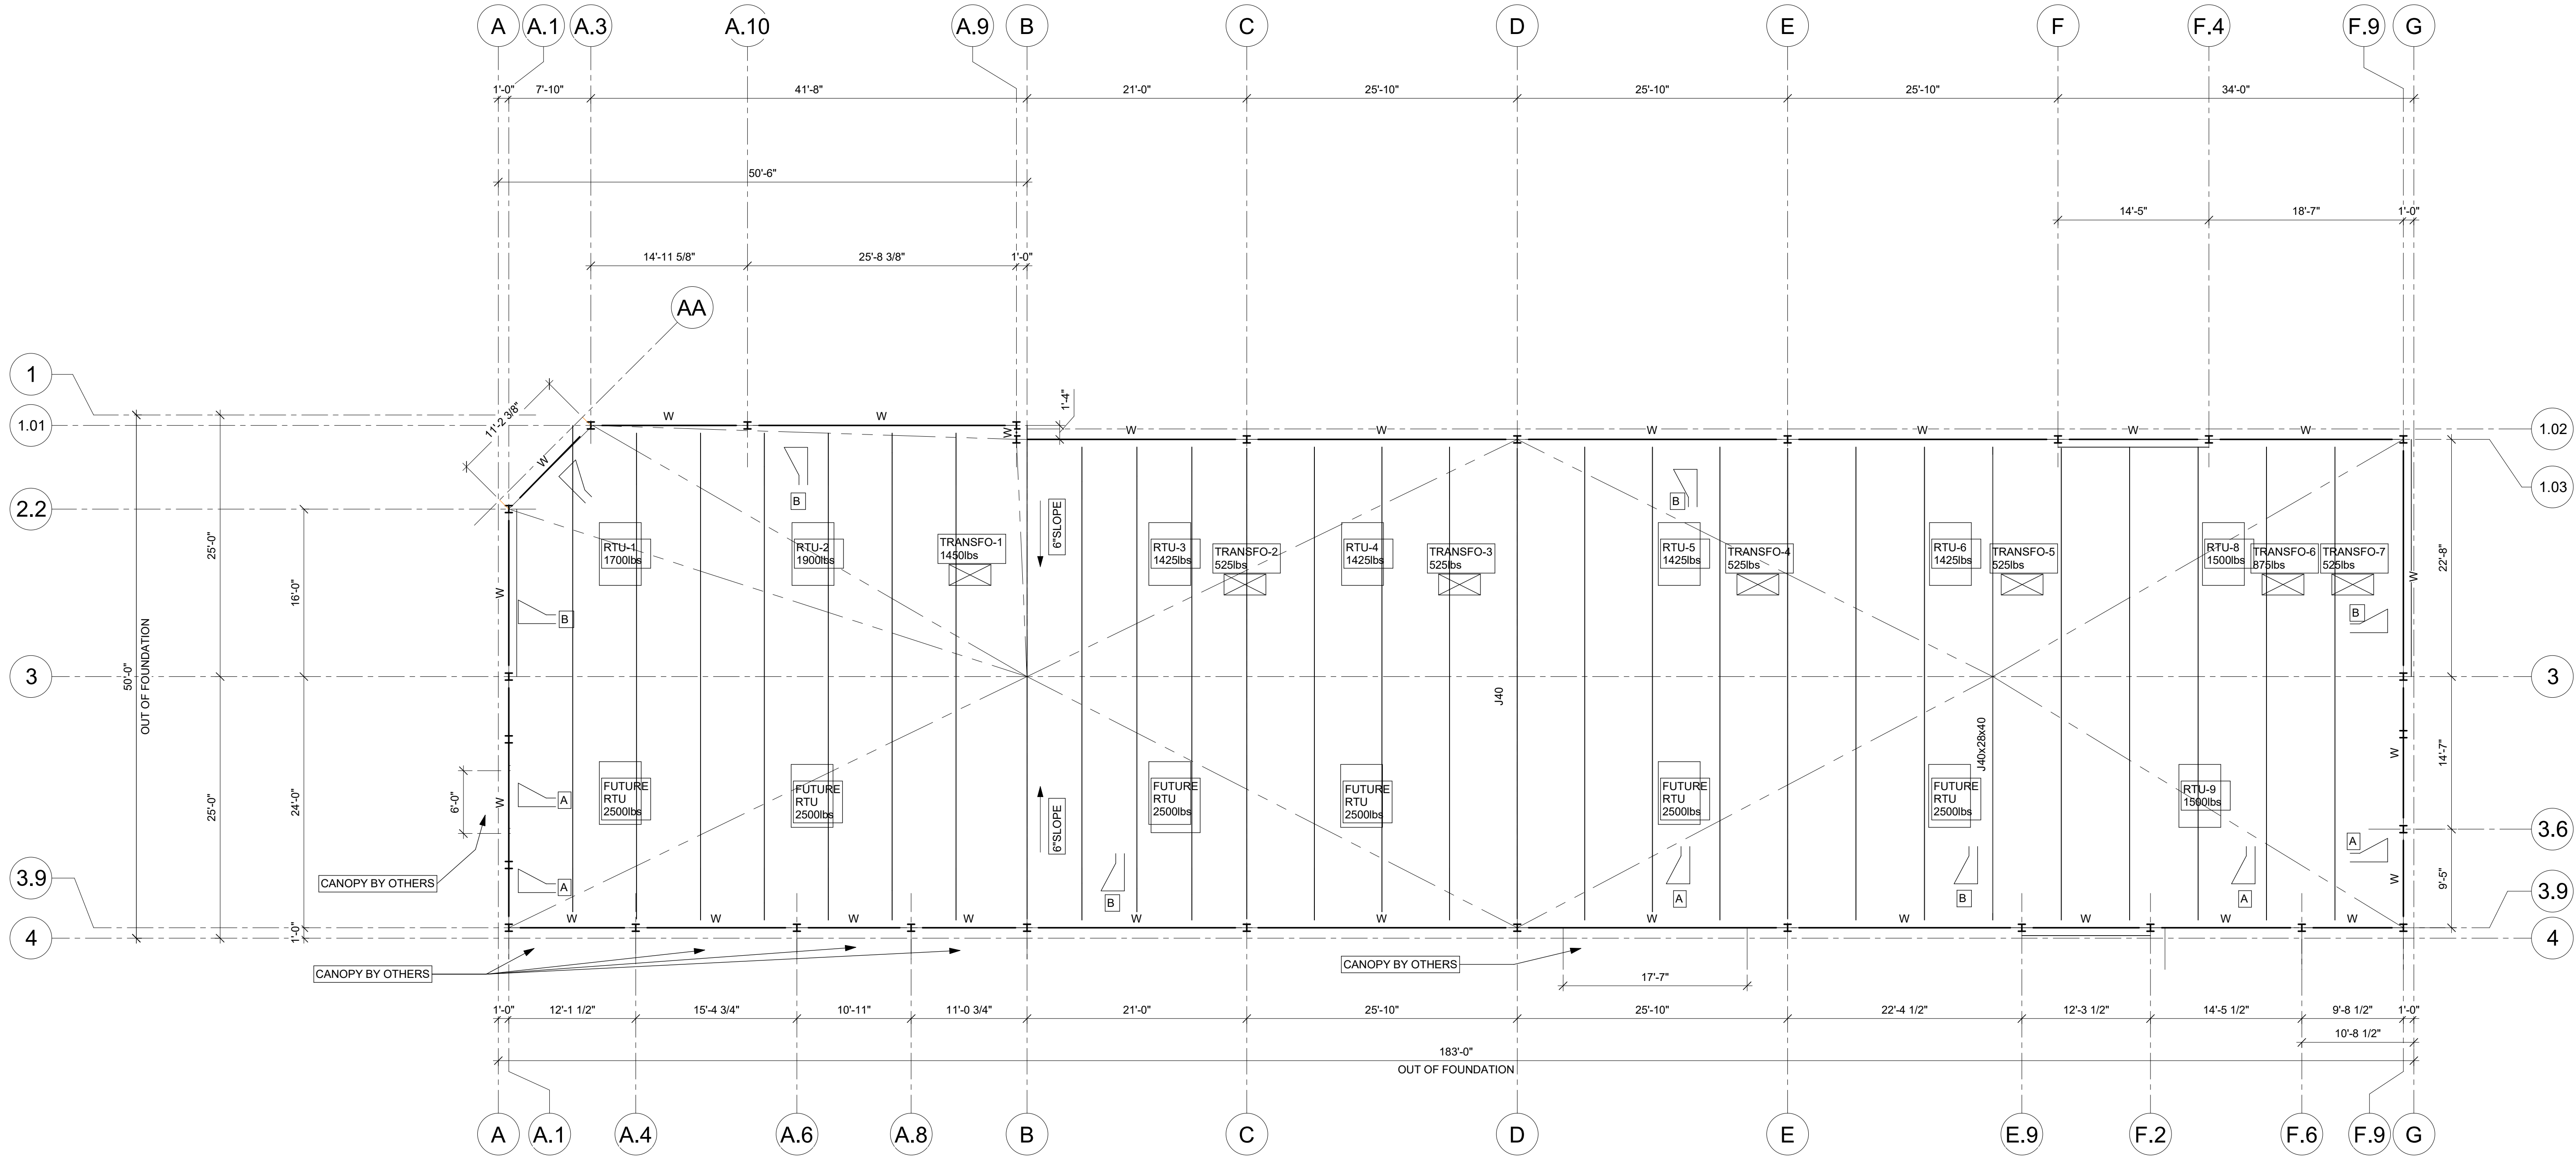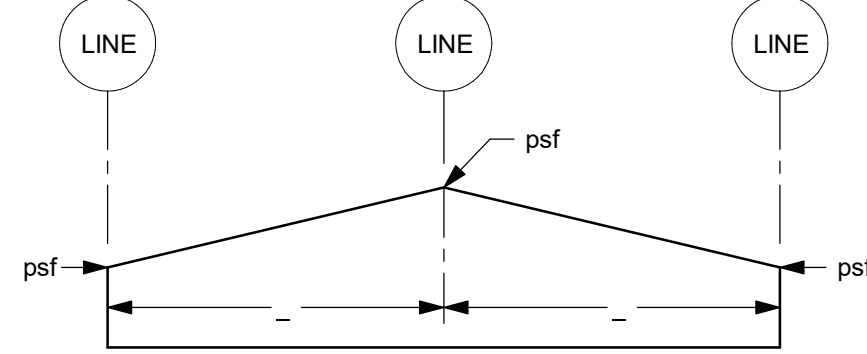

ROOF PLAN
1/8" = 1'-0"

GROSS UPLIFT DIAGRAM (UNFACTORED):

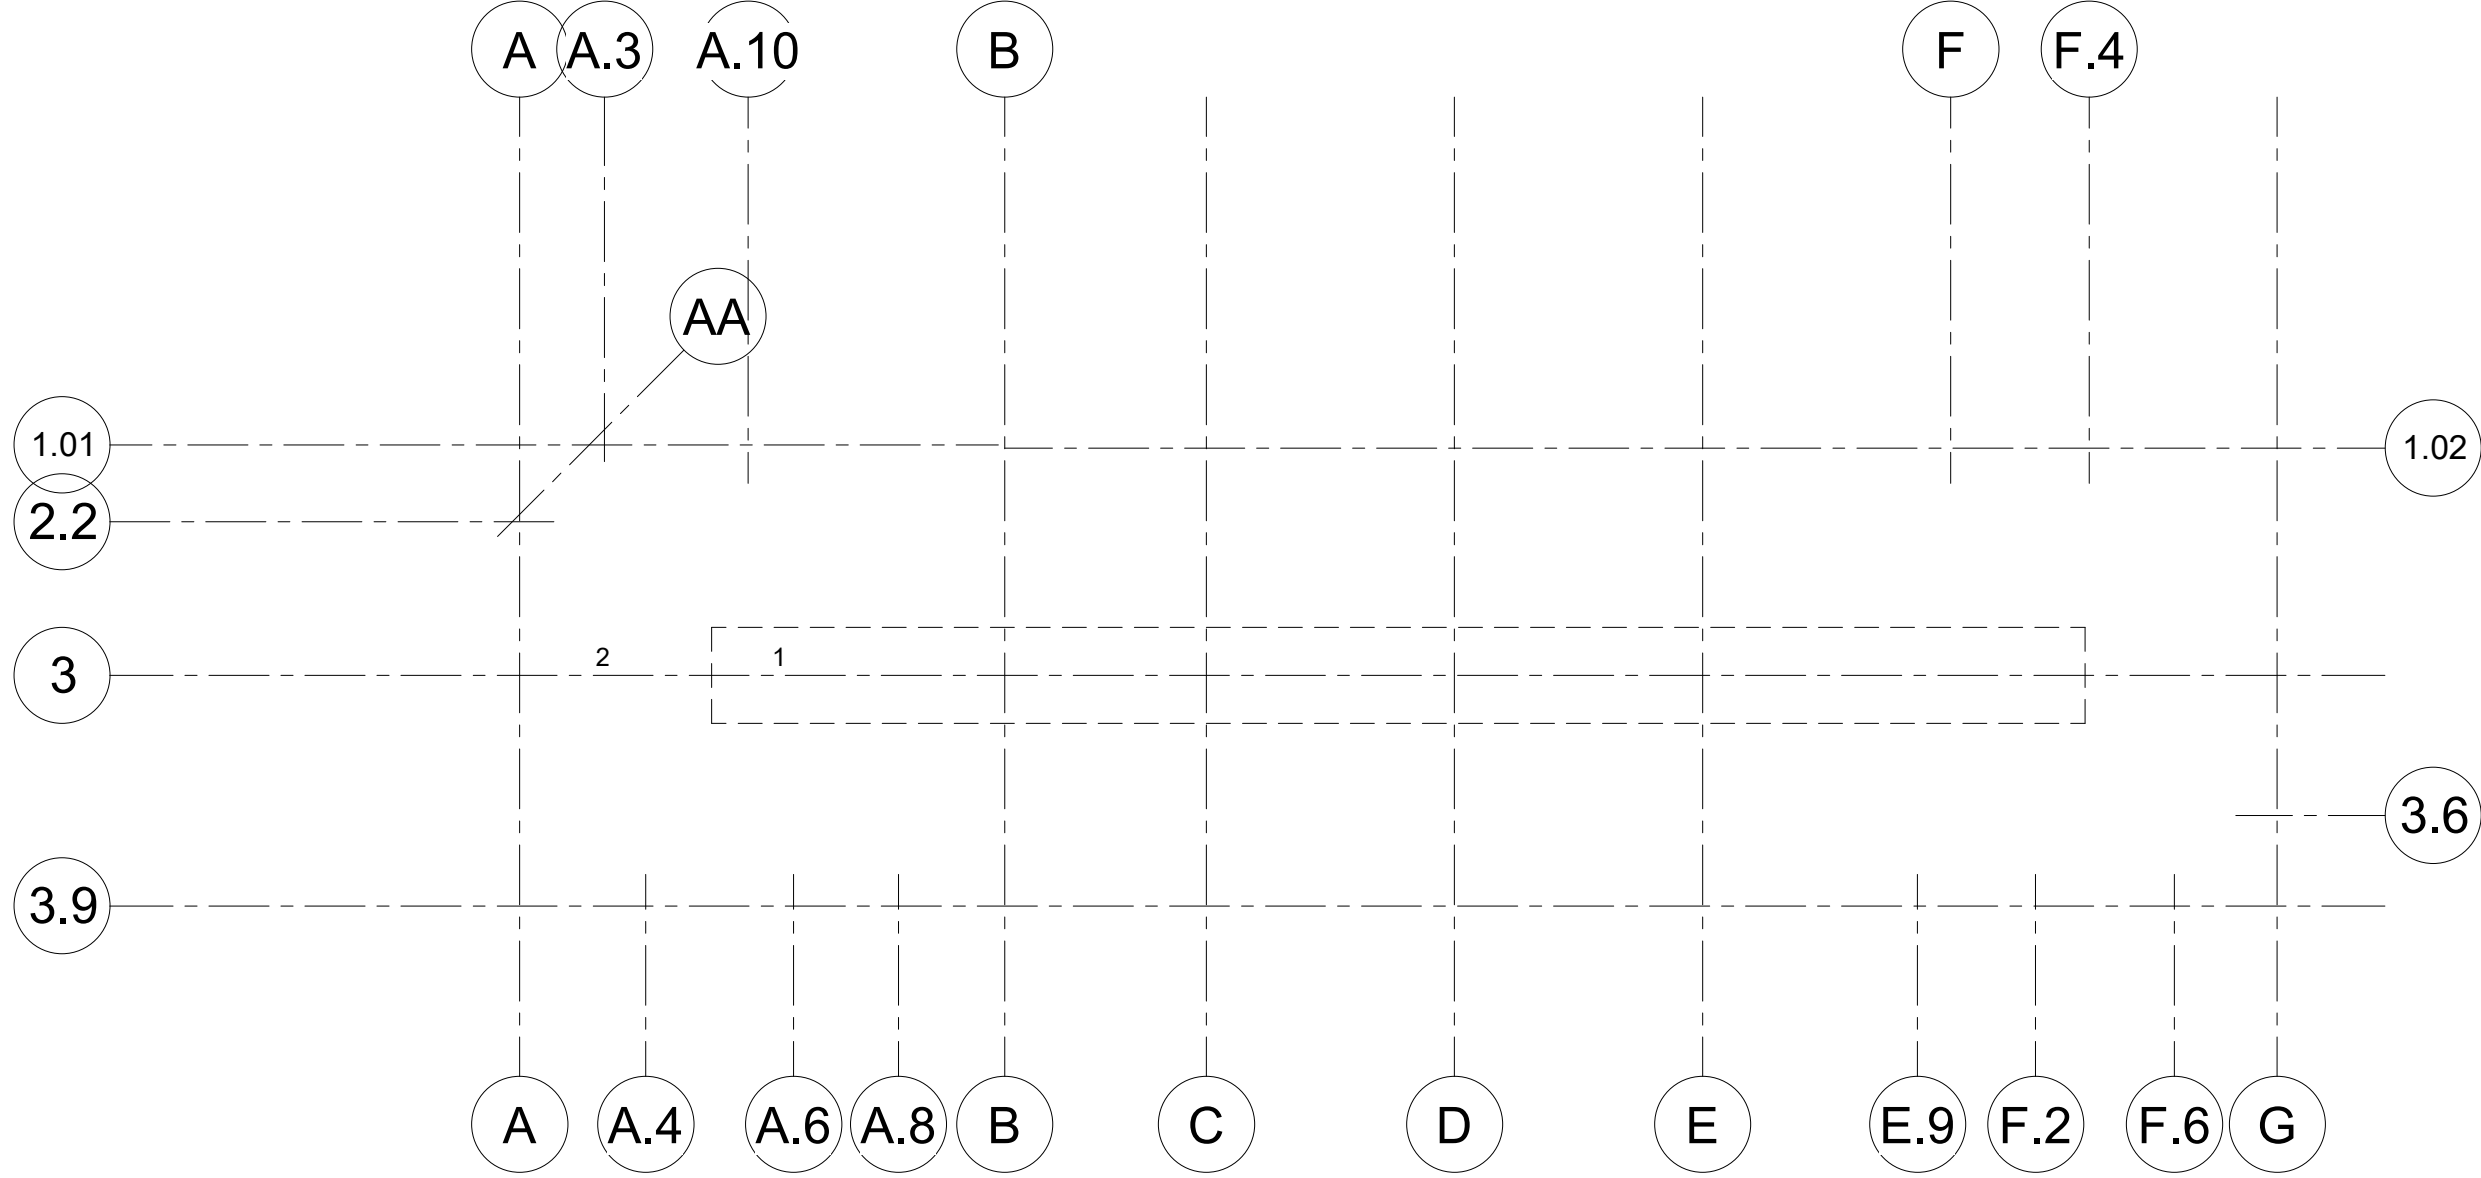

ZONE 1 : -17.77 psf
ZONE 2 : -22psf
a: 6'-0"

POSITIVE WIND PRESSURE
(UNFACTORED): 10.15 psf

CONTRACTOR/RECTOR NOTE:

IT IS PROHIBITED TO MODIFY, COPY, REPRODUCE OR OTHERWISE
DISTRIBUTE THIS DRAWING OR ANY REPRESENTATION OF THIS
DRAWING, OR ANY MEDIA, INCLUDING ELECTRONIC, WITHOUT THE
PRIOR WRITTEN APPROVAL OF CANAM GROUP INC.

ROOF

TOP OF PILASTER	: 99'-0"
TOP OF SLAB	: 100'-0"
TOP OF FOUNDATION	: 100'-0"
CLEAR HEIGHT	: 15'-0"
TOP OF STEEL	: 118'-0"
PARAPET HEIGHT	
LINE 1.01 & 1.03	: 4'-6 1/2"
PARAPET HEIGHT	
LINE A.1	: 5'-11 3/4"
PARAPET HEIGHT	
LINE 3.9&F.9	: 7'-6 1/2"
TOP OF PARAPET	
1.01 & 1.03	: 122'-6 1/2"
TOP OF PARAPET	
LINE A.1	: 123'-11 3/4"
TOP OF PARAPET	
LINE 3.9&F.9	: 125'-6 1/2"

LOADS

D.L.	: 20 psf
Coll.	: 5 psf
Ss	: 39.59 psf
Sr	: 4.18 psf
Cb x Cw	: 0.8
Roof L.L.	: 0 psf
I _s	: 1.0
Roof snow load	: 35.9 psf
I _w	: 1.0
Wind q= 1/50	: 9.4 psf

Seismic (Site class: D (Assumed))

I _e	: 1.0
S _w (0.2)	: 0.0540
S _w (0.5)	: 0.0320
S _w (1.0)	: 0.0160
S _w (2.0)	: 0.0066
S _w (5.0)	: 0.0013
S _w (10.0)	: 0.0007
PGA	: 0.0320
PGV	: 0.0210

LOADINGS:

- Roof dead load excluding collateral load : psf
- Collateral load : psf (includes lighting and/or mechanical and sprinklers of 4 inches in diameter and less)
- Roof snow load : psf
- Wind load q 1/50 : psf
- Roof live load : S_s = psf
- Ground snow load : S_s = psf
- Risk Category : normal
- Snow load factors : C_b = 0.8
- Snow load factors : C_w = 1.0

• Code Applicable : National building Code of Canada
Manitoba Building Code 2024
Code of Standard Practice CISC.

• Assumed soil site class: E

• NOTE :
1. If, however, the seismic site class is determined to be E or F according to the geotechnical report, the preliminary structural concept (location and geometry of bracings, etc.) must be validated and coordinated by a Canam's engineer.

PRELIMINARY

NOT TO BE USED FOR CONSTRUCTION

REVISION DATE DESCRIPTION USER VER

PROJECT MANAGER
-
-
-

DRAFTING
-

DESIGNED	PROJECT ENGINEER	SCALE
S.L.		Comme indiqué
CHECKED	CONSULTING ENGINEERS ARCHITECTS	DATE (yyyy/mm/aa)
		2028/01/09

CUSTOMER: GS HOMES LTD

CANAM
11505, 1re Avenue, bureau 500, Saint-Georges Beauce
Quebec, Canada, G3Y 7G3
Phone : (418) 228-8031
Toll free : (877) 499-6049
www.canam.com

PROFESSIONAL SEAL

PROJECT

287 MAIN (CLEAR SPAN)
WINNIPEG, MANITOBA

DRAWING TITLE

PRELIMINARY SKETCH - ROOF PLAN

CONTRACT NUMBER DIVISION REVISION

P2025-206 EsMx401

Initials