

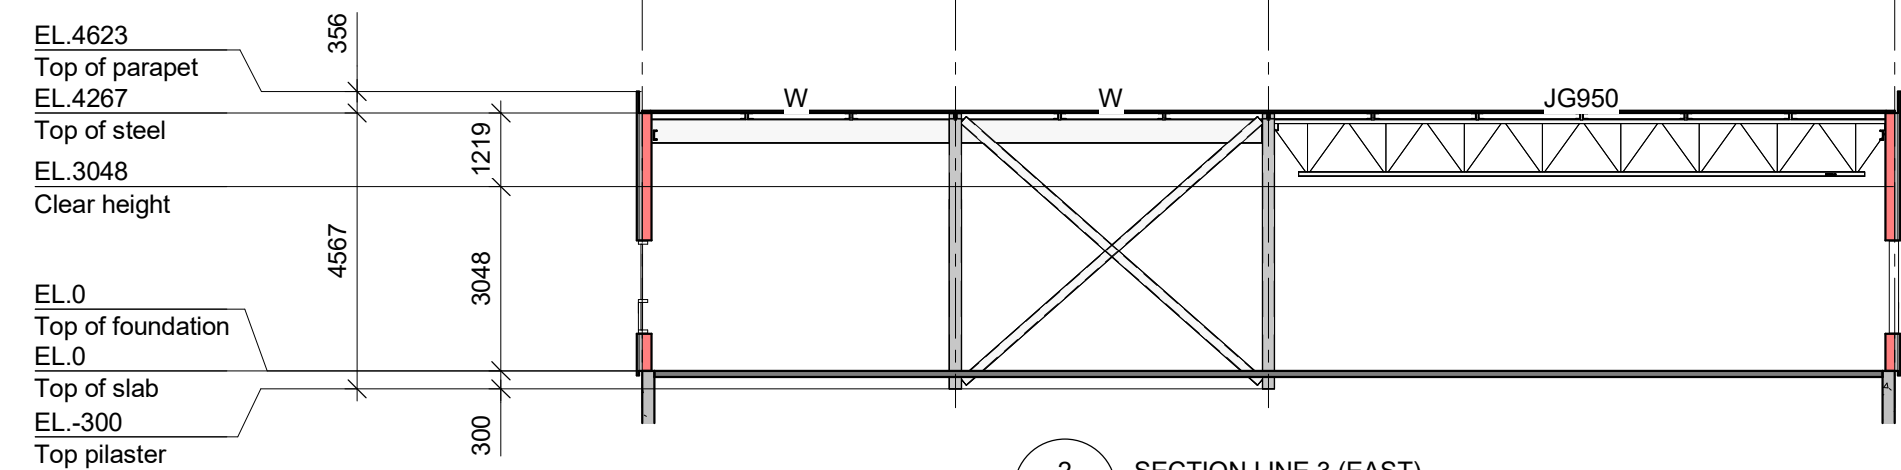


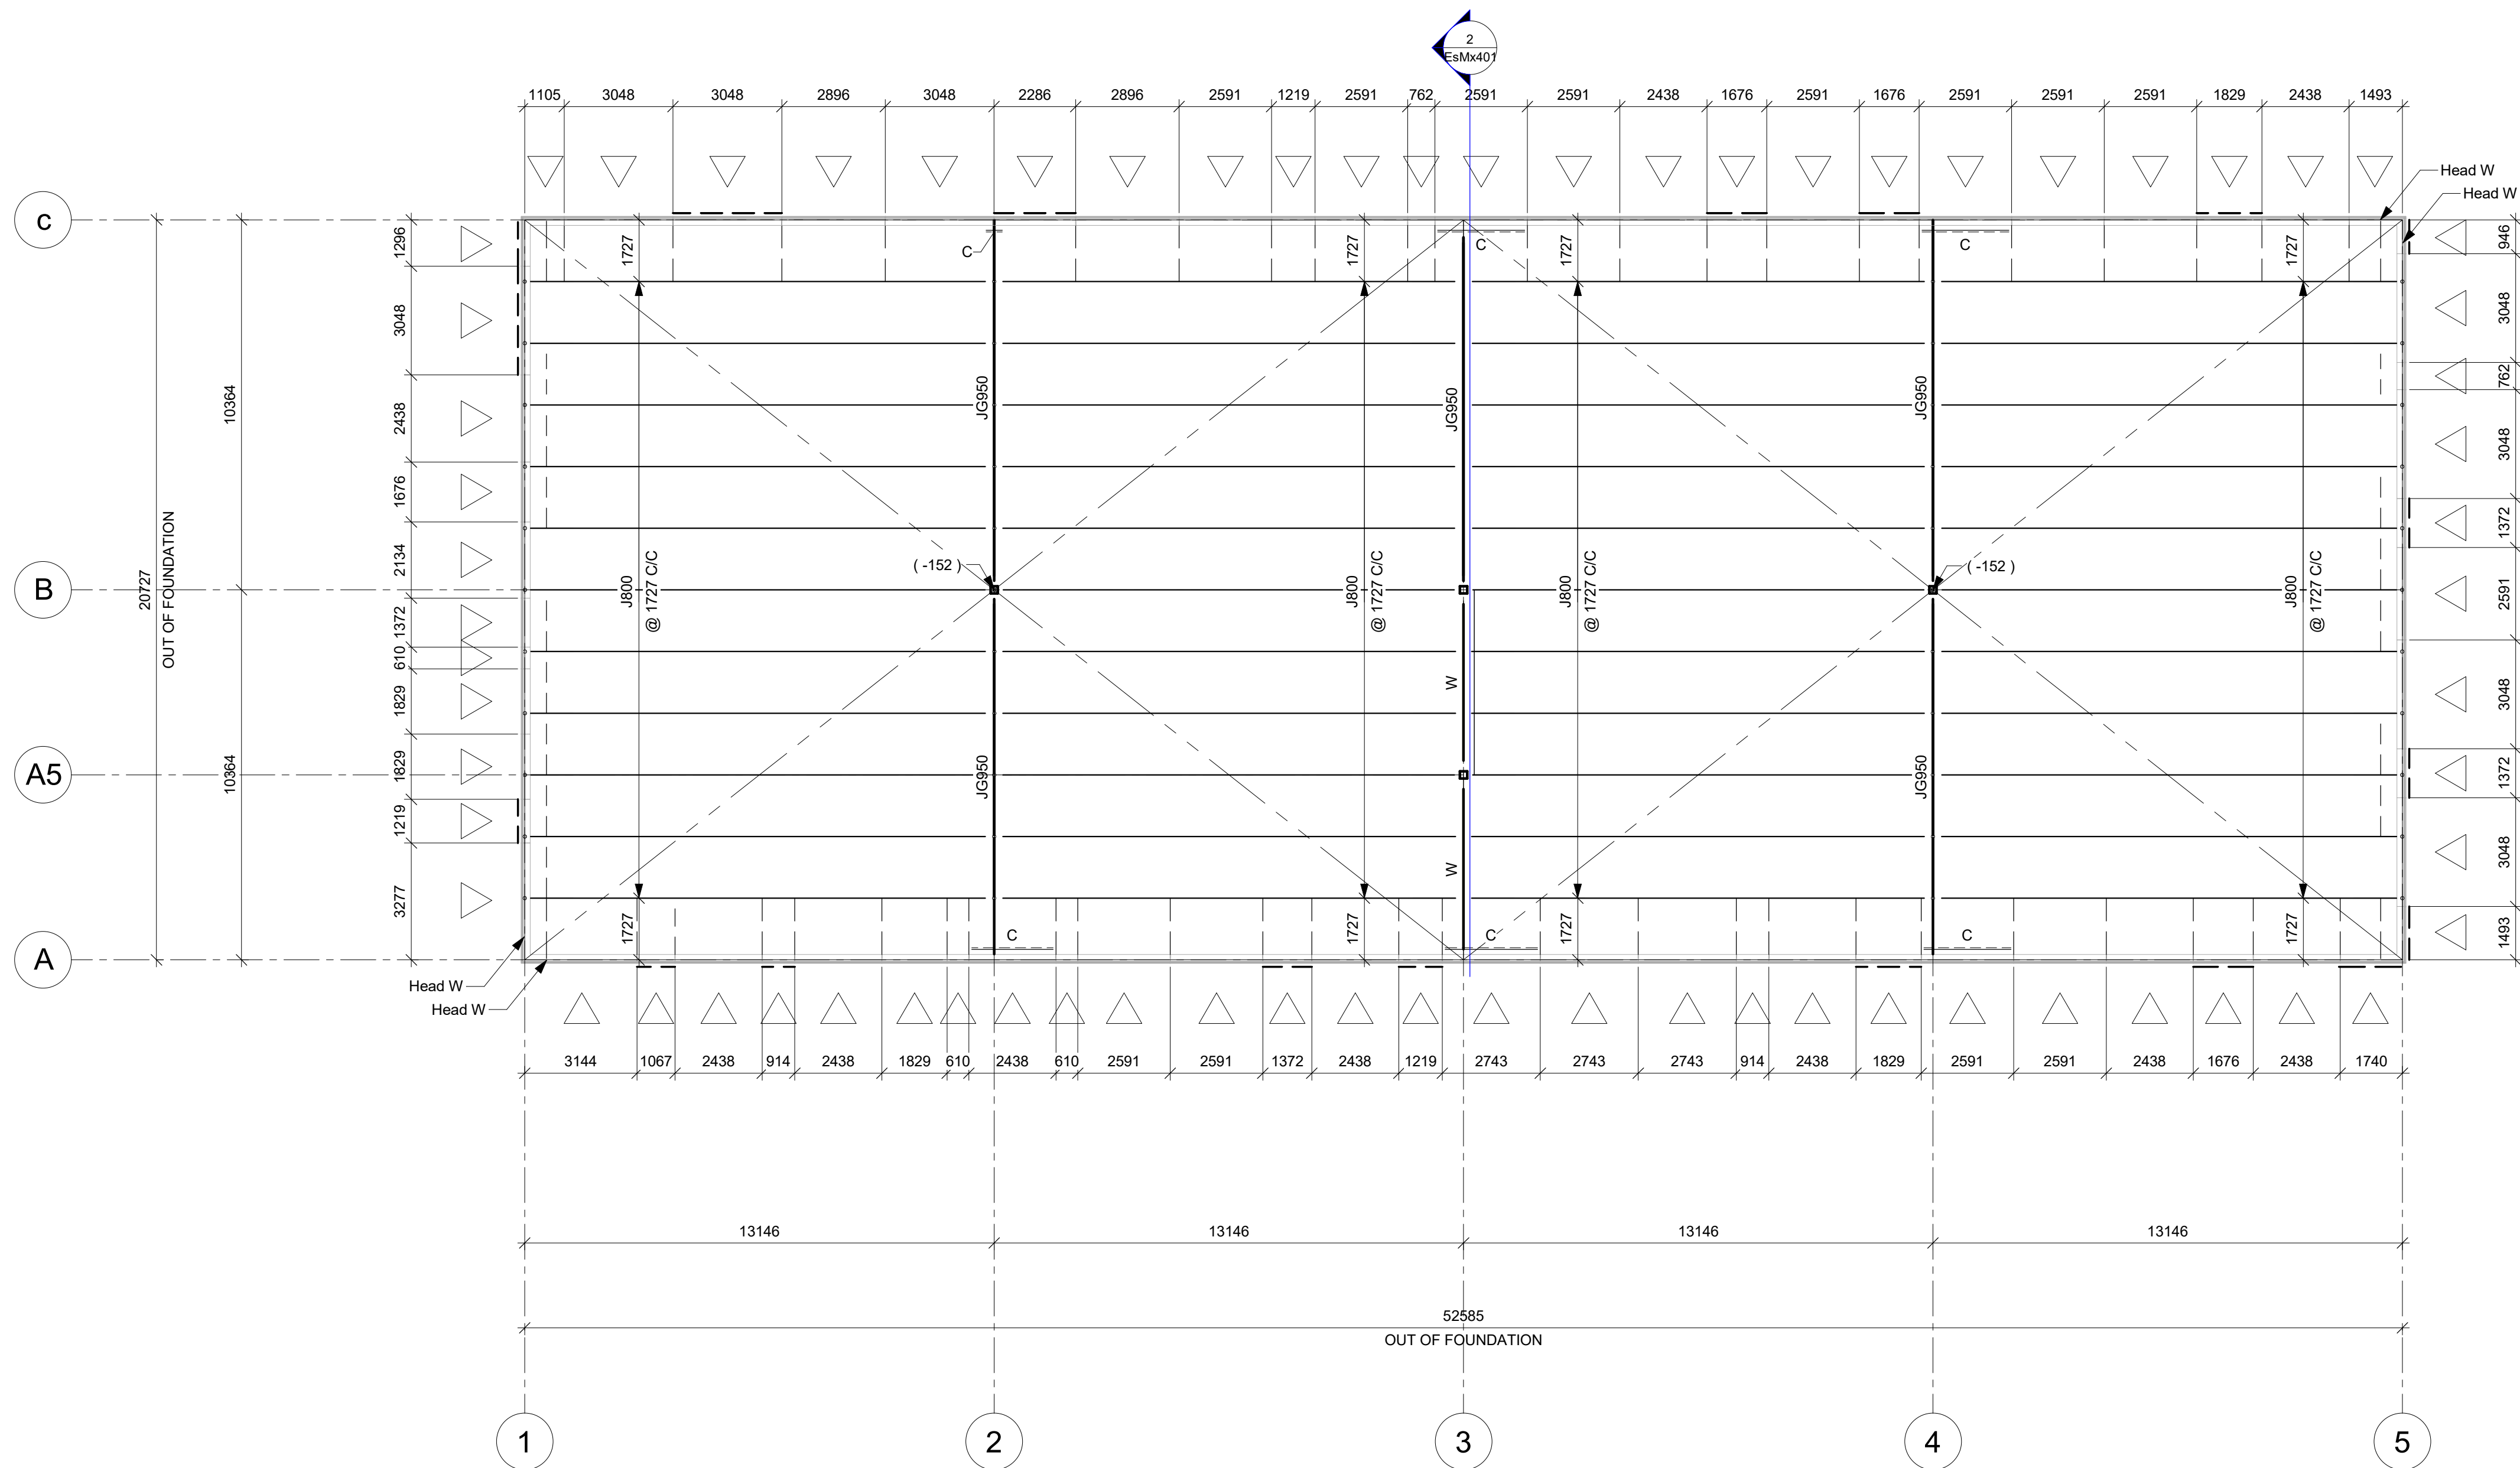

2 SECTION LINE 3 (EAST)
EsMx401 1:125

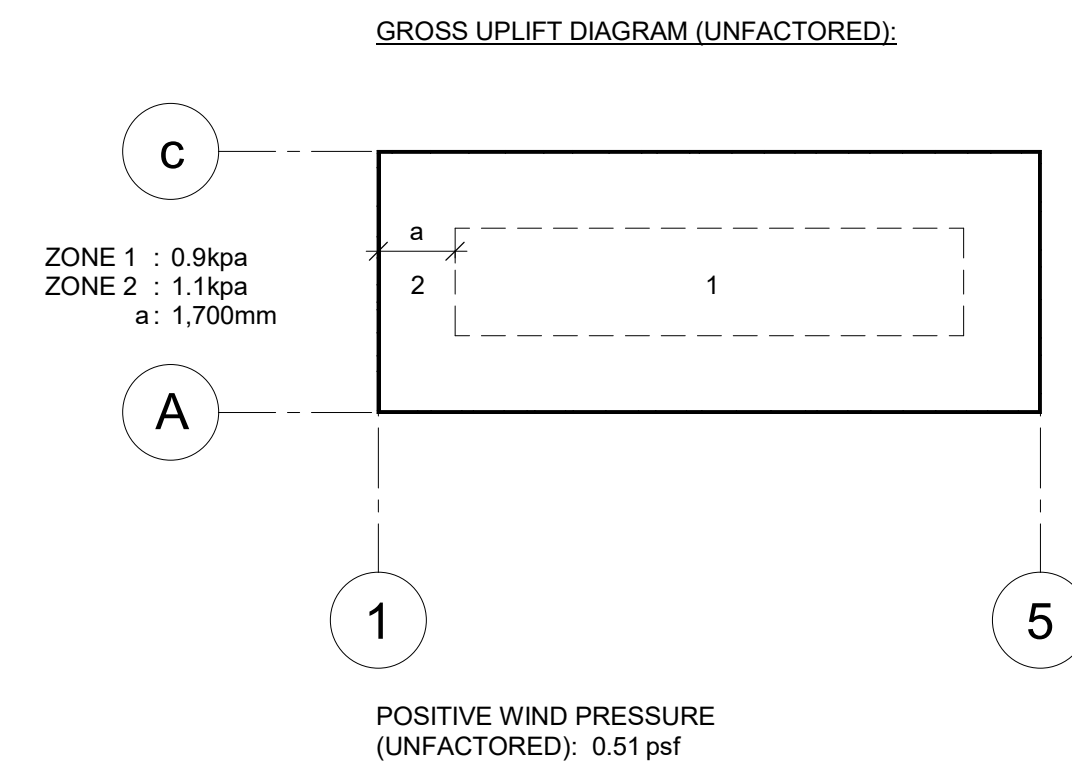

ROOF PLAN
1:125

CONTRACTOR/ERECTOR NOTE:

IT IS PROHIBITED TO MODIFY, COPY, REPRODUCE OR OTHERWISE DISTRIBUTE THIS DRAWING OR ANY REPRESENTATION OF THIS DRAWING, OR ANY MEDIA, INCLUDING ELECTRONIC, WITHOUT THE PRIOR WRITTEN APPROVAL OF CANAM GROUP INC.

ROOF

TOP OF PILASTER RWL : -600mm
TOP OF PILASTER : -300mm
TOP OF SLAB : 0mm
TOP OF FOUNDATION : 0mm
CLEAR HEIGHT : 3.048mm
TOP OF STEEL : 4.267mm
PARAPET HEIGHT : 356mm
LOAD OF PARAPET : 4.623mm

LOADS

D.L. : 0.9 kPa
Coll. : 0.2 kPa
Ss : 2.1 kPa
Sr : 0.4 kPa
Cb x Cw : 0.8
Roof L.L. : 0.0 kPa
Is : 1.0
Roof snow load : 2.1 kPa
lw : 1.0
Wind q= 1/50 : 0.47 kPa

Seismic (Site class: D (Assumed))

I_e : 1.0
S_s (0.2) : 0.370
S_s (0.5) : 0.368
S_s (1.0) : 0.225
S_s (2.0) : 0.110
S_s (5.0) : 0.031
S_s (10.0) : 0.010
PGA : 0.205
PGV : 0.243

LOADINGS:

• Code Applicable : National building Code of Canada
Ontario Building Code, latest adopted editions
Code of Standard Practice CISC.

• Assumed soil site class: D

NOTE :

1. If, however, the seismic site class is determined to be E or F according to the geotechnical report, the preliminary structural concept (location and geometry of bracings, etc.) must be validated and coordinated by a Canam's engineer.

PRELIMINARY

NOT TO BE USED FOR CONSTRUCTION

REVISION	DATE	DESCRIPTION	DESS	VER.
PROJECT MANAGER				
		-		
		-		
		-		
		-		

DRAFTING:			
DRAWN	DESIGNED	PROJECT ENGINEER	SCALE:
J.P.			Comme indiqué
CHECKED	CONSULTING ENGINEERS / ARCHITECTS		DATE (yyyy/mm/iss) :
			2026/07/28

CUSTOMER: Strong Bros.



PROFESSIONAL SEAL

PROJECT

DCC Site Office
Kingston, Ontario

DRAWING TITLE

PRELIMINARY SKETCH - ROOF PLAN

CONTRACT NUMBER	DRAWING NUMBER	DIVISION	REVISION
P2026-142	EsMx401		

Initials

