





SNOW LOAD ACCUMULATION

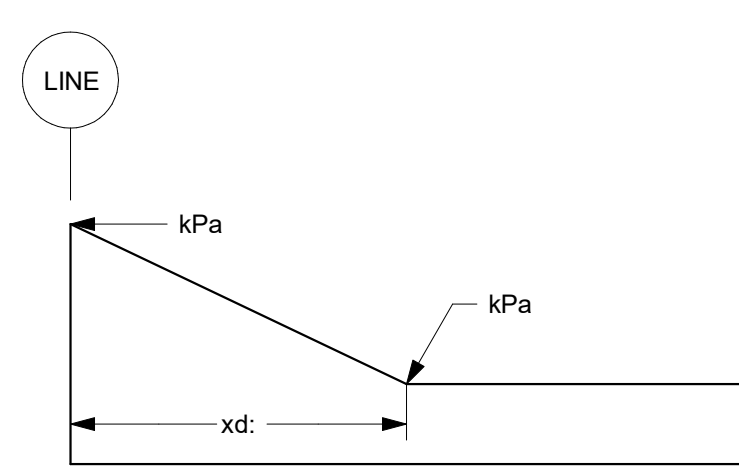

RAIN LOAD + ADDITIONAL LIVE LOAD

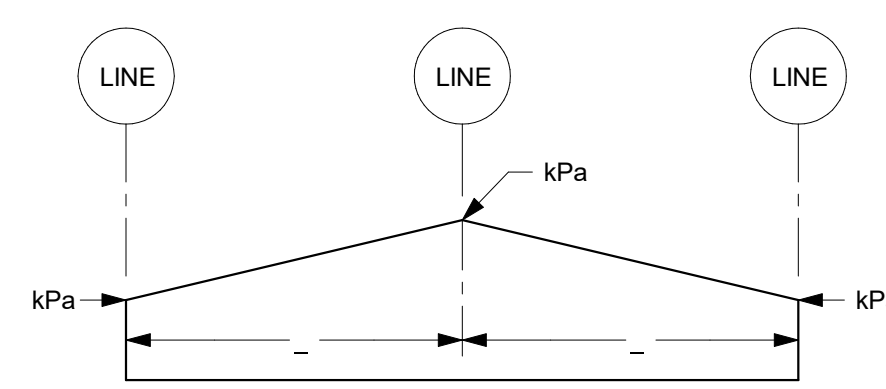

ZONE 1 : -0.86 kPa
ZONE 2 : -1.07 kPa
s : 4700

1 1.82 2 3 3.8 4 4.2 4.85 5 5.2 6 6.1 6.9 7 7.1 7.2 8 8.89 9.2 10 10.8 11 11.2 11.8 12 12.2 13

GROSS UP LIFT DIAGRAM (UNFACTORED)

G
H
J
K
L
M

POSITIVE WIND PRESSURE
(UNFACTORED) : +0.46 psf

1 1.8 2 2.2 3 3.8 4 4.2 4.8 5 5.2 6 6.1 6.9 7 7.1 7.2 8 8.89 9.2 10 10.8 11 11.2 11.8 12 12.2 13

G
H
J
K
L
M

OUT OF FOUNDATION

EXPANSION JOINT

ANNEX #2

J_400-300-400

ANNEX #1

ROOF PLAN

1 - 225

CONTRACTOR/RECTOR NOTE:

IT IS PROHIBITED TO MODIFY, COPY, REPRODUCE OR OTHERWISE
DISTRIBUTE THIS DRAWING OR ANY REPRESENTATION OF THIS
DRAWING, OR ANY MEDIA, INCLUDING ELECTRONIC, WITHOUT THE
PRIOR WRITTEN APPROVAL OF CANAM GROUP INC.

ROOF

TOP OF PLASTER RWL : -600
TOP OF PLASTER : -500
TOP OF SLAB : 0
TOP OF FOUNDATION : 8534
TOP OF STEEL : 10484
PARAPET HEIGHT : 610
TOP OF PARAPET : 11094

ANNEX #1

TOP OF PLASTER RWL : -1820
TOP OF PLASTER : -1520
TOP OF SLAB : -1220
TOP OF FOUNDATION : -1220
CLEAR HEIGHT : 9754
TOP OF STEEL : 10484
PARAPET HEIGHT : 610
TOP OF PARAPET : 11094

ANNEX #2

TOP OF PLASTER RWL : -1820
TOP OF PLASTER : -1520
TOP OF SLAB : -1220
TOP OF FOUNDATION : -1220
CLEAR HEIGHT : 6900
TOP OF STEEL : 6900
PARAPET HEIGHT : 610
TOP OF PARAPET : 6900

LOADS

D.L. : 0.72 kPa
C.C. : 0.24 kPa
S.s. : 2.4 kPa
S.r. : 0.4 kPa
C.b x C.w : 0.86
Roof L.L. : 0.4 kPa
I.e. : 1.0
Roof snow load : 2.46 kPa
I.e. : 1.0
Wind q : 1/50 : 0.41 kPa
Seismic (Site class: D (Assumed))

I.e. : 1.0
S_u(0.2) : 0.739
S_u(0.5) : 0.500
S_u(1.0) : 0.326
S_u(2.0) : 0.154
S_u(5.0) : 0.043
S_u(10.0) : 0.013
PGA : 0.444
PGV : 0.389

• Code Applicable : National building Code of Canada
Quebec Building Code, latest adopted editions
Codes of Standard Practice CISC.

• Assumed soil site class: D

• NOTE :
1. If, however, the seismic site class is determined to be E or F according to the
geotechnical report, the preliminary structural concept (location and geometry
of bracings, etc.) must be validated and coordinated by a Canam's engineer.

Position de la colonne HSS et W :

- On va conserver 1'-4" pour la majorité des cas.
- Pour la coupe de 60" ou R-25 et 2 heures au feu, on va
mettre 1'-6".

- L'espacement va avoir des colonnes de panneau C10 et
C12, on va déterminer la localisation de la colonne
selon le design. L'idée est de rester avec 1'-4" et 1'-6",
mais dans certains cas, on va devoir utiliser 1'-8".

HSS and W column position:

- We will keep 1'-4" for the majority of cases.
- For the R-25 and 2-hour fire wall, we will put 1'-6".
- When we have C10 and C12 panel columns, we will
determine the location of the column according to the
design. The idea is to stay with 1'-4" and 1'-6", but in
some cases, we will have to use 1'-8".

PRELIMINARY

NOT TO BE USED FOR CONSTRUCTION

REVISION DATE DESCRIPTION DESI VER

PROJECT MANAGER
-
-
-

DRAFTING

DRAWN DESIGNED PROJECT ENGINEER SCALE

Donald Piché Comme indiqué

CHECKED CONSULTING ENGINEERS ARCHITECTS DATE (yyyy/mm/dd)

2026-02-09

CUSTOMER: Megha Holdings Inc.



11505, 1re Avenue, bureau 500, Saint-Georges Beauce
Québec, Canada, G5V 7G3
Phone : (418) 228-8031
Toll free : (877) 499-6049
www.canam.com

PROFESSIONAL SEAL

PROJECT

Vars Development BLDG 2
Vars, On

DRAWING TITLE

PRELIMINARY SKETCH - ROOF PLAN

CONTRACT NUMBER DRAWING NUMBER DIVISION REVISION

P2026-021 EsMx401

Initials