




GROSS UPLIFT DIAGRAM (UNFACTORED):

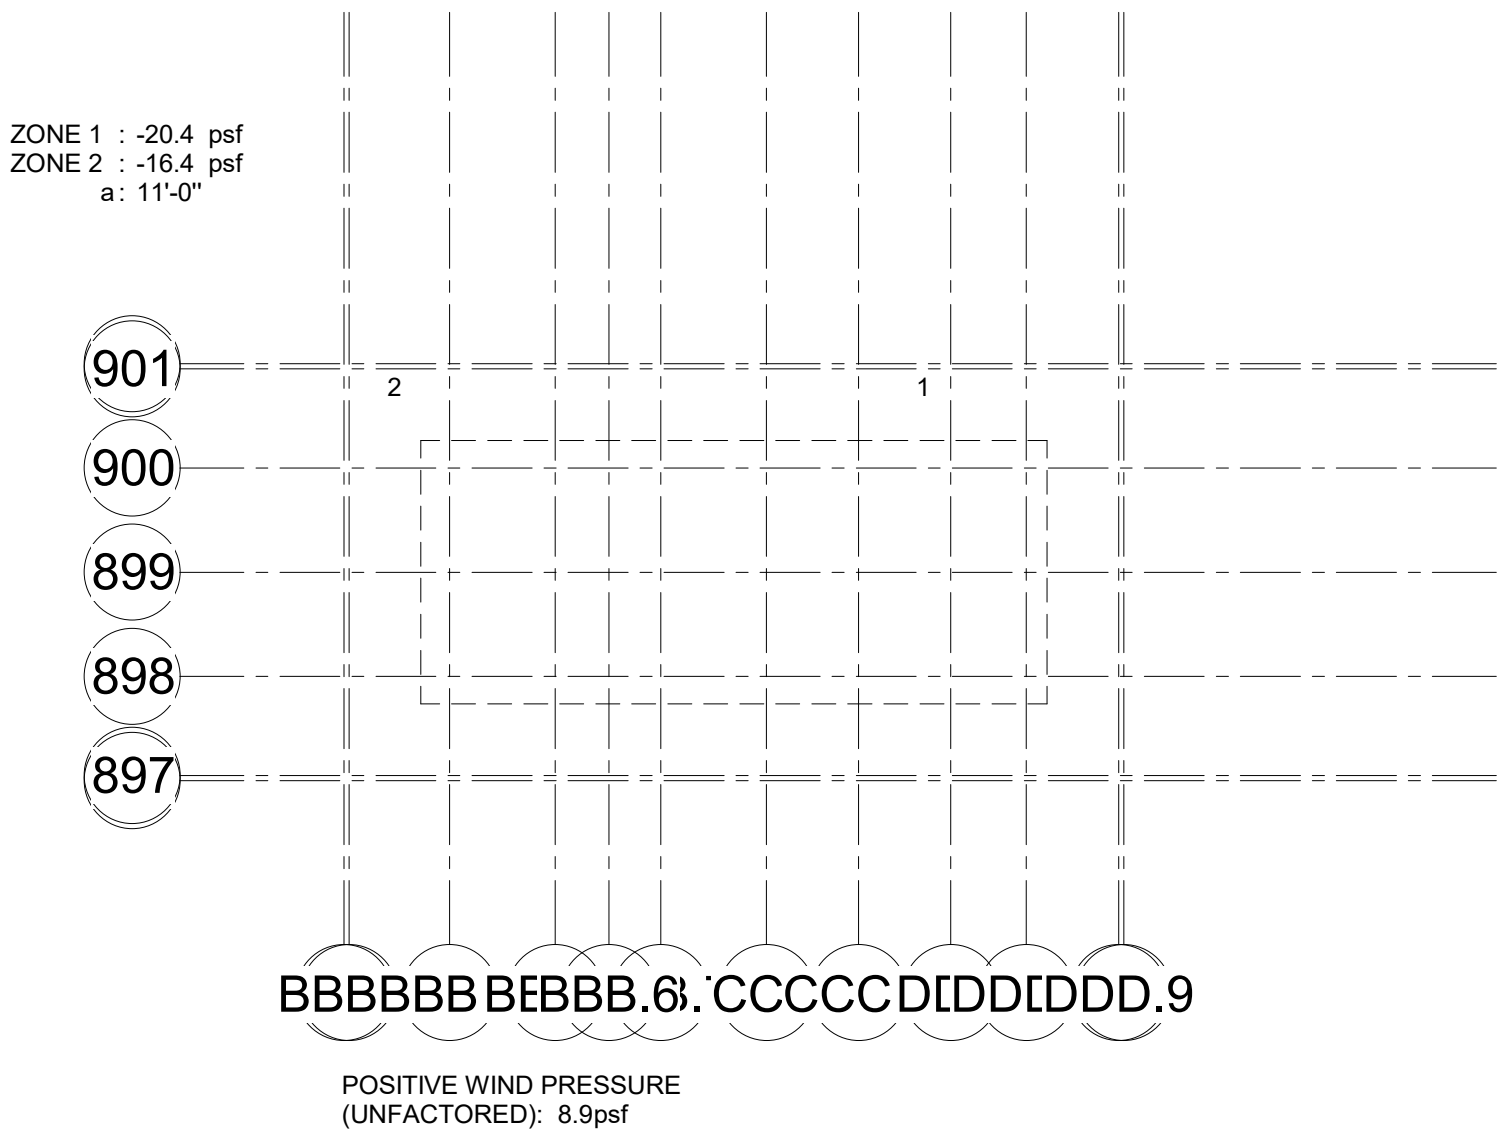

CONTRACTOR/RECTOR NOTE:

IT IS PROHIBITED TO MODIFY, COPY, REPRODUCE OR OTHERWISE DISTRIBUTE THIS DRAWING OR ANY REPRESENTATION OF THIS DRAWING, OR ANY MEDIA, INCLUDING ELECTRONIC, WITHOUT THE PRIOR WRITTEN APPROVAL OF CANAM GROUP INC.

ROOF

TOP OF PLASTER RWL : 98'-0"
TOP OF PLASTER : 99'-0"
TOP OF SLAB : 100'-6"
TOP OF FOUNDATION : 100'-6"
CLEAR HEIGHT : 47'-7 1/4"
TOP OF STEEL GRIDLINE BBB: 104'-3 1/4"
TOP OF STEEL GRIDLINE EEE: 162'-6 1/8"

LOADS

D.L : 21 psf
C.G.L : 183.0 psf
Ss : 46.86 psf
Sv : 4.18 psf
Cb x Cw : 0.67
Roof L.L : 0 psf
Roof L.L : 1.0
Roof snow load: 44.3 psf
Lv : 1.0
Wind q= 150 : 7.31 psf

Seismic (Site class: C (Assumed))

I_e : 1.0
S_s (0.2) : 0.0815
S_s (0.5) : 0.0511
S_h (1.0) : 0.0252
S_h (2.0) : 0.0194
S_h (5.0) : 0.00218
S_h (10.0) : 0.00026
PGA : 0.0391
PGV : 0.0275

• Code Applicable : National building Code of Canada
Quebec Building Code, latest adopted editions
Code of Standard Practice CISC.

• Assumed soil site class: C

• NOTE :
1. If, however, the seismic site class is determined to be E or F according to the geotechnical report, the preliminary structural concept (location and geometry of bracing, etc.) must be validated and coordinated by a Canam's engineer.

Position de la colonne HSS et W

- On va conserver 1'-4" pour la majorité des cas.
- Pour la coupe de mur R-29 et 2 heures au feu, on va mettre 1'-6".
- Lorsqu'on va avoir des colonnes de panneau C10 et C12, on va déterminer la localisation de la colonne selon le design. L'idée est de rester avec 1'-4" et 1'-6", mais dans certain cas, on va devoir utiliser 1'-8".

HSS and W column position

- We will keep 1'-4" for the majority of cases.
- For the R-29 and 2-hour fire wall, we will put 1'-6".
- When we have C10 and C12 panel columns, we will determine the location of the column according to the design. The idea is to stay with 1'-4" and 1'-6", but in some cases, we will have to use 1'-8".

PRELIMINARY

NOT TO BE USED FOR CONSTRUCTION

REVISION	DATE	DESCRIPTION	DES	VER
----------	------	-------------	-----	-----


PROJECT MANAGER	-
	-
	-
	-

DRAFTING

DRAWN	DESIGNED	PROJECT ENGINEER	SCALE
Donald Piché			Comme indiqué

CHECKED	CONSULTING ENGINEERS' ARCHITECTS	DATE (yyyy/mm/dd)
		2025-02-10

CUSTOMER: Fws Industrial Project Ltd



CANAM

11505, 1re Avenue, bureau 500, Saint-Georges Beaulac
Québec, Canada, G5V 7G5
Phone : (418) 228-8031
Toll free : (877) 499-6049
www.canam.com

PROFESSIONAL SEAL

PROJECT

Strong Pine- Hanson Lake Phase 3
Hanson Lake, SK

DRAWING TITLE

PRELIMINARY SKETCH - ROOF PLAN

CONTRACT NUMBER	DRAWING NUMBER	DIVISION	REVISION
-----------------	----------------	----------	----------

P2029-034

EsMx401



CRANE BEAM LOAD	
CAPACITY	1/2 TON. IMP. EACH
CRANE WEIGHT	-
HOIST	300 lbs
MAXIMUM WHEEL LOAD	1.8 kips
WHEELS SPACING	N/A

CRANE - SPECIFICATION

1" = 1'-0"

ROOF PLAN

3/32" = 1'-0"