





ROOF DECK DIAPHRAGM

1) GENERAL NOTES FOR DECK

- A) THE DECK IS REQUIRED TO ACT AS A LATERAL FORCE DISTRIBUTING DIAPHRAGM.
- B) ☐ WELDED DECK
- THE DECK MUST BE WELDED TO THE STRUCTURAL FRAMING SYSTEM WITH E60XX ELECTRODES.
 - ALL SPOT WELDS 3/4"Ø TO BE DONE BY CANADIAN WELDING BUREAU QUALIFIED WELDER.
 - APPLY A SUITABLE PRIMER, ON EACH BURNED TOPSIDE AREAS.
- ☐ SCREWED DECK
- THE STEEL DECK SHALL BE SCREWED TO STRUCTURAL SUPPORT WITH SCREWS TYPE TEK 5 #12-24x1 1/2".
- ☐ NAILED
- THE STEEL DECK SHALL BE NAILED TO STRUCTURAL SUPPORT WITH NAILS TYPE HILTI - X-HSN 24 : 1/8" (3 mm) $\leq$ 3/8" (10 mm)
 - X-ENP19 L15 : 1/2 x 1/4" (6 mm)
- THE ERECTOR IS RESPONSIBLE FOR THE FASTENING OF THE DECK TO THE STEEL STRUCTURE AND THE SELECTION OF THE FASTENER, THE TOOL, THE CARTRIDGE AS WELL AS THE POWER REGULATION OF THE TOOL IN ACCORDANCE WITH THE PRODUCT SPECIFICATIONS.
- C) THE MINIMUM EDGE DISTANCE MEASURED FROM CENTERLINE OF THE FASTENER TO THE END OR BOUNDARY OF THE DECK SHALL NOT BE LESS THAN 1".
- D) ERECTION SHALL BE IN ACCORDANCE WITH CSSBI 10M-2013 PUBLICATIONS, AND ALL OTHER APPLICABLE STANDARDS.

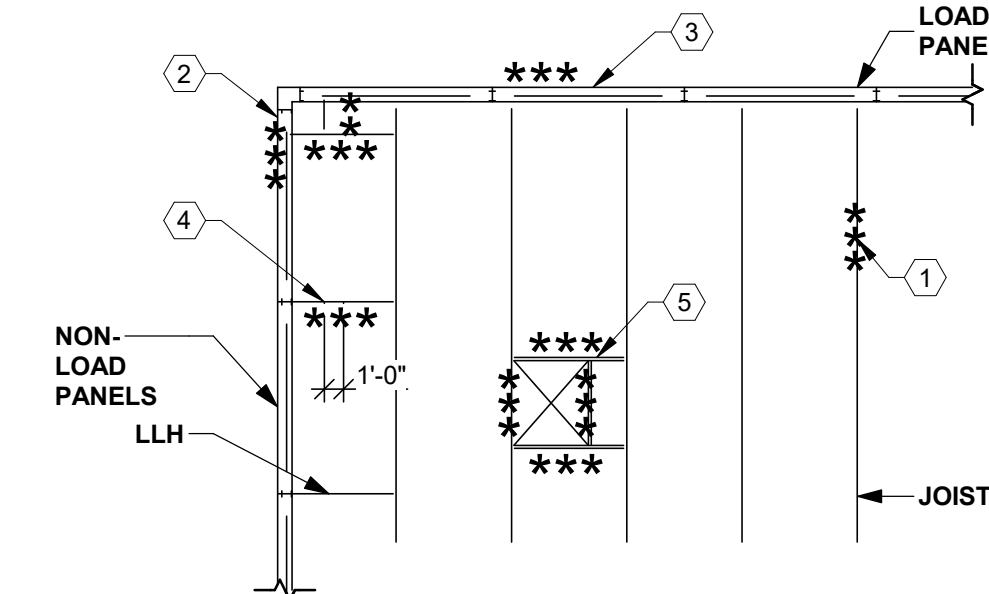

2) FASTENER PATTERN AT SUPPORT

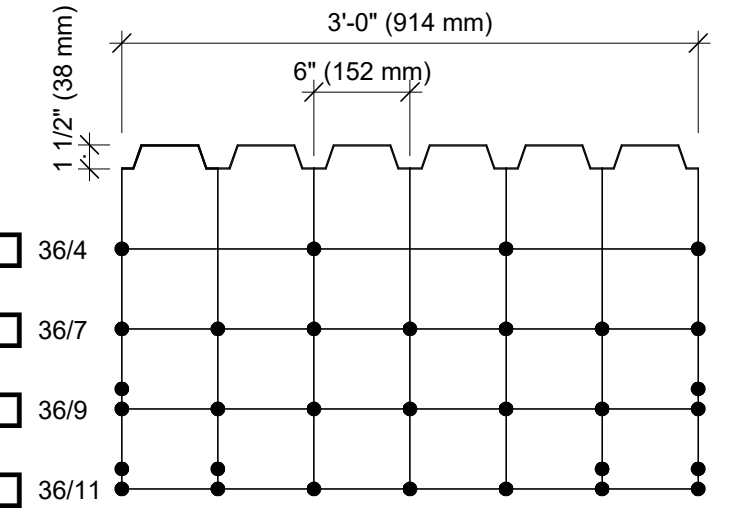

3) SIDE LAP FASTENING

SIDE LAP SHALL BE SCREW:

- ☐ SCREW TEK 2 #10 - 16 x 1 1/2"
- @ 6" c/c
 - @ 12" c/c
 - @ 24" c/c
- ☐ HILTI S-SLC 01 M HWH (22 ga., 20 ga. & 18 ga.)
- @ 6" c/c
 - @ 12" c/c
 - @ 24" c/c
- ☐ HILTI S-SLC 02 M HWH (16 ga.)
- @ 6" c/c
 - @ 12" c/c
 - @ 24" c/c

4) PERIMETER FASTENING

- (2) A) ATTACH DECK TO PERIMETER MEMBER AT EACH RIB.
- (3) B) ATTACH DECK TO PERIMETER MEMBER @ 6" c/c.
- (4) C) ATTACH DECK TO LLH AND CS" @ 12" c/c.
- (5) D) ATTACH DECK TO ROOF OPENING FRAMES @ 6" c/c.



5) SHEAR CONNECTORS FASTENING

- A) PROVIDE ATTACHMENT BETWEEN DECK AND EACH SHEAR CONNECTOR WITH:
- SPOT WELD 3/4"Ø @ 6" c/c TYP. UN
 - SCREW TEK 5 #12-24x1" @ 6" c/c TYP. UN
 - HILTI NAIL X-HSN 24 @ 6" c/c TYP. UN

NOTES STEEL DECK ROOF EN IMP (CAN)

1" = 1'-0"

GROSS UPLIFT DIAGRAM (UNFACTORED):

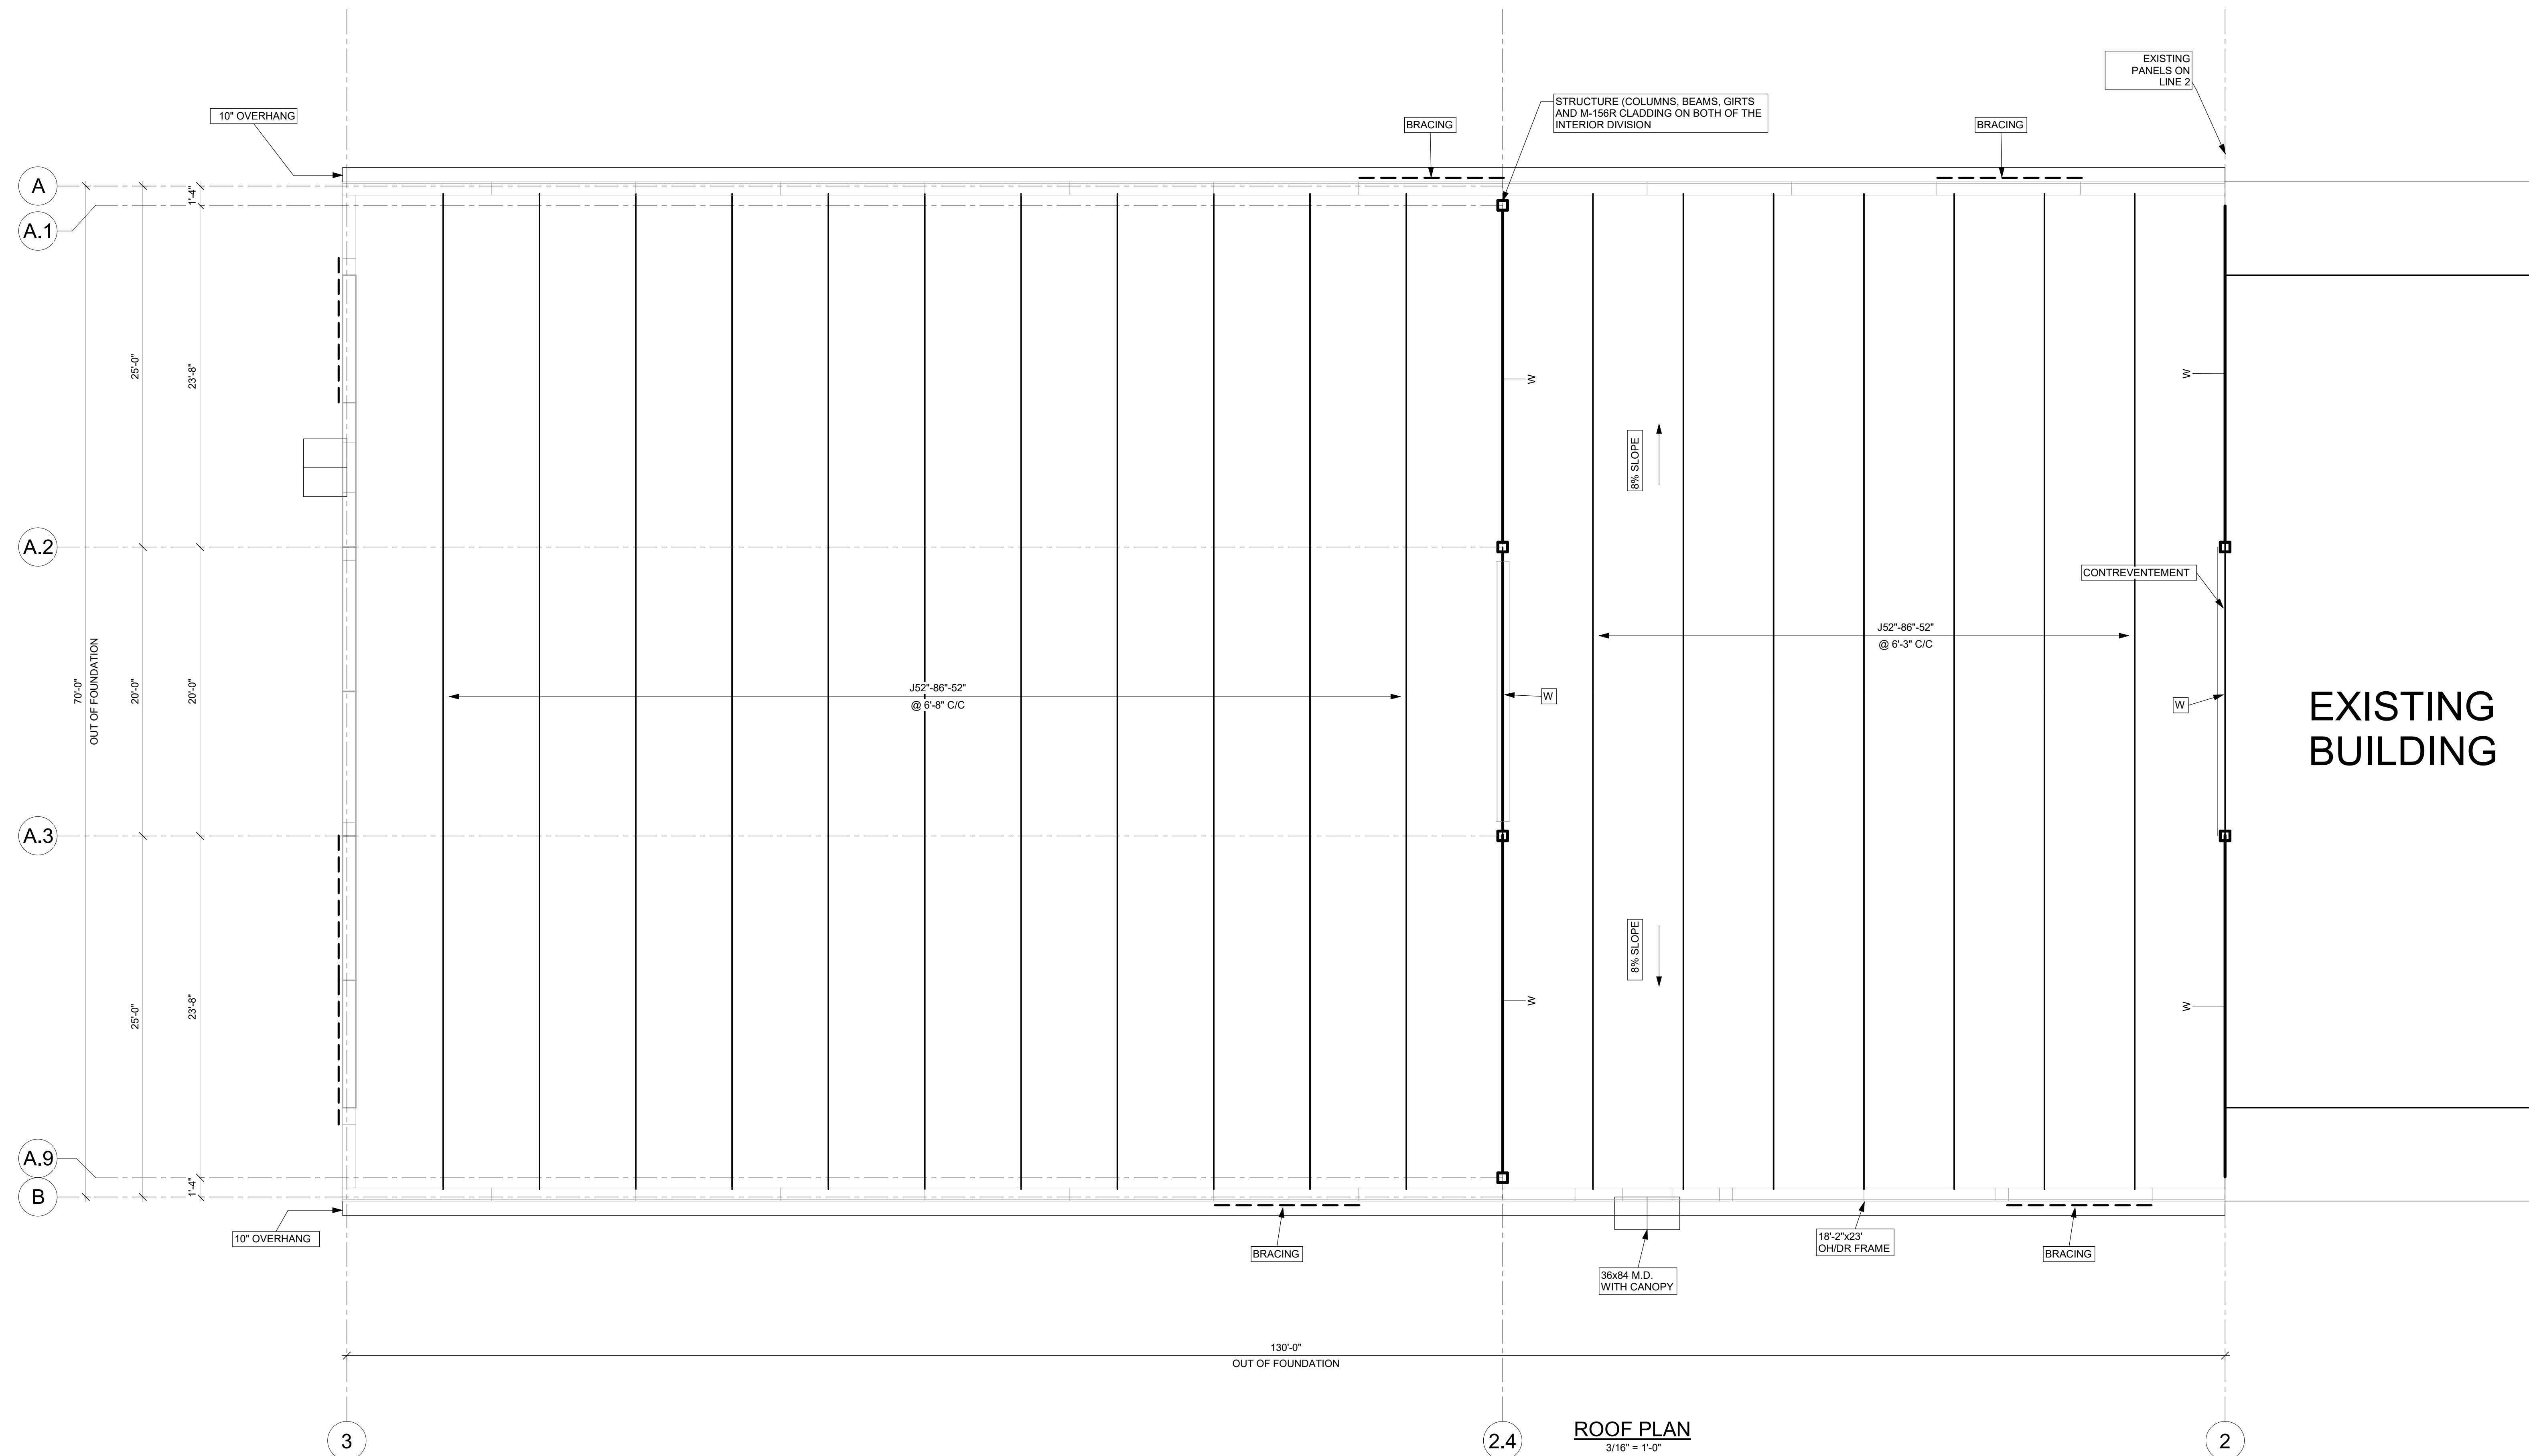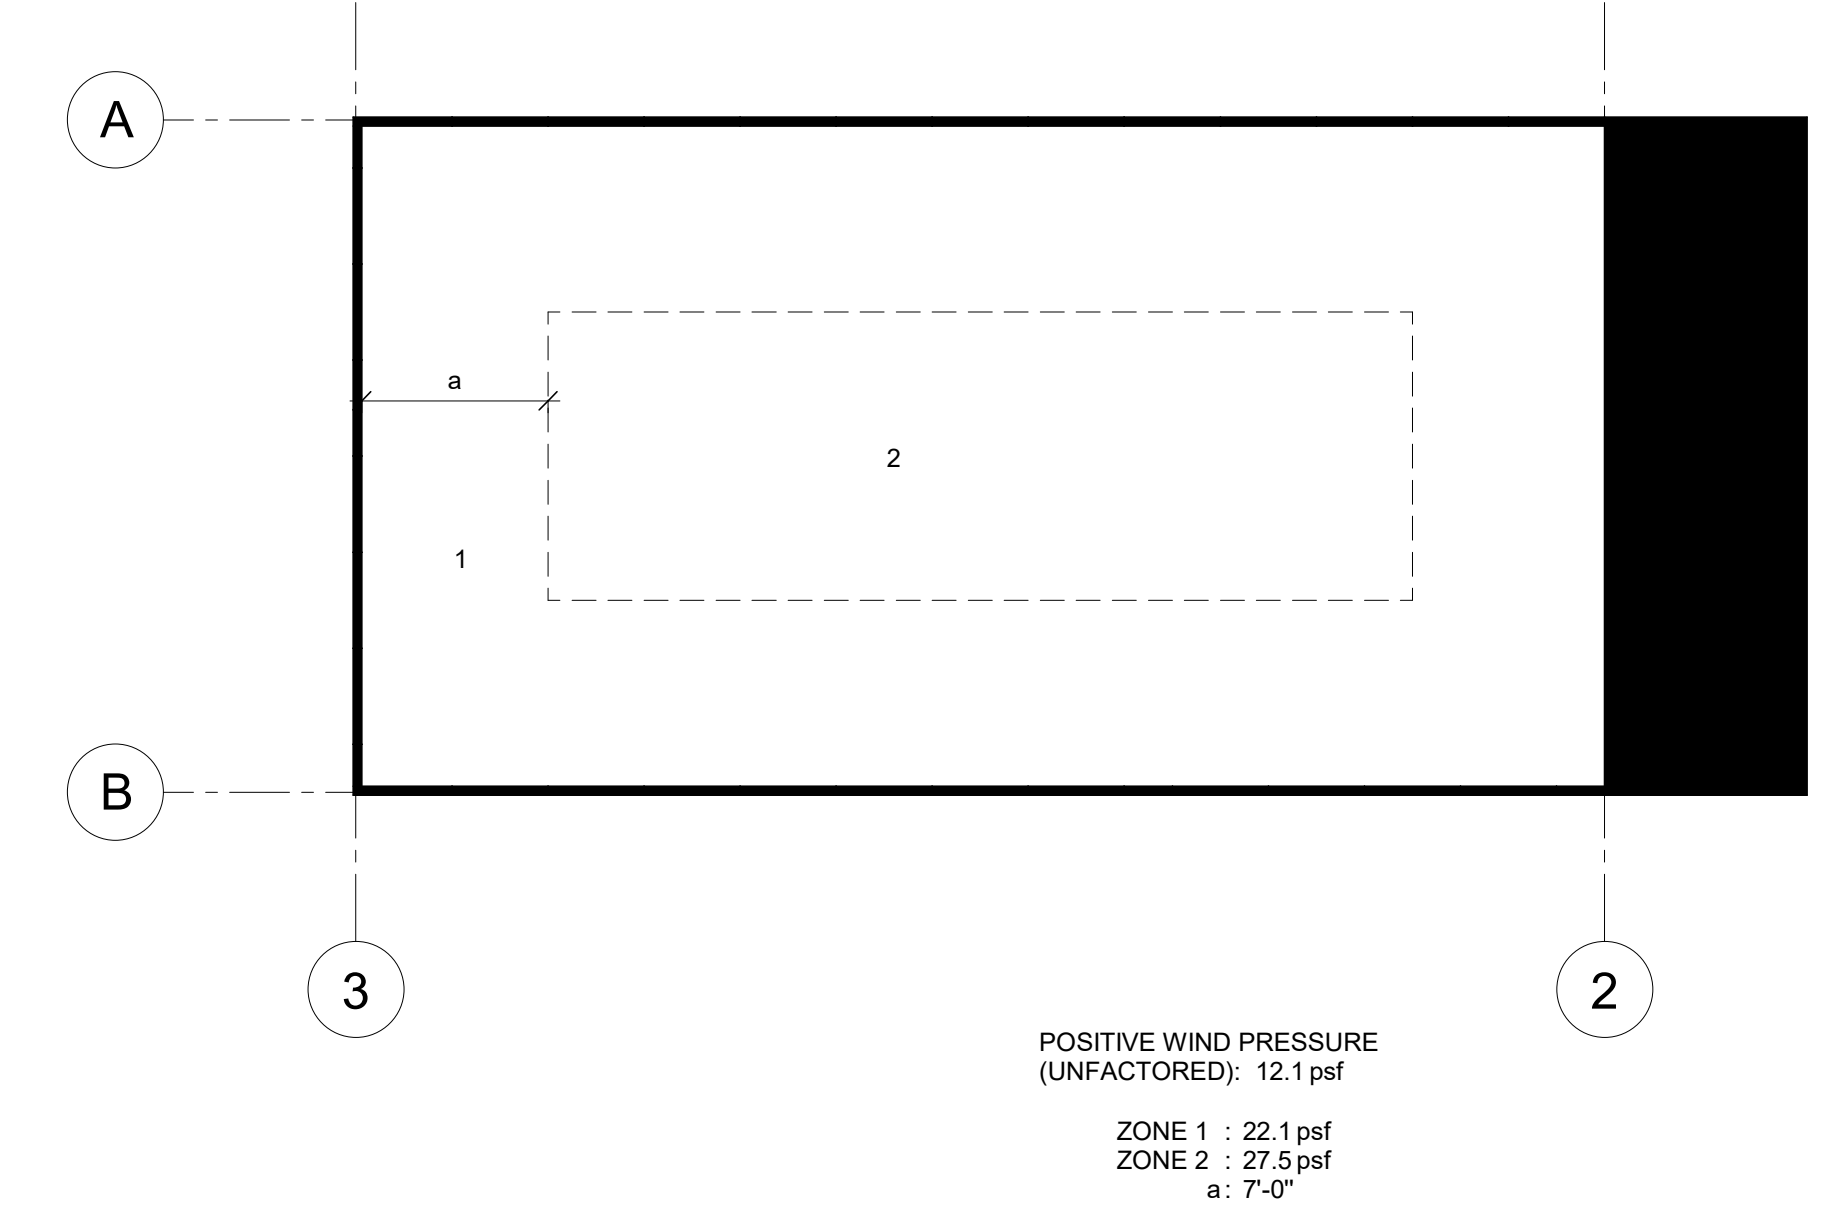

ROOF PLAN

3/16" = 1'-0"