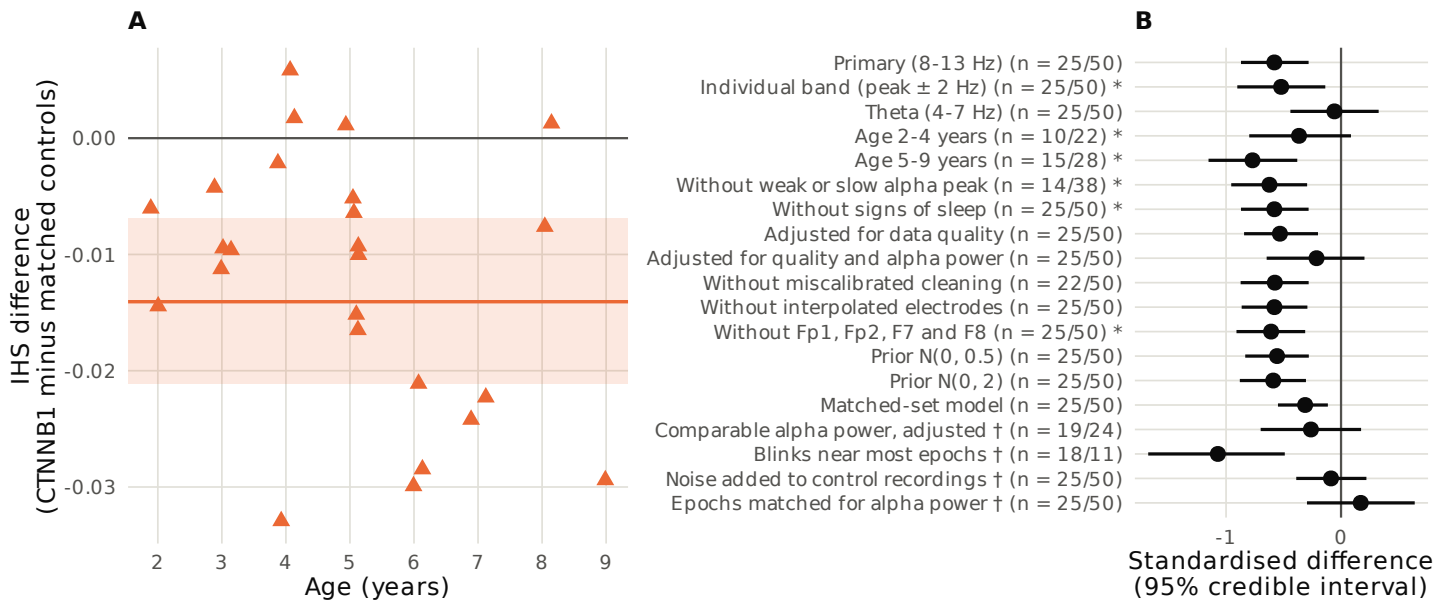
A
IHS difference
(CTNNB1 minus matched controls)
0.00
-0.01
-0.02
-0.03
2
3
4
5
6
7
8
9
Age (years)
B
Primary (8-13 Hz) (n = 25/50)
Individual band (peak ± 2 Hz) (n = 25/50) *
Theta (4-7 Hz) (n = 25/50)
Age 2-4 years (n = 10/22) *
Age 5-9 years (n = 15/28) *
Without weak or slow alpha peak (n = 14/38) *
Without signs of sleep (n = 25/50) *
Adjusted for data quality (n = 25/50)
Adjusted for quality and alpha power (n = 25/50)
Without miscalibrated cleaning (n = 22/50)
Without interpolated electrodes (n = 25/50)
Without Fp1, Fp2, F7 and F8 (n = 25/50) *
Prior N(0, 0.5) (n = 25/50)
Prior N(0, 2) (n = 25/50)
Matched-set model (n = 25/50)
Comparable alpha power, adjusted † (n = 19/24)
Blinks near most epochs † (n = 18/11)
Noise added to control recordings † (n = 25/50)
Epochs matched for alpha power † (n = 25/50)
-1
0
Standardised difference
(95% credible interval)