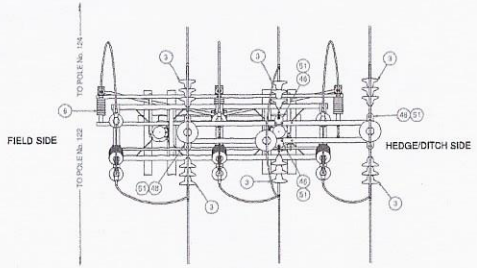

PLAN VIEW

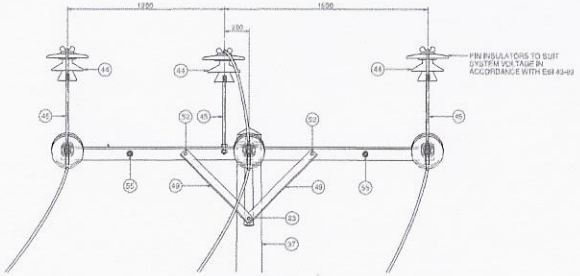

ENLARGED TRANSVERSE ELEVATION

CDM NOTES

1. ONLY COMPETENT/EXPERIENCED CONTRACTORS SHALL BE APPOINTED TO UNDERTAKE THIS WORK.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH PROJECT SPECIFICATION AND ANY OTHER DOCUMENTS ISSUED BY THE CLIENT.
3. CONTRACTOR SHALL CONSIDER ALL PHASES OF WORK AND ENSURE LIMITS OF APPROACH ARE ADHERED TO WHEN LIVE ELECTRICAL EQUIPMENT IS IN PLACE.
4. CONTRACTOR SHALL ADHERE TO ALL ELECTRICITY COMPANIES OPERATIONAL PROCEDURES, MANUFACTURERS RECOMMENDED & INSTALLATION PROCEDURES FOR PLANT AND MATERIALS.
5. CONTRACTOR SHALL HAVE ASSESSED RISKS AND USE SAFE METHODS OF WORKING TO COMPLY WITH CURRENT HEALTH AND SAFETY LEGISLATION AND CDM REGULATIONS.
6. THE CONTRACTOR SHALL HAVE TAKEN DUE COGNISANCE OF THE HAZARDS IDENTIFIED IN THE DESIGN HAZARD INVENTORY AND HEALTH AND SAFETY PLAN, PARTICULARLY MEN WORKING AT HEIGHT AND ELECTROCUTION AND SHALL HAVE IMPLEMENTED MITIGATION MEASURES TO REDUCE RISKS TO ACCEPTABLE LEVEL.

REF	QTY	SCHEDULE / COMMODITY	COMMENTS
Morris Line Disconnector	1	Morris Line Drawing 74698AC1	33kV type 'RX' disconnector underline mounting on 'H' wood poles (P314 Insulators)
Sub-Kits			
54	*1*	*18_15127_04*	***SCARFING & DRILLINGS FOR 33kV EXTRA STOUT 'LAY LEG' POLE (10.5M HIGH)***
37	*1*	*18_15127_03*	***SCARFING & DRILLINGS FOR 33kV EXTRA STOUT SECTION POLE (12.5M HIGH)***
38	1	E2021	BONDING FOR 33KV SINGLE CIRCUIT POLYMERIC TERM POLE
Commodities			
2	6	175401	BALL ENDED HOOK, HEAVY CONSTRUCTION
3	18	066648	INSULATOR STRING 254mm DIAMETER
5	2	179121	33KV POLYMERIC CABLE & SURGE DIVERTER SUPPORT
6	3	217473	BOWTHORPE SURGE ARRESTERS (21-747-3)
7	2	067432	SAFETY SIGN HV POLE DANGER OF DEATH
12	2	061290	BRACKET OUTRIGGER ANTI-CLIMBING
13	8	062657	COACHSCREW GALVANISED SQUARE HEAD 0.375x3
15	2	192268	X-ARM BACKBOARD & CLEAT TO DRG 192268
16	1	179131	33KV POLYMERIC CABLE CLEAT SUPPORT MEMBER
17	1	191131	BACKBOARD CABLE TO SE DRG HO/38/512
18	3	174471	CLEAT TREFOIL ATLAS RANGE TAKING
19	3	174426	ATLAS RANGE-TAKER CLEAT FOR SINGLE CABLE
20	4	060862	BOLT & NUT GALV OILED 60x20MM THREAD 45
22	1	178118	CABLE COVER 8FT LENGTH x 4 INCH GALVANISED
24	2	060833	BOLT & NUT GALV OILED 50x16MM THREAD 35
25	16	069531	WASHER SQUARE CURVED TO DRG 06-953-1
26	1	179141	POLYMERIC CABLE CLEAT SUPPORT CHANNEL
27	2	060859	BOLT & NUT GALV OILED 45x20MM THREAD 45
31	16	062628	COACHSCREW GALVANISED SQUARE HEAD 0.375x1.5
33	2	069515	WASHER GALVANISED 16MM
44	3	OLF-38EY14 OR SIMILAR	INSULATOR LINE PIN TYPE 33kV
45	3	BS 3288-2 : 2009	PILOT INSULATOR PIN - Type 50 (500mm LG)
46	2	ESI 43-95 : 439520	CROSSARM MEMBER (2900mm LONG)
47	2	ESI 43-95 : 439528	TERMINAL STRAP (150mm LONG)
48	2	ESI 43-95 : 439525	SECTION STRAP (550mm LONG)
49	4	ESI 43-95 : 439526	CROSSARM STRUT (750mm LONG)
23	16	G6-S11	POLE BOLTS - LENGTH TO SUIT
51	8	BS 4190 - GALVANISED	M20x70mm LG BOLT SET (Screwed 45mm) c/w 2x WASHERS & 1x FULL HEX HD LOCKNUT
52	4	BS 4190 - GALVANISED	M20x40mm LG BOLT SET (Screwed 45mm) c/w 1x WASHER & 1x FULL HEX HD NUT
53	6	ESI 4395 : 439504	M20 SQUARE FLAT WASHER
40	--	060804	M12x45 LG HEX HD BOLT c/w NUT
41	--	069502	M12 WASHER
42	4	TBC	ANTI SPLIT BOLTS - POLE TOP c/w 2x SQ CURVED WASHERS & 2x FULL HEX HD NUTS - LENGTH TO SUIT
55	2	ESI 43-96 : 439608	TIE ROD - TYPE 3 (330mm LG) c/w 4x M20 HEX HD FULL NUTS
56	2	ESI 43-95 : 439558	BRACE, FOUNDATION 1833CRS (100 x 100 x 12 EA)
Decision Items			
10	--	G7-S1	POLE NUMBER & LETTER PLATES
11	1	G7-S7	CIRCUIT IDENTIFICATION PLATE
30	3		COMPRESSION HV LINE DEAD ENDS CU COND (Single Flag type)
34	3	G2S231	SINGLE HOLE LUGS - HEAVY CONSTRUCTION
39	9	G2S232	DOUBLE HOLE LUGS
43	3		COMPRESSION HV LINE DEAD ENDS CU COND (Double Flag Type)
Reminder Items			
8	--	116695	NAIL DRIVE 4MMx50MM ZINC PLATED POLY TOP
14	--	069719	WIRE, BARBED
28	--	118503	STAPLE GALVANISED 40x4MM
32	1	ESI 43-91 : 439112	WOOD FOUNDATION BLOCK - TYPE 1 (2500mm LONG) c/w BOLT SETS
4	4	ESI 43-91 : 439103	WOOD FOUNDATION BLOCK - TYPE 2 (1300mm LONG) c/w BOLT SETS
35	--	023368	UNIAL COMPOUND

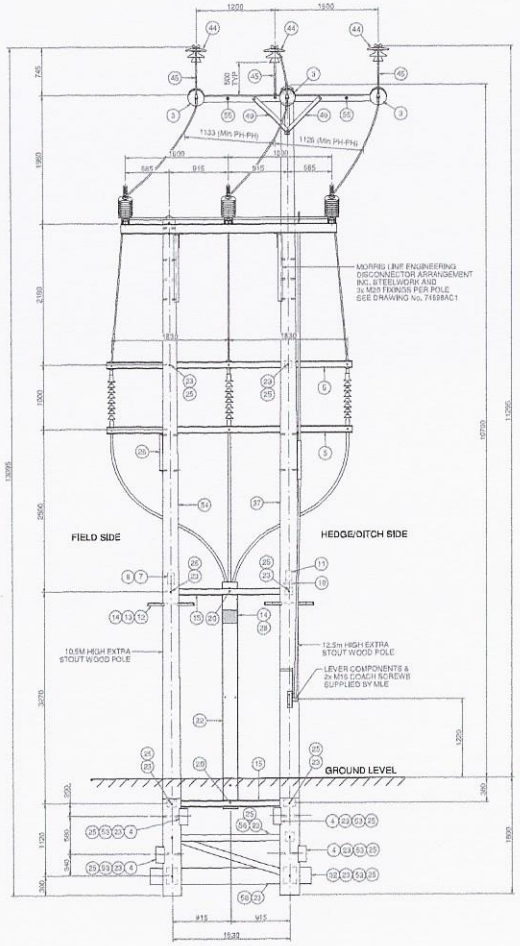

TRANSVERSE ELEVATION

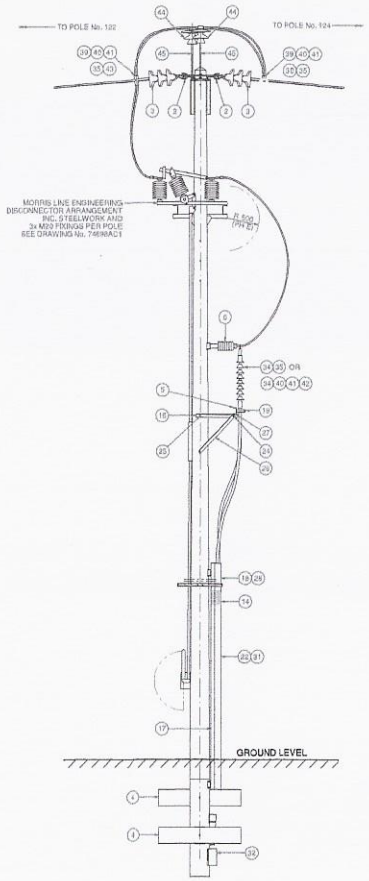

LONGITUDINAL ELEVATION

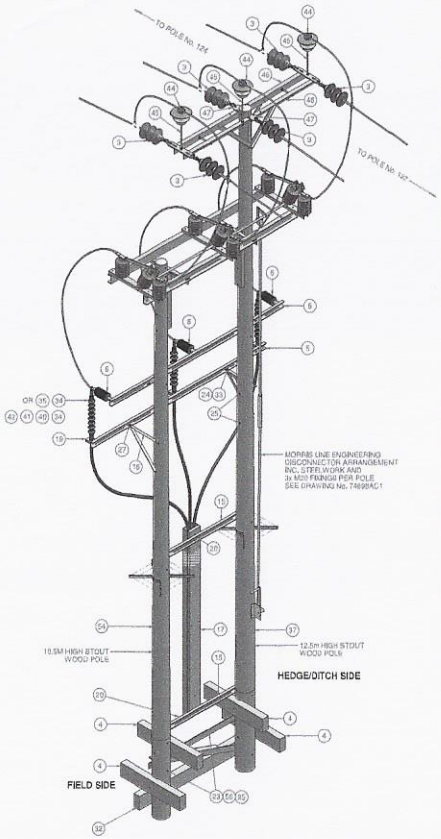

ISOMETRIC VIEW

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE
2. EARTHING DETAILS SEE DRG. No. HO/37/2021 SHEET 2 (CONFIGURATION TO BE USED UP TO SURGE ARRESTER LEVEL ONLY)
3. CABLE TERMINAL ARRANGEMENT BASED UPON SSE DRG No. HO/37/2021 SHT 1 OF 3

Scottish and Southern Energy
Power Distribution

Project Number

Drawing Status: FOR INFORMATION

Title: GENERAL ARRANGEMENT / ERECTION DRAWING
33kV SECTION STRUCTURE c/w LAY LEG
ABSD & CABLE TERMINATIONS

Location: WALLINGFORD GENERATION DYS046 PV

LSTC Drawing Number: 15_15127_02

ShtNo: 1

Rev.: B

WARNING: DRAWING MAY BE REDUCED WHEN PLOTTED OR PRINTED. DO NOT SCALE.

REV	DATE	CHK'D	REV	DATE	CHK'D	REV	DATE	CHK'D	REV	DATE	CHK'D	REV	DATE	CHK'D	REV	DATE	CHK'D	REV	DATE	CHK'D	REV	DATE	CHK'D
A	01/04/2015	SP	B	24/06/2015	SP																		
	DRWN RF	APPD MS		DRWN RF	APPD MS		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD
FIRST CLIENT ISSUE			SECOND CLIENT ISSUE REVISED WITH FOUNDATION BRACE																				

DATE	01/04/2015
DRWN	RFisk
CHK'D	SP
APPD	MS
SCALE	1:40 @ A1

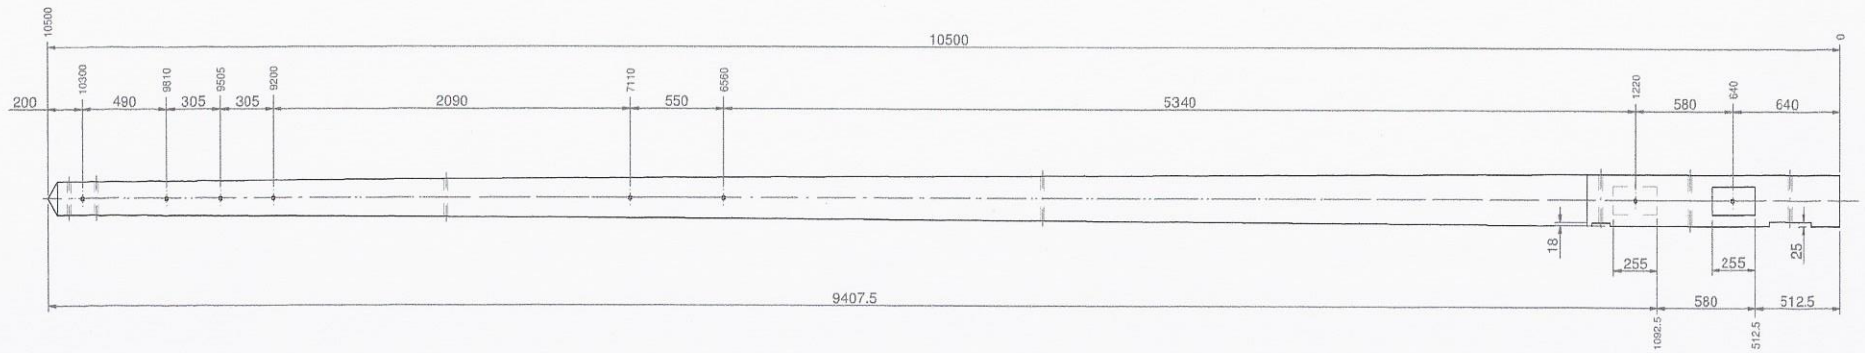

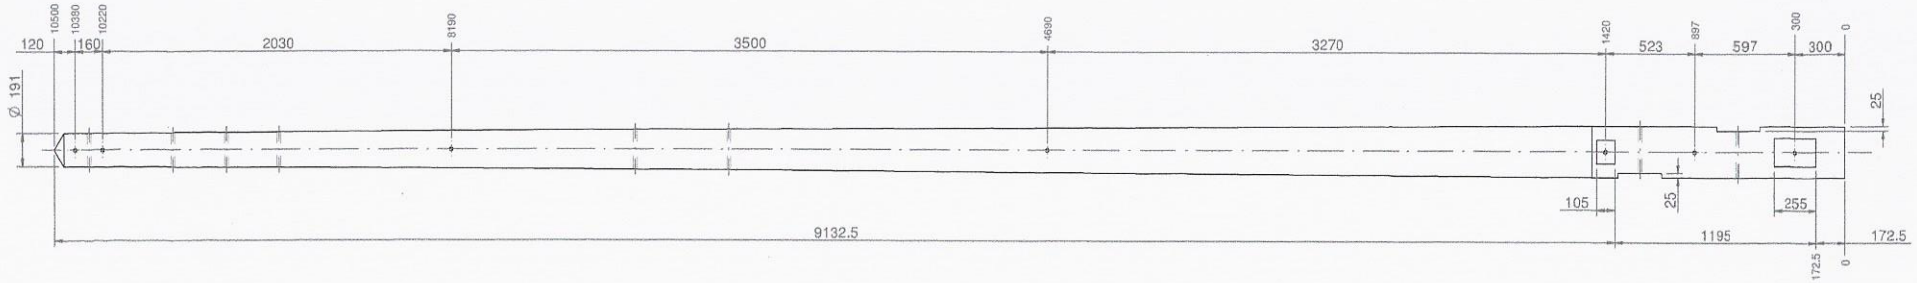

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm).
2. ALL HOLES ARE 22mm DIAMETER (mm) UNLESS NOTED OTHERWISE.
3. POLE FABRICATED FROM EXTRA STOUT WOOD POLE.
4. POLE SIZE AND INSPECTOR'S STAMP TO BE IMPRESSED ON POLE BUTT.
5. USE IN CONJUNCTION WITH THE FOLLOWING DRAWINGS:

   15_15127_02 : GENERAL ARRANGEMENT / ERECTION DRAWING

   FOR STANDARD DETAILS SEE: ESI BASED DRAWINGS.

LEGEND FOR BOLT SIZES

ALL POLE DRILLINGS

⊕ = 22.0mm DIAMETER HOLE THRU

UNLESS OTHERWISE NOTED

WARNING: DRAWING MAY BE REDUCED WHEN PLOTTED OR PRINTED. DO NOT SCALE.

REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD
A	01/04/2015	SP	B	24/06/2016	SP																		
	DRVN RF	APPD MS		DRVN RF	APPD MS		DRVN	APPD		DRVN	APPD		DRVN	APPD		DRVN	APPD		DRVN	APPD		DRVN	APPD
FIRST CLIENT ISSUE			SECOND ISSUE																				

DATE	01/04/2015
DRAWN	RFisk
CHKD	SP
APPD	MS
SCALE	Various

Scottish and Southern Energy Power Distribution

Project Number

Drawing Status: FOR INFORMATION

Title: PIECE SMALL DETAIL

POLE DRILLING & SCARFING DETAIL FOR 10.5M (LAY LEG) EXTRA STOUT POLE 33kV SECTION STRUCTURE c/w LAY LEG WITH ABSD & CABLE TERMINATIONS

Location: WALLINGFORD GENERATION DYS046 PV

LSTC Drawing Number: 18_15127_04

ShtNo

Rev.: B

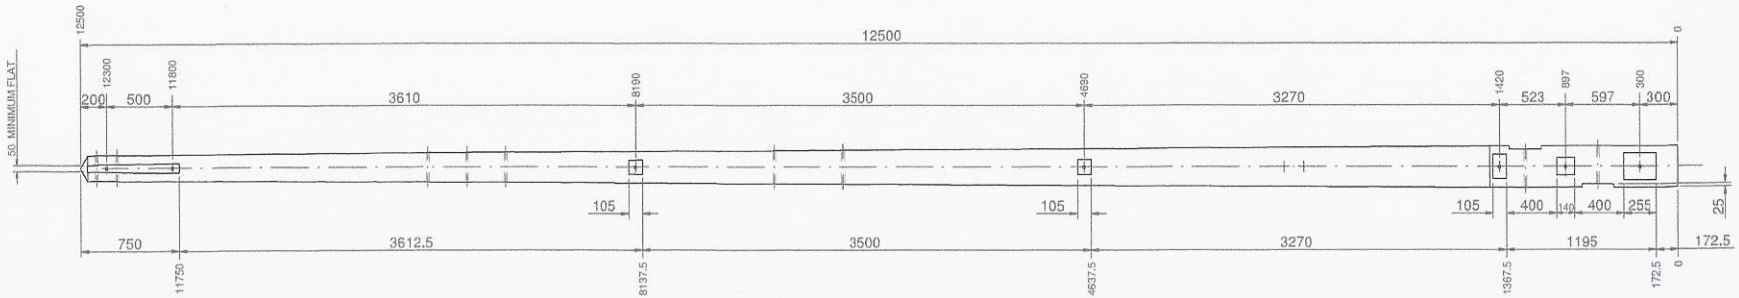

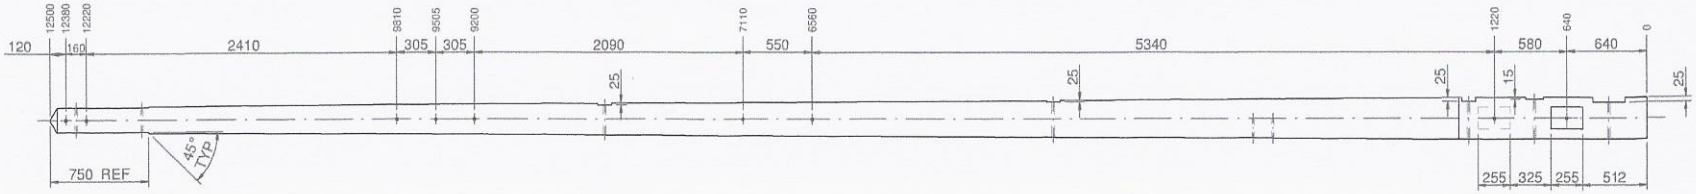

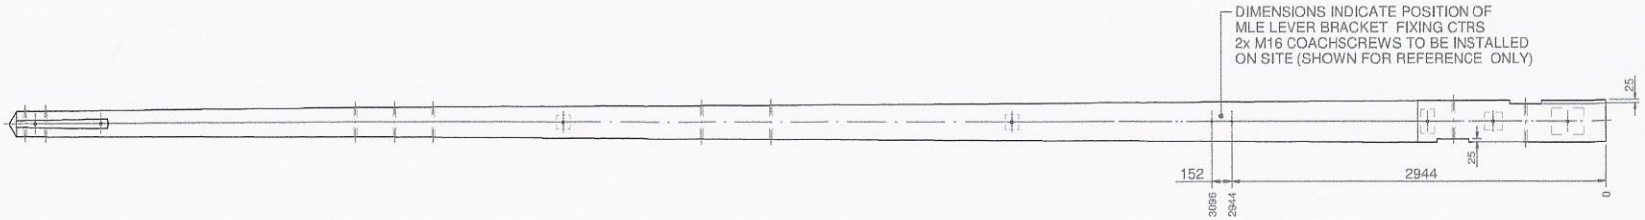

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm).
2. ALL HOLES ARE 22mm DIAMETER (mm) UNLESS NOTED OTHERWISE.
3. POLE FABRICATED FROM EXTRA STOUT WOOD POLE.
4. POLE SIZE AND INSPECTOR'S STAMP TO BE IMPRESSED ON POLE BUTT.
5. USE IN CONJUNCTION WITH THE FOLLOWING DRAWINGS:

   15_15127_02 : GENERAL ARRANGEMENT / ERECTION DRAWING

   FOR STANDARD DETAILS SEE: ESI BASED DRAWINGS.

LEGEND FOR BOLT SIZES

ALL POLE DRILLINGS

⊕ = 22.0mm DIAMETER HOLE THRU

UNLESS OTHERWISE NOTED

WARNING: DRAWING MAY BE REDUCED WHEN PLOTTED OR PRINTED. DO NOT SCALE.

REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD	REV	DATE	CHKD
A	01/04/2015	SP	B	24/06/2015	SP																		
	DRWN RF	APPD MS		DRWN RF	APPD MS		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD		DRWN	APPD
FIRST CLIENT ISSUE			SECOND ISSUE																				

DATE	01/04/2015
DRAWN	RFisk
CHKD	SP
APPD	MS
SCALE	Various

Scottish and Southern Energy
Power Distribution

Project Number

Drawing Status: FOR INFORMATION

Title: PIECE SMALL DETAIL
POLE DRILLING & SCARFING DETAIL FOR 12.5M EXTRA STOUT POLE
33kV SECTION STRUCTURE c/w LAY LEG WITH ABSD & CABLE TERMINATIONS

Location	LSTC Drawing Number	ShtNo	Rev.
WALLINGFORD GENERATION DYS046 PV	18_15127_03		B