


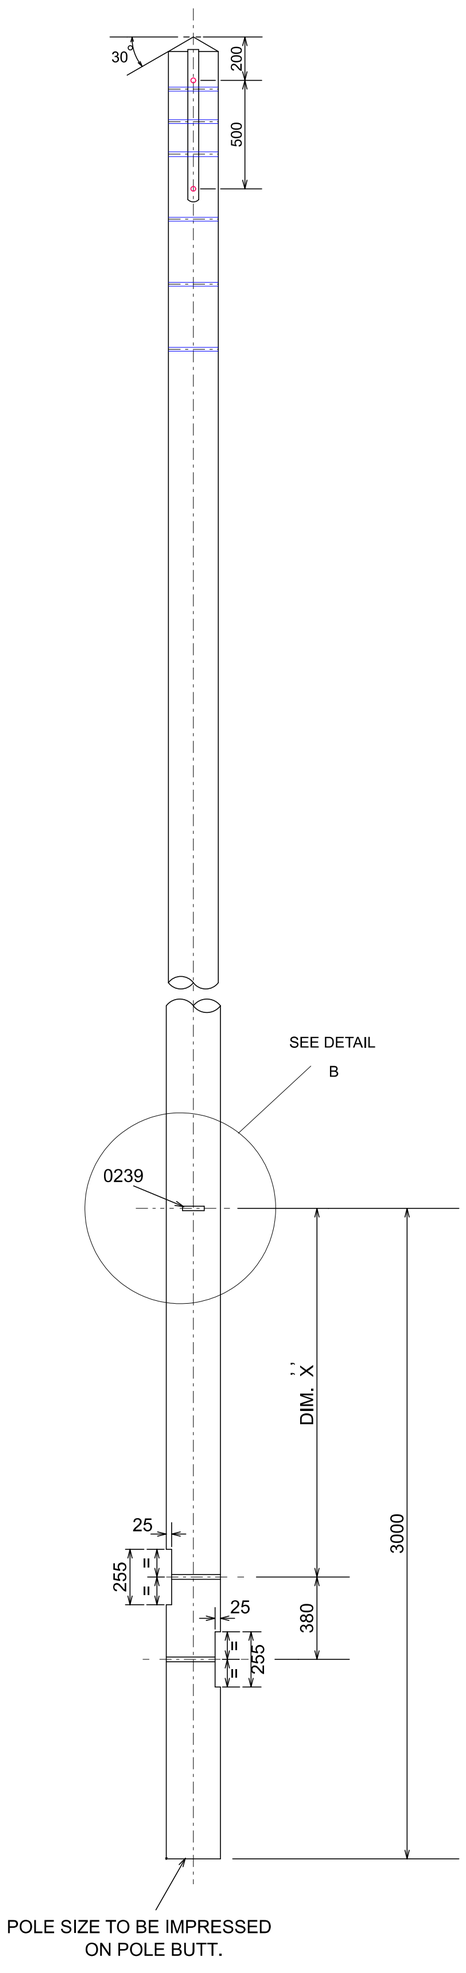


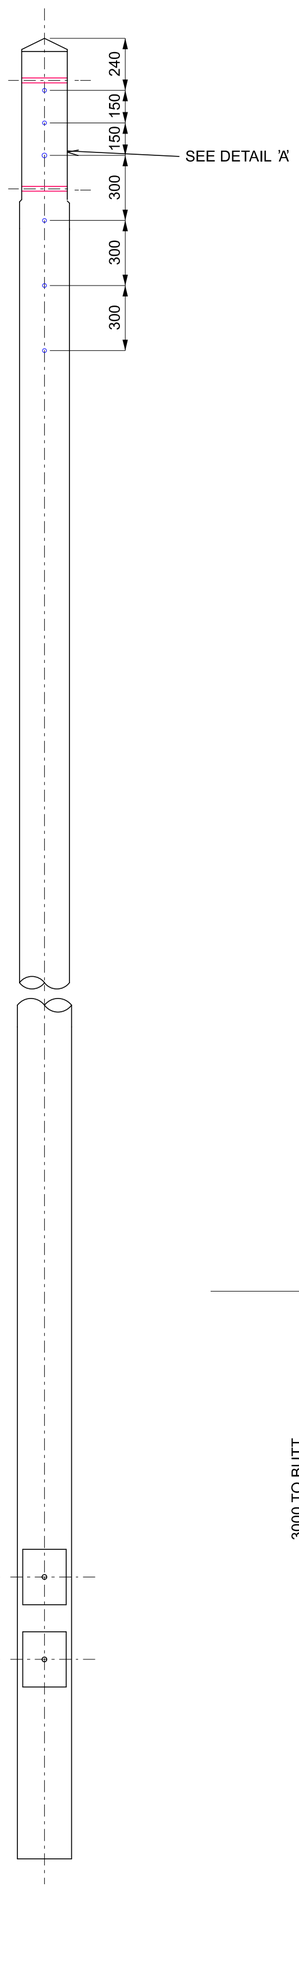

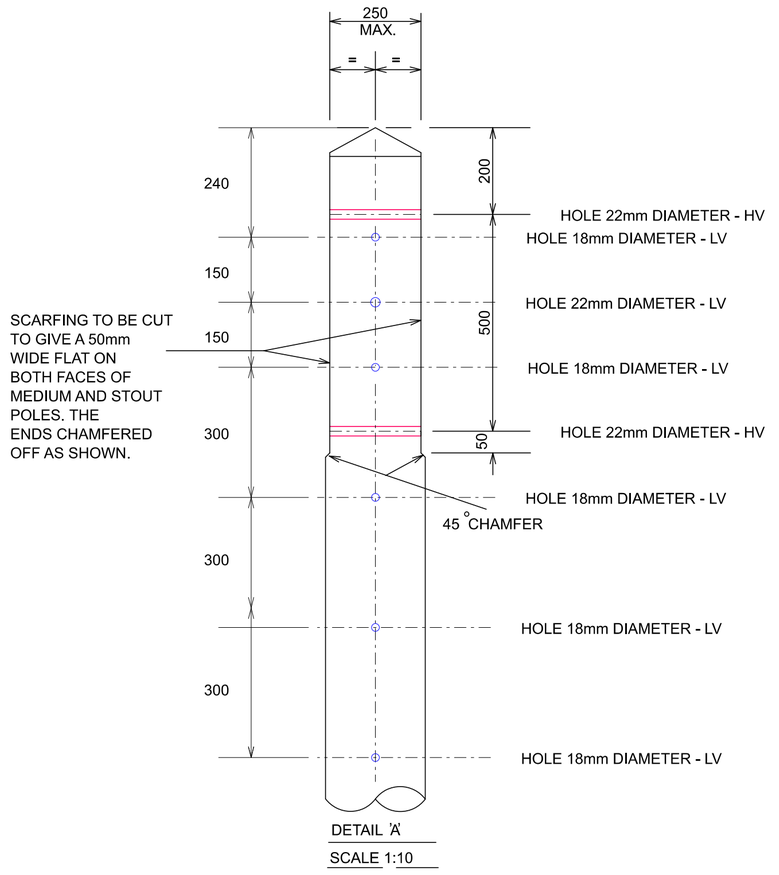

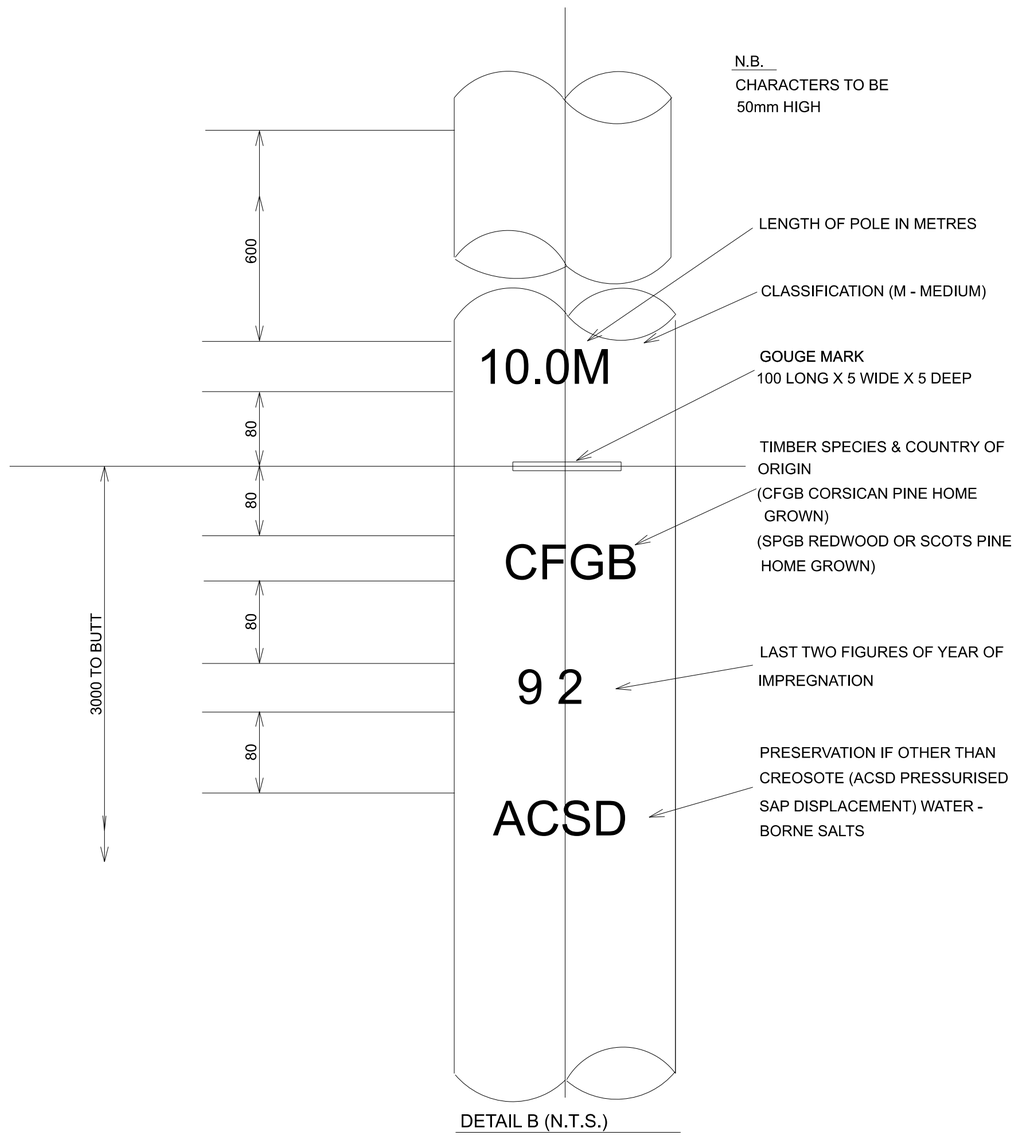

NOTES:

1. CLASS OF POLE TO BE MEDIUM, STOUT OR E/STOUT.
2. ALL HOLES TO BE DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT.
3. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. POLE TO BE NOTCHED AND DRILLED FOR DUPLICATE 250 x 125 BAULKS.
5. HOLES FOR LV TO BE AT 90DEGREES TO THE HOLES FOR HV.

POLE LENGTH. (m)	DIM. X ' ' (mm)
9.0 - 11 INCLUSIVE	1900
12.0	1700
13 - 15 INCLUSIVE.	1400
16 - 18 INCLUSIVE.	1100
20	500

NORTHERN POWERGRID

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

WOOD POLE MULTI-USE FABRICATION DRAWING
- FOR POLES DRILLED AND SCARVED FOR
LV (3301) & HV (4001)

Manufacturer Details			
Sheet No. 7	Scale 1:20	Document Details OVERHEAD LINES	
Prepared By W7Brian.James			
Revised	Grid Reference	Drawing No. C1125691CF	Historic Ref No. 1091080864
Date Issued 03/04/2025	Checked By G HAMMEL	Revision	Notes A1

Copyright of Northern Powergrid Holdings Company. No part of this drawing to be reproduced without prior permission.

File last saved / modified on the 15/12/2013 10:57:49 by John.Brooke, OS File Name - [A1P_SUBSTATION.DGN]