


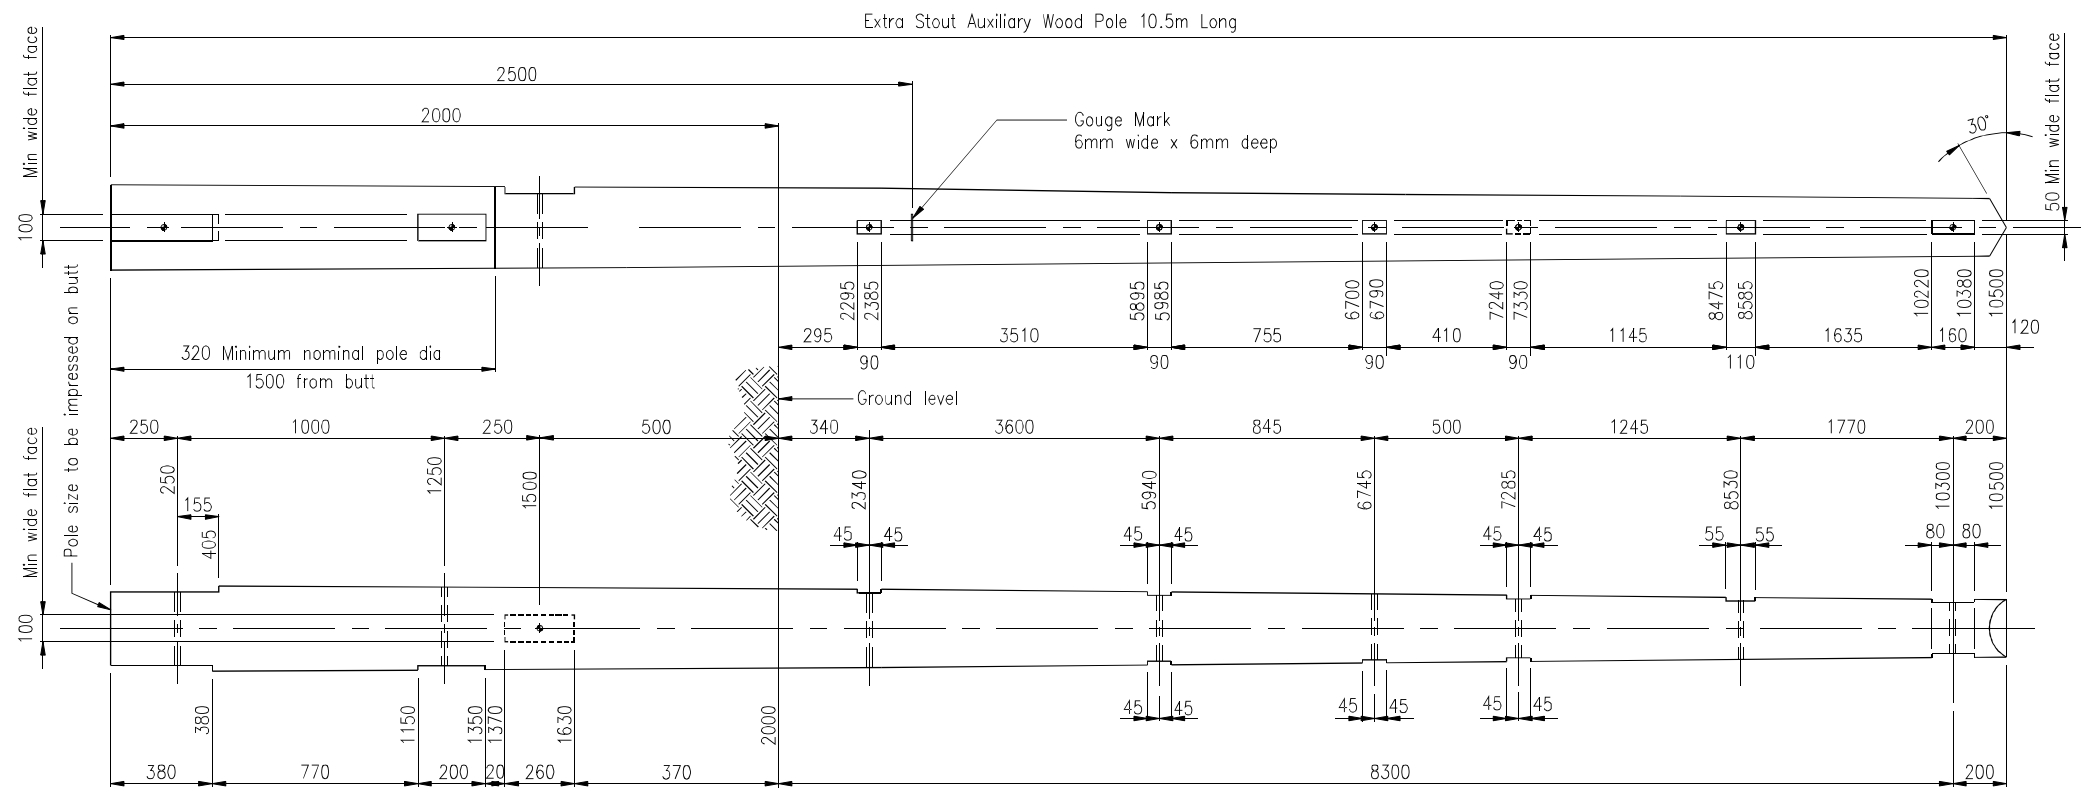

215 Minimum nominal pole diameter at tip.

ALL HOLES 22 DIA

This wood pole is item 18 shown on Termination 'H' Pole Assembly drawing A0/PTD/6547/134

NOTES

1. All dimensions in millimetres.
2. Refer to General Notes Drawing A3/PTD/6547/189A.
3. This drawing is based on ENATS drawing No. 435005.
4. For termination pole assembly refer to drawing A0/PTD/6547/134

A2/PTD/6547/136									
Designer's site specific risk assessment									
By: J.Ridgway					Date: 15/03/16				
☐ No works associated with this drawing									
☒ Controlled by existing procedure/work instruction									
☐ Special control required:-									
☐ Detailed on drawing ☐ Detailed on separate document									
☒ No temporary works required									
☐ Temporary works required and documented separately									
☐ Drawing contains temporary works;									
0 Generic or proprietary solution 1 Specific basic design 2 Specific design 3 High risk or specialist design Complete temporary works design check certificate: DE-SF-081									
Red OK to proceed providing specific design hazards and risks have been recognised, acknowledged and understood by the operation team, Site operatives may require additional instruction/training									
Amber OK to proceed as detailed in existing work instruction or procedure detailed on drawing or separate document.									
Green OK to proceed, no significant design hazards and risks, standard control measures apply.									
CDM REGULATIONS RESIDUAL RISKS Design based hazards are actively eliminated where possible. Where hazards cannot be eliminated, this symbol along with an attached note will identify the hazard and indicate that an action is required by the person supervising the works to manage the design hazard during construction. Other than those noted, we are not aware of any further residual design risks apart from those that a competent contractor would ordinarily consider.									
B	29/06/16	SM	NOTES UPDATED. FOUNDATION DEPTH REDUCED.				JB	REC	
A			FIRST ISSUE						
ISSUE	DATE	DRN	REVISION				CHK'D	APP'D	
BHLARAIDH/BEINNEUN SCHEME OVERHEAD LINE WORKS									
CIRCUIT :- FORT AUGUSTUS - GLENMORISTON (FM) FORT AUGUSTUS - CEANNACROC (FC)									
SSE									
TITLE :- PIECE SMALL DETAIL FOR AUXILIARY POLE TERMINATION ASSEMBLY. EXTRA STOUT WOOD POLE									
JOB No	-		DATE	16/03/16					
DRAWN	TES		CHKD	DPC					
DESIGN	IR		APPD	WJ					
Balfour Beatty									
© Balfour Beatty plc 2016 THE COPYRIGHT IN THIS DRAWING & THE DESIGN RIGHT IN THE ARTICLE(S) DEPICTED BELONG TO BALFOUR BEATTY PLC OR ITS SUBSIDIARY. THE DRAWING MAY NOT BE COPIED BY ANY MEANS (INCLUDING TRACING) OR STORED AS A MICROFILM, AS A CAD FILE, OR CD-ROM OR IN ANY OTHER ELECTRONIC FORM. NOR MAY ARTICLES BE MADE FROM THE DRAWING, EITHER DIRECTLY OR INDIRECTLY, WITHOUT THE PRIOR WRITTEN CONSENT OF BALFOUR BEATTY PLC OR ITS AUTHORISED REPRESENTATIVES.									
SCALE :- N.T.S									
DRAWING No. A2/PTD/6547/136									
SSE CONTRACT No. -								MSTN	
SSE DRAWING No. -								A2	
A	B								