



PARALELL SCARFED
USING
PROPRIETARY JIG

SCARFING DETAILS
SHOWN FOR CABLE
SUPPORT MEMBERS
ARE TYPICAL ONLY
CABLE SUPPORTS TO
BE SPECIFIED AND
SUPPLIED BY CABLE
CONTRACTOR.
CABLE CONTRACTOR
TO CHECK SCARFING
BEFORE MANUFACTURE.

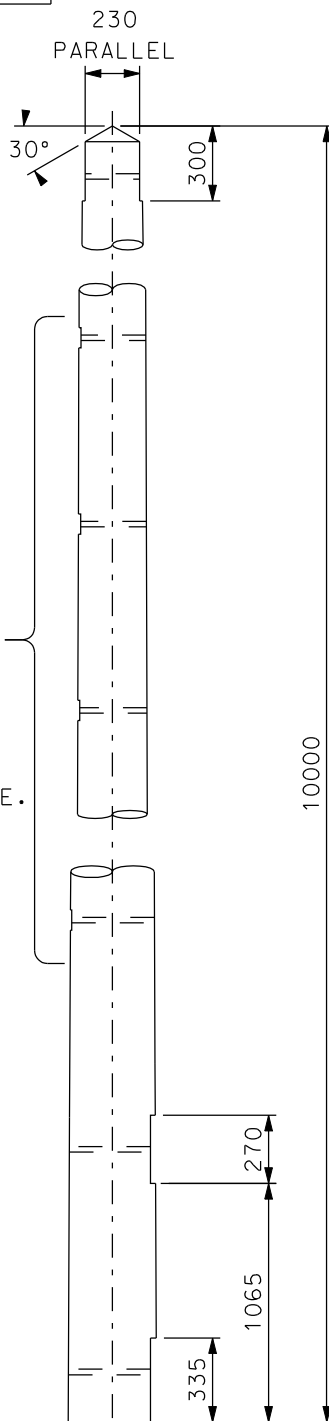

POLE SCARFED PARALLEL
ON BOTH SIDES TO GIVE
MIN 50mm FLAT FACE

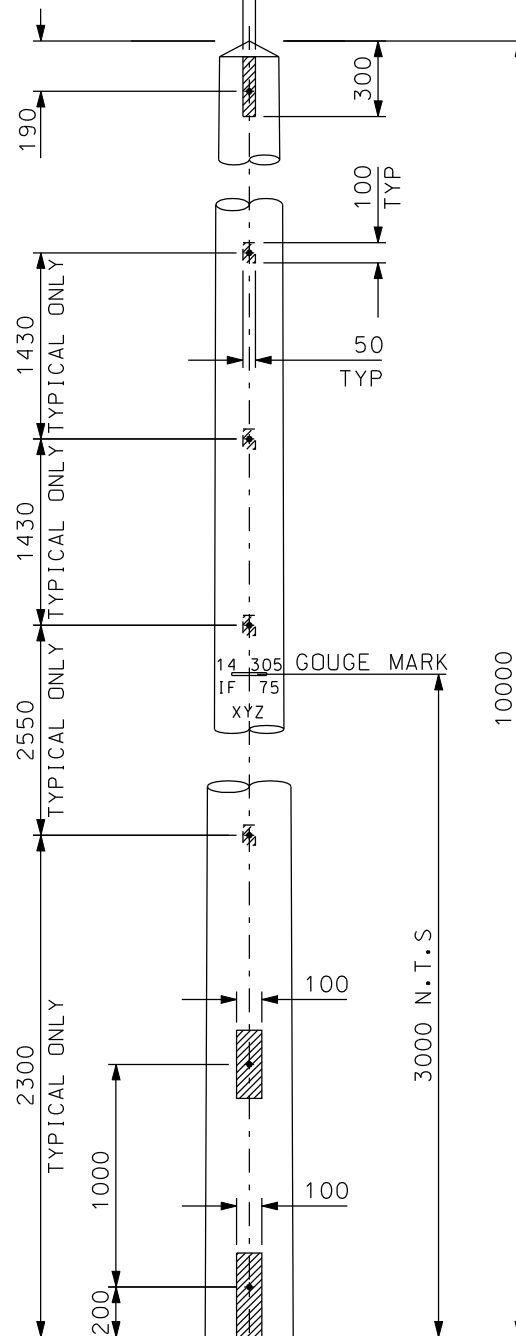

BAR MARK / ITEM NUMBER
TE709

POLE SIZE TO BE
IMPRESSED
ON THE BUTT

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN mm, UNLESS NOTED
2. ALL DRILLINGS TO BE 24mm DIAMETER HOLES
3. POLE SIZES BASED ON BS1990, STOUT POLES RANGE
LENGTH = 10m & PARALLEL WITHIN LIMITS
MINIMUM TOP DIAMETER = 235mm
MINIMUM DIA 1.5m FROM BUTT = 285mm

REFERENCE (typical only)

ACTUAL POLE VALUES TO BE USED

- 10 - POLE LENGTH
- 285 - POLE DIA. 1.5m FROM BUTT
- IF - IMPORTED REDFIR
- 75 - YEAR OF CREOSOTING
- XYZ - SUPPLIERS NAME OR MARK
- GOUGE MARK 6 WIDE x 6 DEEP
- 3m FROM POLE BUTT

SUPPLIER TO NOTE THESE DIMENSIONS ARE FOR GENERIC POLE DRILLING AND SCARFING ONLY TO SUIT A RANGE OF POLE SIZES, ACTUAL POLE MINIMUM DIMENSIONS TO BE SPECIFIED AT TIME OF ORDERING. ORDER VALUES WILL SUPERSEDE THESE STATED VALUES. MAXIMUM VALUE NOT TO BE EXCEEDED

CLIENT	PowerSystems	TITLE	PART -		SCALE	NTS	ORIGINAL SIZE	A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617		
			(UNLESS OTHERWISE STATED)		CHECKED						
WOOD POLE SCARFING			DATE		27/01/05		GS				
SPECIFICATION	OHL-03-132		4 POLE ENTRY TERMINAL STRUCTURES		DRAWN		R.T.J			APPROVED	
			10m AUX. POLE		DRAWING NUMBER		LSTC/STD/PAR/709			REV	
										3	