


DESCRIPTION					
FOR ISSUE					
REV 6	DATE 21/11/2007	BY RF	CHKD SP	APPD GS	

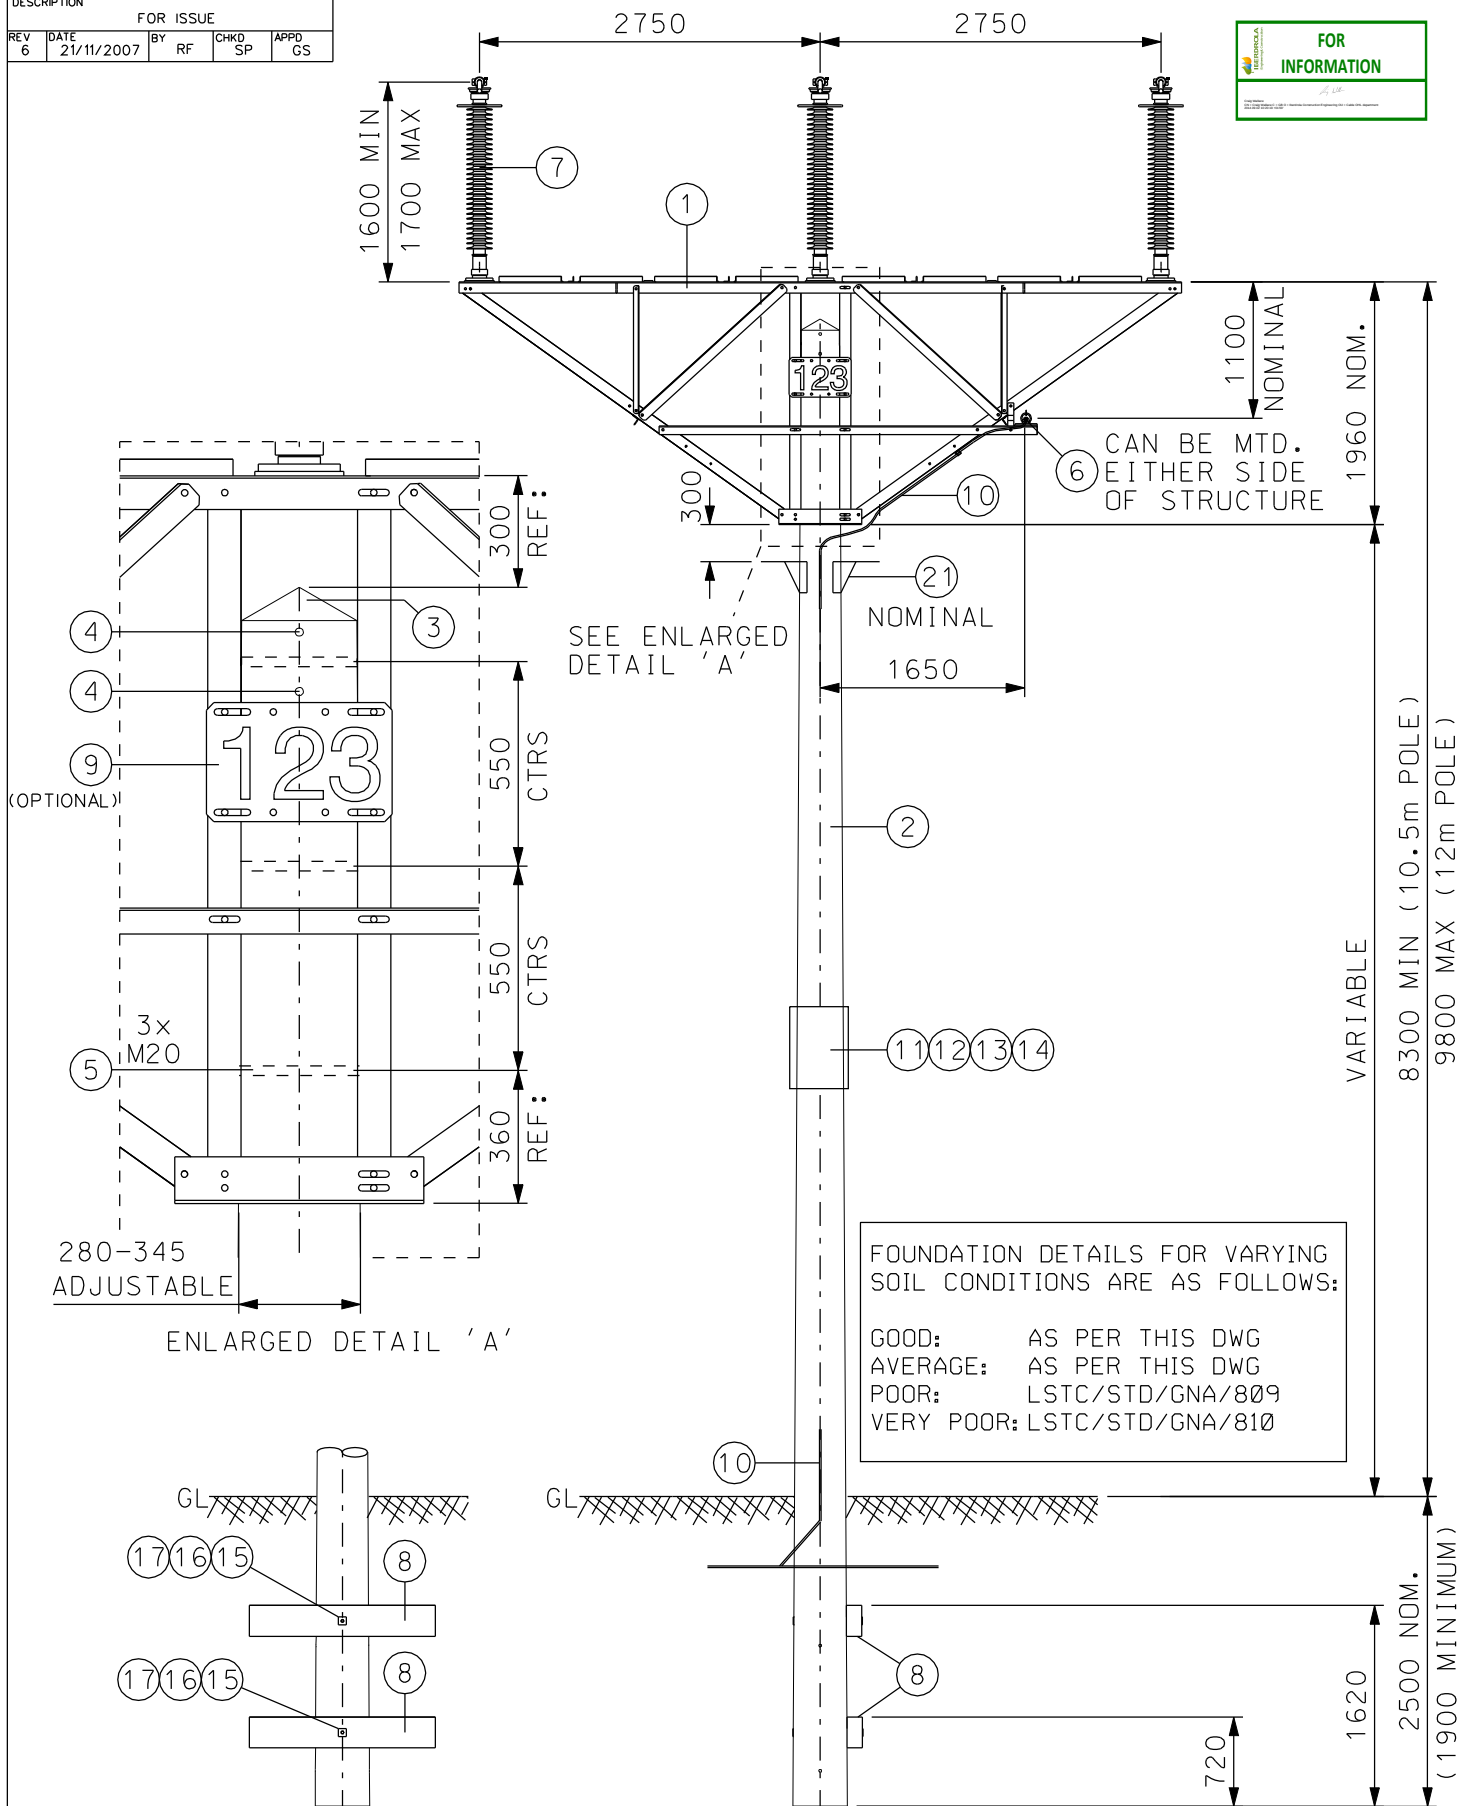

GENERAL NOTES:

1. ALL STEELWORK TO BE PROTOTYPE CHECK
ERECTED BEFORE MASS PRODUCTION.
2. SAFETY SIGNS TO BE INSTALLED TO
CONFORM TO POWER SYSTEMS PROCEDURES
3. FOR MATERIAL LIST SEE LSTC/STD/GNA/521.

5. OPGW TO BE INSTALLED ON THE SAME SIDE OF STRUCTURES THROUGHOUT. NO CROSSING OF OPGW AND PHASE CONDUCTORS PERMITTED.
6. FOR MAINTENANCE ATTACHMENT LOCATIONS SEE LSTC/STD/GNA/549.

CLIENT	PowerSystems	TITLE	GA - SINGLE POLE INTERMEDIATE STRUCTURE	SCALE 1:60 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	 LSTC North: Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA Tel 01377 253617 Fax 01377 259555 LSTC South: Bourne House Office 21 475 Godstone Road Wingfield Surrey CR3 0BL Tel 01883 621114
SPECIFICATION	OHL-03-132			DATE 04/07/07	CHECKED GS	
				DRAWN JR	APPROVED PP	
				DRAWING NUMBER	REV 6	
				LSTC/STD/GNA/520		