


DESCRIPTION		FOR ISSUE			
REV 7	DATE 22/11/07	BY RF	CHKD SP	APPD GS	

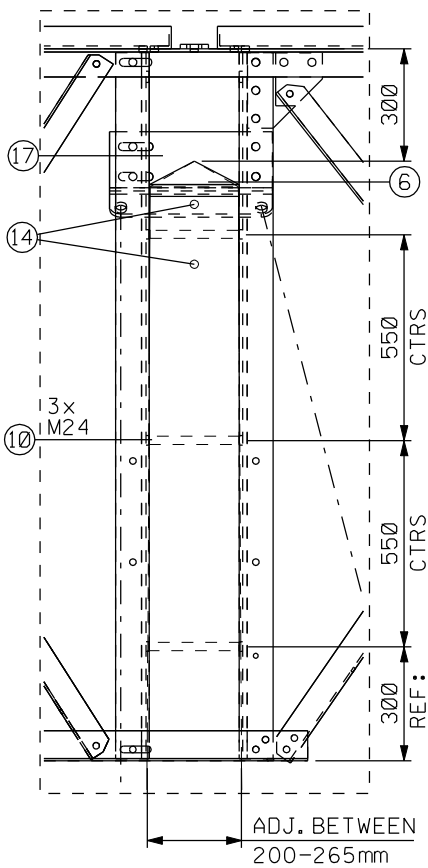


ENLARGED DETAIL 'A'

STAYS INSTALLED AT TRUE VERTICAL ANGLE OF 45° - UNLESS OTHERWISE STATED

- (45) OPERATIONAL PLATES AND DEVICES TO
(46) USERS REQUIREMENTS
(47) POSITION MIN. 3000mm ABOVE GROUND LEVEL

ALTERNATIVE U/GROUND CABLE ARRANGEMENT WITH REDUCED BEND RADIUS SHOWN DOTTED

GROUND LEVEL

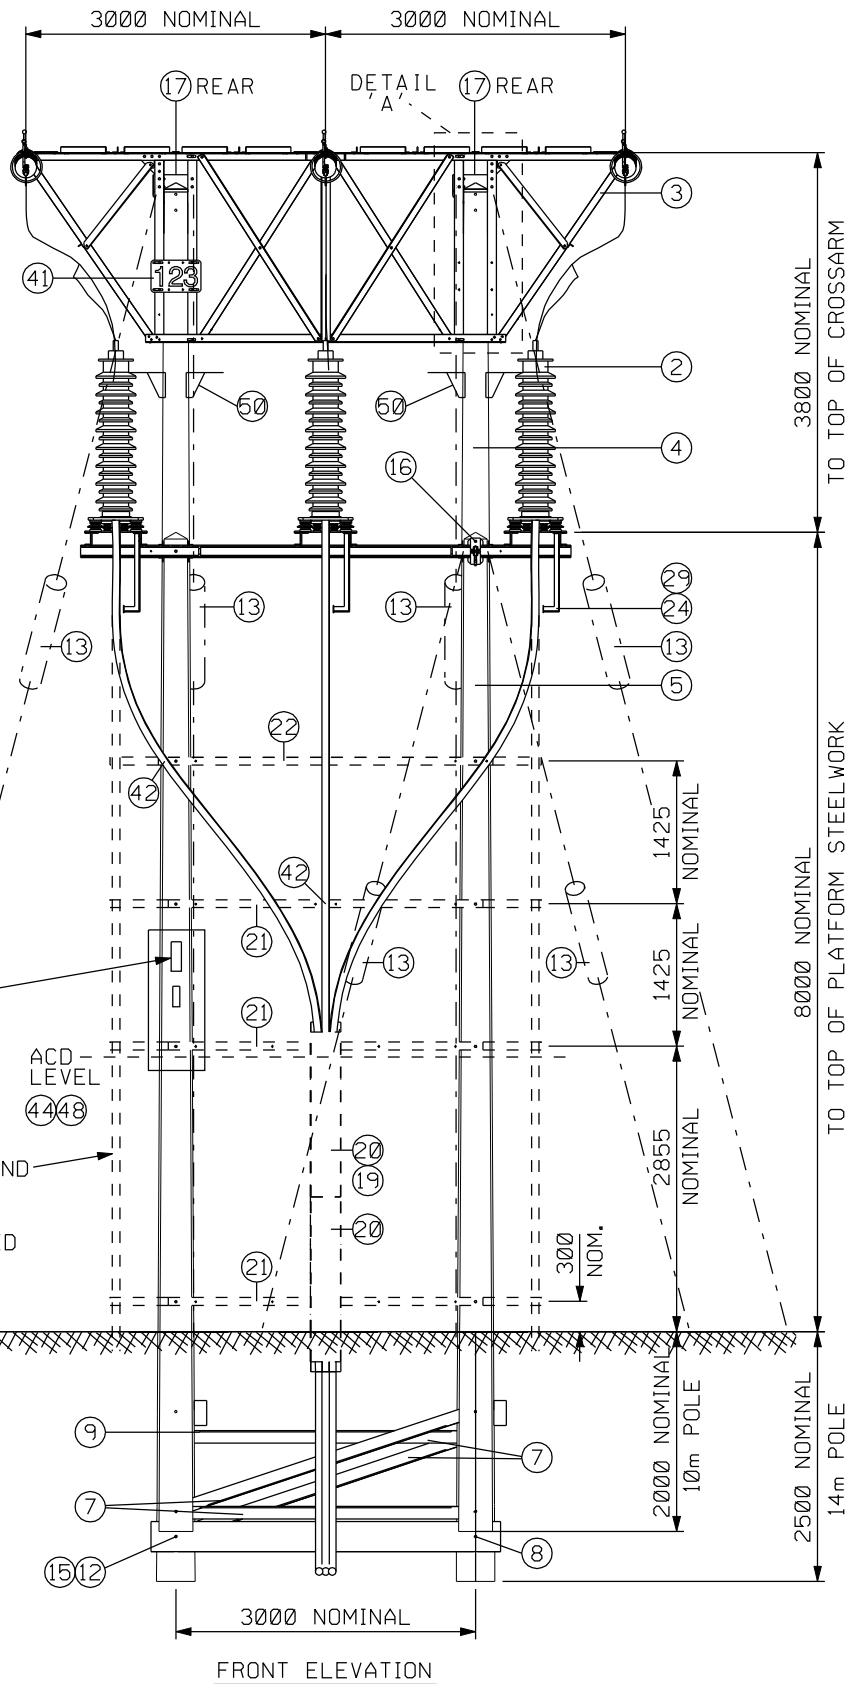

FRONT ELEVATION

GENERAL NOTES

1. FOR PLAN & ISOMETRIC VIEW SEE DRAWING LSTC/STD/GNA/545
2. FOR SIDE ELEVATION SEE DRAWING LSTC/STD/GNA/547
3. FOR MATERIAL LIST SEE LSTC/STD/GNA/548
4. OPGW TO BE INSTALLED ON THE SAME SIDE OF STRUCTURES THROUGHOUT. NO CROSSING OF OPGW AND PHASE CONDUCTORS PERMITTED.

ALL CABLE FIXINGS, SUPPORTS AND GUARDING TO BE SPECIFIED AND SUPPLIED BY CABLE CONTRACTOR

CLIENT PowerSystems	TITLE GA - FRONT ELEVATION 0° ENTRY / TERMINAL 4 POLE STRUCTURE	SCALE 1 : 75 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
		DATE 26/01/05	CHECKED GS	
DRAWN R.T.J		APPROVED PP		
DRAWING NUMBER LSTC/STD/GNA/546		REV 7		
SPECIFICATION OHL-03-132				

