



DESIGN SUITABLE FOR USE IN
LEVEL GROUND WITH MINIMUM
2.5M POLE EMBEDMENT

DESCRIPTION		FOR ISSUE			
REV	DATE	BY	CHKD	APPO	PP
3	31/07/07	JR	GS		

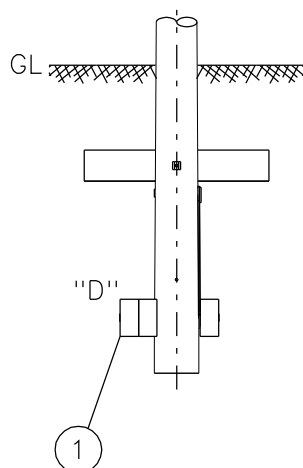

SIDE VIEW

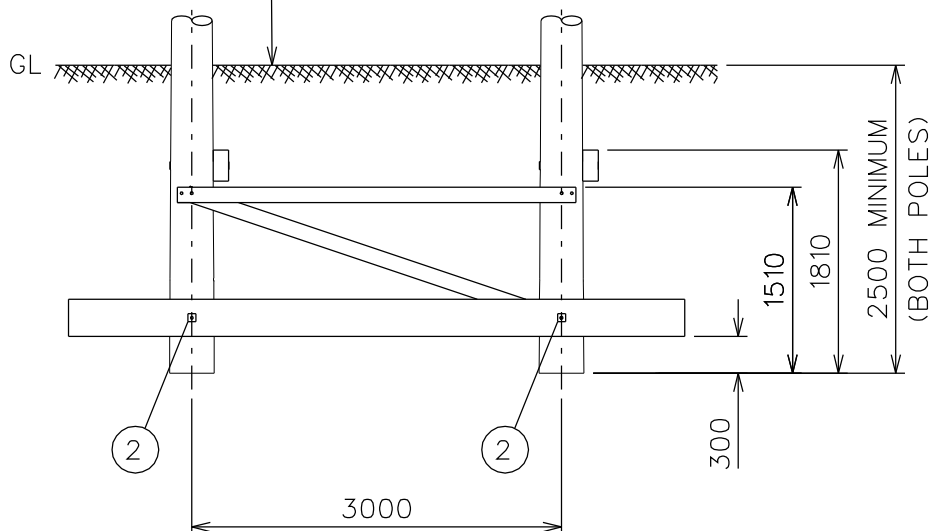

FRONT ELEVATION

	ITEM - DESCRIPTION	REFERENCE No.	QTY REQ'D	WEIGHT EACH (Kg)	REMARKS
1	"H" Pole Timber Baulk	LSTC/STD/PAR/738	1	192.5	Timber Baulk "D" in addition to LSTC/STD/GNA/502
2	M20 Bolts x Length To Suit Pole Diameter	LSTC/STD/GNA/555	2	2.4	M20 Bolts to attach additional Timber Baulk "D" to Foundation
3					
4					
5					
6					
Total Additional Calculated Weight = 198Kg					

GENERAL NOTES:

1. ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
2. ALL DIMENSIONS ARE IN MILLIMETRES.
3. MATERIAL LIST INDICATES ADDITIONAL ITEMS REQUIRED WHEN "POOR" SOIL CONDITIONS ARE ENCOUNTERED.
FOUNDATIONS TO BE INSTALLED IN LEVEL GROUND ONLY.

TO BE READ IN CONJUNCTION WITH:
LSTC/STD/GNA/502: 0-5° ANGLE STRUCTURE
LSTC/STD/GNA/504: MATERIAL LIST
LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION

4. IMPORTANT: REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.

SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
SHT 3 : FACTORS OF SAFETY.
SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.



CLIENT PowerSystems	TITLE ADDITIONAL MATERIAL 0-5° ANGLE STRUCTURE POOR SOIL CONDITIONS	SCALE 1:60 (UNLESS OTHERWISE STATED)		ORIGINAL SIZE A4		LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
		DATE 11/05/05		CHECKED GS		
DRAWN R.F.		APPROVED PP				
DRAWING NUMBER		REV				
LSTC/STD/GNA/792		3				
SPECIFICATION OHL-03-132						

